


NOTES:

1. REMOVE ALL EXISTING LEAD AND FLASHING MATERIAL BEFORE INSTALLING SPLIT PIPE FLASHING.
2. TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 160°F (71°C).
3. INSTALL A MINIMUM OF 4 FASTENERS AND PLATES AROUND THE PIPE, EQUALLY SPACED. IF FASTENERS AND PLATES CANNOT BE INSTALLED AS SHOWN, THEY MAY ALSO BE POSITIONED OUTSIDE THE PIPE MAXIMUM 12" (30cm) O.C. AND FLASHED WITH TPO REINFORCED MEMBRANE/CUT-EDGE SEALANT. REFER TO [DETAIL TPC-8.2](#).
4. FASTENERS AND PLATES ARE NOT REQUIRED ON ADHERED SYSTEMS UNLESS PIPE DIAMETER EXCEEDS 18" (46cm).
5. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE ONLY.
6. T-JOINT COVERS ARE NOT REQUIRED ON WHITE, TAN OR GRAY PREFABRICATED ACCESSORIES. FOR ALL ADDITIONAL COLORS IT IS REQUIRED TO COVER T-JOINTS.

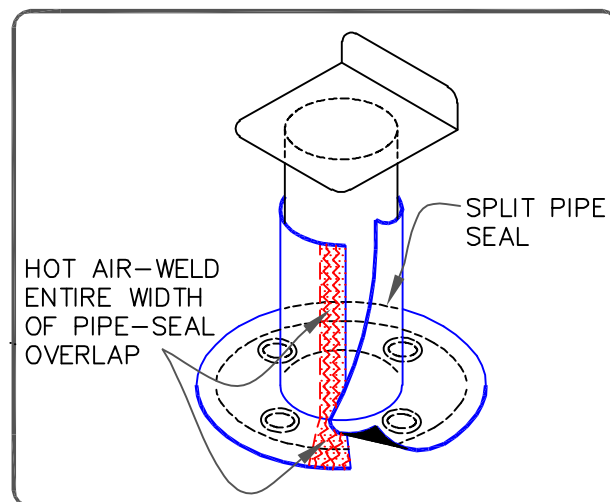

CFA CERTIFIED
PRE-FABRICATED SPLIT PIPE
SEAL

MAXIMUM WARRANTY: 30 YEARS

— TPO
MEMBRANE
— APPROVED
SUBSTRATE
0 — SEE NOTE

PS (PRESSURE
SENSITIVE)
P&S (PEEL &
STICK)
QA (QUICK
APPLIED)

THERMOPLASTIC
ROOFING SYSTEM

TPC-8.5