


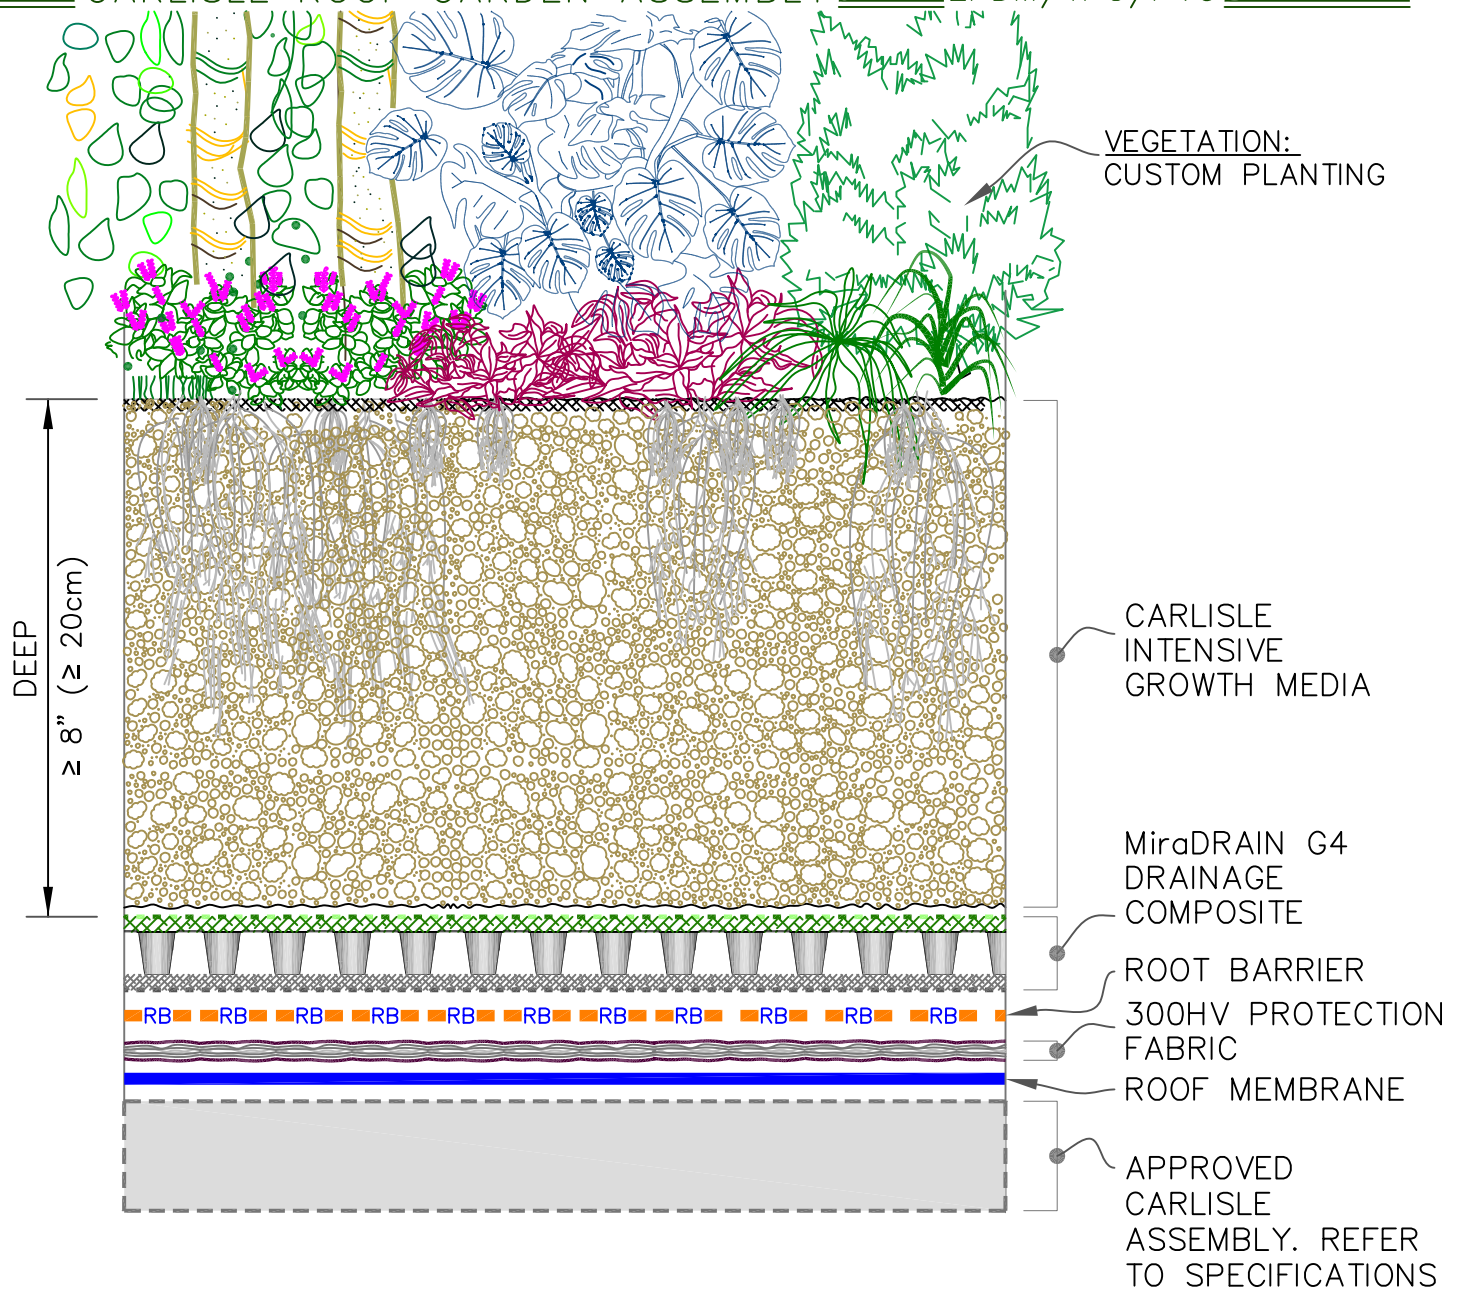

NOTES:

- POSITIVE SLOPE (MIN 1/4" PER 12") MUST BE PROVIDED AT MEMBRANE SURFACE LEVEL, EITHER BY SLOPING THE STRUCTURAL DECK OR BY ADDING TAPERED INSULATION BOARD ON FLAT STRUCTURAL DECK.
- ACCEPTABLE MEMBRANE ON CONCRETE: WHEN WATERPROOFING MEMBRANE TO BE APPLIED DIRECTLY TO STRUCTURAL OR LIGHTWEIGHT CONCRETE SUBSTRATE, FleeceBACK OR FleeceBACK AFX MEMBRANE MUST BE USED.
- SEAMS: REFER TO SPECIFICATIONS.

DEEP (INTENSIVE)	
(≥ 8") (≥ 20cm) ASSEMBLY	
2021 ROOF GARDEN DETAILS	DETAIL NO. RGI C

CARLISLE GROWTH MEDIA MiraDRAIN G4 DRAINAGE COMPOSITE ROOT BARRIER (40-MIL NON-REINFORCED POLYPROPYLENE) 300HV PROTECTION FABRIC	ROOF MEMBRANE POLYSTYRENE INSULATION SEE NOTE(S) IRMA INSULATED ROOF MEMBRANE ASSEMBLY
---	---