


NOTES:

1. REMOVE ALL EXISTING LEAD AND FLASHING MATERIAL BEFORE INSTALLING SPLIT PIPE FLASHING.
2. TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 140°F (60°C).
3. INSTALL A MINIMUM OF 4 FASTENERS AND PLATES AROUND THE PIPE, EQUALLY SPACED. IF FASTENERS AND PLATES CANNOT BE INSTALLED AS SHOWN, THEY MAY ALSO BE POSITIONED OUTSIDE THE PIPE MAXIMUM 12" (30cm) O.C. AND FLASHED WITH PVC REINFORCED MEMBRANE/CUT-EDGE SEALANT. REFER TO [DETAIL U-8B](#).
4. FASTENERS AND PLATES ARE NOT REQUIRED ON ADHERED SYSTEMS UNLESS PIPE DIAMETER EXCEEDS 18" (46cm).
5. T-JOINT COVERS ARE NOT REQUIRED ON WHITE, TAN OR GRAY PREFABRICATED ACCESSORIES. FOR ALL ADDITIONAL COLORS IT IS REQUIRED TO COVER T-JOINTS.

FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY

DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP-X	PIRANHA
	B	HP-XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD-10	PIRANHA
	B	HD 14-10	PIRANHA

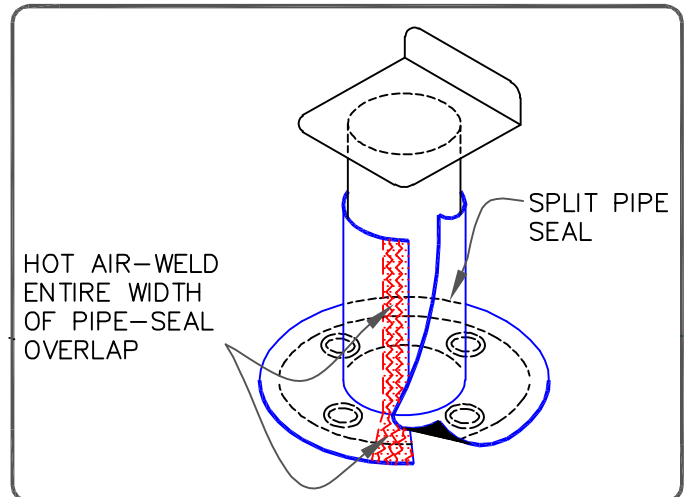

CFA CERTIFIED PRE-FABRICATED SPLIT PIPE SEAL

MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U-8E

U (Universal Detail)