


NOTES:

1. REMOVE ALL LEAD AND OTHER FLASHING BEFORE INSTALLING FIELD-FABRICATED PIPE SEAL.
2. TEMPERATURE OF PENETRATION MUST NOT EXCEED 180°F (82°C).
3. IN COLDER TEMPERATURES, A HEAT GUN MUST BE USED WHEN FORMING PRESSURE-SENSITIVE ELASTOFORM FLASHING.

DIMENSIONS		cm	
(A)	1/2"	1.5	MIN.
(B)	1"	2.5	MIN.
(C)	3"	7.5	MIN.

A

UP TO 20-YEAR WARRANTY

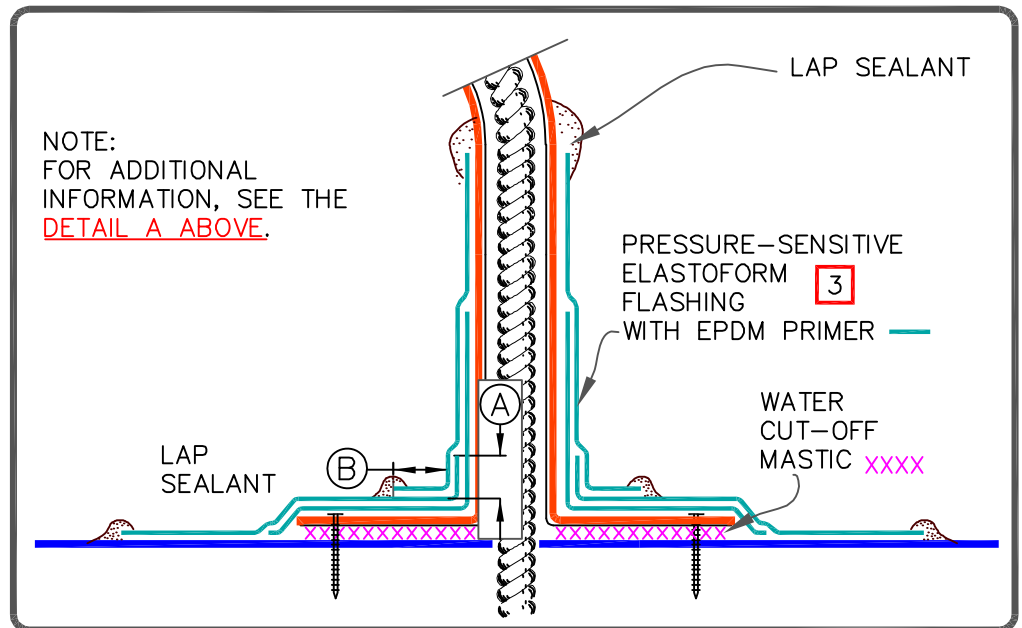

B

UP TO 30-YEAR WARRANTY



FLEXIBLE PENETRATION

MAXIMUM WARRANTY: SEE EACH DETAIL



DETAIL NO.

U-8C

U (UNIVERSAL DETAIL)