




APPLY BASE COAT OF LIQUISEAL Liquid Flashing Resin PER PUBLISHED COVERAGE RATE

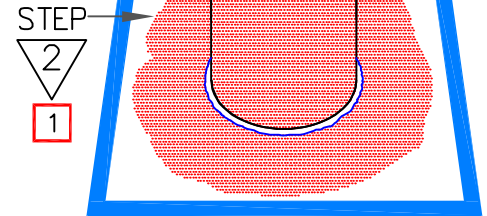


APPLY BASE COAT OF LIQUISEAL Liquid Flashing Resin ON HORIZONTAL SURFACES. IMMEDIATELY PRESS FLEECE INTO RESIN AND OVERLAP LIQUISEAL Flashing Fleece, MIN. 2" (5cm)

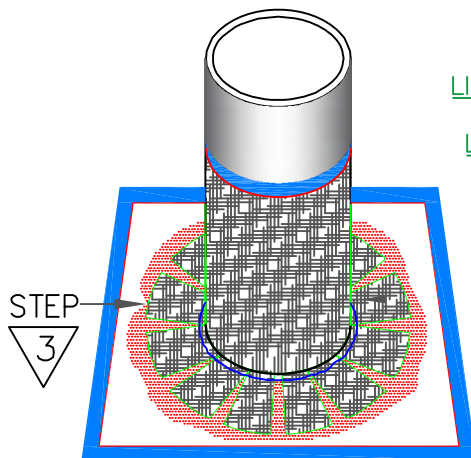


IMMEDIATELY PRESS LIQUISEAL Flashing Fleece, INTO THE APPLIED LIQUISEAL Liquid Flashing Resin. APPLY SECOND COAT OF RESIN. ENSURE ALL ENDS OF FINGERS ARE PROPERLY EMBEDDED.

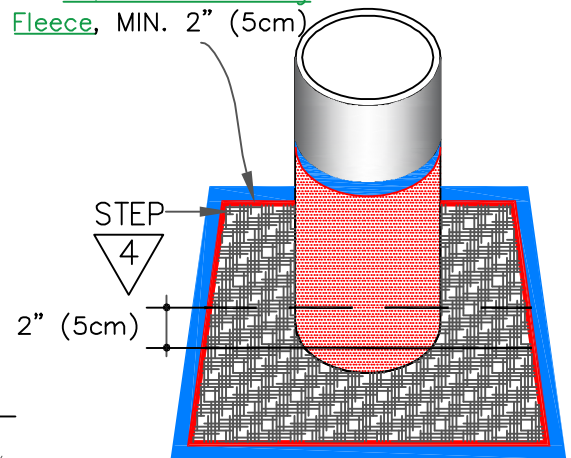

FLEECE MUST BE COVERED 1/4" - 1/2" (1cm - 1.5cm) PAST ALL EDGES





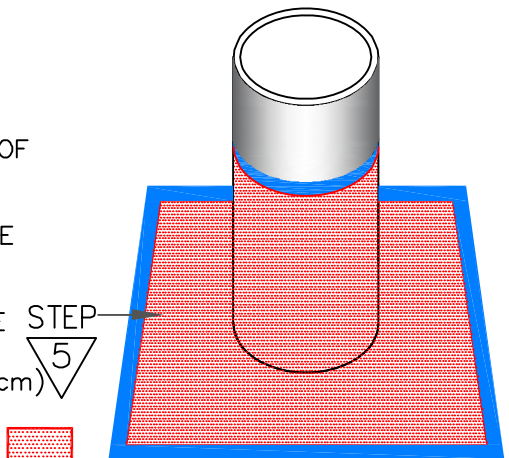

APPLY A TOP COAT OF LIQUISEAL Liquid Flashing Resin, ENSURING THE FLEECE IS COMPLETELY SATURATED PER PUBLISHED COVERAGE RATE AND APPLY 1/4" - 1/2" (1cm - 1.5cm) BEYOND THE FLEECE EDGES




NOTES:

1. FOR MULTIPLE PIPE PENETRATIONS SEE STEP ZERO ON SHEET LF-8.1 (PAGE 2 OF 2) AND FOLLOW REST OF THE STEPS AS SHOWN FOR SINGLE PIPE FLASHING.
2. REFER TO TABLES ON SHEETS ATTACHMENT 1-2 FOR DETAILED INSPECTION, CLEANING AND PRIMING FOR DIFFERENT MATERIALS WITHIN THE FLASHING AREAS.
3. SEE PAGE 2 OF 2 FOR ADDITIONAL NOTES.

	ROOF MEMBRANE
	LIQUISEAL Flashing Fleece
	LIQUISEAL Liquid Flashing Resin
	SEE NOTE(S)

SINGLE OR MULTIPLE PIPE PENETRATIONS (PAGE 1 OF 2)


For additional information, refer to Specifications



DETAIL NO.

LF-8.1

LIQUID FLASHING

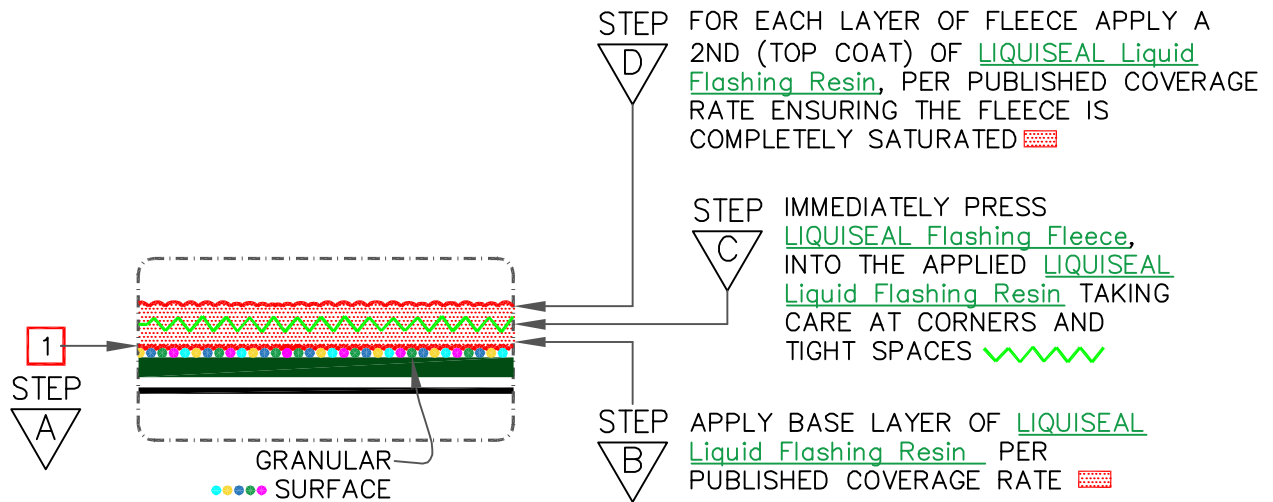







4 FASTENERS REQUIRED MIN.	 PLAN VIEW	SEAM FASTENING PLATES & FASTENERS																		
	PIPE OUTSIDE DIAMETER < 6" (15cm)	<table><tr><th colspan="2">DIMENSIONS</th><th>cm</th><th></th></tr><tr><td>(A)</td><td>6"</td><td>15</td><td>TO</td></tr><tr><td></td><td>12"</td><td>30</td><td></td></tr><tr><td>(B)</td><td>12"</td><td>30</td><td>MAX.</td></tr></table>	DIMENSIONS		cm		(A)	6"	15	TO		12"	30		(B)	12"	30	MAX.	PIPE OUTSIDE DIAMETER > 6" (15cm)	
DIMENSIONS		cm																		
(A)	6"	15	TO																	
	12"	30																		
(B)	12"	30	MAX.																	

TABLE FOR FASTENER REQUIREMENTS ON MECHANICALLY FASTENED SYSTEMS. REFER TO CARLISLE TYPICAL PENETRATION DETAILS FOR FLASHING OVER FASTENER HEADS.

NOTES CONTINUE FROM [LF-8.1 \(PAGE 1 OF 2\)](#)

- WHEN THERE IS ENOUGH CLEARANCE BETWEEN MULTIPLE PENETRATIONS, INSTALL LIQUID FLASHING USING THIS DETAIL.
- WHEN INSTALLATION OF LIQUID FLASHING IS NOT FEASIBLE FOR MULTIPLE PIPE PENETRATIONS, THEN USE APPLICABLE STANDARD ROOF MEMBRANE DETAIL ([U-16](#)) FOR FIELD MEMBRANE TYPE.
- DETAIL NOT FOR USE ON WARRANTY PROJECTS EXCEEDING 20-YEARS. UNLESS OTHERWISE SPECIFIED.

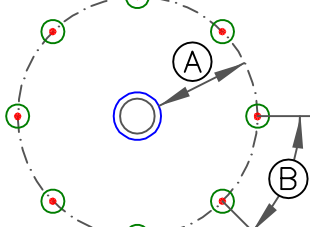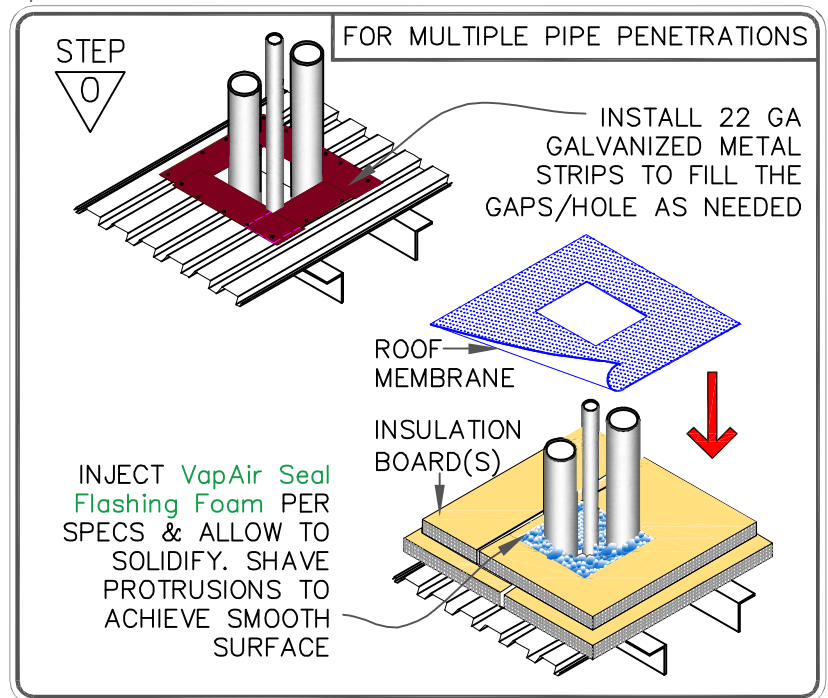

<div><div></div><div></div><div></div><div><div>0</div></div></div> <div><div>— ROOF MEMBRANE</div><div>— LIQUISEAL Flashing Fleece</div><div>— LIQUISEAL Liquid Flashing Resin</div><div>— SEE NOTE(S)</div></div>	SINGLE OR MULTIPLE PIPE PENETRATIONS (PAGE 2 OF 2)		DETAIL NO.
	For additional information, refer to Specifications		LF-8.1
		LIQUID FLASHING	