


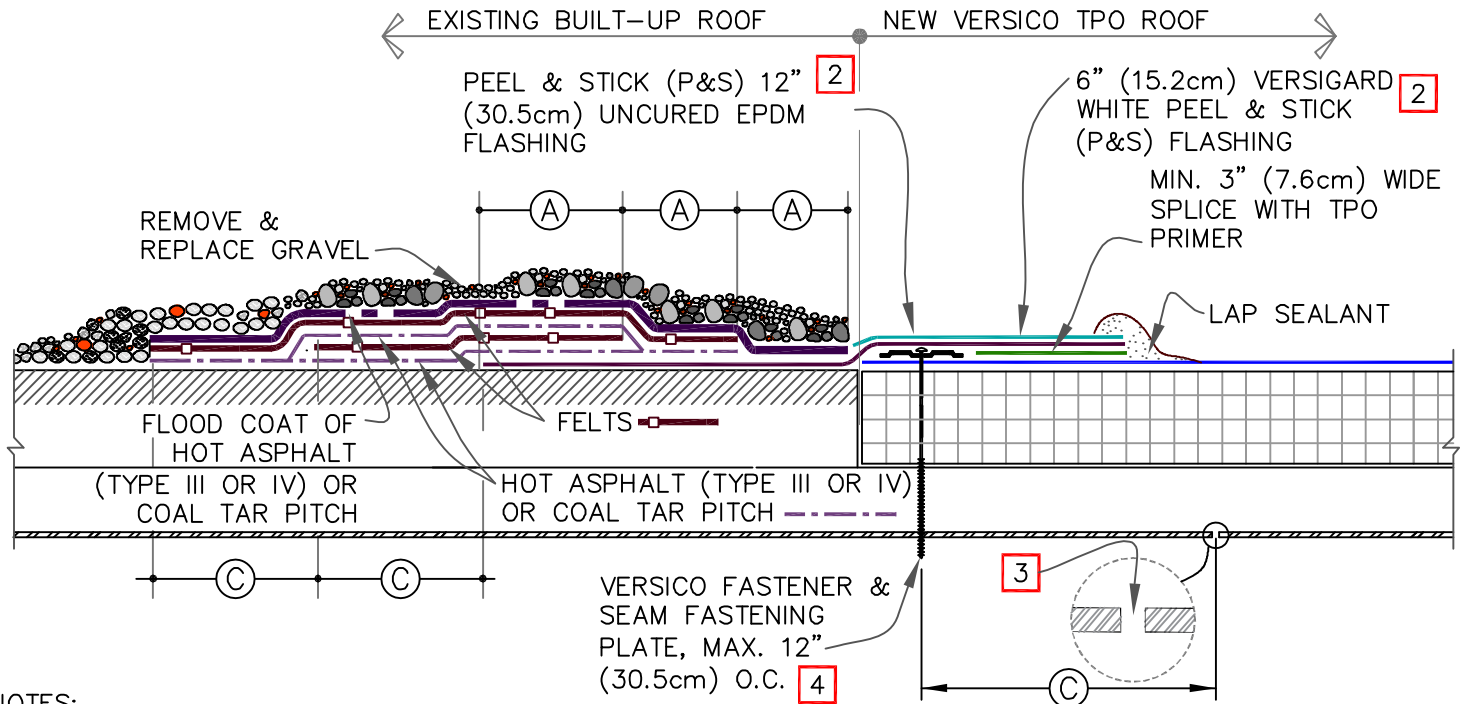


NOTES:

1. REMOVE ALL GRAVEL AT TIE-IN.
2. OVERLAY VERSIGARD P & S FLASHING WITH 6" (15cm) VERSIGARD WHITE P & S FLASHING TO REDUCE HEAT GAIN ON TPO MEMBRANE
3. IF FLUTES ARE PERPENDICULAR TO THE TIE-IN DRILL A 3/8" (1cm) DIAMETER WEEP HOLE INTO THE BOTTOM FLUTES OF THE STEEL DECK ALONG THE PERIMETER OF THE TIE-IN 6" (15cm) MINIMUM TO 12" (30cm) MAXIMUM FROM THE SEAM FASTENING PLATE.
4. IF WATER PONDS OR FLOWS OVER TIE-IN FROM BUR SURFACE, USE [DETAIL TPC-13.2](#).

HOT TIE-IN OPTION

FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY

DECK TYPE	OPTION	FASTENER	PLATE
STEEL	A	HPVX	HPVX
	B	HPV-XL	HPV-XL

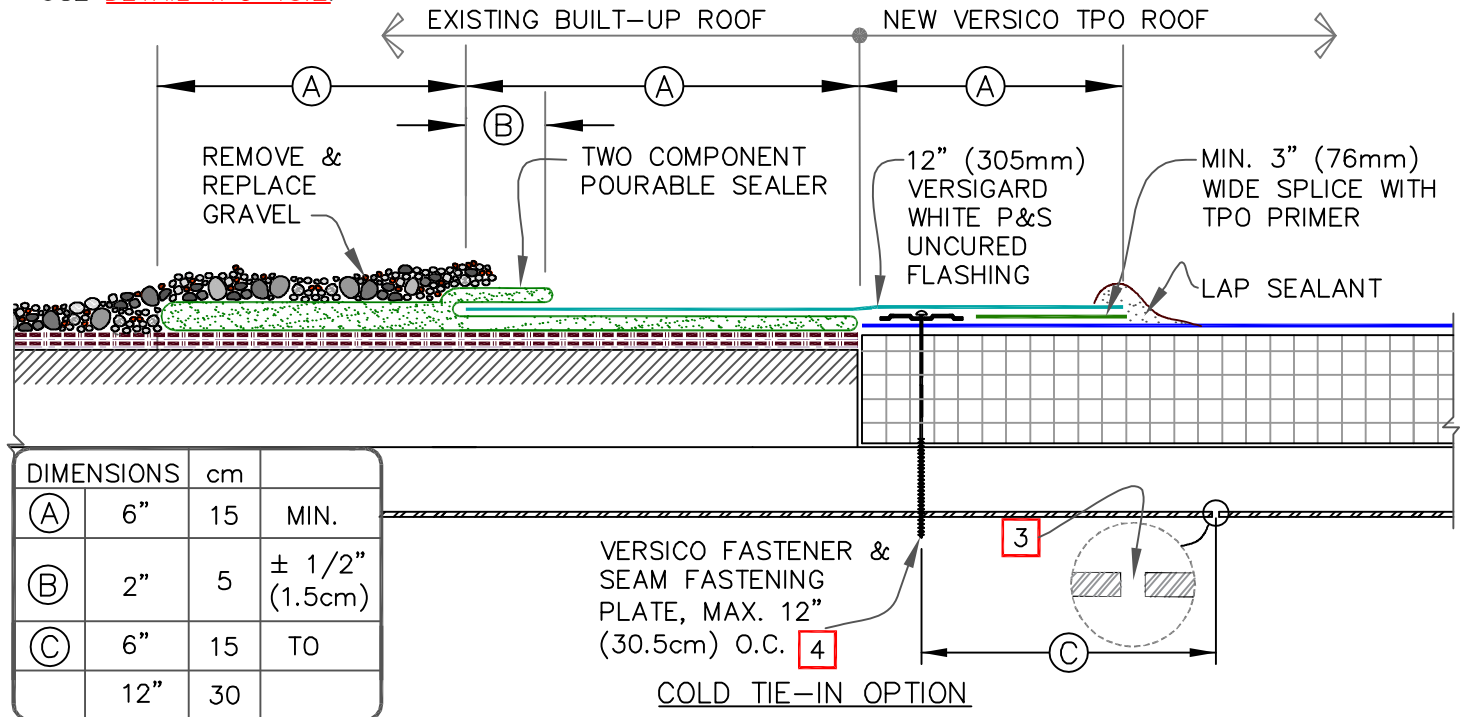


DIMENSIONS	cm	
(A)	6"	15 MIN.
(B)	2"	5 ± 1/2" (1.5cm)
(C)	6"	15 TO
	12"	30

COLD TIE-IN OPTION



TPO TIE-IN TO BUILT-UP
ROOFING OVER STEEL ROOF
DECK

MAXIMUM WARRANTY: 30 YEARS



PS (PRESSURE
SENSITIVE)
P&S (PEEL &
STICK)
QA (QUICK
APPLIED)

THERMOPLASTIC
ROOFING SYSTEM

TPC-13.1