


## NOTES:

1. FASCIA HORIZONTAL FLANGE MUST BE TOTALLY COVERED MINIMUM 2" (5cm) BEYOND THE NAIL.
2. REFER TO [MR Z1.1](#) & [MR Z1.2](#) AT THE END OF THIS SECTION.

EXISTING FLOATING  
RAKE AND CLIP  
REMOVED

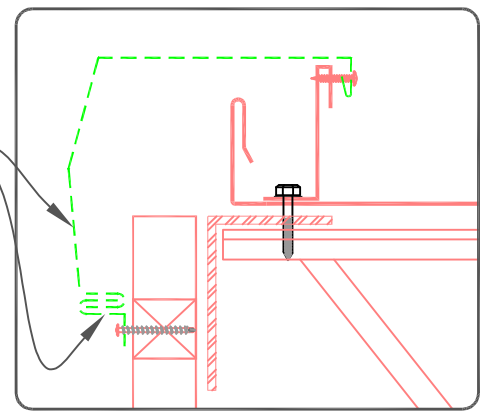

EXISTING FLOATING RAKE EDGE

PVC / TPO  
COATED SHEET  
METAL FASCIA

CUT-EDGE SEALANT FOR  
TPO ONLY, REFER TO  
SPECS

HOT AIR-WELDED 1-1/2"  
(4cm) MIN.

FILL WITH RIGID  
BOARD INSULATION  
OR INJECT  
HIGH-RISE FOAM

GALVANIZED  
CLEAT


TPO OR PVC  
ROOF MEMBRANE

HP-PURLIN  
FASTENER, REFER  
TO SPECS

**B** HP FASTENERS @ 12" (30cm) O.C. OR  
RING-SHANK NAILS @ 4" (10cm) O.C.  
& STAGGERED 3/4" (2cm) O.C.

**D** FASTENERS TO MATCH EXISTING @ 6"  
(15cm) O.C., MAX., EXPOSED 3/4"  
(2cm) MIN. BEYOND EXISTING  
SUBSTRATE

RAKE EDGE



• HIGH DENSITY  
RECOVER BOARD


• IN-FILL INSULATION



• ROOF MEMBRANE  
• WOOD NAILER (BY OTHERS)

**0**

• SEE DRAWING NOTE(S)



SHEET NO.

MRIT1.10