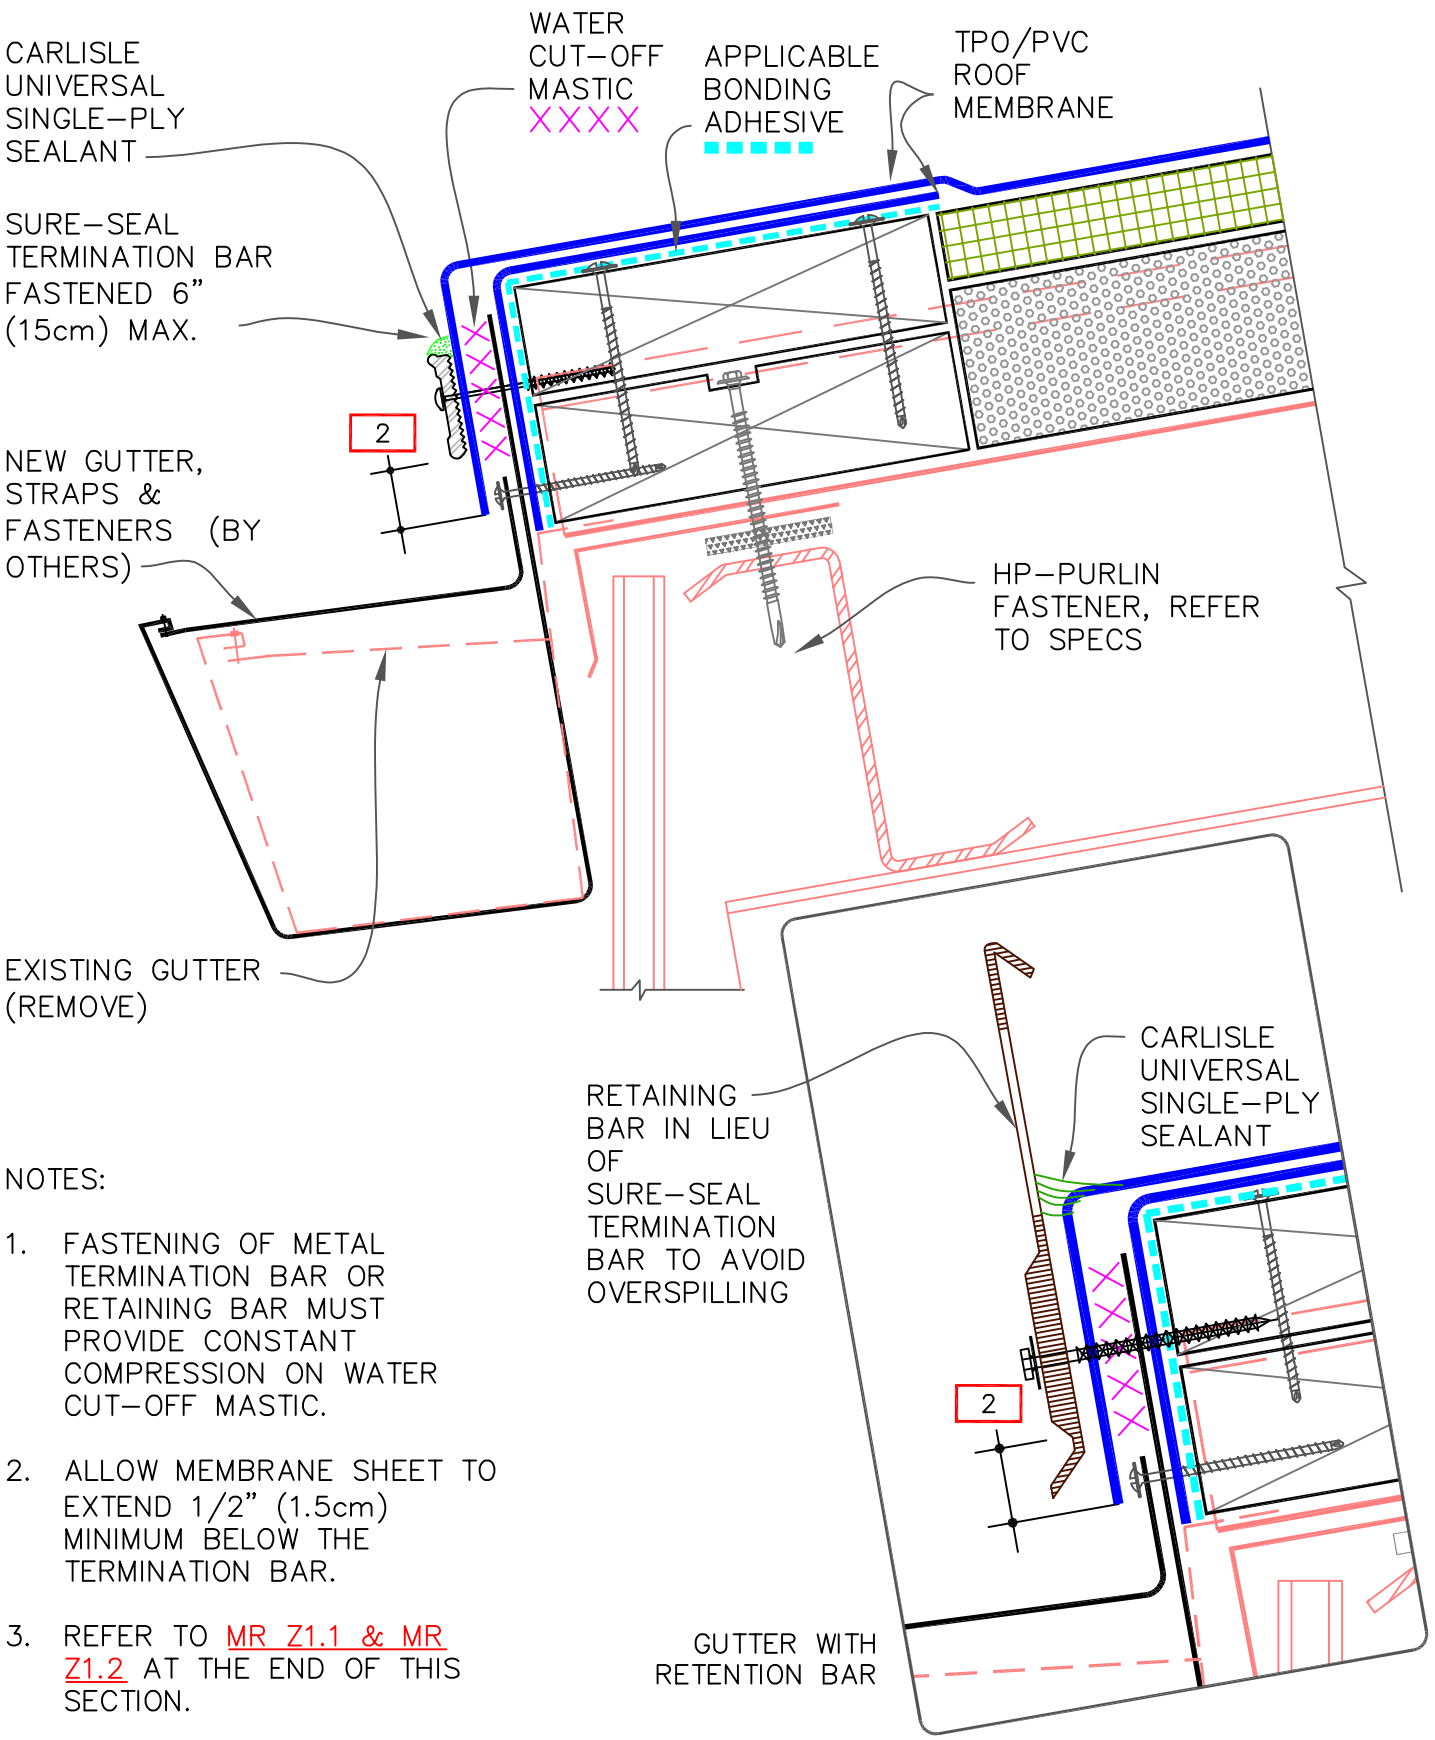

NOTES:

1. FASTENING OF METAL TERMINATION BAR OR RETAINING BAR MUST PROVIDE CONSTANT COMPRESSION ON WATER CUT–OFF MASTIC.
2. ALLOW MEMBRANE SHEET TO EXTEND 1/2" (1.5cm) MINIMUM BELOW THE TERMINATION BAR.
3. REFER TO MR Z1.1 & MR Z1.2 AT THE END OF THIS SECTION.

GUTTER WITH METAL BAR EDGE TERMINATION

- HIGH DENSITY RECOVER BOARD
- IN–FILL INSULATION
- ROOF MEMBRANE
- WOOD NAILER (BY OTHERS)
- 0 — SEE DRAWING NOTE(S)



SHEET NO.
MRI T1.4

©2021 Carlisle SynTec a division of Carlisle Construction Materials Incorporated