


NOTES

1. RIDGE MEMBRANE ATTACHMENT IS ONLY REQUIRED WHEN ROOF SLOPE EXCEEDS 3" TO 12" (7.5cm TO 30.5cm) HORIZONTAL.
2. REFER TO CARLISLE SPECIFICATIONS FOR REQUIRED NUMBER OF PERIMETER SHEETS, SHEET WIDTH AND MEMBRANE FASTENING SPACING.
3. AS AN OPTION TO USING PERIMETER SHEETS, 10" (25cm) WIDE PRESSURE-SENSITIVE RUSS MAY BE USED BENEATH THE TPO FIELD SHEETS ONLY FOR PERIMETER SECUREMENT. SEE DETAIL [MF-2.1, DETAIL A](#).
4. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.

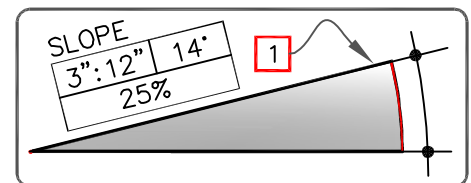

FASTENER & PRESSURE PLATE TYPES FOR DIFFERENT ROOF DECKS

DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP-X	PIRANHA
	B	HP-XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD-10	PIRANHA
	B	HD 14-10	PIRANHA

MECHANICALLY FASTENED ASSEMBLY



RIDGE MEMBRANE ATTACHMENT

MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

MF-22

MF (MECHANICALLY FASTENED)