





Fully Adhered and Mechanically Fastened Roofing Systems

January 2025

Part I – General	Page
1.01 Description	
1.02 Design Considerations	
1.03 Quality Assurance	
1.04 Submittals	
1.05 Warranty	7
Warranty Tables	
TABLE I – VersiFleece Adhered Systems Warranty Options	8
TABLE II –Underlayment and Fastening Density for Assemblies with Warranties Up to 20 YR	9
TABLE III –Underlayment and Fastening Density for Assemblies with Warranties - 25 YR	
TABLE IV – Bead Spacing for VersiFleece Membrane Adhesion	
TABLE V – Minimum Perimeter Width	
1.06 Job Conditions	
1.07 Product Delivery, Storage and Handling	13
Part II - Products	
2.01 General	
2.02 Membrane	
2.03 Insulation/Underlayments	
2.04 Related Materials	
2.05 Fastening Components	
2.06 Vapor/Air Barrier and Primers	
2.08 Roof Walkways	
2.09 Other Products	
2.00 Other Freducts	
Part III - Execution 3.01 General	3/
3.02 Roof Deck/Substrate Criteria	
3.03 Insulation/Underlayment	
3.04 Insulation Attachment	
3.05 Membrane Placement and Securement Criteria	
3.06 Heat Welding Procedures (VersiWeld TPO)	
3.07 Welding Problems/Repairs	
3.08 Flashings	
3.09 Roof Walkways	
3.10 Daily Seal	
Attachment I – Direct Application Over Lightweight Insulating Concrete	47
Attachment II – Mechanically Attached Membrane Option	49
Attachment III – VersiFleece FR TPO Mechanically Attached Membrane Option	53
Attachment IV – VersiFleece RL EPDM/TPO/PVC RapidLock Membrane Option	
Installation Details	

Note: In addition to information listed in this section Specifiers and Authorized contractors should reference Spec Supplement and Design Reference Sections for other pertinent information.

TABLE OF CONTENTS

This page intentionally blank



VersiFleece TPO VersiFleece PVC / VersiFleece FRS PVC VersiFleece KEE HP / VersiFleece KEE HP Fully Adhered and Mechanically Fastened Roofing Systems

January 2025

The information contained in this generic specification represents a part of Versico's requirements for obtaining a roofing systems warranty. Construction materials and practices, building siting and operation, climatic conditions, and other site-specific factors will have an impact on the performance of the roofing system. Versico recommends that the building owner retain a design professional to determine appropriate design measures to be taken in order to address these factors.

This section is to serve as criteria for Specifiers and Authorized Contractors regarding the design and installation of Versico's Fully Adhered VersiFleece Membrane Roofing Systems. Additional information essential for the design and installation of the roof system mentioned herein are also included in the Design Reference Section and also listed in the form of a Specification Supplement at the end of the Technical Manual. Specifiers and Authorized Contractors are advised to reference all applicable sections.

Various Warranty Tables have been included in Paragraph 1.05 citing various requirements by which specific warranty coverage can be obtained. Appropriate Warranty Table should be referenced to ensure proper warranty coverage.

PART I - GENERAL

1.01 Description

Versico's VersiFleece Fully Adhered Roofing Systems utilizes VersiWeld® TPO or VersiFlex[™] PVC or KEE HP PVC membrane laminated to non-woven polyester fleece backing.

A. Fully Adhered Roofing Systems

- 1. **VersiFleece TPO Fully Adhered Roofing System** incorporates 45, 60 or 80-mil thick, 12' or 6' wide, scrim-reinforced, white, gray, tan or Special Color TPO (60-mil only) VersiWeld Thermoplastic Polyolefin (TPO) membrane laminated to a 55-mil thick non-woven polyester fleece-backing resulting in a total finished sheet thickness of 100, 115 or 135-mils.
- 2. **VersiFleece FRS PVC Fully Adhered Roofing System** incorporates 60 or 80-mil thick, 10' wide, fiberglass reinforced scrim (white, gray, light gray and tan) VersiFlex Polyvinyl Chloride (PVC) membrane laminated to a 55-mil thick non-woven polyester fleece-backing resulting in a total finished sheet thickness of 115 or 135-mils.
- 3. **VersiFleece PVC Fully Adhered Roofing System** incorporates 60 or 80-mil thick, 10' wide, polyester reinforced scrim (white, gray, light gray, slate gray and tan) VersiFlex Polyvinyl Chloride (PVC) membrane laminated to a 55-mil thick non-woven polyester fleece-backing resulting in a total finished sheet thickness of 115 or 135-mils.
- 4. VersiFleece KEE HP Fully Adhered Roofing System incorporates 50, 60 or 80-mil thick, 10' wide, polyester reinforced scrim, (white, gray, light gray, slate gray and tan) VersiFlex KEE HP Polyvinyl Chloride (PVC) membrane laminated to a 55-mil thick non-woven polyester fleece-backing resulting in a total finished sheet thickness of 105, 115 or 135-mils.

NOTE: The membrane is fully adhered to an acceptable substrate with a spray, extrusion or splatter applied, two-component, low-rise Flexible DASH or HydroBond Adhesive. Adjoining sheets of VersiFleece membrane are overlapped and joined together with a minimum 1-1/2" wide hot air weld.

NOTE: VersiFleece TPO is available with APEEL Protective Film, refer to PART II – PRODUCTS.

NOTE: VersiFleece FR TPO membrane is also available for mechanically fastened systems over combustible decks – see 'Attachment III – VersiFleece FR TPO Mechanically-Fastened Membrane Option' at the end of this specification.

NOTE: VersiFleece RL (RapidLock) EPDM/TPO/PVC membrane is also available in a non-adhesive system utilizing Velcro® Brand Securable Solutions - see 'Attachment IV – VersiFleece RL EPDM/TPO/PVC Membrane Option' at the end of this specification.

B. Mechanically Attached Roofing System

VersiFleece TPO/PVC Mechanically Attached Roofing System as an option to fully adhering the VersiFleece
Membrane with Flexible DASH Adhesive, the membrane may be loose laid and mechanically attached over an
approved substrate to an acceptable deck minimum 22 ga. steel deck or wood deck refer to Attachment II in this
specification.

1.02 General Design Considerations

- A. Projects with extended wind speed warranty coverage greater than 90 mph and projects requiring a 20-year or greater Total System Warranty and projects which have building control and/or expansion joints will require additional enhancements. Refer to Warranty Tables in Paragraph 1.05.
- B. There are no maximum slope restrictions for the application of this roofing system.
- C. Chemical compatibility will depend on type of membrane used. Versico should be contacted for verification of compatibility with specific products, chemicals or waste products that may come in contact with the roof membrane.
- D. It is the responsibility of the specifier to review local, state and regional codes to determine their impact on this VersiFleece Roofing System.
- E. It is the responsibility of the building owner or his/her designated representative to verify structural load limitation. In addition, a core cut may be taken to verify weight of existing components when the roofing system is to be specified on an existing facility.
- F. Coordination between various trades is essential to avoid unnecessary rooftop traffic over completed sections of the roof and to prevent possible damage to the membrane roofing system and insulation facer.
- G. Concentrated loads from rooftop equipment may cause deformation of insulation/underlayment and possible damage to the membrane if protection is not provided. At protection course or sleepers must be specified.

H. Drainage

1. Drainage must be evaluated by the specifier in accordance with all applicable codes. Slopes may be provided by tapering the structure or through the use of tapered insulation; a sufficient number of roof drains should also be specified and properly located to allow for positive drainage. Significant ponding that could remain after 48 hours should be eliminated with the addition of auxiliary drains in low areas where ponding is anticipated.

Versico specifically disclaims responsibility for design of and selection of an adequate drainage system and drain accessories. Selection must be made by the building owner or owner's design professional.

- 2. Small incidental areas of ponded water will not impact the performance of this roofing system; however in accordance with industry standards, the roofing assembly should be designed to prevent ponding of water on the roof for prolonged periods (longer than 48 hours). Good roofing practice dictates proper drainage to prevent possible excessive live loads and, in the event of a roof leak, to minimize potential interior damage to the roofing assembly and to the interior of the building.
- 3. For roofing systems utilizing white membranes, a slope greater than 1/8" per horizontal foot is recommended to serve the long-term aesthetics.
- 4. Tapered edge strips, crickets or saddles are recommended where periodic ponding of water may occur.
- On new construction projects, especially in cold climate regions, moisture generated due to the construction process could adversely impact various components within the roofing assembly if not addressed. Refer to Design Reference DR-01 "Construction Generated Moisture" included in the Versico Technical Manual.

J. Vapor Retarders

Versico does not require a vapor retarder for the protection of the membrane; however, it should be considered
by the specifier for the protection of the roofing assembly (i.e. primarily insulation, underlayment and adhesives).

The following criteria should be considered by the specifier:

- 2. Use of a vapor retarder to protect insulation and reduce moisture accumulation within an insulated roofing assembly, should be investigated by the specifier.
- 3. In the generally temperate climate of the United States, during the winter months, water vapor flows upward from a heated, more humid interior toward a colder, drier exterior. Vapor retarders are more commonly required in northern climates than in southern regions, where downward vapor pressure may be expected and the roofing membrane itself becomes the vapor retarder.
- 4. All Versico roofing membranes are tested and pass in accordance with ASTM E 2178 and shall qualify as an air barrier when following Versico specifications and details for roofing applications.
- K. On structural concrete decks, when a vapor retarder is not used, gaps in the deck along the perimeter and around penetrations must be sealed along with vertical joints between tilt-up panels, if present, to prevent infiltration of hot humid air and possible moisture contamination resulting from condensation. This is specifically important when adhesive is used to attach the roof insulation.

CAUTION: If left unaddressed, collected moisture could weaken insulation boards and facers resulting in a blowoff or increase the probability of mold growth.

- L. Retrofit Recover Projects (When the existing roofing material is left in place)
 - 1. The removal of existing wet insulation and membrane must be specified. The specifier shall select an appropriate and compatible material as a filler for voids created by removal of old insulation or membrane.
 - 2. On existing built-up roof where partial removal is specified to remove wet or damaged insulation, priming the structural deck, with a Versico primer, is required where residual asphalt is present to ensure adequate adhesion of the new insulation. In lieu of priming and the use of insulation adhesion, insulation used to fill voids or to replace wet sections may be mechanically attached.
 - 3. Entrapment of water between old and new membrane can damage and deteriorate new insulation/underlayment between the two membranes. If a vapor retarder or air barrier is not specified, Versico recommends existing membrane be perforated to avoid potential moisture accumulation to allow for detection of moisture to enable the building owner to take corrective action. This can be accomplished by drilling approximately 3/4" diameter holes every 100 square feet in the existing built-up roof or single-ply membrane (excluding PVC membrane).
 - 4. Existing non-reinforced PVC membrane must be totally removed. If not removed it must be cut into maximum 10' by 10' sections and the new membrane underlayment must be mechanically attached. Flashing must be totally removed.
 - 5. When Specifying this roofing system over existing gravel surfaced built-up roof, loose gravel must be removed to avoid the entrapment of moisture. In all cases, a membrane underlayment is required. Refer to Paragraph 3.02G, Insulation/Substrate Requirements, for minimum thickness of acceptable underlayment.
 - 6. Existing Phenolic Foam insulation must be removed prior to the installation of this roofing system.
 - 7. Refer to Section 3.02 for more information about securement of existing roof.

1.03 Quality Assurance

Building codes are above and beyond the intended purpose of this specification. The building **owner, owner's representative** or **Specifier** should verify local codes for applicable requirements and limitations. It is the responsibility of the specifier to review local, state and regional codes to determine their impact on the specified Versico Roofing System.

NOTE: For code approvals achieved with the Versico VersiFleece Roofing Systems, refer to the Versico VersiFleece Code Approval Guide, DORA (Directory of Roof Assemblies), Factory Mutual (FM) Approval Guide or Underwriters Laboratories (UL) Fire Resistance or Roofing Materials and Systems Directories.

- A. When recovering or retrofitting an existing roof system, the addition of new insulation (type and thickness) may alter the fire performance characteristics of the assembly. Building owners or their designated representatives shall consult the local code enforcement agency to avoid potential code violation.
- B. Versico recommends the use of Versico supplied products for use with this Versico Roofing System. The performance or integrity of products by others, when selected by the specifier and accepted as compatible by Versico, is not the responsibility of Versico and is disclaimed by the Versico Warranty.
- C. The specified roofing system must be installed by a Versico Authorized Roofing Contractor in compliance with

drawings and specifications as approved by Versico.

- D There must be no deviations made from Versico's specification or Versico's approved shop drawings without the PRIOR WRITTEN APPROVAL of Versico.
- E. After completion of the installation, upon request, an inspection shall be conducted by a Field Service Representative of Versico to ascertain that the membrane roofing system has been installed according to Versico's published specifications and details applicable at the time of bid. This inspection is to determine whether a warranty shall be issued. It is not intended as a final inspection for the benefit of the owner.
- F. Provide polyisocyanurate insulation that meets PIMA Quality Mark Certified LTTR value through third party verification meeting ASTM C 1289, Type II, Class 1, Grade 2.
- G. Solar reflectance of this roofing product may decrease over time due to environmental defacement such as dirt, biological growth, ponded water, etc. The roof should be monitored at regular intervals and maintained or cleaned when necessary to assure maximum solar reflectance.
- H. Refer to the <u>Design Reference DR-07 "CRRC/LEED Information"</u> for information. (i.e. solar emittance, solar reflectance and recycled content.)

1.04 Submittals

- A. To ensure compliance with Versico's minimum warranty requirements, the following projects should be forwarded to Versico for review prior to installation, preferably prior to bid.
 - Air pressurized buildings, canopies, and buildings with large openings where the total wall openings exceed 10%
 of the total wall area on which the openings are located (such as airport hangars, warehouses and large
 maintenance facilities). Refer to Attachment IV at the end of this section for perimeter considerations, when a
 Mechanically Attached System is specified.
 - 2. Cold storage buildings and freezer facilities.
 - 3. Fully Adhered Roofing System projects over 100' in height.
 - 4. Mechanically Attached Roofing System projects over 50' in height.
 - 5. Projects where the TPO membrane is expected to come in direct contact with petroleum-based products, waste products (i.e., grease, oil, animal fats, etc) and other chemicals.
 - 6. Projects where hot asphalt is specified for insulation attachment.
 - 7. If a Mechanically Attached membrane securement option is selected in lieu of the use of adhesive, projects specified with a fastener length exceeding 12 inches.
- B. Shop drawings must be submitted to Versico by the Versico Authorized Roofing Contractor along with a completely executed Copy-A Job Approval Request. Approved shop drawings are required for inspection of the roof and on projects where on-site technical assistance is requested.

Shop drawings must include:

- 1. Outline of roof and size
- 2. Deck type (for multiple deck types)
- 3. Location and type of all penetrations
- 4. Perimeter and penetration details
- 5. Key plan (on multiple roof areas) with roof heights indicated
- C. When field conditions necessitate modifications to the originally approved drawings, a copy of the shop drawing outlining all modifications must be submitted to Versico for revision and approval prior to inspection and warranty issuance.
- D. As Built Projects (roofing systems installed prior to project approval by Versico)

The Versico Authorized Contractor may supply Versico with an As-Built drawing for projects completed prior to Versico's approval. The As-Built drawings:

- 1. Must conform to Versico's most current published specification and details applicable at the time of bid.
- 2. Must be submitted along with a completely executed Copy-B Job Completion.

3. Must include the items identified in Paragraph 1.04B.

NOTE: As-Built projects are not recommended for those projects referenced in Paragraph 1.04A in order to ensure Versico Warranty requirements have been met.

E. Copy-B Job Completion

After project completion, a Copy-B Job Completion must be submitted to Versico to schedule the necessary inspection and acceptance of the project prior to issuance of the Versico warranty.

1.05 Warranty

- A. A Total System Warranty is available for roofing systems on commercial buildings within the United States and applies only to **products manufactured or marketed by Versico**. The total system is defined as membrane, flashings, adhesives, sealants and other Versico brand products utilized in the installation. For a complete description of these products, refer to the Part 2 "Products" Section in this Specification and Spec Supplement "Related Products" P-01.
- B. See Tables Below for information regarding Warranted Systems and Design Criteria:
 - 1. **TABLE I Minimum Membrane Thickness for Various Warranty Options** Identifies minimum membrane thickness for membranes used in fully adhered roofing systems.
 - TABLE II Underlayment and Fastening Density for Assemblies with Warranties Up to 20 Yrs Identifies
 required underlayments for fully adhered roofing systems with Warranties up to 20 year based on the various
 wind speed coverages available. The Table also identifies fastening density or adhesive bead spacing and
 required edge terminations.
 - 3. TABLE III Underlayment and Fastening Density for Assemblies with Warranties 25 to 30 YR Identifies required underlayments for fully adhered roofing systems with Warranties from 25 to 30 year based on the various wind speed coverages available. The Table also identifies fastening density or adhesive bead spacing and required edge terminations.
 - 4. **TABLE IV Bead Spacing for VersiFleece Membrane Adhesion** Identifies required bead spacing for field and perimeter sheets for available warranty duration and warranty wind speed coverages.
 - TABLE V Minimum Perimeter Width Identifies required minimum perimeter sheet widths for various building heights.

Table I **VersiFleece Adhered Systems Warranty Options**

Max	Minimum Membrane	Warrant	y Wind S	peed	Additional Hail Coverage (4)		
Warranty Duration	Thickness	55, 72 or 80 mph	90 or 100 mph	110 or 120 mph	1" Dia. Hail	2" Dia. Hail	3" Dia. Hail
	VersiFleece TPO 100-mil	$\sqrt{}$	√	V	$\sqrt{}$	√ (1)	N/A
5,10, or 15 year	VersiFleece PVC 115-mil (3)	$\sqrt{}$	√	V	$\sqrt{}$	√ (1)	N/A
	VersiFleece KEE HP 105-mil	V	√	V	V	√ (1)	N/A
	VersiFleece TPO 115-mil	V	√	V	V	V	√ (1)
20 year	VersiFleece PVC 115-mil (3)(5)	$\sqrt{}$	$\sqrt{}$	$\sqrt{}$	$\sqrt{}$	√ (1)	N/A
	VersiFleece KEE HP 105-mil	$\sqrt{}$	√	$\sqrt{}$	$\sqrt{}$	√ (1)	N/A
	VersiFleece TPO 135-mil	V	√	V	√	√	√ (1)
25 year	VersiFleece PVC 135-mil (3)(5)	$\sqrt{}$	V	$\sqrt{}$	$\sqrt{}$	√	√ (1)
VersiFleece KEE HP 115-mil		$\sqrt{}$	√	$\sqrt{}$	$\sqrt{}$	√	√ (1)
30 voar	VersiFleece TPO 135-mil	V	√	V	V	V	√ (1)
30 year	VersiFleece KEE HP 135-mil	V	V	V	V	V	√ (1)

Notes: √= Acceptable N/A = Not Acceptable

General: Mechanical Fastened Assemblies using any of the above membranes are limited to a maximum warranty wind speed of 72 mph, refer to Attachment II.

- Requires Flexible DASH in full coverage or beads spaced at 4" o.c.
- 1) 2) Require Flexible DASH in full coverage or beads spaced at 4" o.c. Contact Versico for underlayment requirements.
- 3) VersiFleece PVC with Polyester or Fiberglass Reinforced Scrim (FRS).
- 4) Flexible DASH Splatter application (50% coverage or 1/2 gallon per 100 square feet) does not qualify for additional puncture or hail
- 5) VersiFleece PVC 115- or 135-mil membranes in Slate Gray are limited to Warranties Up to 20 Year.

Table II Underlayment and Fastening Density for Assemblies with Warranties Up to 20 YR

Other Requirements are Listed in Additional Design Considerations following this Table

All Versico Products listed for higher wind speed coverage can also be used for Warranties with lesser speed coverage. (i.e. 72 MPH underlayment may be used for 55 MPH underlayment)

Peak		Insulation	/Underlayment A	Attachment		
Gust Wind Speed	Minimum Membrane Underlayment (Versico Supplied Only)	# of Fasteners per 4' x 8' board size			Metal Edging	
Warranty		(1)	Field	Perimeter		
	1" (20-psi) Polyisocyanurate	16 (9)				
	1-1/2" (20-psi) Polyisocyanurate	10			VaraiTrim Drin	
55 or 72	2" (20 -psi) Polyisocyanurate	8	6" (4	6" (4)	VersiTrim Drip Edge, VersiTrim 200	
MPH	1/2" SecurShield HD or 1/2" SecurShield HD Eco (2)	12	O (1	0 (1)	or 300	
	1/4" DensDeck, 1/4" Securock, 1/4" DEXCell, or 1/4" DEXCell FA	12				
	1/2" SecurShield HD Plus (2)	8				
	1/2" Versico Recovery Board (2)	16				
80 MPH	2" SecurShield HD Composite	6	6" (4)(6)	6" (4)(6)	VersiTrim Drip Edge, VersiTrim 200	
OU WIPH	1/2" DensDeck, 1/2" Securock, 1/2" DEXCell or 1/2" DEXCell FA (2)		6" (4)(6)	or 300 (10)		
	1-1/2" (25-psi) Polyisocyanurate	10				
	2" (25 -psi) Polyisocyanurate	8				
	1/2" DensDeck, 1/2" Securock, 1/2" DEXCell or 1/2" DEXCell FA (2)	12				
	1/2" SecurShield HD, 1/2" SecurShield HD Eco, 1- 1/2" (20-psi) SecurShield Polyiso or 1-1/2" (20-psi) SecurShield Eco (2)	16				
	1/2" SecurShield HD Plus (2)	12	6" (8)	6" (6)(7)	VersiTrim Drip Edge	
90 MPH	2" (20-psi) SecurShield Polyiso or 2" (20-psi) SecurShield Eco	8			(3), VersiTrim 2000 or 3000.	
	1-1/2" DuraFaceR (OSB/Polyiso Composite) or 1/2" DuraStorm VSH (2)	8				
	2" SecurShield HD Composite	8	0!! (4)(0)	011 (4)(0)		
	1-1/2" Insulfoam HD Composite	16	6" (4)(6)	6" (4)(6)		
100 MPH	2" (25-psi) SecurShield Polyiso or 2" (25-psi) SecurShield Eco (1)	16	FS	FS	VersiTrim Drip Edge (3), VersiTrim 2000 or 3000.	
110 MPH	1-1/2" DuraFaceR (OSB/Polyiso Composite) or 1/2" DuraStorm VSH (2)	16	FS	FS	VersiTrim 2000 or	
	1/2" SecurShield HD Plus (2)				3000	
	5/8" DensDeck 5/8" DensDeck Sto,rmX Prime, 5/8" Securock, 5/8" DEXCell, 5/8" DEXCell FA, 5/8" DEXCell Cement Roof Board or 5/8" DEXCell FA VSH (2)	16			VersiTrim 2000 or	
120 MPH	1-1/2" DuraFaceR (OSB/Polyiso Composite) (1) or 1/2" DuraStorm VSH (2)	17	FS	FS	3000	
	1/2" SecurShield HD Plus (2)	24				
	2" SecurShield HD Composite	16				

FS = Full Spray, Equipment (Rig) Splatter or Ribbons @ 4" O.C.

⁽¹⁾ For Building heights between 51'-100', enhance 12'-wide perimeter with 50% more fasteners and plates.

⁽²⁾ Cover boards must be installed over a min. 1" thick approved Versico Insulation.

⁽³⁾ Versico HPV or HPVX Fasteners must be used to secure Versico Drip Edge or VersiTrim 200 Metal Fascia to perimeter wood nailers.

⁽⁴⁾ Gravel Surface BUR - Field @ 6" O.C. / Perimeter @ 4" O.C

⁽⁵⁾ Steel Decks - Field & Perimeter @ 6" O.C.

⁽⁶⁾ Cementitious Wood Fiber - Field @ 6" O.C. / Perimeter @ 4" O.C.

- (7) Smooth BUR Field @ 6" O.C. / Perimeter @ 4" O.C
- (8) Gravel Surface BUR 4" O.C.
- (9) Reduced Fastening (11 fasteners per 4 x 8 board) is acceptable on Reroof/No Tear off projects with a maximum roof height of 40'.
- (10) May be fastened with ring shank nails staggered 4" on center. Versico HPV or HPVX Fasteners may also be used fastened 12" on center.
- (11) Maximum 4' x 4' insulation boards when the adhesive is extruded at 12" o.c. or when boards exceed 4" thickness. 4' x 8' insulation boards may be used when the adhesive is applied at Full-Spray, Equipment (Rig) Splatter, 4", or 6" beads).

Table II - Additional Design Considerations (Up to 20 YR Warranty)

- 1 Building height shall not exceed 100 feet*.
- 2 Local Wind Zone per ASCE 7 shall not exceed 130 mph*.
- 3 Acceptable decking: 22-gauge or heavier steel, structural concrete, 1-1/2" wood plank, or 15/32" plywood.**
- 4 All "T-joints" must be overlaid with appropriate flashing material.
- 5 Membrane Attachment: 15 YR Warranty Adhesive Bead Spacing 12" o.c. field, 6" o.c. perimeter up to 55 MPH; 6" o.c. field, 6" perimeter 72 MPH; 4" o.c., Splatter, Full Spray field and perimeter 80 MPH.
- 6 Membrane Attachment: 20 YR Warranty Adhesive Bead Spacing 6" o.c. field and perimeter up to 55 MPH; 6" o.c. field, 4" o.c. perimeter 72 MPH; 4" o.c., Splatter, Full Spray field and perimeter 80 MPH.
- 7 See DR-05 for insulation fastening patterns.
- * For projects where building height exceeds 100' or wind speed exceeds 130 mph, please submit to Versico for review.
- ** 16 fasteners per 4' x 8' board are required for the following decks: OSB, gypsum, cementitious, wood fiber (Tectum), lightweight insulated concrete over steel roof deck thinner than 22-gauge and steel roof deck thinner than 22-gauge. Warranties are limited to a 20-year, 72-mph wind speed.

Table III Underlayment & Fastening Density for Assemblies with Warranties - 25 YR & 30 YR

Other Requirements are Listed in Additional Design Considerations following this Table.

All Versico Products listed for higher wind speed coverage can also be used for Warranties for a lower speed

coverage. (i.e. 72 MPH underlayment may be used for 55 MPH underlayment)

Peak	(i.e. 12 Wi 11 underlayment may be used for		tion Attachm	ent	
Gust Wind Speed Warranty	Minimum Membrane Underlayment	# of Fasteners per 4' x 8' board	Spacing for 4' x 8' size	e Ribbon r 4' x 4' and board (10)	Metal Edging
vvarianty	All to Oli (OF well) Debite a second	size (1)	Field	Perimeter	
	1" to 2" (25 psi) Polyisocyanurate				
55 or 72	1/2" Versico Recovery Board (1)(9)				Versico Drip Edge,
MPH	1/4" DensDeck Prime, 1/4" Securock, 1/4" DEXCell or 1/4" DEXCell FA	16	6" (3)(5)	6" (5)	VersiTrim 200 or 300 (8)
	1/2" SecurShield HD or 1/2" SecurShield HD Eco (2)(7)				333 (3)
	1-1/2" to 2" (25-psi) SecurShield Polyiso or SecurShield Eco	20			Versico Drip Edge
80 MPH	1/2" DensDeck Prime, 1/2" Securock, 1/2" DEXCell or 1/2" DEXCell FA (2)	16	6" (3)(5)(6)	6" (5)(6)	(4), VersiTrim 200 or 300(4)(5) or VersiTrim 2000 or 3000.
	1/2" SecurShield HD Plus (2)				
	1/2" SecurShield HD or 1/2" SecurShield HD Eco (2)(7)	20			
	1/2" SecurShield HD or 1/2" SecurShield HD Eco (2)(7)	24			VersiTrim 2000 or
90 MPH	1/2" SecurShield HD Plus (2) 1/2" DensDeck Prime, 1/2" Securock, 1/2" DEXCell or 1/2" DEXCell FA (2)	20 FS		FS	3000
	5/8" DensDeck Prime, 5/8" DensDeck StormX Prime, 5/8" Securock, 5/8" DEXCell, 5/8" DEXCell FA, 5/8" DEXCell Cement Roof Board or 5/8" DEXCell FA VSH (2)	16			VersiTrim 2000 or
100 MPH	1-1/2" DuraFaceR (OSB/Polyiso Composite) or 1/2" DuraStorm VSH (2)		FS	FS	3000
	2" SecurShield HD Composite (2)				
	1/2" SecurShield HD Plus (2)	24			

FS = Full Spray, Equipment (Rig) Splatter or Ribbons @ 4" O.C.

- (1) For Building heights between 51'-100', enhance 12'-wide perimeter with 50% more fasteners and plates.
- (2) Hail coverage offered with substrate.
- (3) Structural Concrete Field @ 12" O.C. / Perimeter @ 6" O.C.

- (4) 80-mph over structural concrete Field & Perimeter @ 6" O.C.
- (5) Cementitious Wood Fiber & Wood 4" O.C.
- (6) 80-mph over Gypsum Decks 4" O.C
- (7) 1/2" SecurShield HD and 1/2" SecurShield HD Eco limited to 90 mph.
- (8) May be fastened with ring shank nails staggered 4" on center. Versico HPV or HPVX Fasteners may also be used fastened 12" on center.
- (9) 1/2" Recovery Board limited to 55 mph.
- (10) Maximum 4' x 4' insulation boards when the adhesive is extruded at 12" o.c. or when boards exceed 4" thickness. 4' x 8' insulation boards may be used when the adhesive is applied at Full-Spray, Equipment (Rig) Splatter, 4", or 6" beads).

Additional Design Considerations (25 YR or 30 YR Warranty)

- 1 Minimum membrane thickness 135-mil VersiFleece TPO (25 & 30 YR) or 135-mil VersiFleece PVC FRS (25 YR) or 135-mil VersiFleece KEE HP FRS (30 YR)
- 2 Building height shall not exceed 100'*
- 3 1/4" per horizontal foot slope is preferred; however 1/8" slope with sufficient number of drains and crickets / saddles may be accepted.
- 4 Local Wind Zone per ASCE 7 shall not exceed 130 mph*
- 5 Acceptable decking: 22-gauge or heavier steel, structural concrete, 1-1/2" wood plank, or 15/32" plywood. Other decks should be submitted for Versico review.
- 6 All "T-joints" must be overlaid with appropriate flashing material.
- 7 Two layers of insulation with staggered joints, bottom layer must be a minimum 1-1/2" (20-psi) Polyisocyanurate.
- 8 New construction or complete tear-off of existing roofing material.
- 9 Membrane Attachment: 25/30 YR Warranty Adhesive Bead Spacing 4" o.c., Splatter or Full Spray field and perimeter UP to 100 MPH
- 10 See DR-05 for insulation fastening patterns.

Table IV Flexible DASH Bead Spacing for VersiFleece Membrane and Insulation Adhesion Coverage

	Warranty Length in Years						
Peak Gust Wind Speed Warranty	5 to 15 years		20 years		25 years		
	Field	Perimeter*	Field	Perimeter*	Field	Perimeter*	
55 MPH	12"	6"	6"	6"	FS	FS	
72 MPH	6"	6"	6"	FS	FS	FS	
80 to 120 MPH	FS	FS	FS	FS	FS	FS	

FS = Full Spray, Equipment (Rig) Splatter, Dual Tank Splatter or Ribbons @ 4" o.c. Note: Dual Tank Splatter is only approved for VersiFleece Membrane Attachment.

^{*} For projects where building height exceeds 100' or wind speed exceeds 100 mph, please submit to Versico for review.

^{*}Refer to Table V

Table V Minimum Perimeter Width For Insulation Attachment For All Warranties

Width of Perimeter	Building Height
4 feet	25 feet
8 feet	26 to 50 feet
12 feet	51 to 75 feet
18 feet	76 to 100 feet
24 feet	Greater than 100 feet

Note: This Table is for reference for Versico System Warranties and does not replace FM requirements for FM insured projects.

- C. A warranty covering leaks caused by hail, refer to Table I "VersiFleece Adhered Systems Warranty Options" for size of hail. Contact Versico for specific information.
- D. On projects utilizing VersiFleece 115 membrane, a 5, 10, 15, or 20-year warranty with limited coverage for accidental punctures (up to 16 man-hours per year) is available for an additional charge.
- E. On projects utilizing VersiFleece 135 membrane, a 5, 10, 15, 20, 25 or 30-year (30 YR TPO Only) warranty with limited coverage for accidental punctures (up to 32 man-hours per year) is available for an additional charge.
- F. Upon review by Versico, projects incorporating white VersiFleece (TPO Only) Membrane may be eligible for a 10- year Reflectivity Warranty Amendment. These projects must be submitted to Versico prior to installation and preferably prior to bid.
- G. The formation or presence of mold or fungi in a building is dependent upon a broad range of factors including, but not limited to, the presence of spores and nutrient sources, moisture, temperatures, climatic conditions, relative humidity, and heating/ventilating systems and their maintenance and operating capabilities. These factors are beyond the control of Versico and Versico shall not be responsible for any claims, repairs, restoration or damages relating to the presence of any irritants, contaminants, vapors, fumes, molds, fungi, bacteria, spores, mycotoxins, or the like in any building or in the air, land, or water serving the building.

H. Access for Warranty Service

It shall be the owner's responsibility to expose the membrane in the event that warranty service is required when access is impaired. Such impairment includes, but is not limited to:

- 1. Design features, such as window washing systems, which require the installation of traffic surface units in excess of 80 pounds per unit.
- 2. Any equipment, ornamentation, building service units and other top surfacing materials which are not defined as part of this specification.
- 3. Photovoltaic and Mounting Systems or other Rooftop equipment that does not provide Versico with reasonable access to the membrane system for purposes of warranty investigation and related repairs.
- 4. Severely ponding conditions.

CAUTION: Applications such as walking decks, terraces, patios or areas subjected to conditions not typically found on roofing systems are **not** covered by this specification and not eligible for system warranties as stated herein.

1.06 Job Conditions

A. On phased roofing, temporary closures should be provided to prevent moisture infiltration. When a temporary roof is specified, Versico 725TR in conjunction with CCW-702, CCW-702LV or CAV-GRIP 3V Low-VOC Adhesive/Primer may be used. Refer to Product Section Part II for additional product information and Specification Supplement G-07-20.

- B. When possible on multiple level roofs, begin the installation on the highest level to avoid or minimize construction traffic on completed roof sections.
- C. On projects at high altitudes (6,000' and above) rapid flash-off (drying) of Bonding Adhesive and Primers will occur due to low atmospheric pressure.
- D. Polyurethane foam application shall not proceed during periods of inclement weather. Follow Versico requirements for application temperatures and humidity levels.
- E. Wind barriers shall be used if conditions could affect the quality of the sprayed polyurethane foam and to prevent possible over spray.

F. Vapor Retarders

- 1. Versico does not require a vapor retarder for the protection of the membrane; however, it should be considered by the specifier for the protection of the roofing assembly (i.e. primarily insulation, underlayment and adhesives). The following criteria should be considered by the specifier:
 - a) Use of a vapor retarder to protect insulation and reduce moisture accumulation within an insulated roofing assembly, should be investigated by the specifier. Consult latest publications by ASHRAE (American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc.) and NRCA (National Roofing Contractors Association) for specific information.
 - b) In the generally temperate climate of the United States, during the winter months, water vapor flows upward from a heated, more humid interior toward a colder, drier exterior. Vapor retarders are more commonly required in northern climates than in southern regions, where downward vapor pressure may be expected and the roofing membrane itself becomes the vapor retarder.
 - c) On cold storage/freezer facilities, the perimeter and penetration details must be selected to provide an air seal and prevent outside air from infiltrating and condensing within the roofing assembly.
- When a vapor retarder is specified, Versico 725TR Air and Vapor Barrier may be used. Refer to Part II "Products" for necessary information and Spec Supplement G-07 "Application Procedures for 725TR Air and Vapor Barrier" for product Installation.
- G. Wood Nailers are required for the securement of metal edgings, scuppers, and insulated pipes. Wood Nailer shall be secured per specifier recommendation or in accordance with Factory Mutual's property Loss Prevention Data Sheet 1-49. Refer to Design Reference DR-08 "Wood Nailer Securement Criteria" in Versico Technical Manual shall be referenced.
- H. Do not apply Flexible DASH Adhesive when surface and/or ambient temperatures are below 25° F, unless, heated spray equipment is being utilized. Heated spray equipment may include, blankets, preheater and/or heated hoses.

1.07 Product Delivery, Storage and Handling

- A. Deliver materials to the job site in the original, unopened containers.
- B. When loading materials onto the roof, the Versico Authorized Roofing Contractor must comply with the requirements of the specifier/owner to prevent overloading and possible disturbance to the building structure.
- C. Job site storage temperatures in excess of 90°F (32°C) may affect shelf life of curable materials (i.e., Flexible DASH Adhesive- Parts A and B, HydroBond Adhesive, uncured flashing, cleaners, sealants, primers, quick applied products, and Pourable Sealer.)
- D. Prolonged exposure of quick applied products to temperatures below 40°F (5°C) will cause the pre-applied adhesive to lose tack and in extreme cases, not bond to the membrane. Refer to Product Data Sheets for individual products for temperature restrictions.
- E. Flexible DASH Adhesive must be a minimum of 70°F (21°C) at the time of use. Use drum band, blanket heaters and hot boxes when necessary.
- F. VersiFleece Membrane should be stored in its original plastic wrap or be covered to protect from moisture. Moisture absorbed by the fleece-backing must be removed by using a wet-vac system and allowed to dry completely, prior to membrane adhesion.

- G. PVC or KEE HP PVC Membrane that has been exposed to the elements for approximately 7 days must be prepared with PVC and KEE HP Membrane Cleaner prior to hot air welding. Refer to Section 3.06, Paragraph B.2., Exposed Membrane Seam Preparation, for requirements.
- H. Do not store adhesive, primer, cleaners, etc., containers with opened lids due to the loss of solvent, which will occur from flash-off.
- I. When the temperature is expected to fall below 40°F (5°C), heated storage boxes should be provided on the roof for temporary storage of liquid adhesives and sealants. Adhesive and sealant containers should be rotated to maintain their temperature above 40°F (5°C).

PART II - PRODUCTS

2.01 General

The components of this Versico Roofing System are to be products of Versico or accepted by Versico as compatible. The installation, performance or integrity of products by others, **when selected by the specifier and accepted as compatible by Versico**, is not the responsibility of Versico and is expressly disclaimed by the Versico Warranty.

2.02 Membranes

A. VersiFleece TPO Membrane

1. **VersiFleece TPO membrane** incorporates 45, 60 or 80-mil thick Thermoplastic Polyolefin (TPO) membrane laminated to a 55-mil non-woven fleece backing resulting in a total finished sheet thickness of 100, 115 or 135-mils. Membrane sheets are available in rolls 12' or 6' wide by 50' or 75' long. VersiFleece TPO Membrane is available in white, gray or tan in the 100 and 115 thicknesses and conforms to the following:

OPTION: 115-mil VersiFleece TPO is available in 5 special colors (Medium Bronze, Rock Brown, Terra Cotta, Slate Gray and Patina Green) in 12' x 100' long rolls as a limited stock item, depending on stock levels product may require a lead time. Contact Versico for availability.

OPTION: 115-mil (white) and 135-mil (white or gray) VersiFleece TPO reinforced membrane is available with an optional APEEL Protective Film. APEEL Protective Film can be left in place for up to 90 days without affecting the integrity of the film, guarding the TPO membrane's surface from scuffs and dirt accumulation during installation. Durable and easy to remove, APEEL Protective Film improves aesthetics and long-term reflectivity. Available 6' and 12' widths by 100' long rolls for 115-mil membrane and 6' and 12' widths by 75' long rolls for 135-mil membranes. VersiWeld 135-mil VersiFleece APEEL TPO requires a minimum order of 200 squares and 2-3 week lead time. Also available, APEEL 6" Cover Tape, allowing 100% coverage of the TPO surface. APEEL Cover Tape rolls are 1,640 feet long.

Property	Test Method	Property of Unaged Sheet	Property After Aging (1) 28 days @ 240° F
Thickness of reinforced sheet over fleece, in. (mm) tolerance is ± 10	ASTM D 751	0.045 (1.14) – VF 100 0.060 (1.52) – VF 115 0.080 (2.03) – VF 135	
Weight, lb/sq.ft.		0.27 VF 100 0.34 VF 115 0.44 VF 135	
Breaking Strength, min, lbf (kN)	ASTM D 751 Grab Method	300 (1.3) min. VF 100 400 (1.8) min. VF 115 425 (1.9) min. VF 135	375 (1.6) min. VF 100 400 (1.8) min. VF 115 425 (1.9) min. VF 135
Elongation at break of internal fabric,%	ASTM D 751	25 typical	25 typical
Tearing Strength, min, lbf (N) 8" by 8" specimen	ASTM D 751 B Tongue Tear	55 (245) min. 130 (578) typical	55 (245) min. 130 (578) typical
Brittleness Point, °F (°C)	ASTM D 2137	-40 (-40) min. -50 (-46) typical	
Linear Dimensional Change (shrinkage), %	ASTM D 1204	+/- 1.0 max. -0.2 typical	
Ozone Resistance, 100 pphm, 168 hours	ASTM D 1149	No Cracks	No Cracks
Resistance to Water Absorption After 7 days immersion @ 158°F (70°C) Change in mass, %	ASTM D 471 (fleece removed, edges sealed)	4.0 max. 2.0 typical	
Resistance to microbial surface growth, rating (1 is very poor, 10 is no growth)	ASTM D 3274 2 yr. S. Florida	9 – 10 typical	
Field seam strength, lbf/in. (kN/m) Seam tested in peel	ASTM D1876	40 (7.0) typical VF 100 60 (10.5) typical VF 115 70 (12.3) typical VF 135	
Water vapor permeance, Perms	ASTM E 96	0.10 max. 0.05 typical	
		350(1.6) min. VF 100 450 (2.0) typical VF 100	350(1.6) min. VF 100 450 (2.0) typical VF 100
Puncture resistance, lbf (N)	FTM 101C Method 2031	400 (1.8) min. VF 115 500 (2.2) typical VF 115	400 (1.8) min. VF 115 525 (2.3) typical VF 115
		425 (1.9) min. VF 135 525 (2.3) typical VF 135	425 (1.9) min. VF 135 600 (2.6) typical VF 135
Puncture resistance, Joules	ASTM D5635	20 VF 100 25 VF 115 32.5 VF 135	
Resistance to xenon-arc Weathering (2) Xenon-Arc, 17,640 kJ/m² VF 100, 20,160 kJ/m² VF 115, 27,720 kJ/m² VF 135 total radiant exposure visual condition at 10X	ASTM G 155 0.70 W/m ⁻ 80°C B.P.T.	No Cracks No loss of breaking or tearing strength	

 ⁽¹⁾ Aging conditions are 28 days at 240° F (116° C) equivalent to 400 days at 176° F (80° C) for breaking strength, elongation, tearing strength, linear dimensional change, ozone and puncture resistance.
 (2) Approximately equivalent to 14,000 hours exposure at 0.35 W/m² irradiance. B.P.T. is black panel temperature.

B. VersiFleece PVC Membranes

1. **VersiFleece PVC FRS membrane** incorporates 60 or 80-mil thick, fiberglass reinforced scrim, Polyvinyl Chloride (PVC) membrane laminated to a 55-mil thick non-woven polyester fleece-backing resulting in a total finished sheet thickness of 115 or 135-mils. Membrane sheets are available in rolls 10' wide by 100' long for 115-mil membrane and 10' wide by 75' log for 135-mil membranes. VersiFleece PVC FRS Membrane is available in white, gray, light gray and tan and 135 thicknesses and conforms to the following:

Property	Test Method	Requirement	VersiFleece FRS PVC 115-mil	VersiFleece FRS PVC 135-mil
Thickness of reinforced sheet over fleece, in. (mm)	ASTM D 4434	0.016 min. (0.40)	0.025 typ. (0.635)	0.030 typ. (0.762)
Breaking Strength (MD x CD), lbf (N)	ASTM D 751	200 min. (0.022)	450 x 400 (0.05 x 0.045)	500 x 450 (0.056 x 0.045)
Elongation break of reinforcement (MD X CD), %	ASTM D 751	15 min.	70 x 100	70 x 100
Seam Strength, min. (% of breaking strength)	ASTM D 751	>75	PASS	PASS
Tearing Strength (CD), lbf (N)	ASTM D 751	45 (200)	60	60
Low Temperature Bend	ASTM D 2136	No Cracks - 5x	PASS (-40° C)	PASS (-40° C)
Linear Dimensional Change, % (MD x CD)	ASTM D 1204	± 0.5 max.	0.36 x 0.00 typ.	0.36 x 0.00 typ.
Ozone Resistance	ASTM D 1149	No Cracks – 7x	PASS	PASS
Water Absorption Resistance, mass %	ASTM D 570	± 3.0 max.	2.0 typ.	2.0 typ.
Field Seam Strength, lbf/in. (kN/m)	ASTM D1876	No Requirement	25 (4.4) min. 60 (10.5) typ.	25 (4.4) min. 60 (10.5) typ.
Water Vapor Permeance, Perms	ASTM E 96	No Requirement	0.10 max. 0.05 typ.	0.10 max. 0.05 typ.
Puncture Resistance, Dynamic, J (ft-lbf)	ASTM D 5635	20 (14.7)	PASS	PASS
Puncture Resistance, Static, lbf (N)	ASTM D 5602	33 (145)	PASS	PASS
Xenon-Arc Resistance 12,600 kJ/m² total radiant exposure 10,000 hrs	ASTM G 155	No Cracks or Crazing – 10x	PASS	PASS
Properties After Heat Aging, Breaking Strength, % retained	ASTM D 3045	90 min.	90 min.	90 min.
Properties After Heat Aging, Elongation Reinf., % retained	ASTM D 3045	90 min.	90 min.	90 in.

2. **VersiFleece PVC membrane** incorporates 60- or 80-mil thick, polyester reinforced scrim, Polyvinyl Chloride (PVC) membrane laminated to a 55-mil non-woven fleece backing resulting in a total finished sheet thickness of 115, or 135- mils. Membrane sheets are available in rolls 10' wide by 100' long for 115-mil membranes and 10' wide by 75' long for 135-mil membranes. VersiFleece PVC Membrane is available in white, gray, light gray, slate gray and tan and conforms to the following:

Property	Test Method	Requirement	VersiFleece PVC 115-mil	VersiFleece PVC 135-mil
Thickness of reinforced sheet over fleece, in. (mm)	ASTM D 4434	No requirement	0.060 typ. (0.152)	0.080 typ. (0.203)
Membrane Thickness over scrim, in. (mm)	ASTM D 4434	0.016 min. (0.40)	0.027 typ. (0.686)	0.037 typ. (0.940)
Breaking Strength (MD x CD), lbf (N)	ASTM D 751	200 min. (890)	420 x 380 (73 x 66)	450 x 410 (79 x 72)
Elongation break of reinforcement (MD X CD), %	ASTM D 751	15 min.	30 x 30	30 x 30
Tearing Strength (MD x CD), lbf (N)	ASTM D 751	45 (200)	197 x 165 (876 x 734)	173 x 191 (769 x 849)
Low Temperature Bend	ASTM D 2135	No Cracks - 5x	PASS (-40° C)	PASS (-40° C)
Linear Dimensional Change, %	ASTM D 1204	± 0.5 max.	0.4 typ.	0.4 typ.
Water Absorption Resistance, mass %	ASTM D 570	± 3.0 max.	2.0	2.0
Puncture Resistance, Dynamic, J (ft-lbf)	ASTM D 5635	20 (14.7)	40 (29.5)	42.5 (31.3)
Puncture Resistance, Static, lbf (N)	ASTM D 5602	33 (145)	63.99 (284.6)	63.99 (284.6)
Federal Puncture (Max. Load in lbf)	FTM-101C	No Requirement	380	460
Xenon-Arc Resistance 12,600 kJ/m² total radiant exposure 10,000 hrs	ASTM G 155	No Cracks or Crazing – 10x	PASS	PASS
Properties After Heat Aging, Breaking Strength, % retained	ASTM D 3045	90 min.	90 min.	90 min.
Properties After Heat Aging, Elongation Reinf., % retained	ASTM D 3045	90 min.	90 min.	90 min.

3. **VersiFleece KEE HP membrane** incorporates 50-, 60- or 80-mil thick Polyester Reinforced Elvaloy KEE HP PVC membrane laminated to a 55-mil non-woven fleece backing resulting in a total finished sheet thickness of 105-, 115, or 135- mils. Membrane sheets are available in rolls 10' wide by 100' long for 105- and 115-mil and 10' wide by 75' long for 135-mil. VersiFleece KEE HP Membrane is available in white, gray, light gray and tan and conforms to the following:

Property	Test Method	VersiFleece KEE HP PVC 105-mil	VersiFleece KEE HP PVC 115-mil	VersiFleece KEE HP PVC 135-mil
Thickness of reinforced sheet over fleece, in. (mm)	ASTM D 4434	0.050 min. (1.27)	0.060 typ. (1.52)	0.080 typ. (2.03)
Thickness over scrim, in. (mm)	ASTM D 4434	0.024 min. (0.61)	0.029 typ. (0.74)	0.036 typ. (0.91)
Breaking Strength (MD x CD), lbf (kN/m)	ASTM D 751	410 x 360 (72 x 63)	450 x 410 (79 x 72)	500 x 490 (87 x 86)
Elongation break of reinforcement (MD x CD), %	ASTM D 751	35 x 30	35 x 30	35 x 30
Tearing Strength (MD x CD), lbf (N)	ASTM D 751	120 x 150 (534 x 222)	120 x 150 (534 x 222)	120 x 150 (534 x 222)
Low Temperature Bend	ASTM D 2135	PASS (-40° C)	PASS (-40° C)	PASS (-40° C)
Linear Dimensional Change, %	ASTM D 1204	0.4 typ.	0.4 typ.	0.4 typ.
Water Absorption Resistance, mass %	ASTM D 570	1.25	0.87	0.89
Puncture Resistance, Dynamic, J (ft-lbf)	ASTM D 5635	PASS	PASS	PASS
Puncture Resistance, Static, lbf (N)	ASTM D 5602	63.99 (284.6)	63.99 (284.6)	63.99 (284.6)
Federal Puncture (Max Load in lbf)	FTM-101C	332	384	482
Xenon-Arc Resistance 12,600 kJ/m² total radiant exposure 10,000 hrs	ASTM G 155	PASS	PASS	PASS
Properties After Heat Aging, Breaking Strength, % retained	ASTM D 3045	90 min.	90 min.	90 min.
Properties After Heat Aging, Elongation Reinf., % retained	ASTM D 3045	90 min.	90 min.	90 min.

2.03 Insulation / Underlayments

A. General

- 1. Roof insulation thickness must be determined by the thermal value required for each project and may be subject to code approval limitations. On projects where a vapor retarder is used, the specifier must calculate insulation thickness to ensure the temperature at the vapor retarder will not fall below the calculated dew point.
- 2. Multiple layers of insulation are recommended with all joints staggered between layers.
- 3. For minimum recommended R-Values, previously published by American Society of Heating and Air-Conditioning Engineers (ASHRAE), consult local building code official for applicable requirements.
- 4. For Insulation fastening pattern and densities refer to Versico Applicable Details and Design Reference DR-05 "Insulation Fastening Patterns".
- Versico Insulation/underlayment must be specified for all Total System Warranty projects or when the insulation is to be covered by the Versico Warranty. Any of the Versico Insulation/Underlayment may be specified subject to design restrictions included with each table.

B. Versico Polyisocyanurate

Table B1	Polyisoc	yanurate (See below for	r product description	ons)	
	Minimum		Roofing System Acceptability		
Insulations	Thickness	ASTM	Fully Adhered	Mechanically Attached	
Versico VersiCore Polyiso, Versico VersiCore Eco	*1.5"	C1289-06, Type II, Class 1, Grade 2 or 3	√	√	
Versico VersiCore Polyiso NH	*1.5"	C1289-06, Type II, Class 1, Grade 2 or 3	\checkmark	\checkmark	
Versico VersiCore HD, Versico VersiCore HD Eco	0.5"	C1289, Type II, Class 1, Grade 3	N/A	√	
Versico SecurShield Polyisocyanurate, Versico SecurShield Eco	*1.5"	C1289-06, Type II Class 2, Grade 2 or 3	√	√	
Versico SecurShield Polyisocyanurate NH	*1.5"	C1289-06, Type II Class 2, Grade 2 or 3	\checkmark	\checkmark	
Versico SecurShield HD Composite (SS HD)	2"	C1289-06, Type IV, Grade 2 or 3	√	√	
Versico DuraFaceR Polyiso Composite (OSB)	1.5"	C1289-06, Type V, Grade 2 or 3	√	√	
		Design Restrictions			

- Extended Warranty, those with longer duration, higher wind speed, or puncture coverage, may require the use of a cover board over Polyiso Insulation, refer to Warranty Tables in Paragraph 1.04 for applicable requirements.
- Maximum Flute Spanability shall be limited to 2-5/8" when 1" Minimum Polyiso Insulation is to be used.
- Minimum thickness of insulation board may be restricted by wind speed coverage and warranty duration, refer to Tables II and III in Paragraph 1.05.
- *1.5" minimum for fully adhered systems. Subject to Warranty Limitation. 1" minimum may be accepted for fully adhered system, Versico must be contacted for fastening density.

Notes: N/A = Not Acceptable $\sqrt{}$ = Acceptable

- 2. **Versico VersiCore Polyiso** A foam core insulation board covered on both sides with a medium weight fiber-reinforced felt facer meeting ASTM C 1289-06, Type II, Class 1, Grade 2 (20 psi) or Grade 3 (25 psi). The product is available in 4' x 8' standard size with a thickness from 1 to 4 inches. 4' x 4' tapered panels are also available.
- 3. **Versico VersiCore Eco** A rigid roof insulation panel with 5% ISCC-certified bio-attributed content composed of a closed-cell polyisocyanurate foam core bonded to glass-reinforced felt (GRF) facers, meeting ASTM C 1289, Type II, Class 1, Grade 2 (20 psi) or Grade 3 (25 psi). The product is available in 4' x 8' standard size with a thickness from 1 to 4 inches. 4' x 4' tapered panels are also available. UL and FM approved for direct application over steel decks, polyiso provides the highest R-value per inch of any commercially available insulation product.
- 4. **Versico VersiCore Polyiso NH** A foam core insulation board covered on both sides with a glass-reinforced felt meeting ASTM C 1289, Type II, Class 1, Grade 2 (20 psi) or Grade 3 (25 psi). The product is available in 4' x 4' and 4' x 8' standard size with a thickness from ½" to 4 inches. VersiCore Polyiso NH contains zero halogenated flame retardants.
- 5. **Versico VersiCore HD Polyiso** A high-density, foam core insulation board covered on both sides with a glass-reinforced felt meeting ASTM C 1289, Type II, Class 1, Grade 3 (25 psi). The product is available on 4' x 4' and 8' x 8' standard size with a thickness of one-half inch.
- 6. **Versico VersiCore HD Eco** A rigid-roof insulation cover board with 5% ISCC-certified bio-attributed content composed of a high-density closed-cell polyisocyanurate foam core bonded on each side to glass-reinforced felt (GRF), meeting ASTM C1289, Type II, Class 1, Grade 3. UL and FM approved for direct application over steel decks. Available in 1/2" thick, 4' x 4' and 4' x 8' panels with an R-value of 2.5. Suitable for both re-roofing and new construction applications, InsulBase HD is specifically designed for use as a cover board in mechanically-attached single-ply systems only. InsulBase HD delivers an R-value of 2.5.
- 7. **SecurShield Polyisocyanurate** A foam core insulation board covered on both sides with a coasted glass fiber mat facer meeting ASTM C 1289-06, Type II, Class 2, Grade 2 (20 psi) or Grade 3 (25 psi). The product is available in 4' x 8' standard size with a thickness from 1 to 4 inches. 4' x 4' tapered panels are also available. These flat board products feature a dark-colored coated-glass facer (CGF) on one side of the insulation board and a light-colored CGF on the other, labeled Ready Flash. Ready Flash Technology allows applicators to manage adhesive flash-off times by choosing between two different-colored facers on every board.

- 8. **SecurShield Eco** A rigid roof insulation panel with 5% ISCC-certified bio-attributed content composed of a closed-cell polyisocyanurate foam core bonded to high performance coated glass facers (CGF). ASTM C 1289, Type II, Class 2, Grade 2 (20 psi) or Grade 3 (25 psi), available in 4' x 8' standard size with a thickness from 1 to 4 inches. 4' x 4' tapered panels are also available. Ideal for use in adhered membrane systems. Achieves a UL Class A fire rating direct to combustible deck.
- 9. **SecureShield NH Polyisocyanurate** A foam core insulation board covered on both sides with a coated glass fiber mat facer meeting ASTM C 1289, Type II, Class 2, Grade 2 (20 psi) or Grade 3 (25 psi). The product is available in 4' x 4' and 4' x 8' standard size with a thickness from ½ inch to 4 inches. SecurShield NH contains zero halogenated flame retardants.
- 10. **SecurShield HD Composite** Composite insulation panel comprised of 1/2-inch high-density (109 psi max) Polyiso cover board laminated during the manufacturing process to SecurShield rigid Polyiso roof insulation meeting ASTM C1289 Type IV, Grade 2 (20 psi) or Grade 3 (25 psi). Available in 4' x 8' boards with thickness from 2" to 4.5". 4' x 4' panels are also available.
- 11. **DuraFaceR Polyiso Composite (OSB)** Polyiso insulation bonded on the bottom side with a medium weight fiber-reinforced felt face and laminated with a top surface of 7/16" or 5/8" thick Oriented Strand Board (OSB) meeting ASTM C1289, Type V, Grade 2 (20 psi) or Grade 3 (25 psi). Available in 4' x 8' boards with thickness from 1-1/2" to 4".

C. EPS: Expanded Polystyrene

Table C1 EPS : Expanded Polystyrene (See below for product descriptions)						
Minimum		Roofing Syste	em Acceptability			
Thickness	ASTM	Fully Adhered	Mechanically Attached			
1"	C578 Type I	N/A	N/A			
.75"	C578 Type VIII	N/A	N/A			
.75"	C578 Type II	N/A	N/A			
1.5"	C578 Type (I, VIII, II, or IX)	√	\checkmark			
1.5"	C578 Type (I, VIII, II. or IX)	$\sqrt{}$	N/A			
1"	C578 Type VIII	N/A	VersiWeld			
	Minimum Thickness 1" .75" .75" 1.5"	Minimum Thickness ASTM 1" C578 Type I .75" C578 Type VIII .75" C578 Type II 1.5" C578 Type (I, VIII, II, or IX) 1.5" C578 Type (I, VIII, II. or IX)	Minimum Thickness ASTM Roofing System Fully Adhered 1" C578 Type I N/A .75" C578 Type VIII N/A .75" C578 Type II N/A 1.5" C578 Type (I, VIII, II, or IX) √ 1.5" C578 Type (I, VIII, II. or IX) √			

Design Restrictions

- Local Codes must be consulted regarding the acceptance of expanded insulation directly over steel decks. When specified, minimum thickness shall be designated by the manufacturer.
- Expanded polystyrene roof insulations cannot be installed directly over coal-tar pitch roof surfaces or existing PVC membranes. A separation layer of minimum 1/2" SecurShield HD, Versico Recovery Board or Polyiso Insulation shall be used.
- Other Insulations in other densities are available- Contact Versico

Notes: N/A = Not Acceptable √ = Acceptable * R-Tech Fanfold Recover Board is listed in Paragraph E4 below

- a) Insulfoam I A closed-cell lightweight expanded polystyrene (EPS) that meets ASTM C578, Type I. Nominal density of 1.0 lbs/cubic ft (pcf) available in 4' x 4' or 4' x 8' sizes with thickness from 1/4" to 40". Custom lengths, widths and tapered boards are available. May be specified beneath Versico Recovery Board, Dens-Deck Prime, DensDeck StormX Prime, Securock, or DEXCell.
- b) Insulfoam VIII A closed-cell lightweight expanded polystyrene (EPS) that meets ASTM C578, Type VIII. Nominal density of 1.25 lbs/cubic ft (pcf) available in 4' x 4' or 4' x 8' sizes with thickness from 1/4" to 40". Custom lengths, widths and tapered boards are available. May be specified beneath Versico Recovery Board, Dens-Deck Prime, DensDeck StormX Prime, Securock or DEXCell.
- c) Insulfoam II A closed-cell lightweight expanded polystyrene (EPS) that meets ASTM C578, Type II. Nominal density of 1.5 lbs/cubic ft (pcf) available in 4' x 4' or 4' x 8' sizes with thickness from 1/4" to 40". Custom lengths, widths and tapered boards are available. May be specified beneath Versico Recovery Board, Dens-Deck Prime, DensDeck StormX Prime. Securock or DEXCell.
- d) **InsulLam HD Composite** A composite insulation consisting of a closed-cell, lightweight and resilient expanded polystyrene (EPS) bonded to high-density Polyisocyanurate cover board. Available in 4' x 8' boards with overall thickness from 1-1/2" to 7".
- e) InsulLam Insulfoam expanded polystyrene (EPS) insulation laminated with a top surface of 7/16" or 5/8" thick Oriented Standard Board (OSB) or 5/8" plywood. Available in 4' x 8' boards with thickness from 1-1/2" to 7".
- f) **Insulfoam SP** A closed-cell, lightweight and resilient expanded polystyrene (EPS) with a durable and stable, factory-laminated fiber glass facer. Available in 4' x 8' boards with overall thickness from 1" to 7".
- D. XPS: Extruded Polystyrene Available through Versico is dimensionally stable with high thermal and low water absorption performance capability. XPS is available in varying compressive strengths thicknesses and sizes and can be specified as a base layer beneath an acceptable cover board. Refer to specific product data sheets for physical properties and additional technical information.

E. Versico Vacuum Insulated Panel (VIP)

luculations / Hudadayasant	Minimum	ASTM	Roofing System Acceptability		
Insulations / Underlayment	Thickness	ASTW	Adhered	Mechanically Fastened	
Versico Optim-R VIP	*1.6"	C1484	\checkmark	N/A	
Design Restrictions					
*2.6" minimum for total installed system including an additional 2 layers of 1/2" SecurShield HD panels; 1 layer on top and 1 layer on bottom of Optim-R. For adhered systems only. Note: Optim-R VIP cannot be cut or punctured.					
Notes: N/A = Not Acceptable	= Acceptable				

 Optim-R Vacuum Insulated Panel (VIP) – a high R-Value vacuum insulated panel (VIP) used to provide a low-profile solution when height restrictions exist, such as windows, doors, equipment curbs, etc. Provides an R-38 insulating value in a 2.6" system thickness with up to 35% infill (non-VIP material). Available in 23.6" x 23.6" and 23.6" x 47.2" board sizes.

F. Cover Boards

Table F1 Cover Boards (See below for product descriptions)					
	Minimum		Roofing System Acceptability		
Insulations / Underlayment	Insulations / Underlayment Thickness ASTM		Fully Adhered	Mechanically Attached	
SecurShield HD, SecurShield HD Eco	.5"	C1289, Type II, Class 4 (109 psi max)	V	√	
SecurShield HD Plus	.5"	C1289, Type II, Class 4 (109 psi max)	\checkmark	√	
VersiCore HD, VersiCore HD Eco	.5"	C1289, Type II, Class 1, Grade 3	N/A	√	
DuraStorm VSH	.5"	Refer to Technical Data Bulletin	\checkmark	√	
Securock Cover Board	.25"	Refer to Technical Data Bulletin	\checkmark	√	
DensDeck StormX Prime	.625"	C1177	\checkmark	√ (1)	
DensDeck Prime	.25"	C1177	\checkmark	√ (1)	
DensDeck	.25"	C1177	$\sqrt{}$	√ (1)	
R-Tech Fanfold Recovery Board	.5"	C578 Type (I, VIII, II. or IX)	N/A	$\sqrt{}$	
DEXCell	.5"	C1177	\checkmark	$\sqrt{}$	
DEXCell FA	.5"	C1177	\checkmark	$\sqrt{}$	
DEXCell Cement Roof Board	.4375"	C1325	V	V	
DEXCell FA VSH	.625"	C1177	V	√ (1)	
Design Restrictions					

- Versico Recovery Board and R-Tech Fanfold not recommended for direct use over Type B and F steel decks.
- Securock Cover Board, Versico Recovery Board, DensDeck Prime, DensDeck StormX Prime, DensDeck or DEXCell may not be used directly over New or Existing Lightweight Insulating Concrete Decks existing or Structural Concrete.
- Due to some warranty restrictions, DensDeck, DensDeck StormX Prime, DensDeck Prime and DEXCell not recommended for use directly over existing roofing membrane without prior written approval from Versico. Contact Versico for specific requirements.
- R-Tech Fanfold primarily for use in existing roof re-covers applications or directly over structural or lightweight insulating concrete.

 (1) Permitted with roofs with slopes greater than 2" per foot for compliance with external fire codes, refer to UL listings or contact Versico.

Notes: N/A = Not Acceptable $\sqrt{\ }$ = Acceptable

SecurShield HD – A rigid insulation panel composed of a high-density (109 psi max), closed-cell
polyisocyanurate foam core laminated to coated-glass fiber-mat facer meeting ASTM C1289, Type II, Class 4,
Grade 1, for use as a cover board or recover board. Available 1/2" thick 4' x 8' panel weight 11 lbs with an Rvalue of 2.5.

Features Ready Flash, a dark-colored coated-glass facer (CGF) on one side of the insulation board and a light-colored CGF on the other. Ready Flash Technology allows applicators to manage adhesive flash-off times by choosing between two different-colored facers on every board.

- 2. SecurShield HD Eco A rigid roof insulation panel with 5% ISCC-certified bio-attributed content composed of ½" high-density, closed-cell polyisocyanurate foam core bonded to a premium performance coated glass facer (CGF) specifically designed for use as a cover board, meeting ASTM C1289, Type II, Class 4, Grade 1. Provides 5 times the R-value at one-fifth the weight of traditional gypsum cover boards. Achieves a UL Class A fire rating direct to combustible deck. Available in 1/2" thick, 4' x 4' (5.5 lbs) and 4' x 8' (11 lbs) panels with an R-value of 2.5.
- 3. **SecurShield HD Plus** A rigid insulation panel composed of a high-density (109 psi max), closed-cell polyisocyanurate foam core laminated to premium-performance coated-glass fiber-mat facer, meeting ASTM C1289, Type II, Class 4, Grade 1, for use as a cover board or recover board. Available 1/2" thick 4' x 8' panel weight 11 lbs with an R-value of 2.5. Meets an FM 1-90 using only 8 fasteners per 4' x 8' board.
- 4. **VersiCore HD** a closed-cell polyisocyanurate foam core insulation board covered on both sides with glass-reinforced felt (GRF) facer meeting ASTM C 1289, Type II, Class 1, Grade 3. The product is available in 4' x 4' and 4' x 8' standard sizes with a thickness of one-half inch.
- 5. **VersiCore HD Eco** A rigid-roof insulation cover board with 5% ISCC-certified bio-attributed content composed of a high-density closed-cell polyisocyanurate foam core bonded on each side to glass-reinforced felt (GRF), meeting ASTM C1289, Type II, Class 1, Grade 3. UL and FM approved for direct application over steel decks. Available in 1/2" thick, 4' x 4' and 4' x 8' panels with an R-value of 2.5.. Suitable for both re-roofing and new construction applications, InsulBase HD is specifically designed for use as a cover board in mechanically-attached single-ply systems only. InsulBase HD delivers an R-value of 2.5.
- 6. **Securock Cover Board** A uniform composition of fiber-reinforced gypsum, without a facer, for use as a cover board or a thermal barrier. Available in 1/4" to 5/8" thick and 4' x 4' or 4' x 8' size boards. Long uninterrupted runs (>200') may require slight gapping due to thermal expansion.
- 7. **DuraStorm VSH Cover Board** an engineered composite building material made from a proprietary blend of plastic and cellulose fiber sourced from post-industrial and post-consumer waste streams. DuraStorm VSH is a durable, extremely moisture and mold resistant building material with a core that does not disintegrate or delaminate in the presence of water. Available in 1/2" thick and 4' x 8' size board.
- 8. **DensDeck StormX Prime** a reinforced gypsum cover board with an enhanced, moisture-resistant core and coated glass mat facers on the top and bottom side. The top surface is pre-primed and provides excellent bond strength for adhered membrane for use as a cover board. DensDeck StormX Prime is extremely durable and is approved for use in assemblies meeting FM's Very Severe Hail (VSH) Classification. Available in 5/8" thickness and 4' x 4' or 4' x 8' size boards.
- 9. **DensDeck Prime** –gypsum core that incorporates glass-mat facings on the top and bottom side. The top surface is pre-primed and provides excellent bond strength for fully adhered membrane for use as a cover board. Available in 1/4" to 5/8" and 4' x 4' or 4' x 8' size boards.
- 10. **DensDeck Cover Board** –gypsum core that incorporates glass-mat facings on the top and bottom side for use as a cover board. Available in 1/4" to 5/8" and 4' x 4' or 4' x 8' size boards.
- 11. **DEXCeII** A mold & mildew resistant, gypsum substrate board with coated fiberglass facers, used for thermal protection and acoustical enhancement of roof systems. May be used as a substrate for a vapor retarder and /or the continuous substrate for the application of commercial roofing applications. Available in 1/4", 1/2" and 5/8" thicknesses in 4' x 8' boards.
- 12. **DEXCell FA** A mold & mildew resistant, gypsum substrate board with heavy duty, coated fiberglass facers, used for thermal protection and acoustical enhancement of roof systems. May be used as a substrate for a vapor retarder and /or the continuous substrate for the application of commercial roofing applications. The precoated, fiberglass facers are designed to increase adhesive coverage and enhance performance of the bond strength of the system. Available in 1/4", 1/2" and 5/8" thicknesses in 4' x 4' and 4' x 8' boards.
- 13. **DEXCell Cement Roof Board** A mold & mildew resistant, Portland Cement, lightweight aggregate roof board with heavy-duty fiberglass mesh facers used as a substrate board, thermal barrier and cover board for commercial roofing applications. Available in 7/16" and 5/8" thicknesses in 4' x 4' and 4' x 8' boards.
- 14. DEXCell FA VSH A reinforced gypsum panel with enhanced moisture resistant gypsum core and heavy duty

coated glass facers used as a substrate board, thermal barrier and cover board for commercial roofing applications, approved for use in single-ply and multi-ply assemblies meeting FM Very Severe Hail rating. Available in 5/8" thickness in 4' x 4' and 4' x 8' boards.

G. For projects specified in conjunction with new sprayed-in-place polyurethane foam insulation, VersiFleece membrane can be adhered directly to the new urethane foam surface with Versico Flexible DASH Adhesive. Refer to Versico's SPF Fully Adhered Roofing System Specification for specific requirements.

2.04 Related Materials

A. Flashings

1. TPO (VersiWeld) Related Products

- a. VersiWeld Flashing: VersiWeld 60-mil non-reinforced flashing is available in rolls 12" and 24" wide by 50' long. Flashing is used for inside/outside corners, field fabricated pipe flashings, sealant pockets and scuppers, when the use of pre-molded accessories is not feasible. In addition, 45-mil by 6" wide by 100' long, 60-mil by 9" wide by 50' long and 0.080 by 9" wide by 50' long VersiWeld reinforced membrane is available for overlaying fasteners and fastening plates.
- b. VersiWeld Pressure-Sensitive Cover Strip: A nominal 40-mil thick non-reinforced TPO membrane laminated to nominal 35-mil thick cured synthetic rubber quick-applied adhesive used in conjunction with TPO Primer or Low-VOC TPO Primer to strip in flat metal flanges (i.e., drip edges or rows of fasteners and plates). Available in rolls 6" wide by 100' long in colors of white, gray or tan. Not for use on 25-year or 30-year Warranty projects.
- c. **VersiWeld TPO Reinforced Overlayment Strip:** A heat-weldable, reinforced thermoplastic polyolefin membrane. It is available in 45-mil 6" x 100' and 60-mil 6" x 100' and 9" x 50' rolls in colors of white, gray or tan. It can be used to cover end laps on VersiFleece and QA TPO systems and to strip in flat metal flanges on details such as TPO coated drip edges, gravel stops, and scuppers.
- d. **VersiWeld TPO APEEL Cover Tape:** A 6"-wide, 1,640' long roll of APEEL Protective Film used to protect areas of VersiWeld TPO membrane where APEEL Protective Film has been removed (around details) or was not factory applied (seams). APEEL Cover Tape allows contractors to keep 100 percent of the TPO surface clean during installation and is applied using the APEEL Cover Tape Applicator.
- e. **VersiWeld TPO T-Joint Covers:** A 60-mil thick injection molded TPO flashing formed into a 4.5" diameter circle used to seal step-offs at splice intersections. Installation is mandatory on all 60-, 72-, and 80-mil TPO systems and on 45-mil systems where step-offs have not been properly sealed. Packaged in boxes of 100. Available in white, tan or gray.
- f. Yellow Pressure-Sensitive (PS) Warning Strip: A nominal 30-mil-thick non-reinforced TPO flashing laminated to a nominal 30-mil-thick, fully cured synthetic rubber Pressure-Sensitive adhesive and is available in 6" wide by 100' long rolls. Yellow Pressure-Sensitive Warning Strip can be applied to EPDM, TPO or Hypalon roofing systems to provide a visual warning of an impending hazard (i.e. roof edge, deep drain sump, skylight).
- g. **VersiWeld TPO Rib Profile:** Used to obtain the appearance of standing seam metal roofing with the performance of a TPO single-ply membrane. The Rib Profile measures 1-1/4" tall and 2-1/8" wide, including the welding flanges, while the vertical profile is a substantial 3/8" thick. The profile has a continuous 1/8" diameter alignment hole, for use with fiberglass connecting pins, as well as a 1/8" fiberglass reinforcing cord for added strength. The Rib Profile is available in white, gray and tan, 10' lengths and packaged 20 per carton.

h. Pre-molded Accessories:

- Inside Corners: A pre-molded corner flashing for inside corners. Available in white, gray or tan; 60-mil thick.
- Outside Corners: A pre-molded corner flashing for outside corners. Available in white, gray or tan; 60-mil thick.
- 3) TPO Curb Wrap Corners: Fabricated flashings are made of 45-mil thick reinforced VersiWeld membrane designed to reduce installation time to flash a curb when compared to conventional methods. Each corner is fabricated with a 6" wide base flange and a 12" overall height. Six sizes are available to fit curbs up to 6'

- by 6' in size. One curb requires 4 corners for a complete installation. TPO Curb Corners are packaged in boxes of twelve. Custom sizes are available as a special order product requiring lead time.
- 4) TPO Universal Corners: a pre-molded flashing for use in a variety of corner details, including inside and outside corners. Available in white and are 60-mil thick.
- 5) **Pipe Flashings:** A pre-molded white, gray or tan pipe flashing used for pipe penetrations. Available for 1" 6" diameter pipes with clamping rings included.
- 6) **Split Pipe Seals:** A prefabricated flashing consisting of 45-mil thick reinforced VersiWeld Membrane for pipes 1" 6" in diameter. A split (cut) and overlapped tab are incorporated to allow the pipe seal to be opened and wrapped around the pipe when it is not possible to pull a standard pipe flashing over a round penetration. Custom sizes are available as a special order product requiring lead time.
- 7) **TPO Square Tubing Wraps**: Fabricated flashings made of 45-mil thick reinforced VersiWeld membrane for square tubing. A split (cut) and overlap tab are incorporated into these parts to allow the seals to be opened and wrapped around a square penetration. Available for 3", 4", 5" and 6" diameter square tubing.
- 8) **Molded TPO Sealant Pockets:** A pre-fabricated, interlocking, 2-piece, injection molded, flexible pocket with a rigid polypropylene vertical wall and pre-formed deck flanges. Pockets can be adjusted from 11.5" to 7.5" in length by 6" in width by following the cutting lines molded into the pocket. Used in conjunction with Thermoplastic One-Part Pourable Sealer for waterproofing pipe clusters or other odd shaped penetrations. Available in white, gray or tan.
- 9) Pre-Fabricated Sealant Pockets: A two-piece, pre-fabricated sealant pocket that utilizes reinforced TPO membrane and coated metal to form a rigid, oversized sealant pocket with a weldable horizontal deck flange. Available in 12" (total volume of 1.87 gallons), 16" (total volume of 2.77 gallons) and 20" (total volume of 3.81 gallons). Packaged 2 per carton and available in white only. Refer to the applicable Technical Data Bulletin for dimensions and installation instructions.
- 10) Sealant Pocket Extension Legs: Designed for use with the TPO Molded Sealant Pocket and the Pre-Fabricated Sealant Pocket to extend the length in increments of 10". Fabricated from 45-mil thick reinforced TPO membrane and TPO coated metal. Can be used full length, cut to size for customized lengths or welded to each other for extra-long applications. Packaged 10 legs per carton and available in white only.

2. PVC and KEE HP (VersiFleece) Related Products

- a. VersiFlex PVC Flashing is 60-mil thick, non-reinforced, (white, gray, light gray, slate gray or tan) and available in rolls 12" and 24" wide by 50' long. Flashing is used for inside/outside corners and field fabricated pipe flashings when use of pre-molded accessories is not feasible.
- b. **VersiFlex PVC Reinforced Cover Strip:** A 8" wide, nominal 60-mil and 80-mil thick, polyester reinforced PVC membrane. Used for stripping in rows of fasteners and plates and covering the butt joints of VersiFlex PVC membranes. Available in rolls 8" wide by 75' long in colors of white, gray or tan.
- c. VersiFlex KEE HP Reinforced Cover Strip: A 8" wide, nominal 60-mil and 80-mil thick, polyester reinforced KEE HP PVC membrane. Used for stripping in rows of fasteners and plates and covering the butt joints of VersiFlex KEE HP PVC membranes. Available in rolls 8" wide by 75' long in colors of white, gray or tan, also available in 60-mil in rolls of 8" wide by 100' long in white only.
- d. VersiFlex PVC Pressure-Sensitive Cover Strip: A 6" wide, nominal 35-mil thick non-reinforced KEE HP flashing laminated to a nominal 35-mil, fully cured, pressure-sensitive, synthetic rubber adhesive. Used for stripping in flat metal edgins (i.e. drip edge) of VersiFlex PVC and KEE HP PVC membranes. Available in rolls 6" wide by 100' long in colors of white, gray or tan. Used in conjunction with PVC Step 1 Activator and PVC Step 2 Primer.
- e. **VersiFlex PVC "T" Joint Cover:** A 4-1/2" diameter, 60-mil thick (white) or 40-mil (gray or tan), injection molded PVC flashing used to overlay "T" joints at field splices when 80-mil VersiFlex PVC or KEE HP membrane is used.
- f. VersiFlex PVC Yellow Pressure-Sensitive Warning Strip: a nominal 30-mil-thick, non-reinforced membrane flashing laminated to a nominal 30-mil-thick, fully cured, synthetic rubber, pressure-sensitive adhesive and is available in 6"-wide by 100'-long rolls. Pressure-Sensitive Warning Strip can be applied to

VersiFlex PVC or KEE HP systems to provide a visual warning of an impending hazard (e.g., roof edge, deep drain sump, skylight, etc.).

g. **VersiFlex PVC Rib Profile:** Used to obtain the appearance of standing seam metal roofing with the performance of a PVC single-ply membrane. The Rib Profile measures 1-1/4" tall and 2-1/8" wide, including the welding flanges, while the vertical profile is a substantial 3/8" thick. The profile has a continuous 1/8" diameter alignment hole, for use with fiberglass connecting pins, as well as a 1/8" fiberglass reinforcing cord for added strength. The Rib Profile is available in white, gray, light gray, slate gray and tan, 10' lengths and packaged 20 per carton.

h. Pre-Molded Accessories:

- VersiFlex PVC Inside Corners: A pre-molded flashing for inside corners. Available in white or gray on tan;
 60-mil thick.
- VersiFlex PVC Outside Corners: A pre-molded flashing for outside corners. Available in white, gray or tan; 60-mil thick.
- 3) VersiFlex PVC Curb Wrap Corners: Fabricated flashings are made of 60-mil thick reinforced VersiFlex KEE HP PVC Detail membrane designed to reduce installation time to flash a curb when compared to conventional methods. Each corner is fabricated with a 6" wide base flange and a 12" overall height. Three sizes are available to fit curbs up to 3' by 3' in size. One curb requires 4 corners for a complete installation. PVC Curb Wrap Corners are packaged in boxes containing twelve corners. Custom sizes are available as a special order product requiring lead time.
- 4) **VersiFlex PVC Universal Corners:** a pre-molded flashing for use in a variety of corner details, including inside and outside corners. Available in white, tan, gray, and light gray; 60-mil thick.
- 5) **VersiFlex PVC Pipe Flashings:** A pre-molded pipe flashing used for pipe penetrations. Available in white, gray, light gray and tan for 3/4" 8" diameter pipes with clamping rings included.
- 6) **VersiFlex PVC Split Pipe Seals:** A prefabricated flashing consisting of 60-mil thick reinforced VersiFlex Membrane for pipes 1" 6" in diameter. A split (cut) and overlapped tab are incorporated to allow the pipe seal to be opened and wrapped around the pipe when it is not possible to pull a standard pipe flashing over a round penetration. Available in white, gray or tan.
- 7) **VersiFlex PVC Square Tubing Wraps:** Fabricated flashings made of 60-mil thick reinforced VersiFlex membrane for square tubing. A split (cut) and overlap tab are incorporated into these parts to allow the seals to be opened and wrapped around a square penetration. Available for 3", 4" and 6" diameter square tubing. Available in white or gray.
- 8) **VersiFlex PVC Molded Sealant Pocket:** A pre-fabricated, interlocking, 2-piece, injection molded, flexible pocket with a rigid PVC vertical wall and pre-formed deck flanges. Pockets can be adjusted from 11.75" to 7.5" in length by 6" in width by following the cutting lines molded into the pocket. Used in conjunction with White One-Part Pourable Sealer for waterproofing pipe clusters or other odd shaped penetrations. Available in white only.

B. Primers, Adhesives, Sealants and Cleaners

Refer to Technical Data Bulletins for material coverage rates and proper usage. Prior to the use of any of the products listed below, consult the Safety Data Sheets (SDS) for applicable cautions and warnings.

- 1. General Adhesives and Sealants (For all Membranes)
 - a) Flexible DASH Adhesive: A two-component (Part A and B), low-rise polyurethane adhesive designed for bonding VersiFleece membrane and/or insulation to various substrates. Coverage rates can be found in Paragraph 3.05 'Membrane Placement and Securement'. Flexible DASH Adhesive is packaged in 50- and 15-gallon drums, as well as, 5-gallon Jug and Dual Cartridges that can be applied in full spray, extrusion, or splatter application depending on dispensing type.

- b) Flexible DASH Dual Tank Adhesive: A two component (Part A and B), low rise adhesive for bonding VersiFleece membrane and/or insulation to various surfaces. Flexible DASH Dual Tanks utilize an HFO blowing agent. HFO (hydrofluoroolefin) blowing agents are widely recognized as the next-generation environmentally friendly blowing agent, replacing their HFC (hydrofluorocarbon) predecessor. Flexible DASH Dual Tank Adhesive can be applied in bead or spatter application. Coverage rates can be found in Paragraph 3.05 'Membrane Placement and Securement'.
- c) Flexible DASH Dual Cartridge: A two component (Part A and B), extrusion applied, low rise adhesive for bonding insulation to various surfaces. Flexible DASH Dual Cartridge Adhesive can be applied in bead application. Coverage rates can be found in Paragraph 3.05 'Membrane Placement and Securement'.
- d) Aqua Base 120 Bonding Adhesive: A semi-pressure-sensitive, water based adhesive used as a one-sided wet lay-in adhesive for VersiFleece (VersiWeld). Coverage rate is 100-120 square feet per gallon finished surface. Refer to Spec Supplement G-09 "Aqua Base 120 Bonding Adhesive" for further information.
- e) **HydroBond Water-Based Adhesive:** A wet lay-in, one-sided dispersion adhesive. Compatible with all VersiFleece membranes, this product is ideal for bonding to various porous and non-porous substrates. (The use of Hydrobond with VersiFleece EPDM is not approved for use with Coated Glass Faced products). Coverage rates vary between 100-133 square foot per gallon using roller or spray applications.
- f) CAV-GRIP 3V Low-VOC Aerosol Contact Adhesive/Primer: a Low-VOC, spray-applied aerosol contact adhesive and primer used for a variety of applications: adhering standard VersiWeld TPO and VersiGard EPDM membranes to horizontal and vertical surfaces, adhering VersiFleece membrane to vertical surfaces, as a primer for VapAir Seal 725TR, and as an unexposed asphalt primer for Flexible DASH for insulation attachment.
- g) **Water Cut-Off Mastic:** A one-component, low viscosity, self-wetting, Butyl blend mastic used to prevent moisture migration at drains, compression terminations and beneath certain metal edging (at a coverage rate of approximately 10' per tube or 100' per gallon.
- h) **Universal Single-Ply Sealant:** A 100% solids, solvent free, one-part, polyether sealant that provides a weather tight seal to a variety of building substrates. Can be used as a termination bar sealant or for use in counterflashing, coping, and scupper details. Packaged 24 per carton in 10.3 ounce tubs with a coverage rate of approximately 10' per tube.

2. VersiWeld Adhesives, Sealants and Cleaners

- a) VersiWeld Bonding Adhesive: A high-strength, synthetic rubber adhesive used for bonding VersiWeld non-fleece-backed membrane to various surfaces. The adhesive is applied to both the membrane and the substrate at a coverage rate of approximately 60 square feet per gallon per finished surface (includes coverage on both surfaces).
- b) VersiWeld Low-VOC Bonding Adhesive: An alternate, high-strength, adhesive using a blend of VOC exempt and non-exempt solvent which complies with the State of California Clean Air Act of 1988 (updated in 1997).
- c) TPO Cut-Edge Sealant: A clear sealant used to seal cut edges of reinforced VersiWeld membrane. A coverage rate of approximately 225 275 linear feet per squeeze bottle can be achieved when a 1/8"diameter bead is applied.
- d) White One-Part Pourable Sealer: A one-part, moisture curing, elastomeric polyether sealant used to fill TPO Molded Pourable Sealer Pockets. Packaged in 4, 2-liter foil pouches inside a reusable plastic bucket. 1 pouch will fill 2 TPO Molded Pourable Sealer Pockets.
- e) **Weathered Membrane Cleaner:** Used to prepare membrane that has been exposed to the elements for approximately 7 days prior to hot air welding at an approximate coverage rate of 600 linear feet per gallon on a 4" wide surface.
- f) **TPO and Low-VOC TPO Primer:** A primer used to prepare the surface of the membrane for the application of the Quick Applied Cover Strip.

3. VersiFlex Adhesives, Sealants and Cleaners

a) Low-VOC Bonding Adhesive: A high-strength, synthetic rubber adhesive used for bonding VersiFlex

membrane to various surfaces. The adhesive is applied to both the membrane and the substrate at a coverage rate of approximately 60 square feet per gallon per finished surface (includes coverage on both surfaces).

- b) Hydrobond Water-Based Adhesive: A wet lay-in, one-sided dispersion adhesive. Compatible with only VersiFlex PVC smooth-backed and VersiFleece membranes, this product is ideal for bonding only PVC membranes to various porous and non-porous substrates (cannot be used with any KEE or KEE HP PVC bareback membranes). Coverage rates vary between 100-133 square foot per gallon using roller or spray applications.
- c) CAV-GRIP PVC Aerosol Contact Adhesive: a low-VOC, methylene chloride-free adhesive that can be used for a variety of applications including: adhering PVC bareback membranes to a variety of horizontal substrates and vertical walls (cannot be used with any KEE or KEE HP bareback membranes), as well as adhering VersiFleece membranes to vertical walls. Coverage rate is approximately 400 sq. ft. per #40 cylinder and 800 sq. ft. per #85 cylinder as an adhesive for vertical walls, in a double-sided application; 750 sq. ft. per #40 cylinder and 1,500 sq. ft. per #85 cylinder as an adhesive, horizontally, for the field of the roof, in a double-sided applications.
- d) VersiFlex Cut-Edge Sealant: A clear sealant used to seal cut edges of reinforced VersiFlex membrane. A coverage rate of approximately 225 - 275 linear feet per squeeze bottle can be achieved when a 1/8"diameter bead is applied. The use of cut edge sealant to seal cut edges of VersiFlex membrane is not required.
- e) White One-Part Pourable Sealer: A one-part, moisture curing, elastomeric polyether sealant used to fill Molded Sealant Pockets. Packaged in four 1/2 gallon pouches per plastic bucket. One pouch will fill 122 cubic inches of volume within a molded sealant pocket.
- f) PVC and KEE HP Membrane Cleaner: Used to prepare PVC and KEE HP PVC membrane that has been exposed to the elements for approximately 7 days prior to hot air welding or to remove general construction dirt. Approximate coverage rate of 400 square feet per gallon (one surface).
- g) VersiFlex Low-VOC PVC Step 1 Activator: A high-strength, solvent-based activator that allows PVC Pressure-Sensitive (PS) Cover Strip to be bonded to VersiFlex PVC or KEE HP membranes. Low-VOC PVC Step 1 Activator meets the < 250 gpl VOC content requirements of the OTC Model Rule. It is specially formulated using a blend of VOC-exempt and non-exempt solvents and follows the state of California Clean Air Act of 1988 (updated in 1997) as further regulated by California's Air Quality Control Districts listing VOC limitations.</p>
- h) VersiFlex Low-VOC PVC Step 2 Primer: A high-solids-content, polymer based splice primer. This product is applied to KEE HP and PVC membranes to improve the adhesion of PVC Pressure-Sensitive Cover Strip. Low-VOC PVC Step 2 Primer meets the < 250 gpl VOC content requirements of the OTC Model Rule.
- i) **VersiFlex PVC Step 2 Primer:** A high-solids-content, clear (translucent color), polymer-based splice primer used to prepare KEE HP and PVC membranes to be bonded to PVC Pressure-Sensitive Cover Strip.

2.05 Fastening Components

A. Fasteners

The following Table illustrates criteria for fastening of Versico Insulation with the referenced roof deck and includes minimum penetration requirements and pilot hole criteria.

Insulation Fastening Criteria

Deck Type	Versico Fasteners (1)	Min. Penetration	Pilot Hole Depth	Pilot Hole Diameter
Steel or Lightweight Insulating Concrete over Steel	ASAP or InsulTite	3/4"	N/A	N/A
Structural Concrete, rated 3,000 psi	CD-10	1"	Note (2)	7/32"
or greater	MP 14-10	1"	Note (2)	3/16"
Wood Plank, min. 15/32" thick Plywood or min. 7/16" OSB	HPV, ASAP or InsulTite	Min. 1" (3)	N/A	N/A
Cementitious Wood Fiber	Polymer Gyptec	1-1/2"	Note (4)	N/A
Cementitious Wood Fiber	Lite-Deck Fastener	2"	Note (4)	N/A
Gypsum	Polymer Gyptec	1-1/2"	Note (2)	7/16", 1/2" or 9/16" (5)
Gypsum	Lite-Deck Fastener	2"	Note (5)	Note (6)

Notes: N/A = Not Applicable

- (1) Only 3" diameter insulation fastening plates can be used for insulation attachment.
- (2) The pilot hole must be predrilled to a sufficient depth to prevent contact between the fastener point and any accumulated dust in the predrilled hole. This will help prevent bottoming out of the fastener during installation.
- (3) For wood planks only, fastener penetration shall not exceed 1-1/2".
- (4) Most cementious wood fiber decks do not require pre-drilling; however, Versico should be contacted prior to installation for verification of specific types that may require a pilot hole to be predrilled.
- (5) Pilot hole size may be varied to maximize pullout resistance.
- (6) Gypsum hardness varies, and the desired pullout may determine pilot hole

size. This could range from 1/4" to 5/16.

All Fasteners listed below can be used with VersiWeld or VersiFlex Roofing Systems. Refer to the applicable specification for specific requirements.

- 1. **HPV Fastener:** A threaded E-coat square head fastener **for insulation attachment only**. Used into steel, wood plank, minimum 15/32" thick plywood or minimum 7/16" thick oriented strand board (OSB).
- InsulTite Fastener: A threaded Phillips drive fastener used with Versico Insulation Plates for insulation attachment to steel or wood decks.
- Pre-Assembled ASAP Fasteners: Versico's InsulTite Fastener pre-assembled with a 3" diameter plastic plate
 used for insulation attachment only on Fully Adhered and Mechanically Attached Roofing Systems. Installed
 using Olympic Fasteners' Fastening Tool.
- 4. **CD-10 Nail In Fasteners**: A hammer-driven, non-threaded E-Coat fastener for use with structural concrete decks rated 3,000 psi or greater.
- MP 14-10 Concrete Fasteners: A #14 threaded fastener with a #3 Phillips drive used for minimum 3,000 psi concrete decks.
- 6. **Polymer Gyptec Fastener:** A non-penetrating, plastic fastener and corresponding plate used with lightweight deck substrates such as fibrous cement and gypsum.
- 7. **Lite-Deck Fastener**: An oversized diameter fastener and associated 3" Lite-Deck Metal Plate for use on Fully Adhered Roofing Systems to attach insulation to gypsum decks.
- 8. **Term Bar Nail-In**: A 1-1/4" long expansion anchor with threaded drive pin used for fastening Termination Bar or Seam Fastening Plates to concrete, brick or block walls. The fastener is set by hammering the drive pin into place.
- B. Insulation Fastening Plates

- 1. **Insulation Fastening Plates**: A nominal 3" diameter metal plate used for insulation attachment in conjunction with the appropriate Versico Fastener.
- 2. **SecurFast Insulation Fastening Plates:** A nominal 2-7/8" hexagon metal plate used for insulation attachment in conjunction with the appropriate Versico Fastener.
- 3. **Accutrac Insulation Plates:** A nominal 3" square, recessed or flat bottomed, metal plate used for insulation attachment in conjunction with the appropriate Versico Fastener. Flat bottom plate is used with manufactured Philips Head fasteners only.

2.06 Vapor /Air Barrier and Primer

A. General

- 1. The use of a vapor retarder to protect insulation and reduce moisture accumulation within an insulated roofing assembly should be investigated by the specifier, especially on projects with high interior humidity, such as, swimming pools, breweries, pulp mills, etc.
- 2. If insulation is to be adhered to the vapor retarder with Flexible DASH Adhesive, the vapor retarder must be compatible and shall be fully adhered to the substrate. Available products include Versico's VapAir Seal 725TR Air and Vapor Barrier, VapAir Seal MD Air and Vapor Barrier and spray or roller applied butyl coatings. Installation requirements for Versico's VapAir Seal 725TR Air and Vapor Barrier are identified in Spec Supplement G-07 "Application Procedures for 725TR Air and Vapor Barrier" and Versico's VapAir Seal MD Air and Vapor Barrier are identified in Spec Supplement G-12 "Application Procedures for Versico's VapAir Seal MD Air and Vapor Barrier" in the Versico Technical Manual.
- B. **Versico VapAir Seal 725TR Air and Vapor Barrier** A 40-mil thick composite consisting of 35-mil self-adhering rubberized asphalt membrane laminated to an 5-mil UV resistant poly film with an anti-skid surface which is fully compatible with Flexible DASH Adhesive. 725TR can also function as a temporary roof for up to 120 days. Available in rolls 39" wide by 100' long (325 square feet).
- C. **Versico VapAir Seal MD Air and Vapor Barrier** a reinforced composite aluminum foil with self-adhesive SBS backing and removable poly release film. Used for direct application over metal decks. Used for direct application over metal decks. Available in rolls 42.5" wide by 131.23" long (460 square feet).
- D. CAV-GRIP 3V Low-VOC Aerosol Contact Adhesive/Primer: a low-VOC, methylene chloride-free adhesive that can be used for a variety of applications including: enhancing the bond between Versico's VapAir Seal 725TR and various substrates. Coverage rate is approximately 2,000-2,500 sq. ft. per #40 cylinder and 4,000-5,000 sq. ft. per #85 cylinder as a primer, in a single-sided application.
- E. CCW-702 Primer and 702LV Primer (Low-VOC) A single component, solvent based, high tack primer used to provide adhesion between Versico 725TR Air and Vapor Barrier and an approved substrate. Applied by spray or long nap roller with a coverage rating ranging from approximately 300 to 350 square feet per gallon on smooth finishes (i.e., concrete) to 75 square feet per gallon on porous surfaces (i.e., Dens-Deck Prime gypsum board). Available in 5-gallon containers. CCW-702LV Primer contains less than 250g/L VOCs and meets South Coast Air Quality Management District (SCAQMD) and Leadership in Energy and Environmental Design (LEED) Requirements for Volatile Organic Compounds.
- F. CCW-702WB a high-tack, water-based contact adhesive for promoting adhesion of Versico air/vapor barrier membranes and an approved substrate (i.e., concrete, Dens-Deck Prime, Securock, or DEXCell). Applied by roller, brush or spray with an application rate of approximately 200 sq. ft. per gallon. Available in 5-gallon containers. CCW-702WB Primer contains 57g/L VOCs and meets South Coast Air Quality Management District (SCAQMD) and Leadership in Energy and Environmental Design (LEED) Requirements for Volatile Organic Compounds.

2.07 Edges and Terminations

A. General

Products listed below can be used with any of the available Versico Roofing Systems. Refer to the applicable Versico details and installation instruction manuals for specific installation criteria.

B. **Products**

1. Fascia Products

- a. VersiTrim Snap-on Fascia: A two-part snap-on assembly including a base plate and decorative snap-on cover. Includes a 20-gauge retainer base plate with pre-slotted holes for fasteners. The fascia is available in 0.040" or .050" aluminum with mill-finish, anodized-finish or Kynar ® 500 finish or 22- or 24-gauge galvanized steel with Kynar ® 500 finish or acrylic coated galvalume finish. Available in a variety of standard colors. Custom colors are available upon request. Available in sizes from 3-1/2" to 12-1/4" face heights. ANSI/SPRI/FM-4435 ES-1 certified.
- b. <u>VersiTrim One Fascia:</u> A snap-on edge system consisting of a 20-gauge galvanized steel formed rail with pre-punched slots, a 6" stainless steel spring clip. corrosion resistant fasteners with a 24 gauge galvanized steel or 0.040", 0.050" or 0.063" Kynar[®] finished aluminum fascia cover. Available in a variety of standard colors. Custom colors are available upon request. Available in 12' standard lengths with face sizes of 4", 5", 6" and 8". ANSI/SPRI/FM-4435 ES-1 certified.
- c. <u>VersiTrim Snap-On Canted Fascia:</u> A snap-on edge system consisting of a 24-gauge galvanized metal water dam with pre-punched holes, a 24-gauge stainless steel spring clip and a snap-on cover. The cover is available in 0.040", 0.050" or 0.063" thick mill-finish, anodized, or Kynar[®] 500 finish aluminum or 22- or 24-gauge steel with Kynar[®] 500 finish. The fascia is available in a variety of standard colors. Custom colors are available upon request. Available in 12' standard lengths and heights varying from 5" to 12-1/2". ANSI/SPRI/FM-4435 ES-1 certified.
- d. VersiTrim Crimp-On Canted Fascia: A crimp-on edge system featuring a 24-gauge, galvanized metal water dam with pre-punched holes, a 24-gauge stainless steel spring clip and a snap-on cover. The fascia cover is available in 0.040", 0.050" or 0.063" thick mill-finish, anodized, or Kynar® 500 finish aluminum or 22- or 24-gauge steel with Kynar® 500 finish. The fascia is available in a variety of standard colors. Custom colors are available upon request. Available in 12' standard lengths and heights varying from 5-1/4" to 12-3/4". ANSI/SPRI/FM-4435 ES-1 certified.
- e. VersiTrim EX Snap-On Fascia: An anchor bar roof edge fascia system consisting of heavy 0.100" thick extruded aluminum bar, corrosion resistant stainless-steel fasteners and snap-on fascia cover used with Adhered, Mechanically Fastened assemblies. The fascia cover is available in 0.040", 0.050" or 0.063" thick mill-finish, anodized, or Kynar[®] 500 finish aluminum or 22- or 24-gauge steel with Kynar[®] 500 finish. The fascia is available in a variety of standard colors. Custom colors are available upon request. Available in 12' standard lengths and 4", 5-1/2", 7" and 8-1/2" heights. ANSI/SPRI/FM-4435 ES-1 certified.

2. Coping Products

- a. **VersiTrim Gold Coping**: A snap-on coping system that incorporates 20-gauge, galvanized steel anchor clips and 12", 20-gauge, factory-applied stainless-steel springs. Available with 22- and 24-gauge steel with Kynar[®] 500 finish or 0.040", 0.050" and 0.063" mill-finish, anodized or Kynar[®] 500 coated aluminum. A variety of standard colors are available. Custom colors are available upon request. ANSI/SPRI/FM-4435 ES-1 Certified.
- b. **VersiTrim Snap-on Coping:** A snap-on coping system that incorporates 20-gauge, galvanized steel anchor cleats with pre-slotted holes, a concealed joint cover and 0.040", 0.050" and 0.063" thick mill-finish, anodized or Kynar® 500 finish or 22- or 24-gauge Kynar 500® coated steel. The coping cap is available in a variety of colors and widths, including custom pieces such as tees, crosses, and radius copings. Custom colors are available upon request. Available in standard 12' lengths with 6" to 16" wall heights. ANSI/SPRI/FM-4435 FS-1 certified

Also available in VersiTrim CF Gold Coping with 16-gauge anchor cleats for added performance.

- c. VersiTrim One Coping: A mechanically fastened coping system consisting of a 22-gauge retainer bar (face side only), corrosion resistant fasteners and a .040", .050" or .063" mill-finish, anodized or Kynar® 500 coated aluminum and 22- or 24-gauge, Kynar® 500 coated steel coping cover. A variety of standard colors are available. Custom colors are available upon request. Available for wall thicknesses up to 12". ANSI/SPRI/FM-4435 ES-1 Certified.
- d. **VersiTrim Continuous Cleat Coping:** An engineered coping system, featuring continuous, 20-gauge galvanized steel cleats on both the inside and outside face of the parapet. Available with 0.040", 0.050" and 0.063" mill-finish, anodized or Kynar® 500 coated aluminum and 22- and 24-gauge Kynar® 500 coated steel. A variety of standard colors are available. Custom colors are available upon request. Custom fabricated for specific project requirements. Cleat available in standard 12' lengths. ANSI/SPRI/FM 4435/ES-1 Certified. Miami-Dade approved.

3. Water Control Products

- a. **VersiTrim Gravel Stop**: A two-piece assembly that consists of a continuous 22-gauge steel cleat with prepunched holes and snap-on gravel stop cover. The gravel cover is available in 0.040", 0.050", and 0.063" mill-finish, anodized or Kynar® 500 coated aluminum or 22- and 24-gauge steel with galvanized Kynar® 500 coated or acrylic coated galvalume finish. Available in a variety of standard colors. Custom colors are available upon request. Available in 12' standard lengths with 3" to 10" heights and 1" and 3" flange widths. ANSI/SPRI/FM-4435 ES-1 Certified.
- b. VersiTrim Drip Edge: Designed for use on Adhered and Mechanically Fastened Roofing Systems. Includes a 22-gauge continuous 12' pre-punched, 90-degree angle cleat and 10' or 12' long fascia sections, including concealed joint covers. Available in 0.032" or 0.040" mill-finish, anodized or Kynar® 500 coated aluminum or 24-gauge Kynar 500 coated steel. A variety of standard colors are available. Custom colors are available upon request. ANSI/SPRI/FM-4435 ES-1 Certified.
- c. VersiTrim EX Drip Edge: Featuring an extruded aluminum anchor bar with pre-punched holes for roof membrane securement. The cover is manufactured from 0.040" aluminum with mill-finish, anodized or Kynar® 500 finish or 24-gauge steel with Kynar® 500 finish. Available in standard 12' lengths with sizes ranging from 3" to 7.5" face heights. A variety of standard colors are available. Custom colors are available upon request. ANSI/SPRI/FM 4435/ES-1 Certified. Miami-Dade approved.
- d. VersiTrim TPO Coated Drip Edge: Prefabricated, non-reinforced, TPO-coated metal edging featuring a 22-gauge, 90-degree, angle cleat with pre-slotted holes and TPO-coated, and a 24-gauge metal cover used to heat-weld the roofing membrane directly to the metal edge. Available in standard TPO colors of white, gray or tan or special colors (Rock Brown, Slate Gray, Terra Cotta, Patina Green and Medium Bronze) Available in 12' standard lengths with a variety of sizes up to 8" fascia height. ANSI/SPRI/FM 4435/ES-1 Certified.
- e. **VersiTrim PVC Coated Drip Edge:** Prefabricated, non-reinforced, PVC-coated metal edging featuring a 22-gauge, 90-degree, angle cleat with pre-slotted holes and PVC-coated, and a 24-gauge metal cover used to heat-weld the roofing membrane directly to the metal edge. Available in standard PVC colors including white, gray, tan, light gray and slate gray. Available in sizes up to 8" fascia height. Available in standard 10' lengths with a variety of sizes up to 8" fascia height. ANSI/SPRI/FM 4435/ES-1 Certified.
- f. VersiTrim TPO Skirted Drip Edge: Prefabricated TPO-coated metal edging, featuring a 22-gauge, 90 degree, angle cleat with pre-slotted holes, a TPO coated, and a 24-gauge metal cover used to heat-weld the roofing membrane directly to the metal edge. Available in standard TPO colors of white, gray or tan or special colors (Rock Brown, Slate Gray, Terra Cotta, Patina Green and Medium Bronze) Available in 12' standard lengths with a variety of sizes up to 8" fascia height. ANSI/SPRI/FM 4435/ES-1 Certified.
- g. VersiTrim PVC Skirted Drip Edge: Prefabricated PVC-coated metal edging, featuring a 22-gauge, 90-degree, angle cleat with pre-slotted holes, a PVC coated, and a 24-gauge metal cover used to heat-weld the roofing membrane directly to the metal edge. Available in standard PVC colors of white, gray, tan, light gray, and slate gray. Available in 10' standard lengths with a variety of sizes up to 8" fascia height. ANSI/SPRI/FM 4435/ES-1 Certified.
- h. **VersiTrim WR Gutter:** system incorporates 1" wide extruded internal gutter brackets and aluminum or galvanized steel gutter. Available in 0.040", 0.050 or 0.063" aluminum, and 22-gauge or 24-gauge with Kynar® 500 finish. Gutter support brackets are extruded aluminum. Available in box style, chamfer style, and offset profiles. ANSI/SPRI/FM 4435/ES-1 Certified.
- Versico Ballast Retaining Bar A ballast retaining perimeter securement system comprised of a slotted (4" on center) extruded mil aluminum retention bar with an integrated compression fastening strip. 1-1/2" stainless steel fasteners with Neoprene washers are provided for stable securement.
- j. **Termination Bar** A 1" wide and 98-mil thick extruded aluminum bar pre-punched 6" on center which incorporates a sealant ledge to support Lap Sealant and provide increased stability for membrane terminations.
- k. SureTite Snap-On Fascia Cleat: Prefabricated, 22-gauge, Galvalume steel, continuous, snap-on cleat with pre-punched holes. Used for use on single ply roofing applications when Carlisle metal flat sheets are used to shop fabricate the fascia or coping cover. Available in 12' standard lengths and 4-1/4" to 8-1/4" face heights. ES-1 certified.
- I. SureTite Drip Edge Cleat: Prefabricated, 22-gauge, Galvalume steel, continuous, cleat with pre-punched holes. Used for use on single ply roofing applications when Carlisle metal flat sheets are used to shop fabricate the drip edge, gravel stop or flat coping cover. Available in 12' standard lengths and 3", 5" 6" and 7" heights. ES-1 certified.

4. Refer to Spec Supplement P-01 "Related Products" for other edgings and coping materials.

2.08 Roof Walkways

Walkways are to be specified at all traffic concentration points (i.e., roof hatches, access doors, rooftop ladders, etc.), and if regular maintenance, once a month or more, is necessary to service rooftop equipment.

A. Walkway Types

1. **VersiWeld Heat Weldable Walkway Rolls:** Designed to protect VersiWeld membrane in those areas exposed to repetitive foot traffic or other hazards. Walkway material may be heat welded to VersiWeld membrane using an automated heat welder or hand held heat welder. The diamond plate tread pattern offers superior slip resistance. The walk edges are trimmed in safety yellow to better define the designated traffic flow. Walkway Rolls are 34" wide by 50' long and are nominal 180 mils thick. Available in white, tan or gray.

NOTE: As an option, walkway pads may be fully adhered to the membrane surface with QA Seam Tape and TPO Primer

- 2. **VersiFlex PVC Heat Weldable Walkway Rolls:** Manufactured from specially compounded PVC, offering superior tear, puncture and weather resistance. Designed to protect VersiFlex membrane in those areas exposed to repetitive foot traffic or other hazards. Walkway material may be heat welded to VersiFlex membrane using an automated heat welder or hand held heat welder. Walkway Rolls are 36" wide by 60' long and are nominal 80-mils and 110-mils thick. Available in gray only.
- VersiWeld TPO Crossgrip Walkway Rolls: Manufactured from TPO and may be used in lieu of standard VersiWeld TPO Walkway Rolls when a walkway is to be loose-laid and not secured to the membrane. Loose-laid Crossgrip TPO Walkway Rolls are effective for winds up to 55 mph. Rolls are 36" wide by 33' long, available in white, gray and yellow.
- 4. VersiFlex PVC Crossgrip Walkway Rolls: Manufactured from PVC and may be used in lieu of standard VersiFlex PVC Walkway Rolls when a walkway is to be loose-laid and not secured to the membrane. Loose-laid Crossgrip PVC Walkway Rolls are effective for winds up to 55 mph. Rolls are 36" wide by 33' long, available in white, gray and yellow.
- 5. Other Walkways (For use with all membranes)
 - a) Versico InterlockingTM Rubber Pavers: 24" X 24" X 2" thick rubber paver weighing approximately 24 pounds per unit, 6 pounds per square foot manufactured from recycled rubber, which provides a resilient, shock absorbing, weather resistant surface. Designed primarily for use as a walkway or on terrace areas offering a unique, environmentally sound advantage over concrete pavers. Features include freeze/thaw stability, bi-directional drainage and no breakage concerns. Available in black and terra cotta.
 - b) **Smooth concrete pavers**, when specified in conjunction with insulation that is mechanically attached, must be loose laid over a slip sheet of membrane or 2 layers of HP Protective Mat. When insulation is attached with Flexible DASH Adhesive, concrete pavers may be placed over one layer of HP Protective Mat. Pavers cannot weigh more than 80 pounds per paper for ease of removal.
 - c) Hanover Pedestal Paver, used for light traffic areas associated with rooftop or garden roof applications. 23-1/2" x 23-1/2" x 2" thick precast concrete pavers weighing 25 psf with an elevated clearance of 1/2" from incorporated footing. Available in 8 standard colors, with special order colors available. The pedestal paver can either be installed in conjunction with a separation layer of HP Protective Mat or using Hanover Pedestal and shims.
 - d) Hanover Ballast and Lightweight Ballast Pavers, 24" x 24" x 1-13/16" thick, Ballast Paver comes in a natural color and a non-slip Diamond finish and weighs 22 lbs/sq. ft. The Lightweight, 23-1/2" x 23-1/2" x 1-1/4" thick, Ballast Paver comes in a natural color and a non-slip diamond finish and weighs 15 lbs/sq. ft. Both pavers can be used as ballast or walkways.

2.09 Other Versico Products

Refer to Spec Supplement P-01 "Related Products" for additional accessories.

PART III - EXECUTION

Prior to commencing with the installation of any of the VersiFleece Membrane Systems refer to Paragraph 1.05 "Warranty Tables" for applicable components and proper securement method suitable for the appropriate warranty coverage.

Requirements listed in this specification are considered minimum and are intended for the sole purpose of obtaining a Versico Warranty. Additional requirements dictated by Regulatory Agencies, Building Insurance or Specifiers must be complied with and are considered to be beyond the scope of this specification.

3.01 General

- A. Safety Data Sheets (SDS) must be on location at all times during transportation, storage and application of materials. The contractor shall follow all safety regulations as recommended by OSHA and other agencies having jurisdiction.
- B. To ensure most current installation requirements are met and techniques are followed. Technical Data Bulletin should be available on site.
- C. Subject to project conditions, it is recommended to begin the application of this roofing system at the highest point of the project area and work to the lowest point to prevent water infiltration. This will include completion of all flashings, terminations and daily seals.
- D. A proper substrate shall be provided by the building owner. The structure shall be sufficient to withstand normal construction loads and live loads.
- E. Protect areas of high construction traffic using plywood sheets.

3.02 Roof Deck / Substrate Criteria

- A. Proper decking shall be provided by the building owner. The building owner or its designated representative must ensure that the building structure is investigated by a registered engineer to assure its ability to withstand the total weight of the specified roofing system as well as construction and live loads in accordance with all applicable codes. The specifier must also designate the maximum allowable weight and location for material loading and storage on the roof
- B. When insulation/ membrane underlayments are to be mechanically attached, withdrawal resistance tests are strongly suggested to determine the suitability of a roof deck. Refer to Design Reference DR-06 "Withdrawal Resistance Criteria" in the Versico Technical Manual proper procedures for conducting pullout tests.
- C. Defects in the substrate must be reported and documented to the specifier, general contractor and building owner for assessment. The Versico Authorized Contractor shall not proceed with installation unless defects are corrected.
- D. On structural concrete decks, when a vapor retarder is not used, gaps in the deck along the perimeter and around penetrations must be sealed along with vertical joints between tilt-up panels, if present, to prevent infiltration of hot humid air and possible moisture contamination resulting from condensation. This is specifically important when adhesive is used to attach the roof insulation.
- E. For all projects (new or retrofit), the substrate must be relatively even without noticeable high spots or depressions. Accumulated water, ice or snow must be removed to prevent the absorption of moisture in the new roofing components and roofing system.

F. Substrate Preparation

- 1) Prior to the placement of membrane underlayment, clear the substrate of debris and foreign material that may be harmful to the roofing system. Gaps greater than 1/4" must be filled with an appropriate material.
- 2) For direct application over an acceptable roof deck/substrate, the substrate must be smooth, steel trowel finished (structural concrete), free of debris, protrusions, sharp edges and loose and foreign material. Cracks or voids in the substrate, greater than 1/4", must be filled with an appropriate material.
- 3) On retrofit recover projects, cut and remove wet insulation, as identified by the specifier, and fill all voids with new insulation of type specified so it is relatively flush (+/- 1/4") with the existing surface.
 - a) Entrapment of water between the old and new membrane can damage and deteriorate new insulation/underlayment between the two membranes. If a vapor retarder or air barrier is not specified, Versico recommends the existing membrane be perforated to avoid potential moisture accumulation and to

allow the detection of moisture to enable the building owner to take corrective action.

- b) **For existing PVC membranes**, when insulation/membrane underlayment are to be mechanically attached, in lieu of total removal, the membrane may be cut into maximum 10' by 10' sections. All PVC flashings at the perimeter, roof drains and roof penetrations must be removed.
- c) When installing this roofing system over an existing gravel surfaced built-up roof, loose gravel must be removed. Power Brooming or Hydro Vacuuming is recommended by Versico to remove the loose gravel or dirt, which may trap moisture. Any uneven areas of the substrate must be leveled to prevent insulation from bridging.
- d) When installing this roofing system over existing TPO Membranes less than 2 years old or EPDM Membrane, use X-Tenda Coat Membrane Cleaner or X-Tenda Coat EPDM Activator. Dilute the product per the instruction label., Spray the surface and let stand for 15 minutes, prior to power washing.
 - 1) On retrofit projects, all existing phenolic insulation must be removed.
 - 2) Refer to table below for other Recover/Retro-fit considerations.

NOTE: When VersiFleece membrane is installed directly over an existing single-ply roof, the existing single-ply roof must be secured with HPV or HPVX Fasteners and 2" diameter Seam Plates at 12" O.C. at all deck to wall junctions, angle changes greater than 2:12 and around curbs/skylights, regardless of warranty duration or warranty wind speed. Fasten directly through VersiFleece membrane and existing single-ply roof to the deck OR fasten through the existing single-ply roof to the deck, prior to application of VersiFleece. Additional fastening of the existing roof may be utilized to enhance the wind uplift resistance of the existing roof, Contact Versico for further information.

G. The following table identifies the acceptable roof decks/substrates and the minimum underlayment requirements:

Roof Deck & Substrate Criteria for Fully Adhered Roofing Systems

Gyotomo						
Acceptable Roof Deck/Substrate	VersiFleece TPO Membrane	VersiFleece PVC Membrane	VersiFleece KEE HP Membrane			
NEW CONSTRUCTION						
Steel (min. 22 gauge)(1)	Insulation	Insulation	Insulation			
Structural Concrete (min. 3000 psi) or Gypsum	Direct Application	Direct Application	Direct Application			
Plywood (min. 15/32" thick) or Oriented Strand Board (min. 7/16" thick)	Direct Application	Direct Application	Direct Application			
Wood Planks (minimum 3/4" thick)	Direct Application	Direct Application	Direct Application			
Fibrous Cement	Insulation	Insulation	Insulation			
Lightweight Insulating Concrete	Direct Application (2)	Direct Application (2)	Direct Application (2)			
RETROFIT / NO TEAR-OFF						
Existing Smooth Surface BUR (7) or Mineral Surface Cap Sheet	Direct Application (8)	Direct Application (8)	Direct Application (8)			
Gravel Surfaced Asphaltic BUR (3)(4)	Insulation	Insulation	Insulation			
Coal Tar Pitch (3)(4)	Insulation	Insulation	Insulation			
Modified Bitumen	Direct Application (6)(8)	Direct Application (6)(8)	Direct Application (6)(8)			
Existing Single-Ply	Direct Application (5)	Insulation (5)	Direct Application (5)			
Existing SPF	Insulation	Insulation	Insulation			
RETROFIT / TEAR-OFF						
Existing roof material removed (regardless of deck type)	Insulation	Insulation	Insulation			

Notes:

- (1) Local codes must be consulted regarding thermal barrier requirements.
- (2) VersiFleece Fully Adhered Roofing System may be specified directly over a new approved cellular or perlite lightweight insulating concrete substrate, refer to Attachment I for additional information.
- (3) Loose gravel must be removed to avoid moisture entrapment.
- (4) Existing coal tar could drip back into the building, especially when new insulation does not provide sufficient thermal value to prevent the surface of the coal tar from softening.
- (5) An approved mechanically attached insulation/underlayment is required over existing ballasted single-ply systems. For Direct Application Versico may be contacted for required substrate preparation.
- (6) Direct application permitted over smooth or granular surfaced modified bitumen. Membrane shall be positioned with length of sheets parallel to modified bitumen field seams. Efforts should be made to ensure seams of the VersiFleece system are parallel to existing seams, when new splices run perpendicular, the field seam must be carefully inspected especially at intersections.
- (7) Existing Type III or IV smooth asphalt BUR Only
- (8) Possible staining/discoloration of the white membrane may result when installing this system directly over existing smooth surfaced BUR or modified bitumen, especially along the selvage edge where fleece backing is not present. If aesthetics are critical, an approved insulation should be specified beneath the membrane
- (9) Silicone-coated substrates must be scarified (coating removed) prior to the application of Flexible DASH Adhesive.

3.03 Insulation / Underlayment

A. General

- Roof insulation thickness must be determined by the thermal value required for each project and may be subject
 to code approval limitations. On projects where a vapor retarder is used, the specifier must calculate insulation
 thickness to ensure the temperature at the vapor retarder will not fall below the dew point.
- 2. On projects where coal tar pitch is used, sufficient insulation must be used to prevent softening of the coal tar and possible dripping into the building, especially when the insulation is mechanically attached.
- 4. Multiple layers of insulation are recommended with all joints staggered between layers.
- Do not install more insulation/underlayment than can be covered by membrane in the same day.
- 6. All insulation boards must be butted together with no gaps greater than 1/4". Gaps greater than 1/4" are not acceptable.
- 7. Insulation should be protected from repetitive foot or construction traffic during or after installation of the roofing system.
- 8. Adhered or "Peel and Stick" Vapor Retarders, when used, may pull away from angle changes due to inadequate adhesion or poor substrate preparation. When insulation is to be adhered to the Vapor Retarder, mechanical securement is required along the perimeter. Insulation shall be mechanically attached with plates and fasteners at 12" o.c. (within 6" of the angle change).

NOTE: Projects utilizing Versico's "Peel and Stick" Vapor Barrier must comply with Versico's installation requirement outlined in Spec Supplement G-07 "Application Procedures for Versico 725 Air and Vapor Barrier". Applicable Details should also be referenced for Vapor Retarder terminations along angle changes.

9. Restrictions:

- a) Versico Roofing Systems cannot be specified in conjunction with existing or new Phenolic Insulation.
- Fiberglass insulation cannot be specified even if overlaid with additional insulation or membrane underlayment.

3.04 Insulation Attachment

A. General

Prior to proceeding with insulation securement refer to Warranty Tables, Paragraph 1.05, for attachment method and appropriate fastening density required for the specific Versico Warranty.

B. Mechanical Attachment

Insulation fastening density will vary based on insulation type, thickness, and required warranty. Warranty Tables in

Paragraph 1.05 should be referenced for fastening density and the appropriate Versico detail may be consulted to identify acceptable fastening pattern.

- For code compliance, increased fastening density may be required depending upon project wind speed and wind uplift requirement. Refer to <u>Design Reference DR-05</u> "Insulation Fastening Patterns" for fastening pattern reference.
- When insulation securement is to comply with Factory Mutual (FM) approvals, follow the requirements of the specifier concerning additional securement at the roof perimeter and corners. Also refer to Design Reference DR-05 "Insulation Fastening Patterns" for various fastening patterns.
- 3. On Reroof/No Tear off projects with a maximum roof height of 40', any Versico Insulation (i.e., 1/2" SecurShield HD, Versico Recovery Board, Polyisocyanurate less than 1-1/2" thick) may be secured at the minimum rate of 11 Fasteners per 4' x 8' board (5 Fasteners per 4' x 4' board).
- 4. When Oriented strand board (OSB) is specified for membrane underlayment, utilize DuraFaceR OSB/Polyiso Composite, mechanically fastened to the deck at the rate 17 fasteners for 4 x 8 board in accordance with Versico Details. When positioning OSB, butt edges and stagger joints of adjacent panels.

C. Adhesive Attachment

Versico Urethane Adhesive Full Spray (Flexible DASH) or Bead applied (Flexible DASH or OlyBond) or Equipment (Rig) Splatter (Flexible DASH) may be used. When bead adhesive is specified bead spacing will vary based on Warranty coverage, refer to Warranty Tables, Paragraph 1.05 and appropriate Versico Details. **CAUTION:** Ensure the bead of adhesive is 2" from edge of board for 4" o.c. bead spacing and 3" from edge of board for 6" and 12" o.c. bead spacing. Refer to **Detail A-27.7** in **Spec Supplement G-08**.

- **CAUTION:** Apply adhesive bead so that the distance from the edge of the board does not exceed half the bead spacing (i.e. within 6" of bead spacing of 12" O.C.).
- CAUTION: Do not apply urethane adhesives directly to un-weathered asphalt, (new or residual) refer to Spec Supplement G-02 "VersiFleece and Insulation Attachment and Coverage Rates with Flexible DASH Adhesive".
- CAUTION: Gaps between horizontal and vertical surfaces of the roof area as well as gaps around penetrations must be sealed to prevent interior warm air from infiltrating and condensing within the roofing assembly. Condensing moisture could weaken bottom insulation facer and eventually result in dislodgement or loose boards when adhesive is used.
- 1. Flexible DASH may be used in an Equipment (Rig) Splatter application method, in lieu of, full spray or bead attachment for adhering Insulation or VersiFleece Membranes to a smooth, flat surface. Flexible DASH may be dispensed by using Dual Tanks or either a HULK Spray Rig or Patriot Spray Rig with a VEE-AIR Spray Gun to achieve 50% coverage of the substrate at a rate of 1/2 gallon per 100 square feet. To achieve proper coverage, spray in a horizontal, sweeping motion, from a minimum of 24" height, overlapping each new pass with the previous pass by 50%.
- Refer to Spec Supplement G-15 "Flexible DASH Adhesive Equipment and Set-Up Requirements for Full Spray, Bead and Splatter Applications" and G-02 "VersiFleece and Insulation Attachment and Coverage Rates with Flexible DASH Adhesive" for equipment settings, application procedures and coverage rates.
- 3. On FM Global insured projects, consult FM Global's local representative concerning the use of adhesive to attach insulation to steel decks.
- 4. Check to ensure the substrate is dry. Adhesive cannot be applied to a wet or damp surface.
- 5. Apply Adhesive over the dry substrate area at the coverage rates indicated in Spec Supplement G-02 "VersiFleece and Insulation Attachment and Coverage Rates with Flexible DASH Adhesive".
- 6. Allow the adhesive to rise up approximately 1/8" to 3/4", depending on dispensing method, and develop strings prior to setting insulation boards into adhesive.

Note: String-time is measured by touching the adhesive with a splice wipe and looking for development of "strings" of adhesive as you pull the splice wipe out of the adhesive. With Flexible DASH Adhesive, string time is generally around 1-1/2 – 2 minutes after application at room temperature.

7. Walk the boards into the adhesive and roll using the 30" wide, 150 pound weighted segmented steel roller to ensure full embedment. Optimal set up time should be approximately 5 to 7 minutes.

CAUTION: Walking on the boards immediately after placement in adhesive can cause slippage/movement

until the adhesive has started to set up.

CAUTION: If the boards easily slide, string time has not been achieved.

On roofs with a slope greater than 1/2" in 12", begin adhering insulation at the low point and work upward to avoid slippage.

One person should be designated to walk and roll in all boards. Relief cuts may be necessary to allow lifted board to lay flat, or constant weight (a minimum 10 lbs for 5-15 minutes per lifted area) may be necessary to achieve adequate adhesion.

8. Refer to Spec Supplement G-02 "VersiFleece and Insulation Attachment and Coverage Rates with Flexible DASH Adhesive" for application procedures and coverage rates.

NOTE: Projects utilizing Versico's "Peel and Stick" Vapor Barrier must comply with Versico's installation requirement outlined in Spec Supplement G-07 "Application Procedures for Versico 725 Air and Vapor Barrier". Applicable Details should also be referenced for Vapor Retarder terminations along angle changes.

3.05 Membrane Placement and Securement Criteria

A. General

- 1. Do not apply Flexible DASH Adhesive when surface and/or ambient temperatures are below 25° F (-4°C). The temperature of Flexible DASH Adhesive must be between 70° F (21°C) and 90°F (32°C), at the time of use. Use blanket heaters and/or hot boxes when necessary.
- 2. Flexible DASH Adhesive may be applied when surface and/or ambient temperatures are below 25° F (-4°C) when heated equipment is used that includes the following: heated blankets, preheater, and heated hose.
- 3. When using Flexible DASH Adhesive in non-heated spray equipment, substrate and/or ambient temperatures must be between 25°F (-4°C) and 120°F (49°C).
- 4. The coverage rate of Flexible DASH Adhesive used to adhere the membrane are in the table below:

	Flexible DASH Adhesive Coverage Rates								
Approximate Coverage Rate (Sq. Ft.)									
Package Type Full Spray Splatter 4" o.c. 6" o.c. 12" o.c.									
Dual Cartridges	N/A	N/A	100-200	200-300	400-600				
Dual Tanks	N/A	2,600-2,800	1,100-1,300	1,700-1,900	3,500-3,700				
5-Gallon Jugs	600-1,000	1,800-2,000	670-900	1,000-1,250	2,000-2,500				
15-Gallon Drums	1,800-3,000	5,400-6,000	2,110-2,700	3,000-3,750	6,000-7,500				
50-Gallon Drums	5,000-10,000	18,000-20,000	6,700-9,000	10,000-12,500	20,000-25,000				

- 5. **Sweep** all loose debris from the substrate.
- Verify all sections are dry prior to proceeding with the application of Flexible DASH Adhesive/VersiFleece membrane.

CAUTION: Ensure that water does not flow beneath any completed sections of the membrane system by completing all flashings, terminations and daily seals by the end of each work day.

B. TPO/PVC/KEE HP Membrane Placement/Bonding -Option #1

- 1. Position and unroll successive sheets and align to provide a minimum 2" overlap (use pre-marked overlap line) along the selvage edge. At end laps (along the width of the sheet), membrane shall be butted together and to be overlaid with minimum 6" wide VersiWeld/VersiFlex Reinforced Membrane hot air welded on all edges.
- 2. Fold adjacent sheets in half lengthwise (end to end) to expose approximately 10' wide (width of the sheet) by half the length of the sheet substrate area.

Notes: Fold selvage sheet edges (along the length of the sheets) under the membrane to prevent overspray onto the splice area.

Membrane which has the adjacent sheet spliced over it should be adhered to the substrate first. This will prevent the selvage edge splice area from being contaminated by setting splice edge into urethane adhesive.

- 3. Apply Flexible DASH Adhesive onto the substrate and allow to rise approximately 1/8" to 3/4", depending on dispensing method, and develop strings when touched with a Splice Wipe. Roll the membrane with a 30" wide, 150 lb weighted segmented steel roller. For extruded applications, apply adhesive at 4", 6" or 12" on center with a minimum 1/2" wet bead. Refer to Tables IV & V in Paragraph 1.05 for Bead Spacing.
- 4. **HydroBond Adhesive** can be applied directly to the substrate using an airless spray machine or a medium nap roller. Do not apply HydroBond to splice areas to be hot-air welded. When applying HydroBond, ensure that the adhesive has not dried before the membrane is laid in place. This is a wet lay-in adhesive; drying occurs rapidly during high temperatures, and care must be taken to ensure the membrane is laid into wet adhesive. To ensure a wet lay-in, adjust the application technique according to weather conditions. Avoid heavy or thin application of adhesive. Roll the membrane into the wet, adhesive coated substrate while avoiding wrinkles. Immediately brush down the bonded portion of the membrane with a soft-bristle push broom or a clean, dry roller applicator to achieve maximum contact and to work out any air bubbles. Immediately after brooming out from the center, roll the membrane in all directions with a minimum 100–150-lb (45–68 kg) weighted roller to achieve maximum contact.
- 5. Apply **Flexible DASH or HydroBond Adhesive** to the substrate and continue process described above until all sheets are fully bonded, allowing for the necessary splice overlaps. At end laps (along the width of the sheet), membrane shall be butted together and to be overlaid with minimum 6" wide VersiWeld/VersiFlex Reinforced Membrane hot air welded on all edges.

C. TPO/PVC/KEE HP Membrane Placement/Bonding - Option #2

- 1. **Position** first roll of VersiFleece membrane at the designated starting point on the roof.
- 2. **Chalk** a line to ensure proper positioning of the VersiFleece membrane.
- 3. **Unroll** 10' to 15' of membrane to ensure it is properly aligned and fold unrolled section back over roll.
- 4. Apply Flexible DASH Adhesive over the substrate area to be covered by the membrane that is folded back. For extruded applications, apply adhesive at 4", 6" or 12" on center with a minimum ½" wet bead.
- 5. Once the Flexible DASH Adhesive is applied in place and has begun to rise approximately 1/8" in height and **develop strings when touched with a Splice Wipe**, slide the membrane back into the adhesive.
- 6. **Roll** the membrane using a 30" wide, 150 pound weighted segmented steel roller, to set the membrane into the adhesive.
- 7. **HydroBond Adhesive** can be applied directly to the substrate using an airless spray machine or a medium nap roller. Do not apply HydroBond to splice areas to be hot-air welded. When applying HydroBond, ensure that the adhesive has not dried before the membrane is laid in place. This is a wet lay-in adhesive; drying occurs rapidly during high temperatures, and care must be taken to ensure the membrane is laid into wet adhesive. To ensure a wet lay-in, adjust the application technique according to weather conditions. Avoid heavy or thin application of adhesive. Roll the membrane into the wet, adhesive coated substrate while avoiding wrinkles. Immediately brush down the bonded portion of the membrane with a soft-bristle push broom or a clean, dry roller applicator to achieve maximum contact and to work out any air bubbles. Immediately after brooming out from the center, roll the membrane in all directions with a minimum 100–150-lb (45–68 kg) weighted roller to achieve maximum contact.
- 8. Proceed to the front of the roll and continue to apply **Flexible DASH or HydroBond Adhesive** and roll the VersiFleece membrane into the adhesive. At the end of the roll, leave approximately 18" unadhered (to be folded back to prevent overspraying when installing the adjoining sheet).

- 9. Once the first sheet is positioned, measure to allow for a minimum (Refer to Option #1) overlap along the length of the sheet. At end laps, membrane shall be butted together and overlaid with a minimum 6" wide VersiWeld/VersiFlex Reinforced Membrane hot air welded on all edges. (Cut edges of VersiWeld membrane shall be sealed with TPO Cut Edge Sealant.)
- 10. Position the next roll and repeat the process as described above.
- Do not apply Flexible DASH or HydroBond Adhesive to splice areas. If Flexible DASH or HydroBond Adhesive should contaminate the splice area, immediately (while Flexible DASH adhesive is still in liquid form) clean with Weathered Membrane Cleaner for TPO membranes or PVC and KEE HP Membrane Cleaner for PVC and KEE HP membranes. Cured Adhesive which has dried may be removed with paint remover as referenced in Paragraph 3.06 B.3.

3.06 Heat Welding Procedures (VersiWeld/VersiFlex)

A. General

- Hot air weld the VersiFleece membrane sheets using the Automatic Hot Air Welding Machine or Hot Air Hand Welder and silicone roller. For description of heat welding equipment and generator/electrical requirements, refer to Spec Supplement T-01 "Heat Welding Equipment".
- 2. When roof slope exceeds 5 inches per horizontal foot, use of the Automatic Hot Air Welding Machine may become more difficult working parallel with the slope it may be necessary to run the sheets perpendicular to avoid the use of Hand Held Hot Air Welder.
- 3. Membrane has a selvage edge (fleece-backing is discontinued) along the length of the sheet for membrane welding.

Selvage edges are not provided along the width of the membrane. Adjoining membrane sheets shall be butted together, overlaid with a minimum 6" wide VersiWeld/VersiFlex Reinforced Membrane and hot air welded on all edges. Seal all VersiWeld/VersiFlex membrane edges (where scrim reinforcement is exposed) with Cut-Edge Sealant.

Note: When using VersiFleece TPO 115- or 135-mil membrane or VersiFleece PVC 135-mil membrane, a surface splice of non-reinforced flashing or "T-Joint" Cover must be applied over all "T" joint splice intersections.

- B. Check the surfaces of the membrane to be hot air welded to ensure they are properly prepared as outlined below:
 - Membrane Cleaning The surfaces to be hot air welded must be clean. Membrane overlaps that become
 contaminated with field dirt must be cleaned with Weathered Membrane Cleaner (VersiWeld) or PVC and KEE
 HP PVC Membrane Cleaner (VersiFlex) and wiped dry with a clean Splice Wipe. No residual dirt or contaminants
 should be evident.
 - Exposed Membrane Seam Preparation Surface oxidation of membrane will occur upon exposure to heat and sunlight. After exposure to the elements, membrane must be cleaned with Weathered or PVC and KEE HP Membrane Cleaner prior to hot air welding as follows:
 - a) Apply Weathered Membrane Cleaner (VersiWeld) or PVC and KEE HP Membrane Cleaner (VersiFlex) to the surface of the membrane which has been exposed using a clean Splice Wipe or other white natural fiber (cotton) rag or ScotchBrite type pad and wipe along the direction of the seam.

If natural fiber rags are used, they must be white to prevent fabric dye from discoloring the membrane.

- Prior to hot air welding, wipe the surface where Weathered Membrane Cleaner (VersiWeld) or PVC and KEE HP Membrane Cleaner (VersiFlex) has been applied with a clean, dry Splice Wipe or other white rag to remove cleaner residue.
- b) Weathered Membrane Cleaner (VersiWeld) will achieve approximately 600 linear feet (one surface) of coverage per gallon for a standard hot air welded splice area. PVC and KEE HP Membrane Cleaner (VersiFlex) will achieve approximately 400 square feet (one surface) of coverage per gallon for a standard heat welded splice area.
- c) The membrane can typically be repaired up to 6 months to a year with the standard cleaning method

referenced above. In cases where the standard cleaning method is not sufficient, additional scrubbing and cleaning will be required. Refer to Paragraph 3.07-B.

- Check surfaces of the VersiFleece TPO/PVC/KEE HP membrane around details (i.e., walls, curbs, vents, etc.)
 for evidence of Flexible DASH Adhesive overspray since proper heat welding of flashing will not be accomplished
 if overspray is present. Overspray shall be removed as follow:
 - a) Apply a paint remover such as Tal-Strip® Extra Strength manufactured by Mar-Hyde® Corporation (can be purchased at most automotive centers) to the overspray area and allow to remain on the membrane surface approximately 5 minutes.
 - b) Remove residue with a Splice Wipe or clean cloth. Wipe cleaned area with Weathered Membrane Cleaner (TPO) or PVC and KEE HP Membrane Cleaner (PVC or KEE HP Only) prior to heat welding (Acetone may be used in lieu of PVC and KEE HP Membrane Cleaner where VOC requirements are in effect).

C. Automatic and/or Hand Held Hot Air Welder Equipment

- 1. Refer to Spec Supplement T-01 "Heat Welding Equipment" for:
 - a. Temperature Settings
 - b. Equipment Set-up
 - c. Additional Information

D. Membrane Welding

- 1. Prepare the Automatic Hot Air Welding Machine and allow it to warm for approximately 5 to 10 minutes to reach operating temperature.
- 2. Perform test trials before welding to ensure proper welding is achieved.
- 3. Position the Automatic Hot Air Welding Machine properly prior to seaming with the guide handle pointing in the same direction the machine will move along the seam.
- 4. Lift the overlapping membrane sheet and insert the blower nozzle of the Automatic Hot Air Welding Machine between the overlap. Immediately begin moving the machine along the seam to prevent burning the membrane.
- 5. Weight plates provided on Automatic Welders must be utilized.
- 6. Proceed along the seam ensuring that the small guide wheel in front of the machine aligns with the edge of the top membrane sheet. Guide the machine from the front only.

CAUTION: Ensure the power cord has plenty of slack to prevent dragging the machine off course (which could result from a tightly stretched cord).

7. At all splice intersections, roll the seam with a silicone roller to ensure a continuous hot air welded seam (the membrane should be creased into any membrane step-off with the edge of the silicone roller). A false weld may result due to surface irregularities created by multiple thicknesses of VersiFleece membrane sheets.

Note: When using VersiFleece TPO 115- or 135-mil membrane or VersiFleece PVC/KEE HP 135-mil membrane, a surface splice of VersiWeld/VersiFlex Non-Reinforced Flashing or T-Joint Cover must be applied over all "T" joint splice intersections. T-joint covers are also required along the end-lap overlays regardless of membrane thickness.

- 8. To remove the Automatic Hot Air Welding Machine from the finished splice, stop the movement of the machine and immediately remove the nozzle from the seam area. Mark the end of the hot air welded seam with a water-soluble marker for easy identification. A Hand Held Welder will be necessary to complete the weld in the area between where the Automatic Hot Air Welding Machine is stopped and restarted.
- 9. All membranes, at end laps, a minimum 6" wide, reinforced coverstrip must be used in conjunction with applicable primer.

E. Preventing Membrane Creeping During Welding

The operator of automatic welding equipment must apply foot pressure to the membrane, keeping the membrane tight under the welder. Refer to Spec Supplement T-01 "Heat Welding Equipment" for additional information.

F. Test Cuts

Perform a test weld at least at the start of work each morning and afternoon. Refer to Spec Supplement T-01 "Heat Welding Equipment" for additional information.

G. Seam Probing

A blunt or dull cotter pin puller is recommended to probe all heat-welded seams. Probing seams must be done once heat welds have thoroughly cooled. Refer to **Spec Supplement T-01 "Heat Welding Equipment"** for additional information.

3.07 WELDING PROBLEMS/REPAIRS

- A. A Hand Held Hot Air Welder and a 2 inch wide silicone roller must be used when repairing the VersiWeld or VersiFlex VersiFleece membrane. When the entire hot air welded seam is to be overlaid, an Automatic Hot Air Welding Machine may be used.
- B. Prior to proceeding with any repair procedure, the area to be repaired must be cleaned and any material which has been exposed approximately 7 days must be prepared with Versico Weathered Membrane Cleaner (VersiWeld) or PVC and KEE HP Membrane Cleaner (VersiFlex) as outlined in Spec Supplement T-01 "Heat Welding Equipment Use and Procedures Thermoplastic Membranes", Exposed Membrane Seam Preparation. The membrane can typically be repaired up to 6 months to a year with a standard cleaning method. In cases where the standard cleaning method is not sufficient, the following procedures must be used:
 - 1. Scrub the area to be welded with a "Scotch Brite" pad and appropriate Membrane Cleaner. The cleaner will become discolored during this procedure.
 - 2. Clean all residue from the area to be welded with a Splice Wipe or clean rag.
 - 3. Weld the new membrane to the cleaned area using standard welding procedures.
- C. Voids in welded seams can be repaired using a Hand Held Hot Air Welder and a silicone roller.
- D. Position the hand held welder facing into void so hot air is forced between overlapping membranes. Roll the top membrane surface using positive pressure toward the outer edge until the heated membrane surfaces are fused.
- E. Exposed scrim-reinforcement (resulting from scorching surface of membrane) and test cut areas must be repaired by overlaying the damaged area with a separate piece of membrane with rounded corners. The overlay must extend a minimum of 2 inches past the area to be repaired.
- F. Probe all edges of the overlay once cooled to ensure a proper weld has been achieved.
- G. Seal all cut edges of VersiWeld reinforced membrane with TPO Cut-Edge Sealant. PVC Cut-Edge Sealant is not required for VersiFlex membrane.

3.08 Flashings

For other requirements which must be complied with in order for Versico warranty to be issued, refer to Spec Supplement G-04 "Flashing Consideration/Metal Work".

A. General Considerations

- All existing loose flashing must be removed prior to the application of new flashing. New membrane flashing
 must extend above all existing intact flashing but must not conceal weep holes or cover existing through wall
 counter flashing.
- 2. Deck to wall joints, vertical joints between tilt up panels, and any gaps in metal walls must be sealed to prevent any infiltration and possible condensations beneath the membrane. Refer to appropriate Versico Details for recommendation.
- 3. Install surface mounted reglets and compression bar terminations directly to the wall surface.
- 4. In areas where metal counterflashing is used as the vertical termination, the counterflashing must be sealed with a rubber grade caulking to prevent moisture migration behind the new wall flashing.

- 5. At roof drains and compression seal terminations such as terminations bars and coping stones, the fleece-backing must be removed from the back of the membrane so Water Cut-Off Mastic can be applied directly to the VersiFleece membrane surface.
 - a. To remove fleece-backing utilize a Hand Held Hot Air Welder and apply heat in a back and forth motion over the area of where the fleece is to be removed. Fleece will melt and the bottom of the membrane will be exposed.
- 6. Cut-edges of VersiFleece TPO membrane, where scrim reinforcement is exposed, must be sealed with TPO Cut-Edge Sealant (not required on vertical surfaces). The use of PVC Cut-Edge Sealant on cut edges of VersiFlex VersiFleece membrane is not required, but it is recommended, regardless of warranty duration.
- 7. Care must be taken when setting the flashing to avoid bridging greater than 3/4 inch at angle changes (i.e., where a parapet or roof penetration meets the roof deck). This can be accomplished by creasing the membrane into the angle change.
- 8. All vertical EPDM field splices at the base of a wall or curb must be overlaid with a Pressure-Sensitive "T" Joint Cover, 6" wide section (with rounded corners) of VersiGard Pressure-Sensitive Flashing or VersiGard White uncured Peel & Stick Flashing centered over the field splice in accordance with the applicable Versico Details. When 60-mil or greater Reinforced VersiWeld or 80-mil VersiFlex Non-Fleece Membrane is used for wall/curb flashing resulting splice intersection must be overlaid with appropriate "T"-Joint cover.
- 1. Terminate the edges of the installed membrane in accordance with Versico's applicable Termination Details.
- 9. On all Total System Warranty projects, Versico's Termination Bar, in conjunction with Water Cut-Off Mastic, must be installed under all metal counterflashings used for vertical wall terminations.
- 10. The height of the new wall flashing and termination must extend above the anticipated water level (due to heavy rain) or slush line (due to water under accumulated snow).
- 11. The Specifier must examine structural supports for rooftop equipment to determine if reasonable access to the membrane beneath the equipment is provided.
- 12. Bitumen based roof cement must be removed or concealed with an acceptable underlayment.
- 13. When sleepers are used for mounting rooftop equipment, they must be designed to provide adequate support. An appropriate detail must be selected to prevent depression of the insulation and possible damage to the membrane.
 - **NOTE:** When sleeper mounted pipe and gas lines running perpendicular to roof slope should be elevated to reduce forces caused by melting/sliding snow. Designer may consider the utilization of a support system secured to roof structure and properly flashed.

14. Existing Roof Tie-Ins

- a. Depending on the type of the existing roofing system, the tie-in method will vary. Total isolation between the two roofing systems or weep holes may be required to address moisture migration from one roofing system to the other. Refer to appropriate TPC-13 Detail, contact Versico for further information. If constant compression is required, ensure fleece is removed from the bottom of the membrane.
- Flashing of Difficult Penetrations, refer to Spec Supplement G-11 for "LIQUISEAL Liquid Flashing" for additional information and specific requirements.

B. Walls, Parapets, Curbs, Skylights, etc.

- 1. Use continuous deck membrane where feasible as outlined in appropriate Versico Detail.
- 2. When the use of continuous deck membrane for wall flashing is not feasible, a separate piece of Non-Fleece Cured Membrane may be used in accordance with appropriate Versico Detail.
 - When a separate piece of Non-Fleece Cured membrane is used, adhere membrane to the wall or curb with appropriate Bonding Adhesive. Terminate in accordance to the applicable Versico Termination Details.
- 3. When using a separate piece of Non-Fleece membrane for wall flashing should comply with minimum membrane thickness as outlined in Warranty Tables in the appropriate Thermoplastic specifications.

- 4. As an alternative to the use of a separate piece of Non-Fleece Cured Membrane, a separate piece of VersiFleece membrane can be used for wall/curb flashings if a selvage edge is provided.
- 5. At angle changes along walls, curbs, skylights, etc., for warranties up to 20 years, VersiFleece membrane must be adhered in Flexible DASH Adhesive beads placed directly at the angle change and an additional bead spaced a maximum of 3" away from the first bead (at the angle change) see Detail VF-12.1A and VF-12.2A. For warranties over 20 years, mechanical securement of the membrane is required.
- 6. Adhere **VersiFleece** membrane to the wall with **Flexible DASH Adhesive with full spray.** Allow extra time for Flexible DASH Adhesive to gain green strength prior to setting membrane in vertical surface.

NOTE: Splatter Application is not approved for vertical wall attachment.

- a. VersiFleece membrane may be fully adhered with appropriate Bonding Adhesive, however, a coat of bonding adhesive must be first applied to the fleece backing and allowed to dry. Then apply a standard coat of Bonding Adhesive on the wall a second layer over the dried coat of Bonding Adhesive on the fleece membrane, then and allow to properly dry.
- b. VersiFleece membrane may be adhered to vertical surfaces with CAV-GRIP 3V Low-VOC aerosol adhesive. Spray wall and back of the membrane utilizing 50% overlap and 100% coverage.
- 7. When VersiFleece membrane is used as wall/curb flashing, the fleece-backing must be removed along the top edge of the membrane prior to completing compression seal terminations so Water Cut-Off Mastic can be applied directly to the membrane surface. This can be accomplished by applying heat to the fleece until the bottom of the membrane is exposed.
- 8. For corner flashing requirements, refer to the applicable Versico Details included at the end of this section.
- 9. For re-roofing projects where residual asphalt may be present separation must be provided between the asphalt and White Membranes to avoid possible discoloration and permanent staining. Refer to applicable Versico Detail or Versico may be contacted for other recommendations.

C. Metal Edge Terminations

- 1. The width of the perimeter wood nailer to which the metal edge is to be secured must extend beyond the width of the metal edge deck flange.
- 2. All shop fabricated metal must incorporate a continuous cleat (min. 22 ga.) and must be secured at least 6 inches on center. Or as approved by the Specifier, whichever is greater.
- 3. Pre-Manufactured metal edging must be secured to the wood nailer as specified by the respective manufacturer.
- Refer to the appropriate Versico Detail for flashing options and requirements and Design Reference DR-12
 "Metal Edgings" for applicable wind uplift achieved using the various Versico supplied metal.

D. Expansion Joints

At expansion joints, a separate section of VersiFleece membrane installed with the fleece-backing side facing up beneath the field membrane may be required. Refer to the applicable Versico Details for installation requirements.

E. Roof Drains

When the VersiFleece membrane extends into the drain sump/clamping ring, **Fleece-backing must be removed** from the underside of the membrane so Water Cut-Off Mastic can be applied directly to the membrane surface. Apply heat to fleece material until the bottom of the membrane is exposed. As an option, a separate section of Non-Fleece Membrane can be extended into the drain sump. Refer to applicable Versico Details for various flashing options.

Only drain strainers that have been approved by the specifier in accordance with all applicable codes may be used.

F. VersiWeld/VersiFlex Rib Profiles

1. The Rib Profile is recommended for use with VersiFleece TPO and PVC adhered roofing systems.

- 2. The VersiWeld/VersiFlex Rib Profiles should be positioned parallel to the laps of the installed TPO/PVC roofing system and parallel with the roof slope where possible.
- 3. Ensure that all welding surfaces are clean and dry. Inspect all seam areas for proper weld prior to installing VersiWeld/VersiFlex Rib Profile.
- 4. Rib Profile spacing can be individually determined to achieve the desired appearance.
- 5. Connecting multiple ribs is achieved by using fiberglass pins. Insert a pin half-way into the end of one profile. Connect the adjoining rib by inserting the exposed end of the pin into the alignment hole. Repeat previous steps for additional TPO/PVC Rib profiles.
- 6. Consult the VersiWeld or VersiFlex Rib Profile installation guides for instructions on proper installation techniques.

G. Other Penetrations

- 1. Thermoplastic VersiFleece Membrane (TPO/PVC/KEE HP PVC) with Warranties of 20 Year or greater must incorporate Versico supplied pre-fabricated accessories to seal pipes, corners, sealant pockets, etc.
- 2. All Projects, regardless of Warranty Duration, shall incorporate Versico supplied pre-fabricated accessories to seal pipes, corners, sealant pockets, etc., when feasible. When field fabrication is required, the flashing material shall not be less than 60-mils thick.
- 3. For wall and curb flashing, the required thickness shall equal the deck membrane thickness.
- 4. For all membranes, Flexible Penetrations (braided cables, conduits, wires, etc.) must be enclosed in a stable "goose neck".
 - Apply a field fabricated pipe flashing using VersiWeld TPO or VersiFlex PVC non-reinforced flashing to flash the goose neck.
- 5. For pipe clusters or unusually shaped penetrations, a Molded Sealant Pocket must be utilized.
- 6. Hot pipes which exceed 140°F (60°C) (PVC/KEE HP) or 160°F (71°C) (TPO) must be insulated with metal collars and rain hoods and flashed in accordance with appropriate Versico Detail.
- 7. Applicable Versico details shall be utilized. For VersiFleece Fully Adhered Roofing Systems, additional membrane securement around pipes or pourable sealer pockets is not required regardless of size.

3.09 Roof Walkways

Walkways are to be specified at all traffic concentration points (i.e., roof hatches, access doors, rooftop ladders, etc.), and if regular maintenance (once a month or more) is necessary to service rooftop equipment. Refer to Spec Supplement G-05 "Roof Walkway Installation".

3.10 Daily Seal

On phased roofing, when the completion of flashings and terminations is not possible by the end of each workday, provisions must be taken to temporarily close the membrane to prevent water infiltration. Refer to Spec Supplement G-06 "Daily Seal / Clean Up".

Copyright 2025 Versico Roofing Systems

Versico, VersiWeld, VersiFlex, VersiFleece, VersiCore, VersiTrim, DuraFaceR and Flexible DASH Adhesive are Trademarks of Versico Insulfoam, InsulLam, R-Tech by Insulfoam

Thermapink, Foamular and Durapink are Trademarks of Owens Corning

DensDeck, DensDeck Prime and DensDeck StormX Prime are Trademarks of Georgia-Pacific Corporation

Securock is a Trademark of USG

DEXCell is a trademark of National Gypsum

Styrofoam is a Trademark of Dow Chemical Company

Olybond is a Trademark of OMG, Inc.

This specification represents the applicable information available at the time of its publication. Owners, specifiers and Versico authorized Roofing Contractors should consult Versico or their Versico Independent Sales Representative for any information, which has subsequently been made available.

Review the appropriate Versico warranty for specific warranty coverage, terms, conditions and limitations.



VersiFleece TPO/PVC/KEE HP Fully Adhered Roofing System

"Attachment I"

Direct Application Over Lightweight Insulating Concrete

January 2025

When specified, the VersiWeld VersiFleece TPO or VersiFlex VersiFleece PVC/KEE HP membrane may be fully adhered with Flexible DASH Adhesive directly over a new **approved cellular or perlite lightweight insulating concrete** substrate with a **minimum compressive strength of 225 psi**.

Note:

When the use of vermiculite lightweight insulating concrete is specified, Versico must be contacted to determine applicable requirements pertaining to priming, venting and warranty wind speed coverage. Projects where the VersiFleece membrane has been approved over vermiculite will be limited to a wind speed coverage of 55 mph peak gust wind speed unless otherwise approved by Versico.

Note:

Except when the lightweight insulating concrete is poured over slotted steel decks, pressure relief vents must be specified at a minimum rate of 1 every 2000 square feet and shall be installed with each completed section, to provide immediate relief and prevent pressure build-up. Direct Application is not permitted where the lightweight concrete is poured over an existing roofing material.

The Authorized Contractor must provide Versico with a copy of a certification letter from the lightweight insulating concrete manufacturer (on new construction projects), which references the project name and location and contains the manufacturer's brand name, minimum compressive strength, average wet and air dry densities.

The substrate must be dry, free of debris, fins, frost, loose and foreign materials. Fill any gaps in the substrate greater than 1/4" with Flexible DASH Adhesive or other appropriate material.

VersiFleece Membrane - Adhesive Attachment – Up to 20 YR Warranty						
Warranty	Wind One of Occasion	Adhesive Ribbon Spacing				
Duration	Wind Speed Coverage	Field	Perimeter			
	55 MPH	12" O.C.	6" O.C.			
15 YR Warranty	72 MPH	6" O.C.	6" O.C.			
-	80 MPH	FS	FS			
	55 MPH	6" O.C.	6" O.C.			
20 YR Warranty	72 MPH	6" O.C.	4" O.C.			
-	80 MPH	FS	FS			
FS = Full Spray, Equipment (Rig) Splatter or Ribbons @ 4" O.C.						

Application Cautions

- 1. Do not proceed with membrane installation until the lightweight insulating concrete has cured a minimum of 48 hours. If necessary, consult with the lightweight insulating concrete manufacturer concerning additional drying time.
- 2. After rain or other precipitation, follow the manufacturer's requirements concerning proper visual inspection and additional drying time prior to adhering the membrane.
- 3. Prior to membrane installation, darker areas, especially along hairline cracks in the concrete, may serve as an indication of moisture entrapment and possible standing water beneath the surface. If this condition is found, consult with the lightweight insulating concrete manufacturer for proper corrective measures.

- 4. Except when lightweight insulating concrete is poured over slotted steel decks, the roofing contractor must conduct core cuts at the minimum rate of 1 every 2,000 square feet. The core cuts should be located around hairline cracks (if present) where darker areas are visible. After core cuts have been taken, the substrate must be examined for evidence of moisture above the structural deck and, if found, a wet/dry vacuum system, as recommended by the lightweight insulating concrete manufacturer, must be utilized to remove standing water from beneath the surface of the concrete.
 - a) To ensure the efficient operation of the vacuum system, a tight seal must be provided between the nozzle of the vacuum and the lightweight concrete substrate.
 - b) A one-way pressure relief vent, approved by Versico, must be installed over each core cut in accordance with applicable Versico Details. Contact Versico for approved pressure relief vents.

END OF ATTACHMENT



VersiFleece TPO/PVC/KEE HP Mechanically Attached Roofing System

"Attachment II"

Mechanically Attached Membrane Option

January 2025

General Considerations

- A. As an option to fully adhering the VersiFleece Membrane (TPO with polyester reinforcing and PVC/KEE HP with fiberglass reinforcement) with Flexible DASH Adhesive, the membrane may be loose laid and mechanically attached over an approved substrate to an acceptable deck (minimum 22 ga. steel deck or wood decks) using HPVX Fasteners and HPVX Plates as described in Table I & II of this attachment.
- B. **Any Versico approved insulation or cover board** included in the Thermoplastic Specification, approved for Mechanically Attached Assemblies, may be used as part of the roofing assembly.
- C. The approved insulation/cover board shall be mechanically attached to the roof deck at the minimum rate of **1 fastener and plate per every 8 square feet** (4 fasteners in a 4 x 8 board) for warranties up to 15 year. Projects with 20 year warranties require the use of 6 fasteners and plates in a 4' x 8' board (1 per 5.333 square feet).

CAUTION: Versico Polyisocyanurate Insulation with a thickness less than 1.5" installed over an existing roofing membrane without a tear-off must be mechanically attached to the roof deck with a minimum of 1 fastener and plate for every 4 square feet or less of insulation. Refer to Thermoplastic Mechanically Attached Specification for Specific Cautions, Warnings and other membrane/insulation fastening options.

D. Use of DensDeck, DensDeck Prime and DensDeck StormX Prime should be limited to assemblies with slopes greater than 2" per foot to ensure compliance with external fire codes, care shall be exercised to ensure polymer plates are fully seated. DensDeck, DensDeck Prime and DensDeck StormX Prime are not approved in re-roofing applications for use directly over existing roofing membranes. Not for use directly over lightweight insulating concrete substrates in either new construction or re-roofing applications/tear-off.

Submittals

- A. In addition to the Submittal requirements outlined in Paragraph 1.04 of the main specification, for mechanically attached systems shop drawings must include:
 - 1. Sheet width and number of perimeter sheets
 - 2. Versico Fastener type, length and maximum spacing (for membrane securement).
- B. Along with project submittals (shop drawing and Request for Warranty), the roofing contractor must include pullout test results when the results are below the requirements identified in the Table included in Design Reference DR-06 "Withdrawal Resistance Criteria".

Warranty

A. Projects meeting the conditions below can be eligible for a maximum 15 year System Warranty with wind speed coverage up to 72 mph peak gusts. Projects requiring extended wind speed coverage or a 20-year System warranty must be submitted to Versico for review prior to installation.

Table I	Table I VersiFleece TPO/PVC/KEE HP Membrane Fastening Criteria for Mechanically Attached Roofing Systems						
		2	2 GA. Stee	el Deck Or	ıly		
Peak		Min. Number of Perimeter Sheets				*Fastening	
Gust Wind	Membrane	Max. Building	Building Distance from Coastline		Field Membrane	Perimeter Sheet	Density (Field &
Speed Type Warranty		Height	Greater than 7 miles	Less than or equal to 7 miles	Width	Width	Perimeter Sheets)
55 MPH	TPO	Up to 50'	1	2	12'	6'	12" O.C.
55 IVIPI	PVC	Up to 40'	1	2	10'	5'	12 0.0.
72 MPH	TPO	Up to 50'	2	2	12'	6'	12" O.C.
12 WIFT	PVC	Up to 40'	2	2	10'	5'	12 0.0.

^{*}TPO or PVC or KEE HP PVC using HPVX Fasteners and HPVX Plates.

Table II	Table II VersiFleece TPO/PVC/KEE HP Membrane Fastening Criteria for Mechanically Attached Roofing Systems Wood Decks							
Peak					mber of er Sheets			Fastening Density (Field & Perimeter Sheets)
Gust	Deck Type	Projected Pull-Out	Membrane		Distance oastline	Field Membrane	Perimeter Sheet	
Speed Warranty	, , , , , , , , , , , , , , , , , , ,	Values	Туре	Greater than 7 miles	Less than or equal to 7 miles	Width	Width	
	7/16" OSB* or 15/32" 3-Ply	210 lbs* (OSB) or	ТРО	2	3	12'	6'	12" O.C.*
55 MPH	Plywood or 5/8" OSB	240 lbs (3- Ply) or 310lbs (OSB)	PVC	2	3	10'	5'	12 O.G.
	15/32" 5-Ply	530 lbs	TPO	1	2	12'	6'	12" O.C.
	Plywood	330 lbs	PVC	1	2	10'	5'	12 0.0.
72 MPH	15/32" 5-Ply	530 lbs	TPO	2	3	12'	6'	12" O.C.
7 Z IVIT IT	Plywood	200 ID2	PVC	2	3	10'	5'	12 0.0.

^{*}Fastening Density for Field and Perimeter Sheets is 9" o.c. when fastening to 7/16" OSB with minimum pullout of 210lbs.

Roof Deck and Substrate Criteria

A. The following table identifies the acceptable roof decks/substrates and the minimum underlayment requirements:

Roof Deck & Substrate Criteria for Mechanically Attached Roofing Systems

Acceptable Roof Deck/Substrate	VCISII ICCCC		VersiFleece FRS PVC Membrane	VersiFleece KEE HP Membrane		
NEW CONSTRUCTION						
Steel (min. 22 gauge)(1)(2)	Insulation	Insulation	Insulation	Insulation		
Plywood (min. 15/32" thick) or Oriented Strand Board (min. 7/16" thick)	Direct Application	Direct Application	Direct Application	Direct Application		
Wood Planks (minimum 3/4" thick)	Direct Application	Direct Application	Direct Application	Direct Application		
Lightweight Insulating Concrete	Direct Application	Direct Application	Direct Application	Direct Application		
RETROFIT / NO TEAR-OFF						
Existing Smooth Surface BUR (7) or Mineral Surface Cap Sheet	Direct Application (10)(11)	Direct Application (11)	Direct Application (8)(9)	Direct Application (9)(11)		
Gravel Surfaced BUR (3)(4)	Insulation	Insulation	Insulation	Insulation		
Coal Tar Pitch (4)	Insulation (4)	Insulation (4)	Insulation (4)	Insulation (4)		
Modified Bitumen (6)	Direct Application	Direct Application (6)	Direct Application	Direct Application		
Existing Single-Ply	Direct Application (5)	Direct Application (5)	Direct Application (5)	Direct Application (5)		
		RETROFIT / 1	EAR-OFF			
Existing roof material removed (steel or wood decks)	Insulation	Insulation	Insulation	Insulation		

Notes:

- (1) Local codes must be consulted regarding thermal barrier requirements.
- (2) Mechanically Attached Systems cannot be specified on steel decks less than 22 gauge or for corrugated steel decks, regardless of gauge.
- (3) Loose gravel must be removed to avoid moisture entrapment.
- (4) Existing coal tar could drip back into the building, especially when new insulation does not provide sufficient thermal value to prevent the surface of the coal tar from softening.
- (5) An approved Insulation / Underlayment is required over existing ballasted single-ply systems and PVC roofing systems of any type.
- (6) Direct application permitted over smooth surfaced modified bitumen. Membrane shall be positioned with length of sheets parallel to modified bitumen field seams. At end laps or other locations where splices intersect modified bitumen field seams. Refer to VersiFleece specification and applicable Versico Details.
- (7) Existing Type III or IV smooth asphalt BUR only.
- (8) Possible staining/discoloration of the white membrane may result when installing this system directly over existing smooth surfaced BUR or modified bitumen, especially along the selvage edge where fleece backing is not present. If aesthetics are critical, an approved insulation should be specified beneath the membrane.
- (9) Direct application for VersiFleece KEE HP Only. VersiFleece PVC requires insulation.
- (10) Mechanically Fastened Systems (VersiGard (black) may be applied directly to the substrate providing asphalt on existing smooth surfaced built-up roof has a softening point above 185°F (85°C).
- (11) Existing Type III or IV smooth asphalt BUR Only.

This page intentionally blank



VersiFleece FR TPO Mechanically Attached Roofing System

"Attachment III"

January 2025

General Considerations

- A. A UL Class A roof assembly can be achieved without the use of a coverboard over combustible decks by utilizing the VersiFleece FR TPO, 115-mil white, membrane, available in 5' or 10' wide by 50' or 100' long. This roof assembly is loose laid and mechanically fastened over a combustible deck with Versico HPVX Fasteners and HPVX Plates positioned along the centerline of the 10'-wide sheets as follows:
 - 1. Adjoining sheets of VersiFleece FR TPO are overlapped approximately 5½" along the length of the membrane (at the selvage edge) where fastening plates will be located.
 - **Note:** To qualify for Versico's 2" hail coverage warranty, adjoin the two VersiFleece FR TPO sheets by overlapping approximately 9" to ensure the fastening plates are covered by the FR fleece. The fleece portion of the membrane must extend a minimum of 3/4" past the edge of the plate.
 - At end laps (along the width of the sheet), membranes shall be butted together which will be overlaid with minimum 6"-wide VersiWeld reinforced membrane hot-air welded on all edges. Cut edges of TPO membrane shall be sealed with TPO cut edge sealant.
- B. The membrane shall be secured around the building perimeter using either 5' wide sheets of VersiFleece FR TPO or additional rows of HPVX Fasteners and HPVX Plates positioned along the centerline of the 10'-wide sheets as follows:
 - 1. VersiWeld Pressure-Sensitive Cover strip (in conjunction with TPO Primer) or a minimum 6"-wide VersiWeld Reinforced membrane (hot-air welded) used to overlay the fasteners and plates. Cut edges of TPO membrane shall be sealed with TPO cut edge sealant.
 - Note: Projects, where a 20-year Warranty is specified, must utilize a minimum 6"-wide VersiWeld Reinforced membrane (hot-air welded) used to overlay the fasteners and plates.

Submittals

- A. In addition to the Submittal requirements outlined in Paragraph 1.04 of the main specification, for mechanically fastened systems shop drawings must include the number of perimeter sheets.
- B. Along with project submittals (shop drawing and Request for Warranty), the roofing contractor must include pullout test results when the results are below the requirements identified in Table I.

Warranty

Projects meeting the conditions outlined in Table I can be eligible for a maximum 20 year System Warranty with wind speed coverage up to 72 mph peak gusts. Projects requiring extended wind speed coverage must be submitted to Versico for review prior to installation.

Table I	Table I VersiFleece FR TPO Membrane Fastening Criteria for Wood Decks							
	Perimeter Sheets		Min. Number of Perimeter Sheets			_ , .		
Peak Gust Wind	Dook Type	Projected Pull-	Membrane	Building Distance from Coastline		Field Membrane	Perimeter Sheet	Fastening Density
Speed Warranty	Deck Type	Out Values	Туре	Greater than 7 miles	Less than or equal to 7 miles	Width	Width	(Field & Perimeter Sheets)
55 MPH	7/16" OSB* or 15/32" 3-Ply Plywood or 5/8" OSB	210 lbs* (OSB) or 240 lbs (3-Ply) or 310lbs (OSB)	FR TPO	2	3	10'	5'	12" O.C. *
	15/32" 5-Ply Plywood	530 lbs	FR TPO	1	2	10'	5'	12" O.C.
72 MPH	15/32" 5-Ply Plywood	530 lbs	FR TPO	2	3	10'	5'	12" O.C.

^{*}Fastening Density for Field and Perimeter Sheets is 9" o.c. when fastening to 7/16" OSB with minimum pullout of 210lbs.

Roof Deck and Substrate Criteria

The following table identifies the acceptable roof decks/substrates and the minimum underlayment requirements:

Roof Deck & Substrate Criteria for Mechanically Fastened Roofing Systems


Acceptable Roof Deck/Substrate	VersiFleece FR TPO Membrane				
NEW CONSTRUCTION					
Plywood (min. 15/32" thick) or Oriented Strand Board (min. 7/16" thick)	Direct Application				
Wood Planks (minimum 3/4" thick)	Direct Application				
RE ⁻	TROFIT / TEAR-OFF				
Existing roof material removed (wood decks)	Direct Application with some limitations*				

^{*} For direct application over an acceptable roof deck/substrate, the substrate must be smooth, free of debris, protrusions, sharp edges and loose and foreign material. Cracks or voids in the substrate, greater than 1/4", must be filled with an appropriate material. Protruding nails or screws shall be removed and replaced with threaded screw-type fasteners.


Associated Installation Details

Direct Application Over Wood Deck	VFFR-2.1
Cricket or Saddle Covered with Standard TYPO Membrane	VFFR-2.2
Roof Drain for VersiFleece FR TPO Membrane	VFFR-6.1
VersiFleece FR TPO – Insert Drain Through Deck	VFFR-6.2

END OF ATTACHMENT

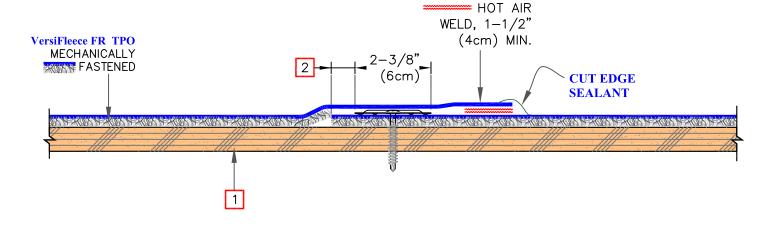


DETAIL A (TYPICAL SEAM)

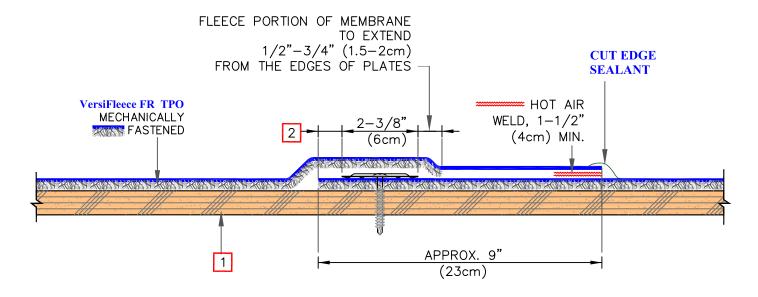


DETAIL B (SEAM FOR OBTAINING HAIL WARRANTY COVERAGE)

NOTES:


- 1. COMBUSTIBLE DECK, MAX. SLOPE 1/4" PER FOOT PLYWOOD SHOWN. ON EXISTING DECKS, REMOVE PROTRUDING NAILS/FASTENERS AND REPLACE WITH NEW THREADED FASTENERS.
- 2. PLATE EDGES 1/2"-3/4" (1.5-2cm) FROM THE EDGE OF MEMBRANE.




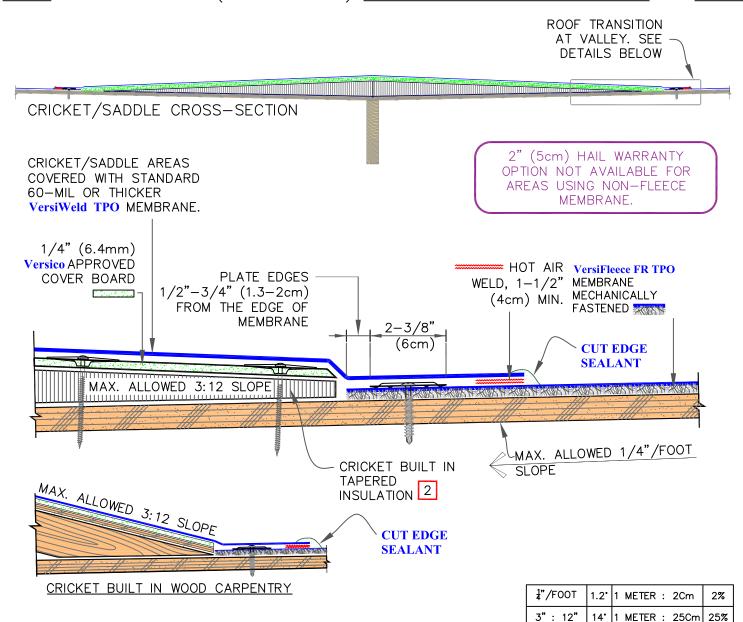

NOTES:

- 1. SEE <u>INSET A</u> TO FURTHER ENHANCE THE FIRE PROTECTION, (OPTIONAL).
- 2. POLYISOCYANURATE OR EXPANDED POLYSTYRENE BOARDS. SEE GRAPHIC EXAMPLE BELOW FOR SLOPE RATIO.

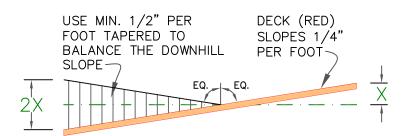






CRICKET OR SADDLE COVERED WITH STANDARD TPO MEMBRANE THIRITIFIET → VERSIFLEECE FR TPO MEMBRANE

→ APPROVED ADHESIVE
→ APPROVED SUBSTRATE

O → SEE NOTE(S)


FR (FIRE RATED)

VFFR-2.2

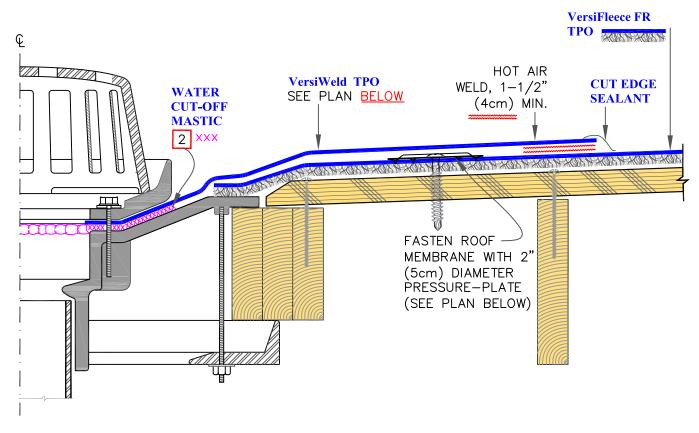


NOTES:

- 1. ROOF DRAIN SIZE AND NUMBER OF DRAINS SHALL BE IN ACCORDANCE WITH THE LOCAL CODES.
- 2. ALL BOLTS OR CLAMPS MUST BE IN PLACE TO PROVIDE CONSTANT COMPRESSION ON WATER CUT-OFF MASTIC.
- 3. THE HOLE IN THE MEMBRANE SHALL EXCEED THE DIAMETER OF THE DRAIN PIPE, BUT SHALL BE NO LESS THAN 1/2" (1.5cm) FROM THE ATTACHMENT POINTS OF THE DRAIN CLAMPING RING.
- 4. APPROXIMATELY 1/8" (3mm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES O REINFORCED TPO MEMBRANE.

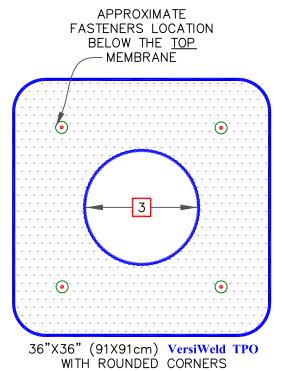



ROOF DRAIN FOR VersiFleece FR TPO MEMBRANE




→ APPROVED SUBSTRATE

O → SEE NOTE(S)


FR (FIRE RATED)

VFFR-6.

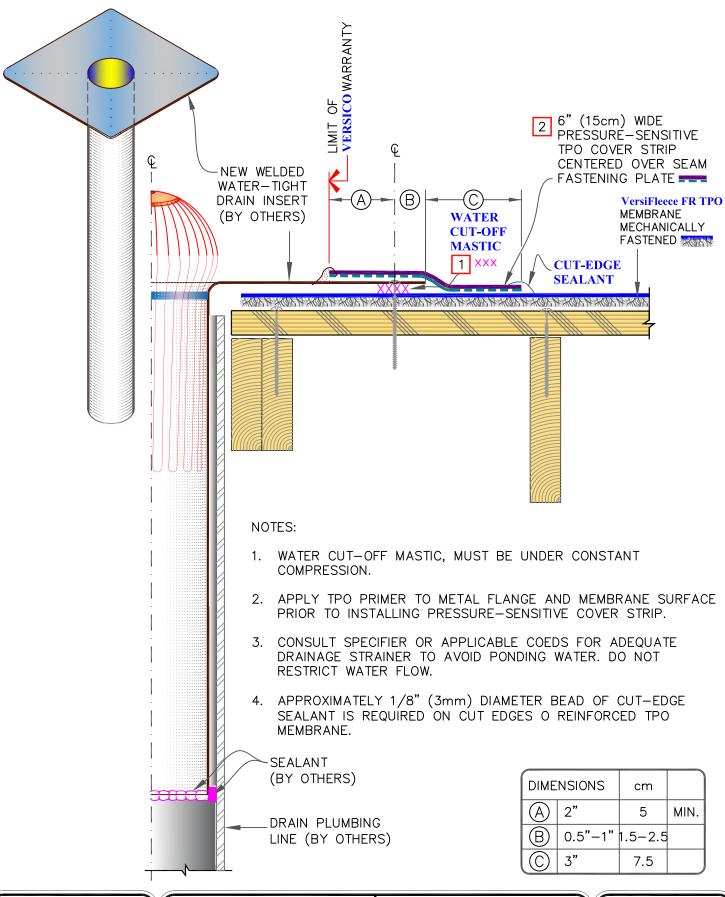



VersiFleece FR — INSERT DRAIN THROUGH DECK



O → SEE NOTE(S)

FR (FIRE RATED)

VFFR-6.2



VersiFleece RL EPDM/TPO/PVC/KEE HP RapidLock Roofing System

"Attachment IV"

January 2025

General Considerations

This system utilizes VersiFleece RL EPDM, TPO or PVC membrane attached with Velcro® Brand Securable Solutions to either VersiCore RL Polyiso, SecurShield RL Polyiso or SecurShield HD RL Cover Board resulting in a fully adhered membrane without the use of adhesives. Available in 115-mil thick EPDM (black) or TPO (white, gray or tan) or PVC (white) in 10' wide by 50' or 100' length rolls. The VersiFleece RL EPDM membrane is manufactured with 3" Factory-Applied Tape. VersiFleece RL EPDM, TPO and PVC membranes have a factory-applied release liner to aid in installation. The VersiFleece RL TPO 115-mil membrane is available with APEEL Protective film in white, tan or gray and 10' wide by 100' long rolls.

Warranty

Projects meeting the conditions below can be eligible for a maximum 20 year Membrane System Warranty with wind speed coverage up to 90 mph peak gusts. Projects requiring extended wind speed coverage warranty must be submitted to Versico for review prior to installation.

NOTE: See Tables Below for information regarding Warranted Systems and Design Criteria.

Table I **VersiFleece RL Adhered Systems Warranty Options**

.,			nty Wind	d Speed	Additional Hail Coverage(4)		
Years	Minimum Membrane Thickness	55, 72 or 80 mph	90 or 100 mph	110 or 120 mph	1" Dia. Hail	2" Dia. Hail	3" Dia. Hail
5,10, or 15 year	VersiFleece RL EPDM 115-mil (1) or VersiFleece RL TPO 115-mil or VersiFleece RL PVC 115-mil	$\sqrt{}$	\checkmark	$\sqrt{}$	\checkmark	\checkmark	N/A
20 year	VersiFleece RL EPDM 115-mil (1) or VersiFleece RL TPO 115-mil or VersiFleece RL PVC 115-mil	$\sqrt{}$	$\sqrt{}$	$\sqrt{}$	V	$\sqrt{}$	N/A
	VersiFleece RL EPDM 115-mil (2)	$\sqrt{}$	$\sqrt{}$	√	$\sqrt{}$	√	$\sqrt{}$
25 year	VersiFleece RL EPDM 145-mil (2)	√	√	√	√	\checkmark	V
	VersiFleece RL TPO 135-mil		$\sqrt{}$	\checkmark	$\sqrt{}$	$\sqrt{}$	$\sqrt{}$
	VersiFleece RL PVC 135-mil	$\sqrt{}$	$\sqrt{}$	$\sqrt{}$	$\sqrt{}$	$\sqrt{}$	$\sqrt{}$
	VersiFleece RL EPDM 145-mil (2)	$\sqrt{}$	$\sqrt{}$	$\sqrt{}$	$\sqrt{}$	\checkmark	$\sqrt{}$
30 year	VersiFleece RL PVC 135-mil	$\sqrt{}$	$\sqrt{}$	V	$\sqrt{}$	√	$\sqrt{}$
	VersiFleece RL TPO 135-mil	√	$\sqrt{}$	$\sqrt{}$	V	√	

Notes: N/A = Not Acceptable √= Acceptable

⁽¹⁾ Using 3" Factory-Applied Tape (FAT)(2) Using 6" Factory-Applied Tape (FAT)

Table II Underlayment/Insulation & Required Attachment Assemblies Up to 20 YR Warranty

Other Requirements are Listed in Additional Design Considerations following this Table

All Versico Products listed for higher wind speed coverage can also be used for Warranties with lesser speed coverage.

(i.e. 72 MPH underlayment may be used for 55 MPH underlayment)

	·	Insulation/Und	erlayment Atta	chment	
Peak Gust Wind Speed Warranty	Minimum Membrane Underlayment (Versico Supplied Only)	# of Fasteners per 4' x 8' board	Adhesive Ribbon Spacing for 4' x 4' and 4' x 8' size board (9)		Metal Edging
warranty		size (1)	Field	Perimeter	
	1/2 SecurShield HD RL (2)	12			
	2" VersiCore RL				Versico Drip Edge,
55 or 72 MPH	2.6" VersiCore RL	8	6" (4)	6" (4)	SecurEdge 200 or
WIPH	2" SecurShield Polyiso RL	0	, ,	` ,	300
	2.6" SecurShield Polyiso RL				
	1/2 SecurShield HD RL (2)	16			Versico Drip Edge,
80 MPH	2" SecurShield Polyiso RL	8	6" (4)	6" (4)	SecurEdge 200 or
	2.6" SecurShield Polyiso RL	0			300 (8)
	1/2" SecurShield HD RL (2)	16			Versico Drip Edge
90 MPH	2" SecurShield Polyiso RL	8	6" (7)	6" (7)	(3), SecurEdge 2000
	2.6" SecurShield Polyiso RL	8			or 3000.
400 MDL:	2" SecurShield Polyiso RL	40	F0.	FC	Versico Drip Edge
100 MPH	2.6" SecurShield Polyiso RL	16	FS	FS	(3), SecurEdge 2000 or 3000.
110 or 120 MPH	1/2" SecurShield HD RL (2)	Not Acceptable	FS	FS	SecurEdge 2000 or 3000

FS = Full Spray, Equipment (Rig) Splatter or Ribbons @ 4" O.C.

- (1) For Building heights between 51-100', enhance 12'-wide perimeter with 50% more fasteners and plates. Cannot exceed 24 fasteners per board.
- (2) Cover boards must be installed over a min. 1" thick approved Versico Insulation.
- (3) Versico HP or HP-X Fasteners must be used to secure Versico Drip Edge or SecurEdge 200 Metal Fascia to perimeter wood nailers.
- (4) Gravel Surface BUR Field @ 6" O.C. / Perimeter @ 4" O.C
- (5) Steel Decks Field & Perimeter @ 6" O.C.
- (6) Smooth BUR Field @ 6" O.C. / Perimeter @ 4" O.C
- (7) Gravel Surface BUR FS
- (8) May be fastened with ring shank nails staggered 4" on center. Versico HP or HP-X™ Fasteners may also be used fastened 12" on center.
- (9) Maximum 4' x 4' insulation boards when the adhesive is extruded at 12" o.c. or when boards exceed 4" thickness. 4' x 8'
- insulation boards may be used when the adhesive is applied at Full-Spray, Equipment (Rig) Splatter, 4", or 6" beads).

Additional Design Considerations (Up to 20 YR Warranty)

(Required in conjunction with Table II)

- A Building height shall not exceed 100 foot*
- B Local Wind Zone per ASCE 7 shall not exceed 130 mph*
- C Acceptable decking: 22-gauge or heavier steel, structural concrete, 1-1/2" wood plank, or 15/32" plywood.
- D All "T-joints" must be overlaid with appropriate flashing material
- * For projects where building height exceeds 100' or wind speed exceeds 130 mph, please submit to Versico for review.

Table III Underlayment/Insulation & Required Attachment Assemblies 25 YR or 30 YR Warranty

Other Requirements are Listed in Additional Design Considerations following this Table.

All Versico Products listed for higher wind speed coverage can also be used for Warranties for a lower speed coverage. (i.e. 72 MPH underlayment may be used for 55 MPH underlayment)

		Insula	ation Attachm		
Peak Gust Wind Speed	Minimum Membrane Underlayment	# of Fasteners per 4' x 8'	Adhesive Spacing for boo	4' x 8' size	Metal Edging
Warranty		board size (1)	Field	Perimeter	
	2" SecurShield Polyiso RL	20		-	Versico Drip Edge,
55 or 72	2.6" SecurShield Polyiso RL	20	6" (3)	6"	SecurEdge 200 or 300
МРН	1/2" SecurShield HD RL (1) (2)(7)				(5)
	2" SecurShield Polyiso RL			6"	Versico Drip Edge (4),
80 MPH	2.6" SecurShield Polyiso RL	20	6"		SecurEdge 200 or 300(4) or SecurEdge
	1/2" SecurShield HD RL (2)(7)				2000 or 3000.
90 MPH	1/2" SecurShield HD RL (1) (2)(7)	24	FS	FS	SecurEdge 2000 or 3000
100 or 120 MPH	1/2" SecurShield HD RL (2)	Not Acceptable	FS	FS	SecurEdge 2000 or 3000

FS = Full Spray, Equipment (Rig) Splatter or Ribbons @ 4" O.C.

- (1) For Building heights between 51-100', enhance 12'-wide perimeter with 50% more fasteners and plates. Cannot exceed 24 fasteners per board.
- (2) Hail coverage offered with substrate.
- (3) Structural Concrete Field @ 12" O.C. / Perimeter @ 6" O.C.
- (4) 80-mph over structural concrete Field & Perimeter @ 6" O.C.
- (5) May be fastened with ring shank nails staggered 4" on center. Versico HP or HP-X Fasteners may also be used fastened 12" on center.
- (6) Gravel Surface BUR Field @ 6" O.C. / Perimeter @ 4" O.C.
- (7) 1/2" SecurShield HD limited to 90 mph.

Additional Design Considerations (25 YR or 30 YR Warranty) (Required in conjunction with Table III)

- A Minimum membrane thickness of 145-mil FleeceBACK RL EPDM, 135-mil FleeceBACK RLTPO or RL PVC, Maximum 25-year warranty for FleeceBACK RL PVC
- B Building height shall not exceed 100 foot *
- C 1/4" per horizontal foot slope is preferred; however, 1/8" slope with sufficient number of drains and crickets / saddles may be accepted.
- D Local Wind Zone per ASCE 7 shall not exceed 130 mph*
- E Acceptable decking: 22-gauge or heavier steel, structural concrete, 1-1/2" wood plank, or 15/32" plywood.
- F All "T-joints" must be overlaid with appropriate flashing material.
- G Two layers of insulation with staggered joints, bottom layer must be a minimum 1-1/2" (20-psi) Polyisocyanurate.
- H New construction or complete tear-off of existing roofing material.
- *For projects where building height exceeds 100" or wind speeds exceeds 100 mph, please submit to Versico for review.

Table IV Minimum Perimeter Width For Adhered Insulation Attachment

Width of Perimeter	Building Height
4 feet	25 feet
8 feet	26 to 50 feet
12 feet	51 to 75 feet
16 feet	76 to 100 feet
24 feet	Greater than 100 feet

Note: This Table is for reference for Versico System Warranties and does not replace FM requirements for FM insured projects.

Insulation/Underlayments

- A. Versico VersiCore RL (RapidLock) Polyisocyanurate A foam core insulation board covered on both sides with a glass fiber-reinforced felt facer (GRF) meeting ASTM C 1289, Type II, Class 1, Grade 2 (20 psi). The product is available in 4' x 8' standard size with a thickness of 2.0 inch and 2.6 inch. VersiCore RL has an additional "hook" facer to be used with the "loop" fleece of the VersiFleece RL membrane.
- B. Versico SecurShield RL (RapidLock) Polyisocyanurate A foam core insulation board covered on both sides with a premium coated glass facer (CGF) meeting ASTM C 1289, Type II, Class 2, Grade 2 (20 psi). The product is available in 4' x 8' standard size with a thickness of 2.0 inch and 2.6 inch. SecurShield RL has an additional "hook" facer to be used with the "loop" fleece of the VersiFleece RL membrane.
- C. Versico SecurShield HD RL Cover Board— a rigid insulation panel composed of a high-density, closed-cell polyisocyanurate foam core laminated to moisture resistant coated-glass fiber-mat facer for use as a cover board or recover board meeting ASTM 1289, Type II, Class 4, Grade 1 (80 psi). Available 1/2" thick 4' x 8' panel weight 11 lbs with an R-value of 2.5. SecurShield HD RL has an additional "hook" facer to be used with the "loop" fleece of the VersiFleece RI membrane.
- D. Versico SecurShield HD Composite RL Polyiso a rigid roof insulation panel composed of a top layer of high-density, closed cell foam, and a bottom layer of 20 psi closed cell foam. Both layers are laminated to a coated glass facer. SecurShield HD Composite RL has an additional "hook" facer to be used with the "loop" fleece of the FleeceBACK RL membrane; May be used as a cover board in compliance with ASTM C1289 Type II, Class 4, Grade 1 (109 psi max.) or as base insulation meeting ASTM C1289 Type II, Class 2, Grade 2 (20 psi). The product is available in 47.5" x 95.5" (1206 mm x 2425 mm) and 47.5" x 47.5" (1206 mm x 1206 mm) in 2" to 4.0" thickness in .5" increments.

Insulation Installation

- A. Insulation Attachment (Mechanically Fastened) RapidLock insulation is mechanically fastened to the roof deck per Paragraph 3.04 of this VersiFleece specification.
- B. Insulation Attachment (Adhered) RapidLock insulation is adhered with Flexible DASH Adhesive to the roof deck. When adhering insulation with Flexible DASH, the adhesive is spray-applied or extruded onto the substrate and allowed to rise and foam. Once the adhesive develops string/body/gel (approximately 2 minutes depending on climate), place insulation into the adhesive and walk board into place. Roll the insulation with 30" wide, 150-pound weighted segmented steel roller to ensure full embedment.

NOTE: Assemblies with multiple layers of insulation may incorporate both methods by fastening the bottom layer(s) and adhering the top layer.

Membrane Installation

A. Membrane Attachment –
Prior to membrane placement, the surface of the RapidLock insulation must be cleaned of dust and other foreign

matter using a fine push broom or a blower.

B. Option 1

- 1. Remove the RapidLock fleece release film on one half of the sheet starting from the split in the liner at the middle of the sheet. The liner should be removed at an angle to reduce splitting or tearing.
- 2. Roll the membrane onto the substrate at an angle while avoiding wrinkles. When applying the VersiFleece RL EPDM, TPO, or PVC membrane, it is recommended to maintain a large curve (radius) on the leading edge of the membrane. This will help eliminate creases and bubbles that cannot be removed after the sheet is in place.
- 3. Broom the sheet and then roll the membrane in place starting using a 30" wide, 150-pound weighted segmented steel roller from the middle of the 10'-0" wide sheet and working towards the outer edge.
- 4. Fold back the remaining half of the sheet and repeat the above process.

C. Option 2

- 1. Pull both release liners off simultaneously from underneath the membrane at a low angle.
- 2. Broom the sheet and then roll the membrane in place starting using a 150-lb weighted segmented steel roller from the middle of the 10'-0" wide sheet and working towards the outer edge.

D. Membrane Splicing - VersiFleece RL EPDM

- To complete seams between two adjoining membrane panels, apply primer to the splice area in conjunction with Versico's Quick Applied Seam Tape.
- 2. Strip-in end laps with 6" Quick Applied Overlayment Strip or Quick Applied Cured Cover Strip.
- 3. Roller-apply V-150 Primer or Low-VOC EPDM Primer to the splice area of the bottom sheet with a short-naplength paint roller. The primed area shall be free of globs and puddles. Allow primer to dry until it does not transfer to a dry finger.
- 4. Allow the taped edge of the top sheet to fall freely onto the primed sheet below.
- 5. Pull the poly backing from the Quick Applied Seam Tape beneath the top sheet and allow the top sheet to fall freely onto the exposed primed surface.
- 6. Press top sheet onto bottom sheet using firm, even hand pressure across the splice and toward the splice edge.
- Immediately roll the splice with a 2"-wide (50 mm) steel roller or Versico's Stand-Up Seam Roller, using
 positive pressure. Roll across the splice edge when using a 2" roller, not parallel to it. When using the StandUp Seam Roller, roll parallel to direction of the splice.
- 8. For cold-weather splicing below 40°F (4°C), these steps must be followed:
 - a. Heat the primed area of the bottom membrane with a hot-air gun as the top sheet with Factory-Applied Tape is applied and pressed into place.
 - b. Prior to rolling the splice area with a 2"-wide steel hand roller, apply heat to the top side of the membrane with a hot-air gun. The heated surface should be hot to the touch. Be careful not to burn or blister the membrane.
- Install Quick Applied Uncured Flashing or Quick Applied T-Joint Covers over all field splice intersections. Apply Lap Sealant according to appropriate detail.

E. TPO Membrane Splicing using Heat-Welding - VersiFleece RL TPO

- 1. Refer to the paragraph 3.06 of this VersiFleece specification for typical heat welding procedures.
- 2. The membrane has an uncoated edge on one side along the length of the sheet for membrane welding. Adjoining membrane sheets are overlapped lengthwise a minimum of 2" to provide for a minimum 1-1/2" wide heat weld. It is recommended that all splices be shingled to avoid bucking of water.
- 3. An uncoated edge is not provided at the ends of the rolls. Adjoining membrane sheets must be butted together and overlaid with 6"- wide TPO Reinforced Membrane, hot-air welded along all edges. Seal all membrane edges (where scrim reinforcement is exposed) with TPO Cut-Edge Sealant.

F. PVC Membrane Splicing using Heat-Welding – VersiFleece RL PVC

- 1. Refer to the paragraph 3.06 of this VersiFleece specification for typical heat welding procedures.
- 2. The membrane has an uncoated edge on one side along the length of the sheet for membrane welding. Adjoining membrane sheets are overlapped lengthwise a minimum of 2" to provide for a minimum 1-1/2" wide heat weld. It is recommended that all splices be shingled to avoid bucking of water.


3. An uncoated edge is not provided at the ends of the rolls. Adjoining membrane sheets must be butted together and overlaid with 6"- wide PVC Reinforced Membrane, and hot-air welded along all edges. PVC Cut-Edge Sealant is not required on cut edges of VersiFlex membrane.

Associated Installation Details

EPDM RL (RapidLock) Membrane Splices	RL-2.1
EPDM RL (RapidLock) Membrane Splice (145-mil; 25 and 30-YEAR WARRANTY)	
PVC/TPO RL (RapidLock) Membrane Splices	RL-2.2A
EPDM RL (RapidLock) Roof Drain	RL-6A.1
EPDM RL (RapidLock) Roof Drain with Target Patch	RL-6B.1
EPDM RL (RapidLock) Parapet/Curb Flashing with No Adhesive	RL-12A.1A
EPDM RL (RapidLock) Parapet/Curb Flashing with CAV-GRIP 3V (Page 1 of 2)	RL-12A.1B
EPDM RL (RapidLock) Parapet/Curb Flashing with CAV-GRIP 3V (Page 2 of 2)	RL-12A.1C
PVC/TPO RL (RapidLock) Parapet/Curb Flashing with No Adhesive	RL-12B.1A
PVC/TPO RL (RapidLock) Parapet/Curb Flashing with CAV-GRIP 3V Adhesive on Wall	RL-12B.1B

Velcro is a Trademark of Velcro BVBA

END OF ATTACHMENT

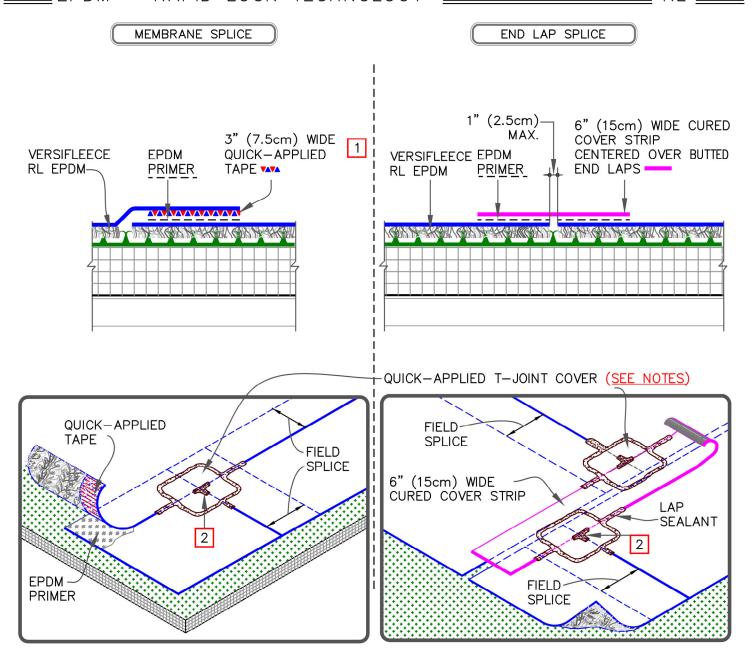


NOTES:

- 1. APPLY EPDM PRIMER TO MEMBRANE SURFACES PRIOR TO INSTALLING QUICK-APPLIED FLASHING AND/OR QUICK-APPLIED SEAM TAPE.
- 2. APPLY LAP SEALANT ALONG THE EDGE OF THE MEMBRANE SPLICE (UNDER THE 6"x6" (15x15cm) T-JOINT COVER) COVERING THE EXPOSED SPLICE TAPE 1/2" (1.5cm) IN EACH DIRECTION FROM THE SPLICE INTERSECTION.
- 3. 6" (15cm) QUICK-APPLIED UNCURED EPDM FLASHING MAY ALSO BE CENTERED OVER THE FIELD SPLICE INTERSECTION.


*RAPID LOCK TECHNOLOGY IS MAGNIFIED ON SCALE



RL[™] EPDM (RAPID LOCK) MEMBRANE SPLICE-PROJECTS WITH 10, 15 AND 20 YEAR WARRANTIES




RAPID LOCK

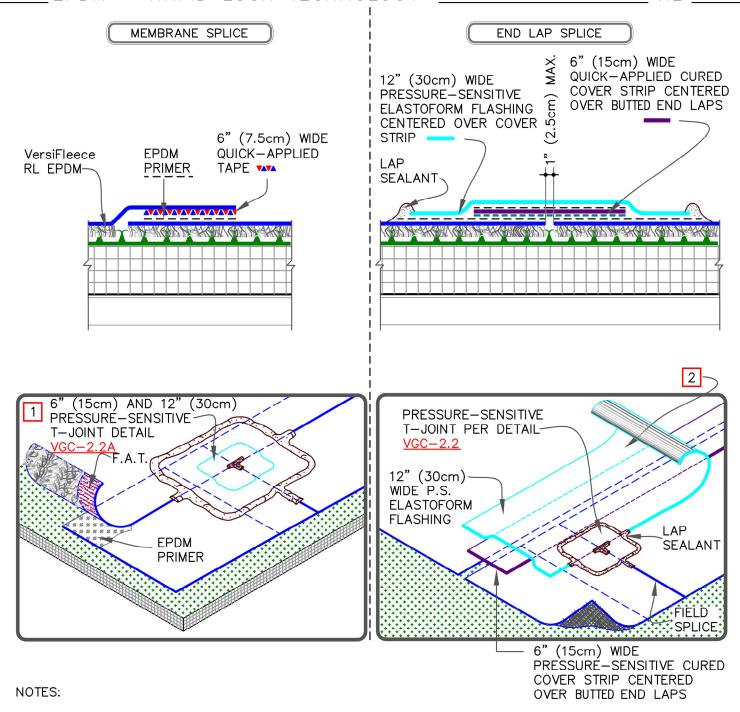


- 1. APPLY EPDM PRIMER TO MEMBRANE SURFACES PRIOR TO INSTALLING PRESSURE-SENSITIVE FLASHING AND/OR FACTORY APPLIED SecurTAPE.
- 2. APPLY LAP SEALANT ALONG THE EDGE OF THE MEMBRANE SPLICE (UNDER THE 6"x6" (15cm X 15cm) T-JOINT COVER) COVERING THE EXPOSED SPLICE TAPE 1/2" (1.5cm) IN EACH DIRECTION FROM THE SPLICE INTERSECTION.
- 3. ALL EPDM SPLICE INTERSECTIONS MUST BE OVERLAID WITH TWO LAYERS OF PRESSURE—SENSITIVE ELASTOFORM FLASHING. THE BOTTOM LAYER SHALL BE 6"X6" (15cm X 15cm) COVERED WITH A 12"X12" (30cm X 30cm) TOP LAYER. BOTH LAYERS SHALL BE CENTERED OVER THE SPLICE INTERSECTION AND SEALED WITH CONTINUOUS LAP SEALANT, AS SHOWN.
- *RAPID LOCK TECHNOLOGY IS MAGNIFIED ON SCALE



RL™ EPDM (RAPID LOCK) MEMBRANE SPLICE-PROJECTS WITH 145-MIL MEMBRANE OR 25 AND 30-YEAR WARRANTIES



RAPID LOCK RL-2.1A

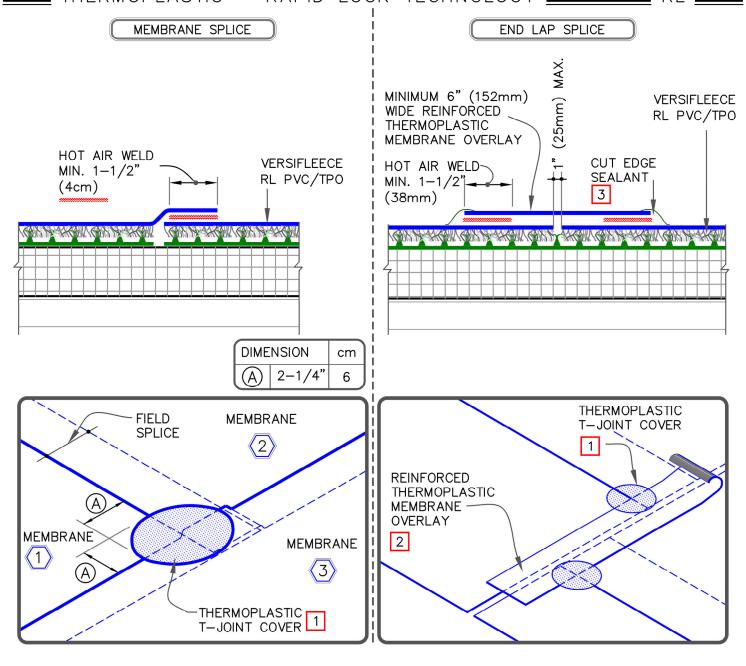

NOTES:

- 1. WHEN USING 115-MIL OR 135-MIL VERSIFLEECE RL PVC OR TPO MEMBRANE, APPLY A 4-1/2" (11cm) DIAMETER THERMOPLASTIC "T-JOINT" COVER AT ALL FIELD SPLICE INTERSECTIONS.
- 2. WHEN USING 60 MIL OR 80-MIL THERMOPLASTIC REINFORCED MEMBRANE OVERLAY, INTERSECTIONS BETWEEN SPLICES MUST BE OVERLAID WITH A 4-1/2" (11cm) DIAMETER THERMOPLASTIC "T-JOINT" COVER.
- 3. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.
- 4. WHEN USING 115-MIL VersiFleece RL TPO OR PVC MEMBRANES, MAXIMUM WARRANTY IS 20 YEARS.


*RAPID LOCK TECHNOLOGY IS MAGNIFIED ON SCALE



RL™ PVC/TPO (RAPID LOCK) MEMBRANE SPLICES -PRÓJECTS UP TO 30-YEAR WARRANTIES




RAPID LOCK

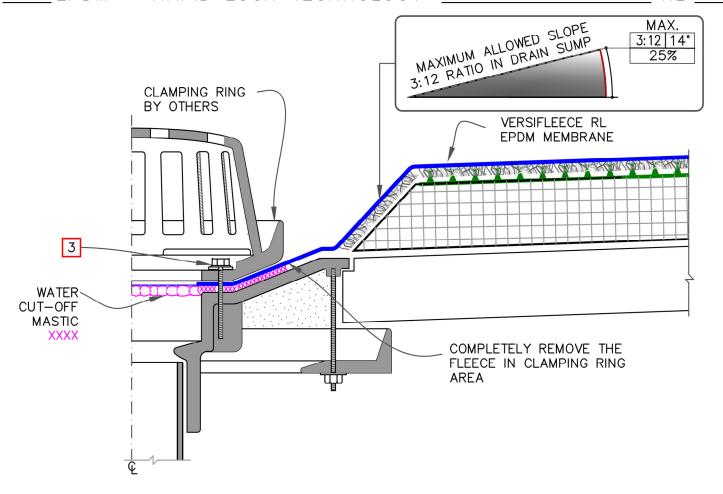

NOTES:

- REMOVE EXISTING LEAD, FLASHING MATERIAL & ENSURE THE DRAIN RING IS COMPLETELY CLEAN DOWN TO BARE METAL.
- 2. FLEECE RL BACKING MUST BE REMOVED FROM THE MEMBRANE SO THAT WATER CUT OFF MASTIC IS IN DIRECT CONTACT.
- 3. THE HOLE IN THE MEMBRANE SHALL EXCEED THE DIAMETER OF THE DRAIN PIPE, BUT SHALL BE NO LESS THAN 1/2" (1.5cm) FROM THE ATTACHMENT POINTS OF THE DRAIN CLAMPING RING.
- 4. ALL BOLTS OR CLAMPS MUST BE IN PLACE TO PROVIDE CONSTANT COMPRESSION ON WATER CUT—OFF MASTIC.


- FIELD SPLICES MUST BE LOCATED AT LEAST 6 INCHES (15cm) OUTSIDE THE DRAIN SUMP.
- ROOF DRAIN SIZE AND NUMBER OF DRAINS SHALL BE IN ACCORDANCE WITH THE LOCAL CODES.



*RAPID LOCK TECHNOLOGY IS MAGNIFIED ON SCALE




ROOF DRAIN WITH CONTINUOUS MEMBRANE



RAPID LOCK RL-6A.1

AUTION


EPDM MEMBRANE SPLICES SHALL INCORPORATE 6" (15cm) WIDE FIELD APPLIED QA TAPE FOR PROJECTS WITH 20, 25 & 30-YEAR WARRANTIES.

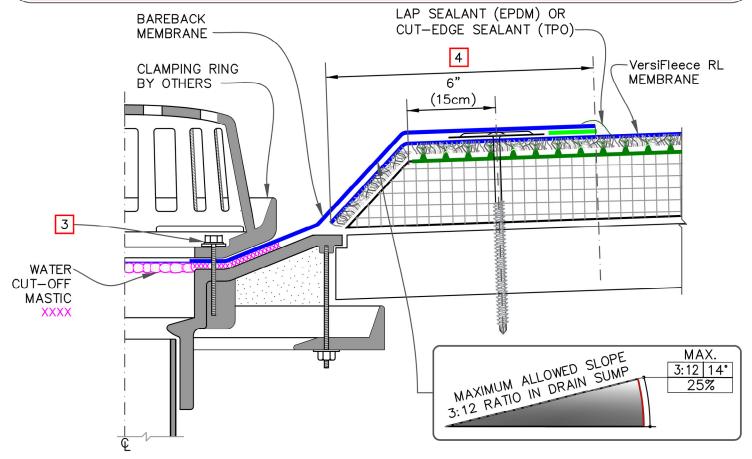

NOTES:

- REMOVE EXISTING LEAD, FLASHING MATERIAL & ENSURE THE DRAIN RING IS COMPLETELY CLEAN DOWN TO BARE METAL.
- 2. THE HOLE IN THE MEMBRANE SHALL EXCEED THE DIAMETER OF THE DRAIN PIPE, BUT SHALL BE NO LESS THAN 1/2" (1.5cm) FROM THE ATTACHMENT POINTS OF THE DRAIN CLAMPING RING.
- 3. ALL BOLTS OR CLAMPS MUST BE IN PLACE TO PROVIDE CONSTANT COMPRESSION ON WATER CUT—OFF MASTIC.
- 4. SPLICES SHALL BE COMPLETED USING MIN. 3" (7.5CM) WIDE QA TAPE/PRIMER WITH EPDM MEMBRANE AND MIN. 1-1/2" (4cm) HOT AIR WELD WITH TPO/PVC MEMBRANES


- 5. FIELD SPLICES MUST BE LOCATED AT LEAST 6 INCHES (15cm) OUTSIDE THE DRAIN SUMP.
- 6. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.
- ROOF DRAIN SIZE AND NUMBER OF DRAINS SHALL BE IN ACCORDANCE WITH THE LOCAL CODES.

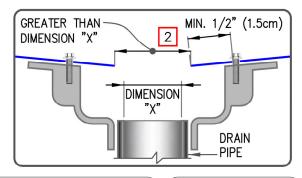



*RAPID LOCK TECHNOLOGY IS MAGNIFIED ON SCALE



ROOF DRAIN WITH SEPARATE TARGET SPLICE



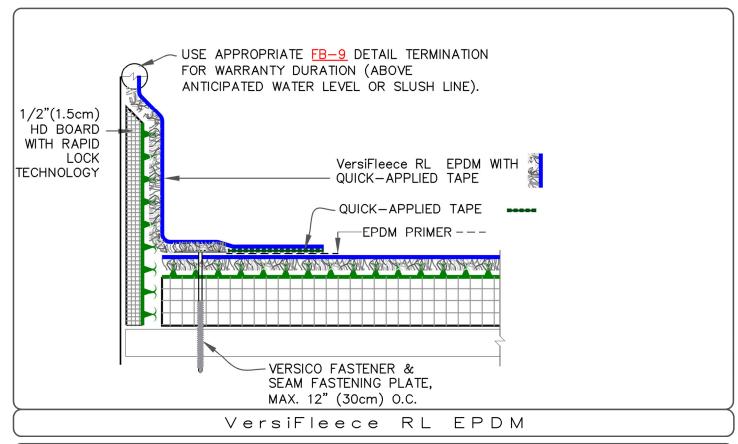


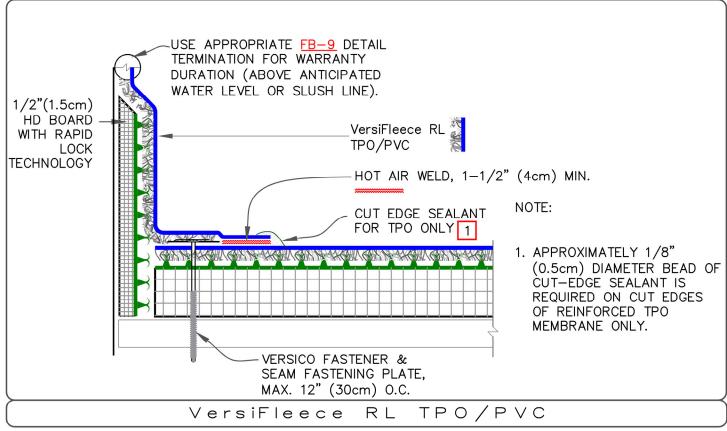

*RAPID LOCK TECHNOLOGY IS MAGNIFIED ON SCALE





PARAPET/CURB WITH SEPARATE MEMBRANE: NO ADHESIVE



RAPID LOCK

1 - 12 A.1 A

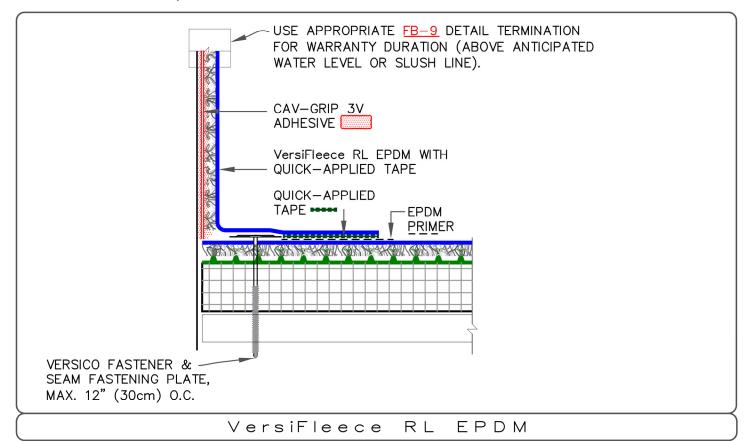


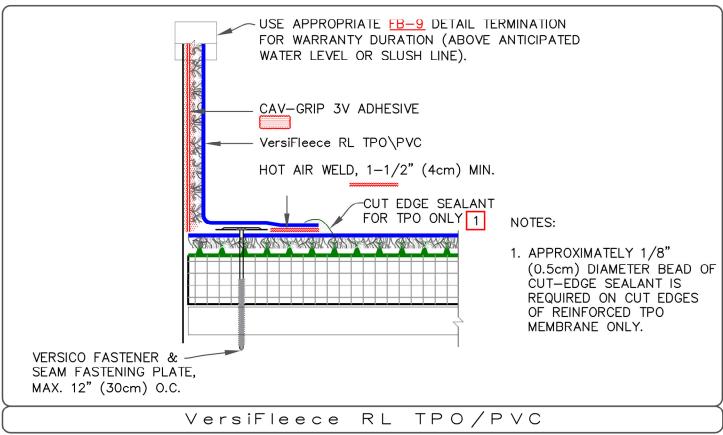

*RAPID LOCK TECHNOLOGY IS MAGNIFIED ON SCALE





PARAPET/CURB WITH SEPARATE MEMBRANE: RL MEMBRANE ADHERED WITH CAV-GRIP 3V



RAPID LOCK

1 - 12A.1B

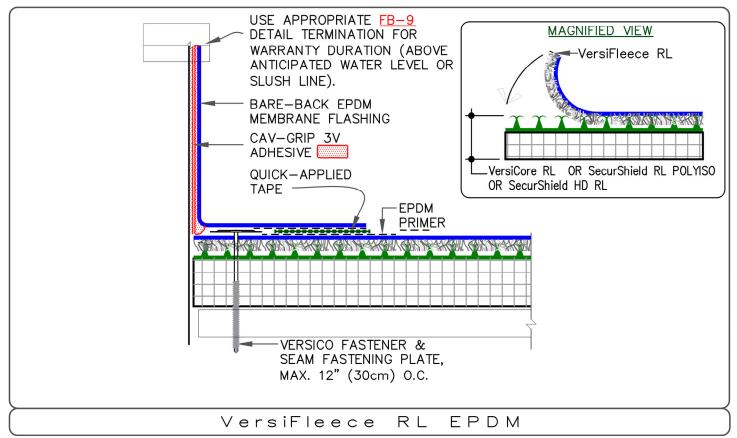


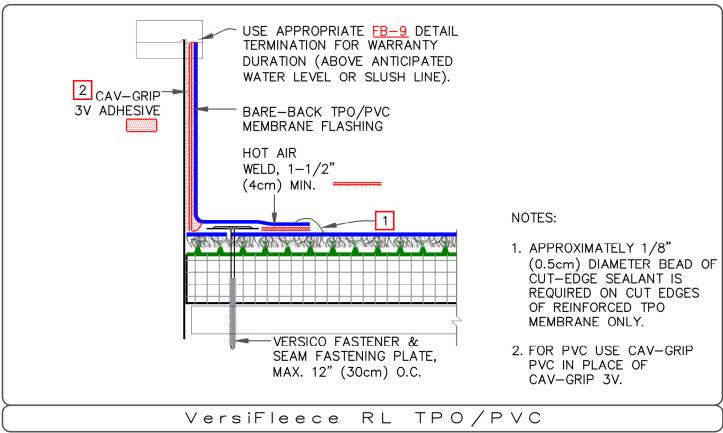


*RAPID LOCK TECHNOLOGY IS MAGNIFIED ON SCALE




PARAPET/CURB WITH
SEPARATE MEMBRANE:
BARE-BACK MEMBRANE
ADHERED WITH CAV-GRIP
3V/CAV-GRIP PVC



L-12A.1C

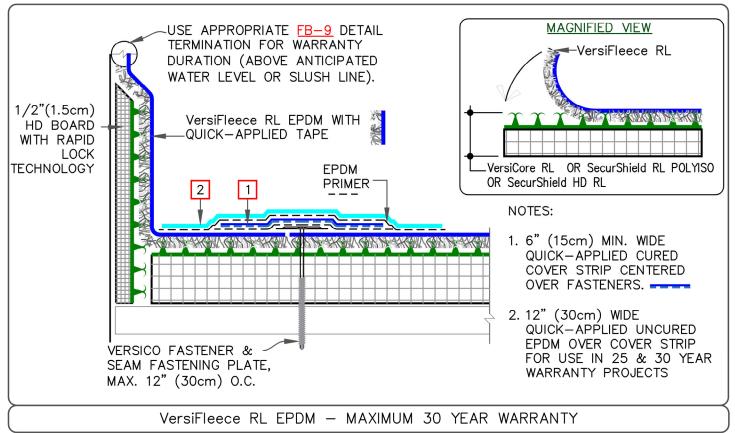


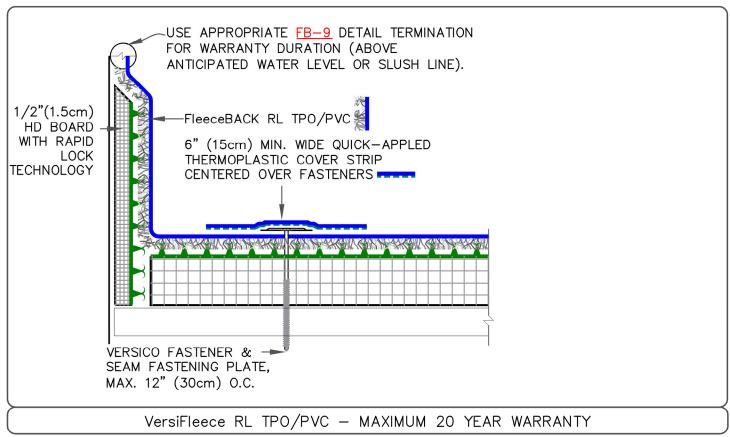

*RAPID LOCK TECHNOLOGY IS MAGNIFIED ON SCALE





PARAPET/CURB WITH CONTINUOUS MEMBRANE-NO ADHESIVE



RAPID LOCK

L-12B.1A

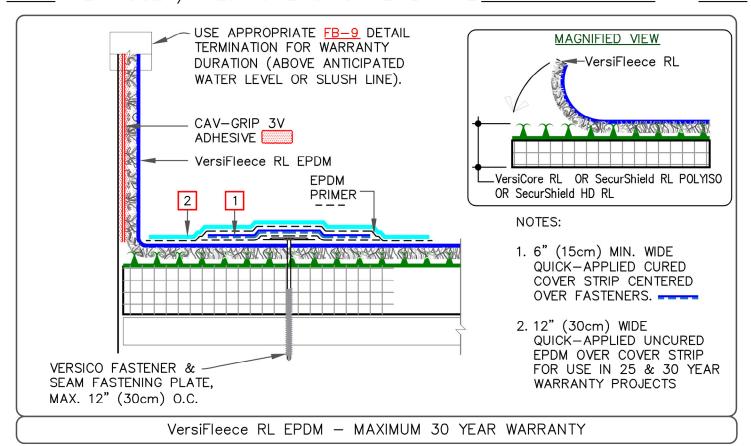


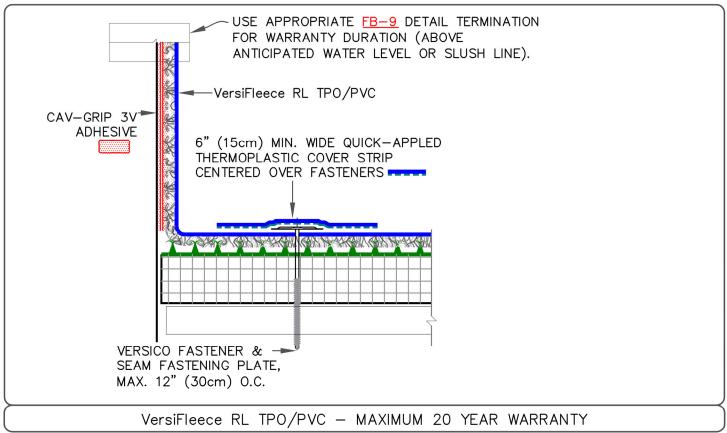

*RAPID LOCK TECHNOLOGY IS MAGNIFIED ON SCALE



PARAPET/CURB WITH CONTINUOUS MEMBRANE-RL MEMBRANE ADHERED WITH CAV-GRIP 3V



RAPID LOCK




VersiFleece TPO/PVC/KEE HP Fully Adhered Roofing System

January 2025

Table of Contents

Metal Edges and Gravel Stops	Detail
VersiTrim Drip Edge Fascia	
VersiTrim Heat Weldable Drip Edge	VF-1.2A
Metal Bar Edge Termination	
VersiTrim Snap-On Canted Fascia	
VersiTrim 300	VF-1.5A
VersiTrim EX Snap-On Fascia & VersiTrim Snap-On Fascia	VF-1.6A
Membrane Splices Thermoplastic Membrane Splices	VF-2.2A
Expansion Joints	
Deck-to-Deck Expansion Joint.	VF-3.1A
Deck-to-Wall Expansion Detail	
Drains	
Roof Drain with Continuous Membrane	
Roof Drain with Separate Target Splice	VF-6.2A
Pipe Flashing	
Pre-molded Pipe Seal	
Field Fabricated Pipe Flashing	VF-8.2A
Terminations	\/ <u>\</u>
Membrane Terminations (Page 1 of 3)	
Membrane Terminations (page 2 of 3)	
Wiembrane Terminations (page 2 of 3)	VF-9.0
Parapet Flashing Parapet / Curb with Separate Membrane – Full Coverage	VE 12.1A
Parapet / Curb with Separate Membrane – Bead Applied	VF-12.1A
Parapet / Curb with Continuous Membrane – Full Coverage	VF-12.7D
Parapet / Curb with Continuous Membrane – Bead Applied	
Parapet / Curb with Water Based Adhesive	VF-12.3
Parapet / Curb with Continuous Membrane – Bead Applied Over Concrete	
Inside / Outside Corners	
Thermoplastic Pre-Molded Inside Corner	VF-15.3A
Thermoplastic Pre-Molded Outside Corner	VF-15.4A
Sealant Pocket	
Thermoplastic Molded Sealant Pocket	VF-16.2A
Through-Wall Scupper	
Through-Wall Scupper with Thermoplastic Coated Metal	VF-18.2A
Rib Profile	
Simulation of Metal Roof in Thermoplastic Membranes	
VersiFleece membrane Attachment Using Bead Adhesive VersiFleece Membrane Attachment Using Splatter	
versificede ivienibrane Attachment Osing Spiatter	V


DETAIL NOT FOR USE ON 25 & 30-YEAR WARRANTY PROJECTS. ACCEPTABLE EDGING SHALL CONFORM WITH THERMOPLASTIC VERSIFLEECE VF-1.2, 1.3, 1.4, 1.5 OR 1.6.

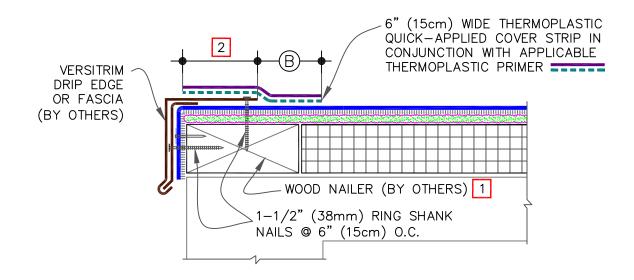

NOTES:

- 1. WOOD NAILER MUST EXTEND PAST TOTAL WIDTH OF METAL FASCIA DECK FLANGE.
- 2. METAL FASCIA DECK FLANGE MUST BE TOTALLY COVERED BY QUICK-APPLIED COVER STRIP WITH MINIMUM 2" (5cm) COVERAGE PAST NAIL HEADS.
- TO REMOVE FINISHING OILS, SCRUB METAL FLANGE WITH WEATHERED MEMBRANE CLEANER; ALLOW TO DRY PRIOR TO APPLYING PRIMER.
- 4. APPLY APPLICABLE THERMOPLASTIC PRIMER TO METAL FLANGE AND MEMBRANE SURFACE PRIOR TO INSTALLING QUICK-APPLIED FLASHING.
- 5. WHEN METAL FASCIA BY OTHERS IS USED, FASTENER TYPE AND FASTENING FREQUENCY SHALL BE RECOMMENDED BY METAL EDGE MANUFACTURER.

DIME	NSIONS	cm	
\bigcirc	1/2"	1.5	ТО
	1"	2.5	
lacksquare	2"	5	MIN.

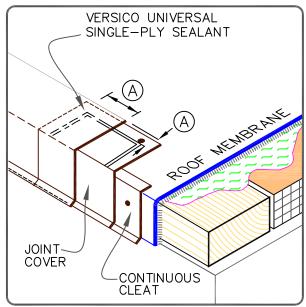



VERSITRIM DRIP EDGE FASCIA


→ VERSIFLEECE MEMBRANE → FLEXIBLE DASH → APPROVED SUBSTRATE

→ SEE NOTE(S)


0


THERMOPLASTIC VERSIFLEECE ADHERED


VF — 1.1

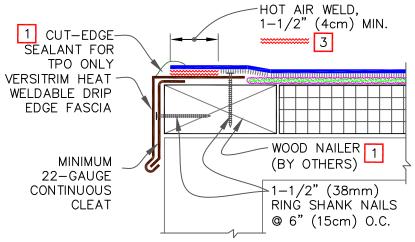


- 1. APPROXIMATELY 1/8" (0.5cm)
 DIAMETER BEAD OF CUT-EDGE
 SEALANT IS REQUIRED ON CUT
 EDGES OF REINFORCED TPO
 MEMBRANE.
- 2. WOOD NAILER MUST EXTEND PAST TOTAL WIDTH OF METAL FASCIA DECK FLANGE.
- 3. POSITION MEMBRANE WITH SELVAGE EDGE TO AVOID REMOVAL OF FLEECE BACKING.

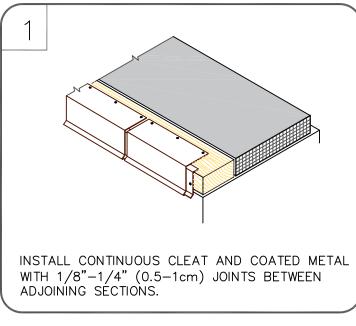

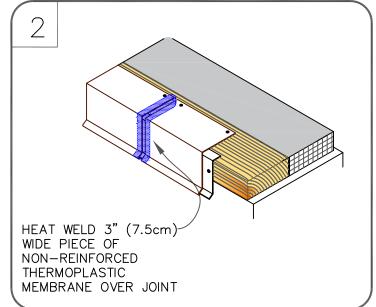

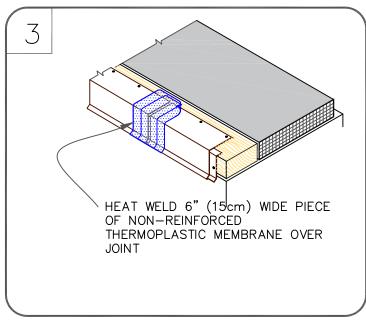

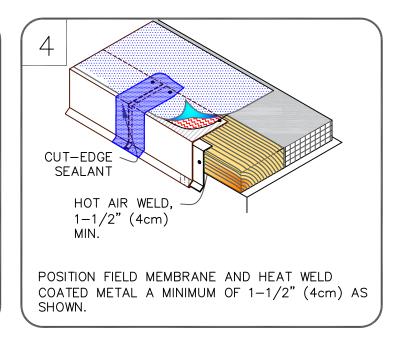



VERSITRIM HEAT WELDABLE DRIP EDGE



→ VERSIFLEECE MEMBRANE




→ APPROVED SUBSTRATE

0


→ SEE NOTE(S)

THERMOPLASTIC VERSIFLEECE ADHERED

VF-1.2A

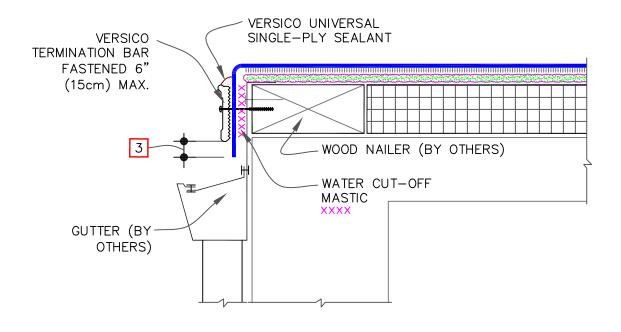


- POSITION MEMBRANE WITH SELVAGE EDGE AT TERMINATION BAR LOCATION TO AVOID REMOVAL OF FLEECE BACKING.
- 2. FASTENING OF METAL TERMINATION BAR MUST PROVIDE CONSTANT COMPRESSION ON WATER CUT-OFF MASTIC.
- 3. ALLOW MEMBRANE SHEET TO EXTEND 1/2" (1.5cm) MINIMUM BELOW THE METAL TERMINATION BAR.

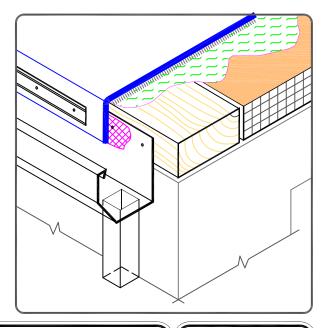




METAL BAR EDGE TERMINATION




THERMOPLASTIC VERSIFLEECE ADHERED

VF - 1.3A

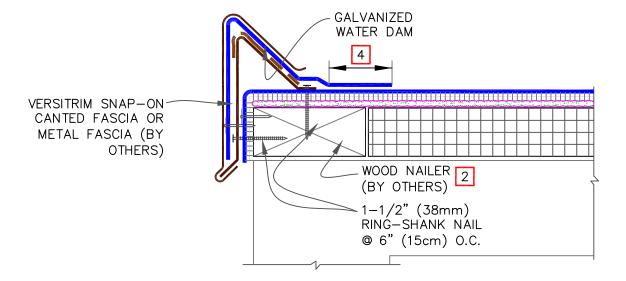


- 1. REFER TO <u>VERSITRIM SNAP-ON CANTED FASCIA INSTALLATION</u>
 <u>INSTRUCTION MANUAL</u> FOR STEP-BY-STEP INSTALLATION PROCEDURES.
- 2. WOOD NAILER MUST EXTEND PAST TOTAL WIDTH OF GRAVEL STOP DECK FLANGE.
- 3. WHEN METAL FASCIA BY OTHERS IS USED, FASTENER TYPE AND FASTENING FREQUENCY SHALL BE RECOMMENDED BY METAL EDGE MANUFACTURER.

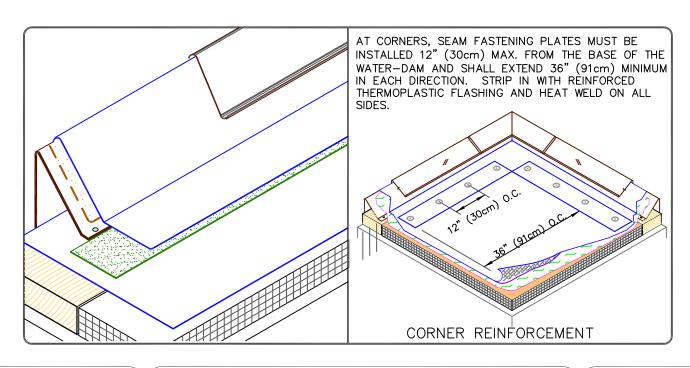




VERSITRIM SNAP-ON CANTED FASCIA




THERMOPLASTIC VERSIFLEECE ADHERED

VF-1.4A

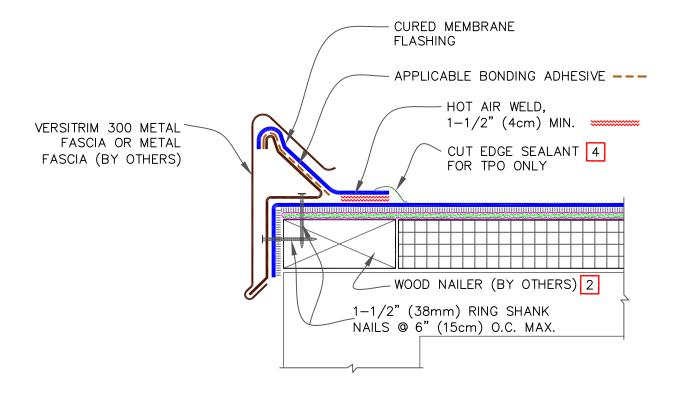

- 1. REFER TO <u>VERSITRIM 300 INSTALLATION INSTRUCTION</u>
 <u>MANUAL</u> FOR STEP-BY-STEP INSTALLATION
 PROCEDURES.
- 2. WOOD NAILER MUST EXTEND PAST TOTAL WIDTH OF GRAVEL STOP DECK FLANGE.
- 3. WHEN METAL FASCIA BY OTHERS IS USED, FASTENER TYPE AND FASTENING FREQUENCY SHALL BE RECOMMENDED BY METAL EDGE MANUFACTURER.
- 4. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.

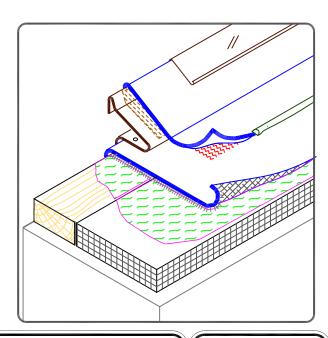



VERSITRIM 300

→ VERSIFLEECE MEMBRANE


→ FLEXIBLE DASH

→ APPROVED SUBSTRATE

→ SEE NOTE(S)


THERMOPLASTIC VERSIFLEECE ADHERED

VF-1.5A

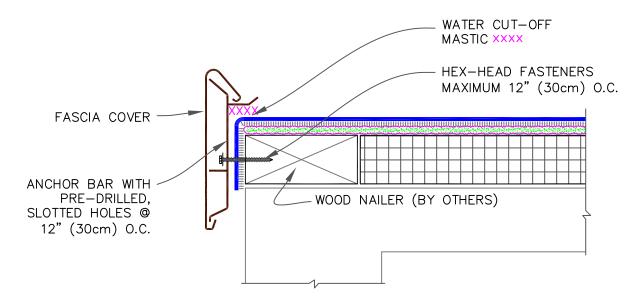


VERSITRIM EX SNAP-ON FASCIA

- 1. REFER TO VERSITRIM 2000 OR 3000 INSTRUCTION MANUALS FOR THE STEP BY STEP INSTALLATION PROCEDURES.
- 2. IF INCIDENTAL/TEMPORARY PONDED WATER IS EXPECTED, THE VERSITRIM MUST BE ELEVATED AND SCUPPERS PROVIDED FOR DRAINAGE.
- 3. ENSURE ROOF SLOPES AWAY FROM VERSITRIM.

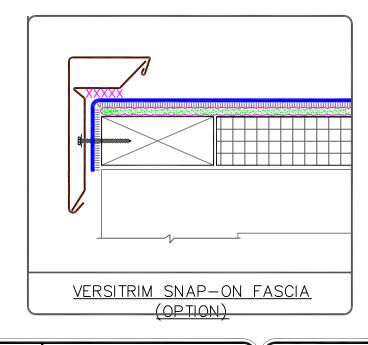



VERSITRIM EX SNAP-ON FASCIA & VERSITRIM SNAP-ON FASCIA





→ FLEXIBLE DASH
→ APPROVED SUBSTRATE


O → SEE NOTE(S)


THERMOPLASTIC VERSIFLEECE ADHERED

VF-1.6A

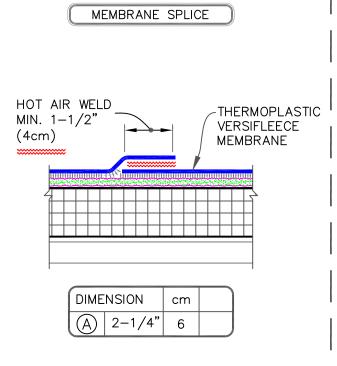

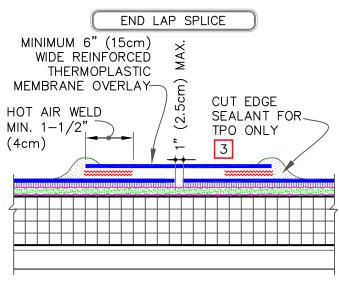

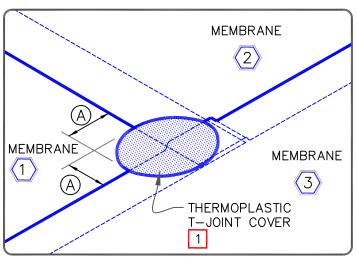


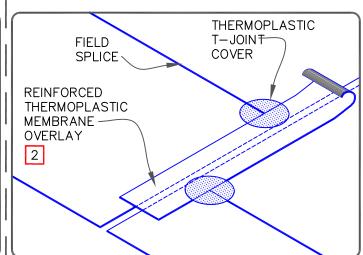

- 1. WHEN USING 115 OR 135-MIL TPO VERSIFLEECE OR 115 OR 135 PVC VERSIFLEECE MEMBRANE, APPLY A 4-1/2" (11cm) DIAMETER THERMOPLASTIC "T-JOINT" COVER AT ALL FIELD SPLICE INTERSECTIONS.
- 2. WHEN USING 60 OR 80 MIL THERMOPLASTIC REINFORCED MEMBRANE OVERLAY, INTERSECTIONS BETWEEN SPLICES MUST BE OVERLAID WITH A 4-1/2" (11cm) DIAMETER THERMOPLASTIC "T-JOINT" COVER.
- 3. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.
- 4. WHEN USING 115-MIL TPO VERSIFLEECE, MAXIMUM WARRANTY IS 20 YEARS




THERMOPLASTIC MEMBRANE SPLICES



THERMOPLASTIC VERSIFLEECE ADHERED

VF - 2.2A

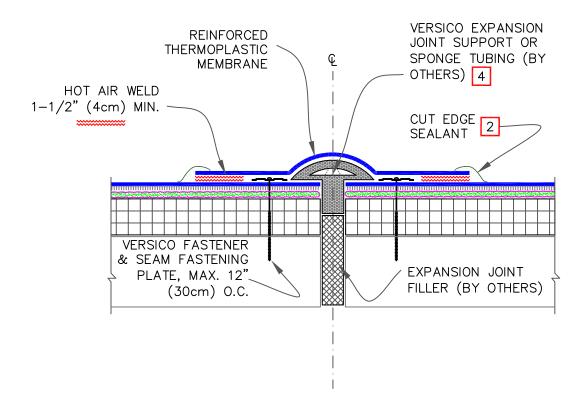


- 1. WHEN VERSICO EXPANSION JOINT SUPPORT IS USED, WIDTH OF JOINT SHALL BE A MINIMUM OF 3/4" (2cm) AND SHALL NOT EXCEED 3" (7.5cm).
- 2. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.
- 3. WHEN USING 60 OR 80 MIL REINFORCED THERMOPLASTIC MEMBRANE, APPLY A 4-1/2" (11cm) DIAMETER THERMOPLASTIC "T-JOINT" COVER AT ALL FIELD SPLICE INTERSECTIONS.
- 4. ROOF MEMBRANE SHALL NOT BE ADHERED OVER THE EXPANSION JOINT SUPPORT OR SPONGE TUBING.



DECK-TO-DECK EXPANSION JOINT




THERMOPLASTIC VERSIFLEECE ADHERED

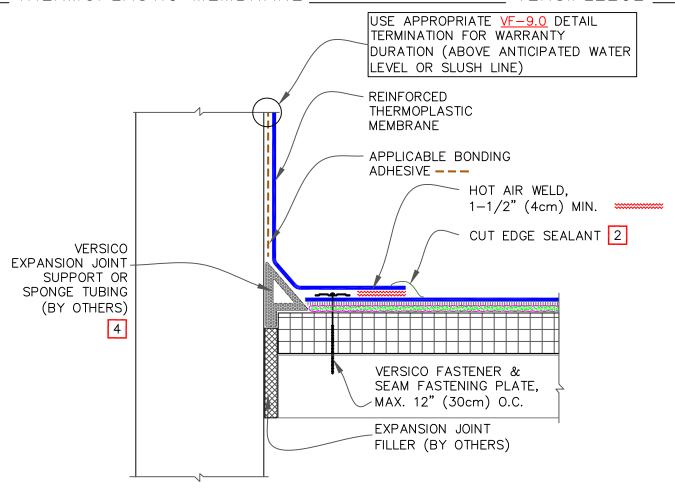



- 1. WHEN VERSICO EXPANSION JOINT SUPPORT IS USED, WIDTH OF JOINT SHALL BE A MINIMUM OF 3/4" (2cm) AND SHALL NOT EXCEED 2" (5cm).
- 2. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.
- 3. WHEN USING 60 OR 80 MIL REINFORCED THERMOPLASTIC MEMBRANE, APPLY A 4-1/2" (11cm) DIAMETER THERMOPLASTIC "T-JOINT" COVER AT ALL FIELD SPLICE INTERSECTIONS.
- 4. ROOF MEMBRANE SHALL NOT BE ADHERED OVER THE EXPANSION JOINT SUPPORT OR SPONGE TUBING.


DECK-TO-WALL EXPANSION DETAIL



THERMOPLASTIC VERSIFLEECE ADHERED

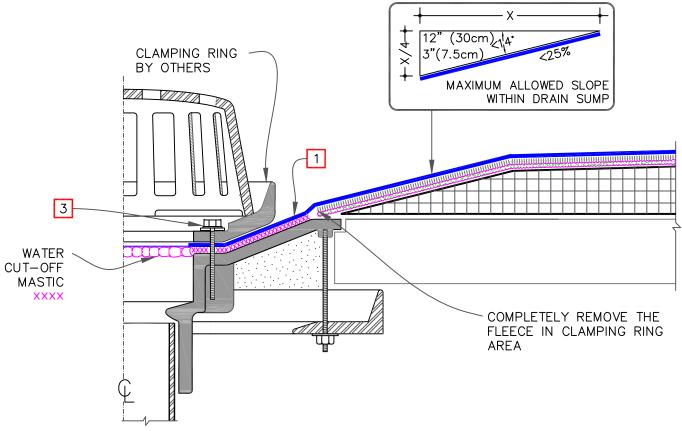



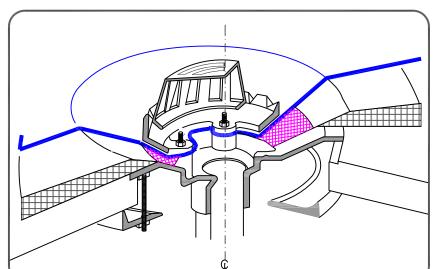

- REMOVE EXISTING LEAD, FLASHING MATERIAL & ENSURE THE DRAIN RING IS COMPLETELY CLEAN DOWN TO BARE METAL.
- 2. FLEECE-BACKING MUST BE REMOVED FROM THE MEMBRANE SO THAT WATER CUT-OFF MASTIC IS IN DIRECT CONTACT.
- 3. ALL BOLTS OR CLAMPS MUST BE IN PLACE TO PROVIDE CONSTANT COMPRESSION ON WATER CUT-OFF MASTIC.
- ROOF DRAIN SIZE AND NUMBER OF DRAINS SHALL BE IN ACCORDANCE WITH THE LOCAL CODES.
- 5. REMOVE EXISTING LEAD, FLASHING MATERIAL & ENSURE THE DRAIN RING IS COMPLETELY CLEAN DOWN TO BARE METAL.



ROOF DRAIN WITH CONTINUOUS MEMBRANE



→ VERSIFLEECE MEMBRANE

→ FLEXIBLE DASH


→ APPROVED SUBSTRATE


0 -

→ SEE NOTE(S)

THERMOPLASTIC VERSIFLEECE ADHERED

VF - 6.1 A

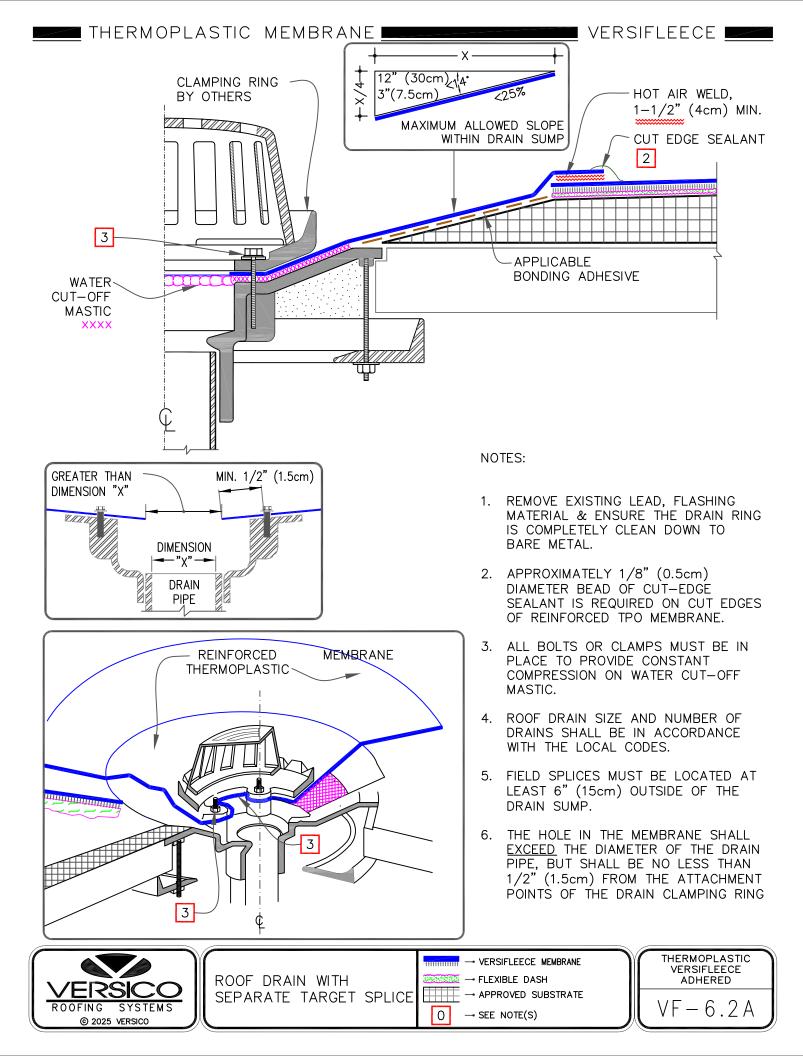

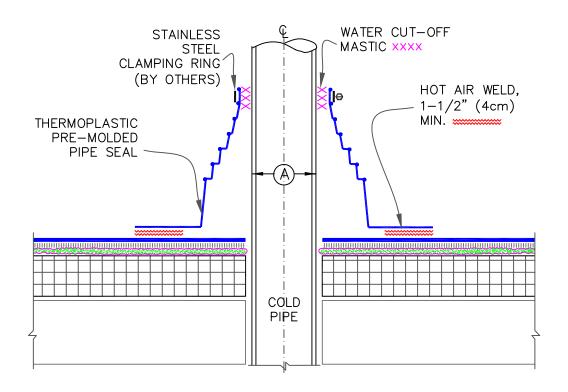


DIME	NSIONS	cm	
A	3/4"	2	ТО
	8"	20	

- 1. REMOVE ALL LEAD AND OTHER FLASHING BEFORE INSTALLING PRE-MOLDED PIPE SEAL.
- 2. TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 140°F (60°C) WHEN USING PVC AND 160°F (71°C) WHEN USING TPO FLASHING.
- 3. PRE-MOLDED PIPE SEAL MUST HAVE INTACT RIB AT TOP EDGE, REGARDLESS OF PIPE DIAMETER.
- 4. DECK FLANGES OF THE PRE-MOLDED PIPE SEAL SHALL NOT BE OVERLAPPED, CUT OR APPLIED OVER ANY ANGLE CHANGE.




PRE-MOLDED PIPE SEAL



THERMOPLASTIC VERSIFLEECE ADHERED

VF - 8.1A

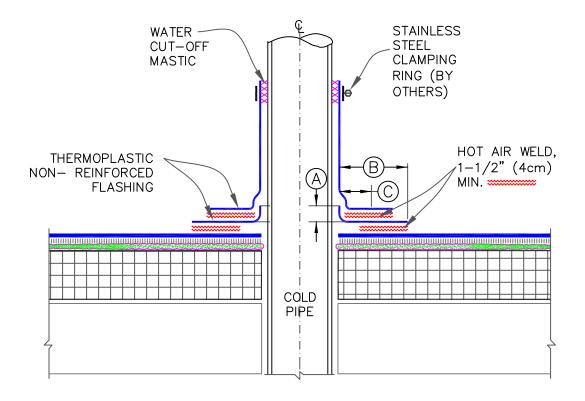


DIME	NSIONS	cm			
A	1/2"	1.5	MIN.		
B	1-1/2"	4	ТО		
	2"	5			
0	1"	2.5	MIN.		

- 1. REMOVE ALL LEAD AND OTHER FLASHING BEFORE INSTALLING FIELD FABRICATED PIPE SEAL.
- 2. TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 140°F (60°C) WHEN USING PVC AND 160°F (71°C) WHEN USING TPO FLASHING.
- 3. APPLY HEAT TO FLASHING AND FORM BY HAND PRIOR TO HOT AIR WELDING
- 4. MECHANICAL SECUREMENT IS REQUIRED AROUND ALL PIPES GREATER THAN 18" (46cm) IN DIAMETER.
- 5. REFER TO THERMOPLASTIC COMMON DETAILS FOR HOT STACK, STEEL TUBING & FLEXIBLE PENETRATIONS.




FIELD FABRICATED PIPE FLASHING



THERMOPLASTIC VERSIFLEECE ADHERED

VF - 8.2A

9A MECHANICAL TERMINATION WITH COUNTER FLASHING



VERSICO UNIVERSAL SINGLE-PLY SEALANT OR SEALANT (BY OTHERS)


METAL COUNTER-FLASHING WITH LEAD WEDGES, AS REQUIRED (BY OTHERS).

THREADED FASTENERS OR VERSICO HP TERM BAR NAIL-IN

VERSICO TERMINATION BAR

WARRANTY UP TO 30 YEARS SEE INSET

9B MECHANICAL TERMINATION




VERSICO UNIVERSAL SINGLE-PLY SEALANT OR SEALANT (BY OTHERS)

VERSICO ZINC NAIL-IN ANCHOR RECOMMENDED @ 6" (15cm) O.C.

VERSICO TERMINATION BAR

WARRANTY UP TO 20 YEARS SEE INSET


INSET A

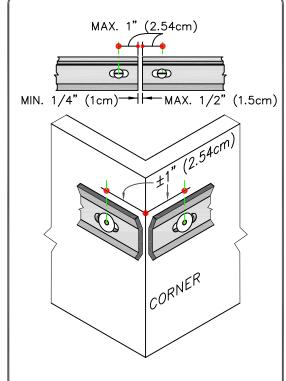

NOTES:

- 1. APPLY ON HARD SMOOTH SURFACE ONLY; NOT FOR USE ON EXPOSED WOOD.
- 2. DO NOT WRAP TERMINATION BAR AROUND CORNERS.
- 3. DETAIL <u>9D ON PAGE 2 OF 3</u>
 MUST BE USED AT VERTICAL
 JOINTS IN PANEL WALLS.

9C COUNTER FLASHING TERMINATION



VERSICO UNIVERSAL SINGLE-PLY SEALANT OR SEALANT (BY OTHERS)

METAL COUNTER-FLASHING WITH LEAD WEDGES, AS REQUIRED (BY OTHERS).

FASTEN MEMBRANE @ 12" (30cm) O.C. MAX. USE GALVANIZED WASHERS, MIN. 1", (2.54cm) DIAMETER

NOTE:

1. WHEN MECHANICAL FASTENERS ARE USED TO PENETRATE THE METAL COUNTER-FLASHING, USE EPDM WASHERS, APPLY WATER CUT-OFF MASTIC UNDER THE COUNTER-FLASHING OR CAULK THE FASTENER HEADS.

WARRANTY UP TO 10 YEARS

XXX WATER CUT-OFF MASTIC- MUST BE HELD UNDER CONSTANT COMPRESSION.



MEMBRANE TERMINATIONS (PAGE 1 OF 3)




- → VERSIFLEECE MEMBRANE
- → FLEXIBLE DASH
- → APPROVED SUBSTRATE
 - O → SEE NOTE(S)

THERMOPLASTIC VERSIFLEECE ADHERED

VF - 9.0

MECHANICAL TERMINATION AT VERTICAL 9D **JOINTS**

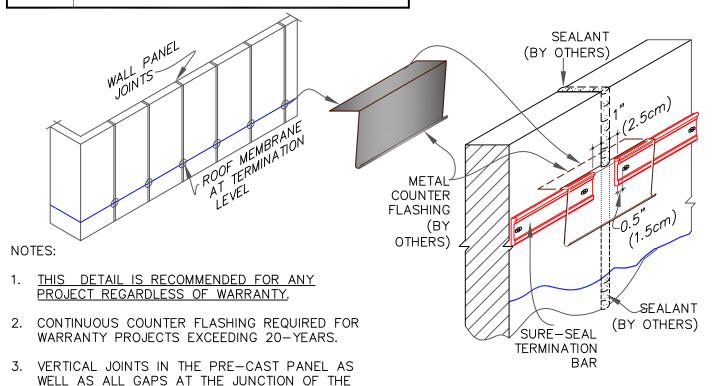


4. APPLY ON HARD SMOOTH SURFACE ONLY.

TILT-UP PANEL AND ROOF DECK MUST BE FULLY SEALED TO PREVENT AIR INFILTRATION.

9F VERSITRIM & VERSITRIM 300 COPINGS

NOTES:

- MEMBRANE MUST BE EXTENDED AT CORNERS TO PROVIDE COMPLETE COVERAGE OF THE TOP WALL SURFACE. SEE 9F ON PAGE 3 OF 3.
- 2. REFER TO **VERSITRIM COPING** INSTALLATION INSTRUCTION MANUAL FOR STEP-BY-STEP INSTRUCTION PROCEDURES.
- 3. STOP ADHESIVE AT APPROPRIATE DISTANCE TO AVOID STAINING ON EXTERIOR FACE OF WALL. EXTEND THE MEMBRANE DOWN & TEMPORARILY SECURE WITH CAPPED NAILS AT 12" (30.5cm) O.C. ENSURE SEAMS ARE SEALED.

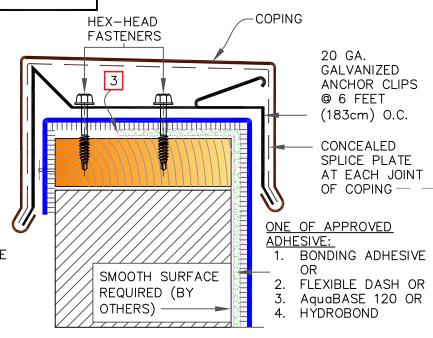



MEMBRANE TERMINATIONS (PAGE 2 OF 3)

→ VERSIFLEECE MEMBRANE

→ FLEXIBLE DASH

→ APPROVED SUBSTRATE

→ SEE NOTE(S)


0

ADHERED


THERMOPLASTIC

VERSIFLEECE

VF-9.0

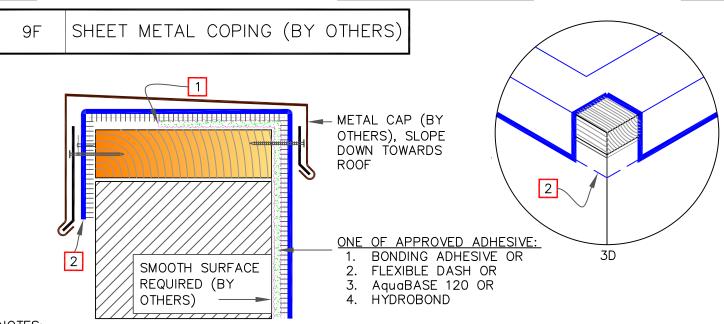

- 1. STOP ADHESIVE AT APPROPRIATE DISTANCE TO AVOID STAINING ON EXTERIOR FACE OF WALL. EXTEND THE MEMBRANE DOWN & SECURE WITH CAPPED NAILS AT 12" (30.5cm) O.C. ENSURE SEAMS ARE SEALED.
- 2. EXTEND THE MEMBRANE BELOW THE JOINT. AT CORNERS, MEMBRANE MUST BE EXTENDED TO PROVIDE COMPLETE COVERAGE OF WALL SURFACE.

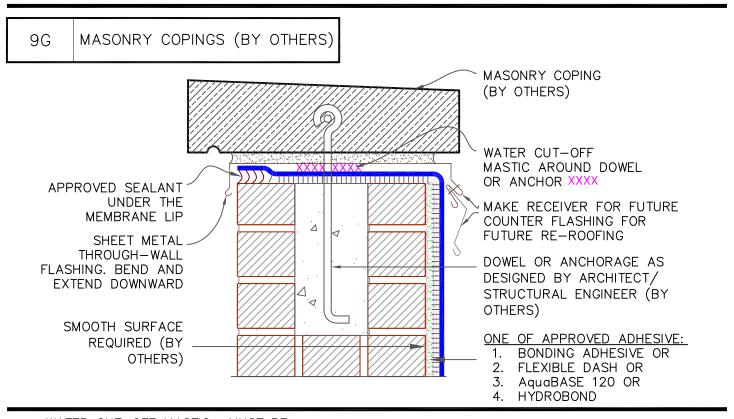

WATER CUT-OFF MASTIC- MUST BE HELD UNDER CONSTANT COMPRESSION.



MEMBRANE TERMINATIONS (PAGE 3 OF 3)



0

→ VERSIFLEECE MEMBRANE

→ FLEXIBLE DASH


→ APPROVED SUBSTRATE

→ SEE NOTE(S)

THERMOPLASTIC VERSIFLEECE ADHERED

VF - 9.0

REFER TO DETAIL VF-12.3 WHEN USING AQUA BASE 120 ADHESIVE.

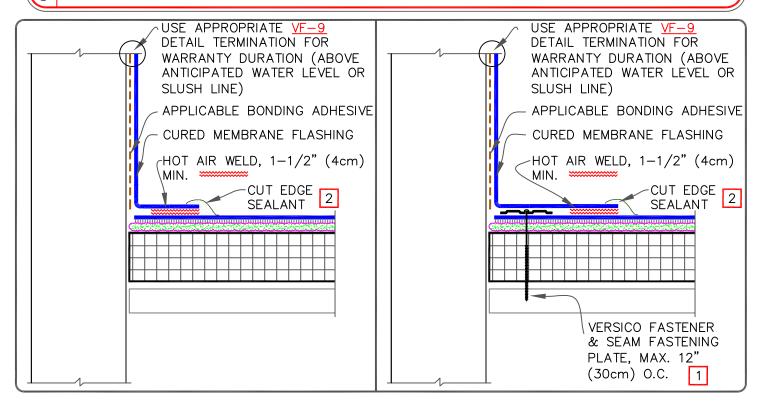


NOTES:

- 1. MECHANICALLY ATTACHED BASE SECUREMENT IS REQUIRED WHEN ANY ONE OF THE FOLLOWING MAY OCCUR:
 - 1.1. SPECIFIED WARRANTIES GREATER THAN 20-YEARS.
 - 1.2. WARRANTY WIND SPEEDS GREATER THAN 90MPH.
 - 1.3. PROJECTS WITH CONTROL OR EXPANSION JOINTS OR ANTICIPATED BUILDING MOVEMENT.
 - 1.4. WHEN VERSIFLEECE MEMBRANE IS INSTALLED DIRECTLY OVER AN EXISTING SINGLE-PLY ROOF.
- 2. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.
- 3. WHEN USING 60 OR 80-MIL REINFORCED THERMOPLASTIC MEMBRANE, APPLY A 4-1/2" (11cm) DIAMETER THERMOPLASTIC "T-JOINT" COVER AT ALL FIELD SPLICE INTERSECTIONS.




PARAPET/CURB WITH SEPARATE MEMBRANE - FULL COVERAGE/SPLATTER



VERSIFLEECE ADHERED

VF-12.1A

• REFER TO DETAIL VF-12.3 WHEN USING AQUA BASE 120 ADHESIVE OR HYDROBOND.

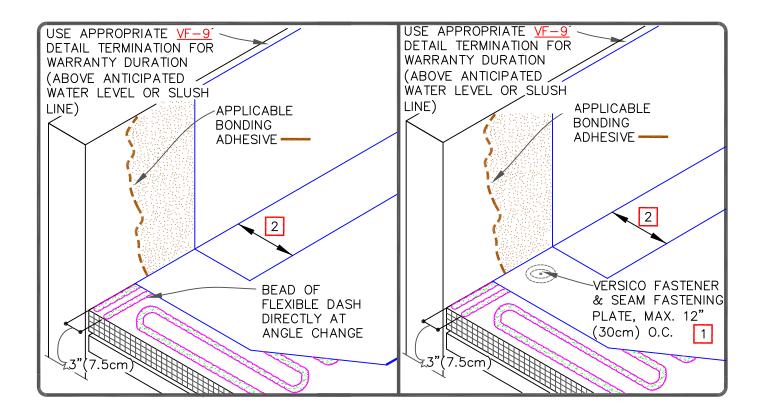


NOTES:

- 1. MECHANICALLY FASTENED BASE SECUREMENT IS REQUIRED WHEN ANY ONE OF THE FOLLOWING MAY OCCUR:
 - 1.1. SPECIFIED WARRANTIES GREATER THAN 20-YEARS.
 - 1.2. WARRANTY WIND SPEEDS GREATER THAN 90MPH.
 - 1.3. PROJECTS WITH CONTROL OR EXPANSION JOINTS OR ANTICIPATED BUILDING MOVEMENT.
 - 1.4. WHEN VERSIFLEECE MEMBRANE IS INSTALLED DIRECTLY OVER AN EXISTING SINGLE-PLY ROOF.
- 2. SPLICES SHALL BE COMPLETED USING MINIMUM 1-1/2" (4cm) HOT AIR WELD.
- 3. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.
- 4. WHEN USING 60 OR 80-MIL REINFORCED THERMOPLASTIC MEMBRANE FLASHING, APPLY A 4-1/2" (11cm) DIAMETER THERMOPLASTIC "T-JOINT" COVER AT ALL FIELD SPLICE INTERSECTIONS.




PARAPET/CURB WITH SEPARATE MEMBRANE — BEAD APPLIED



THERMOPLASTIC VERSIFLEECE ADHERED

VF-12.1B

REFER TO DETAIL VF-12C WHEN USING AQUA BASE 120 ADHESIVE OR HYDROBOND.

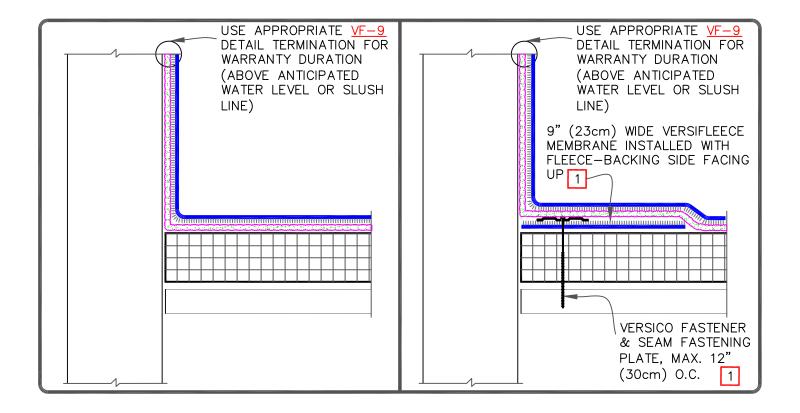


NOTES:

- 1. MECHANICALLY FASTENED BASE SECUREMENT IS REQUIRED WHEN ANY ONE OF THE FOLLOWING MAY OCCUR:
 - 1.1. SPECIFIED WARRANTIES GREATER THAN 20-YEARS.
 - 1.2. WARRANTY WIND SPEEDS GREATER THAN 90MPH.
 - 1.3. PROJECTS WITH CONTROL OR EXPANSION JOINTS OR ANTICIPATED BUILDING MOVEMENT.
 - 1.4. WHEN VERSIFLEECE MEMBRANE IS INSTALLED DIRECTLY OVER AN EXISTING SINGLE-PLY ROOF.
- 2. WHEN THE USE OF FLEXIBLE DASH (FULL SPRAY) IS NOT FEASIBLE ON THE VERTICAL SUBSTRATE, SEE APPROPRIATE TDB FOR INSTALLATION INSTRUCTIONS FOR BONDING ADHESIVE.




PARAPET/CURB WITH CONTINUOUS MEMBRANE - FULL COVERAGE/SPLATTER



THERMOPLASTIC VERSIFLEECE ADHERED

VF - 12.2A

REFER TO DETAIL VF-12.3 WHEN USING AQUA BASE 120 ADHESIVE OR HYDROBOND.

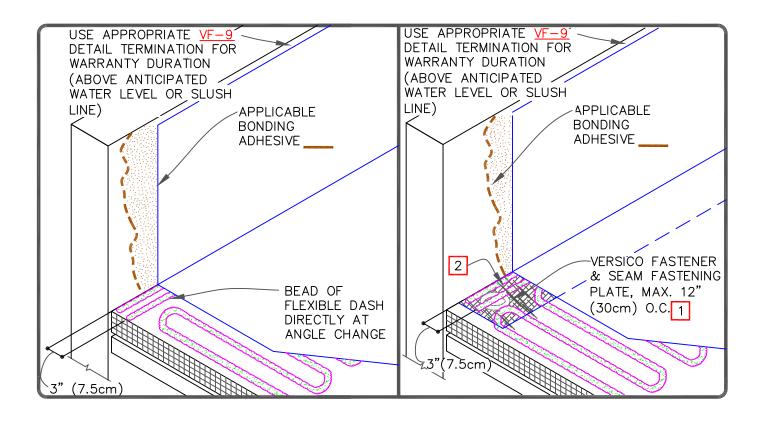


NOTES:

- MECHANICALLY FASTENED BASE SECUREMENT IS REQUIRED WHEN ANY ONE OF THE FOLLOWING MAY OCCUR:
 - 1.1. SPECIFIED WARRANTIES GREATER THAN 20-YEARS.
 - 1.2. WARRANTY WIND SPEEDS GREATER THAN 90MPH.
 - 1.3. PROJECTS WITH CONTROL OR EXPANSION JOINTS OR ANTICIPATED BUILDING MOVEMENT.
 - 1.4. WHEN VERSIFLEECE MEMBRANE IS INSTALLED DIRECTLY OVER AN EXISTING SINGLE-PLY ROOF.
- 2. 9" (23cm) WIDE VERSIFLEECE MEMBRANE INSTALLED WITH FLEECE-BACKING SIDE FACING UP.
- 3. WHEN USING 60 OR 80-MIL REINFORCED THERMOPLASTIC MEMBRANE FLASHING, APPLY A 4-1/2" (11cm) DIAMETER THERMOPLASTIC "T-JOINT" COVER AT ALL FIELD SPLICE INTERSECTIONS.




PARAPET/CURB WITH CONTINUOUS MEMBRANE - BEAD APPLIED



THERMOPLASTIC VERSIFLEECE ADHERED


VF-12.2B

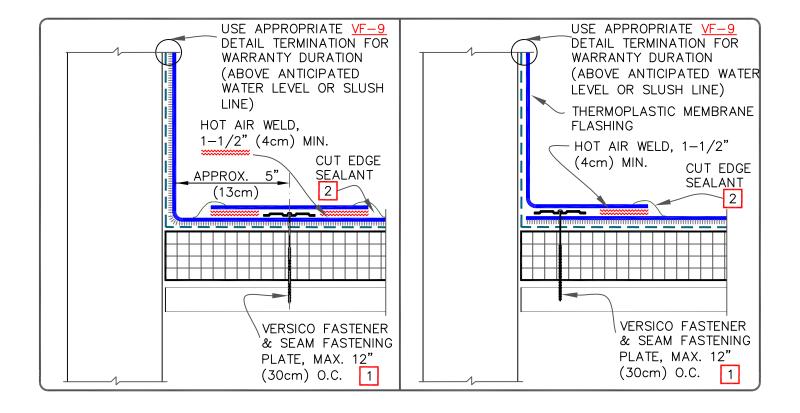

- 1. REGARDLESS OF WARRANTY/ WARRANTY WIND SPEEDS, MECHANICAL SECUREMENT MUST BE PROVIDED AT THE PERIMETER OF EACH ROOF LEVEL, ROOF SECTION, EXPANSION JOINT, CURB FLASHING, SKYLIGHT, INTERIOR WALL, PENTHOUSE, ETC., AT ANY INSIDE ANGLE CHANGE WHERE SLOPE EXCEEDS 2" IN ONE HORIZONTAL FOOT.
- 2. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.
- 3. WHEN APPLYING AQUA BASE 120 BONDING ADHESIVE TO VERSIFLEECE MEMBRANE ON THE VERTICAL WALL SUBSTRATE, APPLY A COAT OF AQUA BASE 120 ADHESIVE TO THE FLEECE SIDE OF THE MEMBRANE AND ALLOW TO DRY. ONCE THE ADHESIVE ON THE FLEECE IS DRY, APPLY BONDING ADHESIVE AT THE COVERAGE RATE OF 60 SQUARE FEET PER GALLON TO THE WALL SUBSTRATE AND A SECOND COAT TO THE VERSIFLEECE MEMBRANE.




PARAPET/CURB WITH WATER BASED ADHESIVE



VERSIFLEECE ADHERED


VF - 12.3

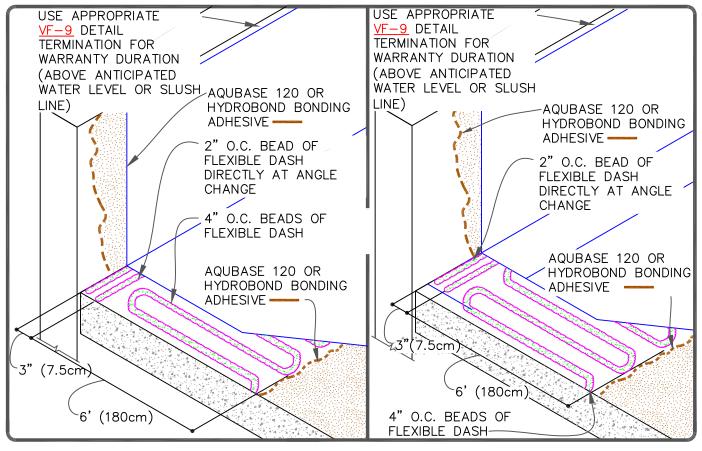


- 1. REGARDLESS OF WARRANTY/ WARRANTY WIND SPEEDS, SECUREMENT MUST BE PROVIDED AT THE PERIMETER OF EACH ROOF LEVEL, ROOF SECTION, EXPANSION JOINT, CURB FLASHING, SKYLIGHT, INTERIOR WALL, PENTHOUSE, ETC., AT ANY INSIDE ANGLE CHANGE WHERE SLOPE EXCEEDS 2" IN ONE HORIZONTAL FOOT.
- 2. SPLICES SHALL BE COMPLETED USING MINIMUM 1-1/2" (4cm) HOT AIR WELD WITH TPO/PVC.
- 3. APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.
- 4. WHEN APPLYING AQUA BASE 120 BONDING ADHESIVE TO VERSIFLEECE MEMBRANE ON THE VERTICAL WALL SUBSTRATE, APPLY A COAT OF AQUA BASE 120 ADHESIVE OR HYDROBOND TO THE FLEECE SIDE OF THE MEMBRANE AND ALLOW TO DRY. ONCE THE ADHESIVE ON THE FLEECE IS DRY, APPLY BONDING ADHESIVE AT THE COVERAGE RATE OF 60 S.F./GALLON FOR AQUA BASE 120 AND 100 S.F./GALLON FOR HYDROBOND TO THE WALL SUBSTRATE AND A SECOND COAT TO THE VERSIFLEECE MEMBRANE.





PARAPET/CURB-WATER
BASED ADHESIVES W/
BEAD APPLIED FLEXIBLE
DASH AT PERIMETERSDIRECTLY OVER CONCRETE



VERSIFLEECE ADHERED

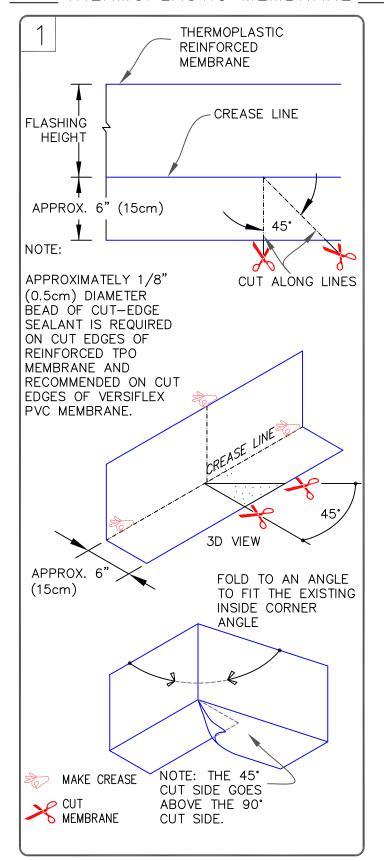

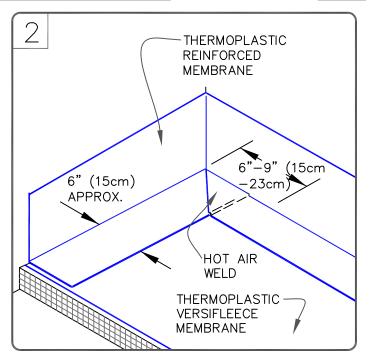

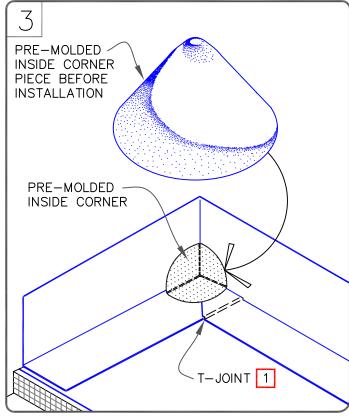

- 1. WHEN USING 115 OR 135-MIL MEMBRANE, APPLY A 4-1/2" (11cm) DIAMETER "T-JOINT" COVER AT ALL FIELD SPLICE INTERSECTIONS.
- 2. WHEN USING 115-MIL VERSIFLEECE TPO, MAXIMUM WARRANTY IS 20 YEARS



THERMOPLASTIC
PRE-MOLDED INSIDE
CORNER



→ VERSIFLEECE MEMBRANE


→ FLEXIBLE DASH

→ APPROVED SUBSTRATE

O → SEE NOTE(S)

THERMOPLASTIC VERSIFLEECE ADHERED

VF-15.3A

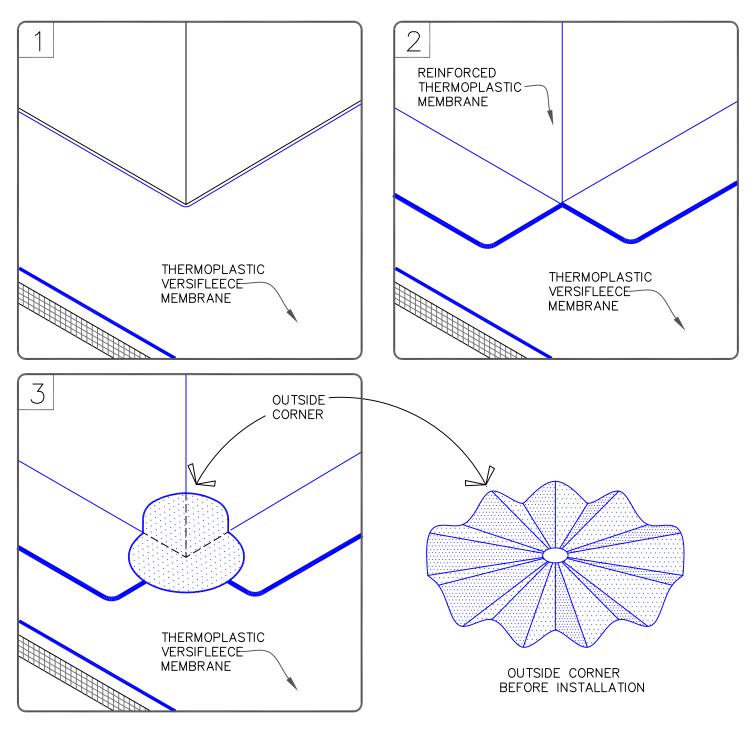

APPROXIMATELY 1/8" (0.5cm) DIAMETER BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF REINFORCED TPO MEMBRANE.



THERMOPLASTIC
PRE-MOLDED OUTSIDE
CORNER



→ VERSIFLEECE MEMBRANE

→ FLEXIBLE DASH


→ APPROVED SUBSTRATE

O → SEE NOTE(S)

THERMOPLASTIC VERSIFLEECE ADHERED

VF-15.4A

MOLDED SEALANT POCKETS MUST BE USED IN CONJUNCTION WITH RAIN HOODS FOR PROJECTS WITH 25 AND 30-YEAR WARRANTIES.

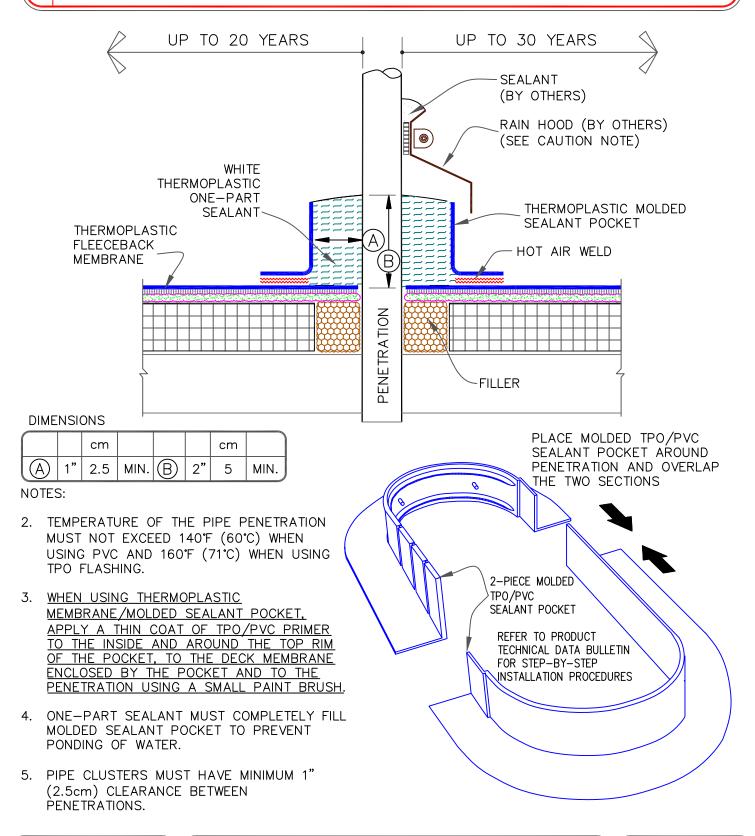



THERMOPLASTIC MOLDED SEALANT POCKET

→ VERSIFLEECE MEMBRANE

→ FLEXIBLE DASH


→ APPROVED SUBSTRATE

→ SEE NOTE(S)


0

THERMOPLASTIC VERSIFLEECE ADHERED

VF-16.2A

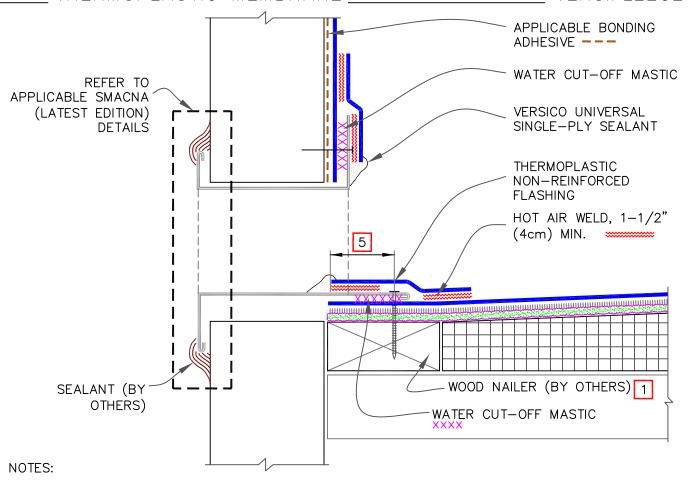


- WOOD NAILERS ARE INSTALLED ONLY AT SCUPPERS TO SECURE METAL SLEEVE AND MUST EXTEND PAST THE WIDTH OF METAL SLEEVE FLANGE.
- 2. INSTALL WALL FLASHING PRIOR TO SCUPPER INSTALLATION.
- 3. METAL SCUPPER BOX MUST HAVE CONTINUOUS FLANGES WITH ROUNDED CORNERS. SOLDER ALL SCUPPER SEAMS WATER-TIGHT.
- WATER CUT-OFF MASTIC UNDER SCUPPER FLANGE MUST BE UNDER CONSTANT COMPRESSION.
- 5. SCUPPER FLANGES MUST BE TOTALLY COVERED BY THERMOPLASTIC NON-REINFORCED FLASHING WITH MINIMUM 2" (5cm) COVERAGE PAST NAIL HEADS.
- 6. UNIVERSAL SINGLE—PLY SEALANT IS REQUIRED AT FLASHING EDGES ON SCUPPER EDGE. WHEN USING THERMOPLASTIC FLASHING, THERMOPLASTIC PRIMER MUST BE USED TO PREPARE SURFACES PRIOR TO THE APPLICATION OF SEALANT.

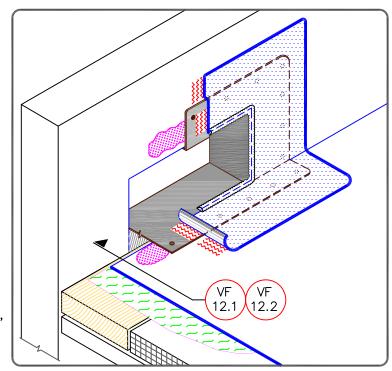



THROUGH-WALL SCUPPER WITH THERMOPLASTIC COATED METAL



→ APPROVED SUBSTRATE

→ SEE NOTE(S)

0

THERMOPLASTIC VERSIFLEECE ADHERED

VF-18.2A

HOT AIR WELD
(REFER TO SPECS)
---- AIR/VAPOR BARRIER
(WHERE REQUIRED)

RI	B PROF	ILE	DIMENSIONS
	INCH	mm	(C)
$\overline{\mathbb{A}}$	1-3/4"	4.5	
$\overline{\mathbb{B}}$	1-1/4"	3	B
0	1/2"	1	
D	VARIES		(A)



SIMULATION OF METAL ROOF IN THERMOPLASTIC MEMBRANES



→ VERSIFLEECE MEMBRANE

→ FLEXIBLE DASH


→ APPROVED SUBSTRATE

O → SEE NOTE(S)

THERMOPLASTIC VERSIFLEECE ADHERED

VF - 25.1A

- REFER TO VERSICO SPECIFICATIONS FOR PRODUCT DATA SHEETS FOR APPROPRIATE BEAD SPACING BASED UPON THE BUILDING HEIGHT, WARRANTY TERM AND ACCEPTABLE SUBSTRATE.
- THE SURFACE TO WHICH ADHESIVE IS TO BE APPLIED SHALL BE DRY, FREE OF FINS, PROTRUSIONS, SHARP EDGES, LOOSE AND FOREIGN MATERIALS. OIL AND GREASE. AREA SHOULD BE CLEANED WITH AN AIR BLOWER.
- PREVIOUSLY UNEXPOSED ASPHALT 3. OR RESIDUE MUST BE PRIMED WITH VERSICO CAVGRIP 3V, 702 OR 702LV PRIMER.
- 4. SEAL ALL GAPS IN THE CONCRETE DECK WITH VERSICO 725TR OR OTHER SUITABLE MATERIAL TO AVOID CONDENSATION ISSUES OR FILL WITH VERSICO INSULATION ADHESIVE.
- 5. UNROLL 10' TO 15' OF MEMBRANE TO ENSURE IT IS PROPERLY ALIGNED AND FOLD UNROLLED SECTION BACK OVER ROLL.
- APPLY FLEXIBLE DASH ADHESIVE OVER THE SUBSTRATE AREA TO BE COVERED BY THE MEMBRANE 6. THAT IS FOLDED BACK.
- ALLOW FLEXIBLE DASH ADHESIVE TO RISE AND DEVELOP "STRING / BODY" (APPROX. 1-1/2 TO 2 MINUTES). STRING TIME WILL VARY BASED ON ENVIRONMENTAL 7. CONDITIONS LIKE TEMPERATURE AND HUMIDITY. DO NOT ALLOW THE ADHESIVE TO OVER—CURE PRIOR TO SETTING INSULATION BOARDS.
- ROLL THE MEMBRANE USING A 30" WIDE, 150 POUND WEIGHTED 8. SEGMENTED STEEL ROLLER, TO SET THE MEMBRANE BACK INTO THE ADHESIVE.

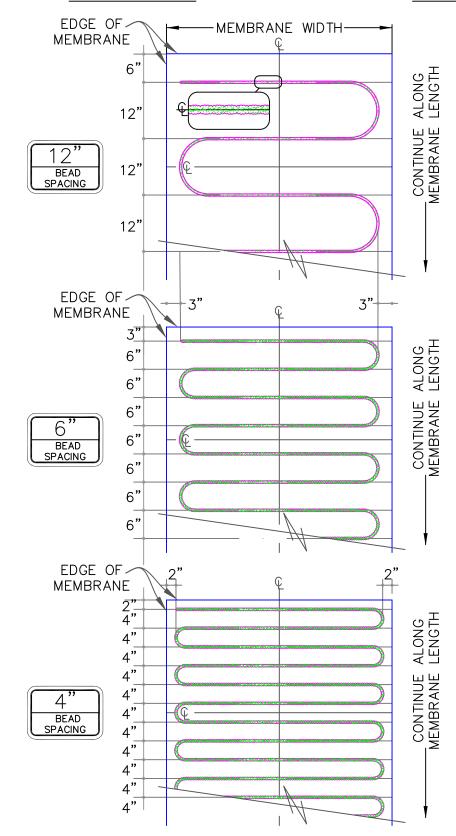


FEET TO CENTIIMETERS										
4'	8'									
122	244									

	INCHES TO CENTIMETERS																
inch	1/4"	1/2"	3/4"	1"	1.5"	2"	2.5"	3"	4"	5"	6"	7"	8"	9"	10"	11"	12"
cm	1	1.5	2	2.5	4	5	6.5	7.5	10	13	15	18	20	23	25	28	30



VERSIFLEECE MEMBRANE ATTACHMENT USING BEAD **ADHESIVE**



ADHERED SYSTEM VF - 27

- 1. Flexible FAST ADHESIVE SHOULD BE DISPENSED IN LARGE DROPLETS, NOT A FINE MIST. AIR PRESSURE/FLOW IS TOO HIGH IF THE Flexible FAST ADHÉSIVE IS DISPENSING IN A FINE MIST.
- 2. REFER TO VERSICO DOCUMENT, SPEC SUPPLEMENT, SECTION G-02-22.3a FOR EQUIPMENT INFORMATION.
- 3. THE SURFACE TO WHICH ADHESIVE IS TO BE APPLIED SHALL BE DRY, FREE OF FINS, PROTRUSIONS, SHARP EDGES, LOOSE AND FOREIGN MATERIALS, OIL AND GREASE. AREA SHOULD BE CLEANED WITH AN AIR BLOWER.
- 4. PREVIOUSLY UNEXPOSED ASPHALT OR RESIDUAL MUST BE PRIMED WITH VERSICO CAVGRIP 3V, 702 OR 702LV PRIMER.
- 5. SEAL ALL GAPS IN THE CONCRETE DECK WITH VERSICO 725TR OR OTHER SUITABLE MATERIAL TO AVOID CONDENSATION ISSUES OR FILL WITH VERSICO INSULATION ADHESIVE.
- 6. UNROLL 10' TO 15' (305-457cm) OF MEMBRANE TO ENSURE IT IS PRÓPERLY ALIGNED AND FOLD UNROLLED SECTION BACK OVER ROLL.
- 7. APPLY Flexible FAST ADHESIVE OVER THE SUBSTRATE AREA TO BE COVERED BY THE MEMBRANE THAT IS FOLDED BACK.
- 8. ALLOW Flexible FAST ADHESIVE TO RISE AND DEVELOP "STRING/BODY" (APPROX. 1-1/2 TO 2 MINUTES). STRING TIME WILL VARY BASED ON ENVIRONMENTAL CONDITIONS LIKE TEMPERATURE AND HUMIDITY. DO NOT ALL THE ADHESIVE TO OVER-CURE PRIOR TO SETTING INSULATION BOARDS.
- 9. ROLL THE MEMBRANE USING A 30" (76cm) WIDE, 150 POUND (68 KILOGRAM) WEIGHTED SEGMENTED STEEL ROLLER, TO SET THE MEMBRANE BACK INTO THE ADHESIVE. REFER TO VERSICO DOCUMENT G-03-22.4.



FIG 1. CORRECT COVERAGE - SPLATTER **APPLICATION**



FIG 2. LIGHT COVERAGE - SPLATTER **APPLICATION**

0

