



NOTES:

1. THIS DETAIL FOR USE WHEN A RELIEF CUT OR MEMBRANE SPLICE IS PRESENT AT THE PIPE SEAL. USE DETAIL [U-8A](#) WHEN NO CUT OR SPLICE IS PRESENT.
2. REMOVE ALL LEAD AND OTHER FLASHING BEFORE INSTALLING PRESSURE-SENSITIVE PIPE SEAL.
3. PIPE SEAL MUST HAVE INTACT RIB AT TOP EDGE, REGARDLESS OF PIPE DIAMETER.
4. DECK FLANGES OF THE MOLDED PIPE SEAL SHALL NOT BE OVERLAPPED, CUT OR APPLIED OVER ANY ANGLE CHANGE.
5. ON MECHANICALLY FASTENED ROOFING SYSTEMS REFER TO DETAIL [MF-8A.1](#).

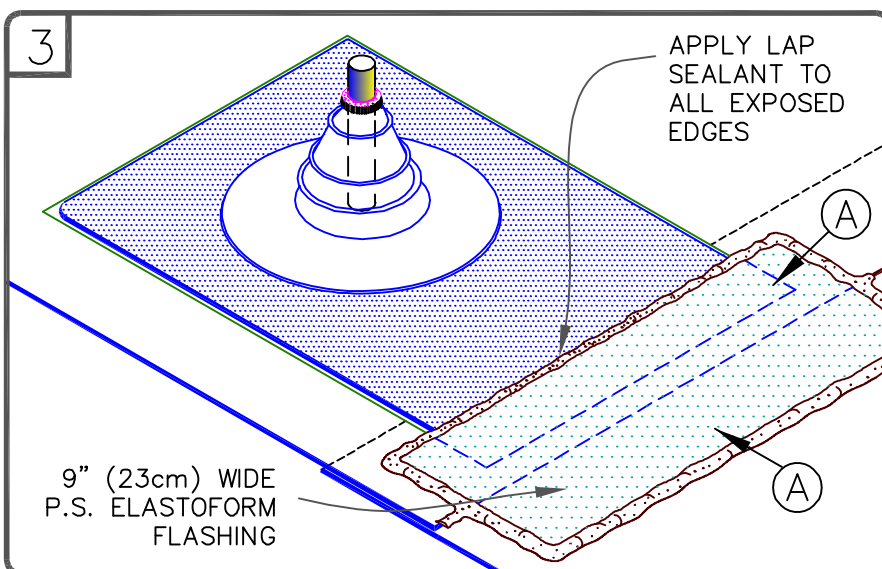

DIMENSIONS		cm	
(A)	3"	7.5	MIN.
(B)	1"	2.5	MIN.

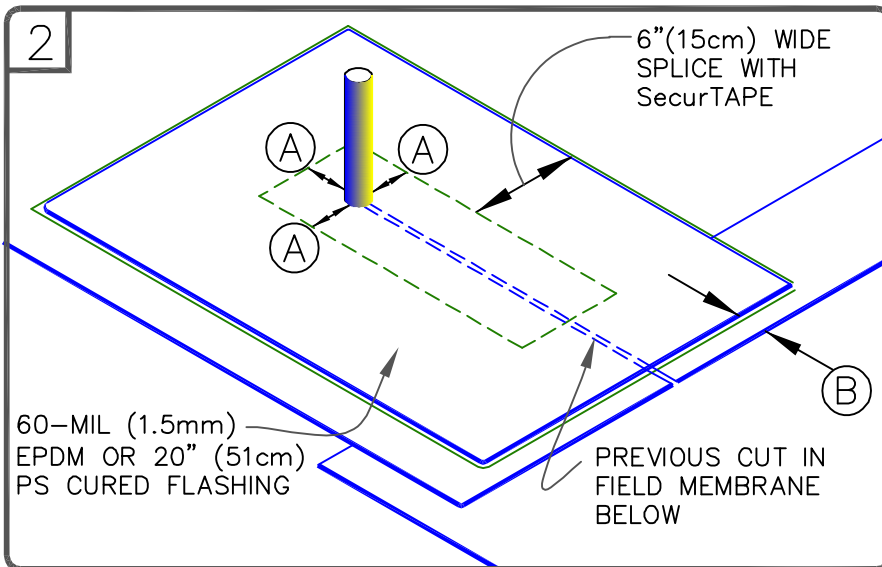

PRESSURE-SENSITIVE PIPE SEAL WITH
90-MIL MEMBRANE OR 30-YEAR
WARRANTY

MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U-8A.1

U (UNIVERSAL DETAIL)