

**Sure-Flex™**  
**Mechanically Fastened and Adhered Roofing Systems**

**TABLE OF CONTENTS**  
January 2026

**Part I – General**

1.01	Description.....	3
1.02	General Design Considerations .....	4
1.03	Quality Assurance.....	5
1.04	Submittals.....	6
1.05	Warranty.....	7
	TABLE I – Warranty Options and Minimum Membrane Thickness .....	8
	TABLE II – Mechanically Fastened PVC / KEE HP PVC – Membrane Fastening – Steel/Concrete Decks.....	9
	TABLE III – Mechanically Fastened PVC / KEE HP PVC – Membrane Fastening – Plywood / OSB Decks.....	10
	TABLE IV – Mechanically Fastened PVC / KEE HP PVC – Membrane Fastening – Lightweight/Gypsum/Wood Fiber Decks.....	11
	TABLE V – Adhered PVC / KEE HP PVC – Underlayment/Fastening – Up to 20 Yr Warranties .....	12
	TABLE VI – Adhered PVC / KEE HP PVC – Underlayment/Fastening – 25/30 Yr Warranties.....	14
	TABLE VII - Minimum Perimeter Width For Insulation Attachment For All Warranties.....	15
1.06	Job Conditions.....	16
1.07	Product Delivery Storage and Handling .....	16

**Part II – Product**

2.01	General.....	17
2.02	Membranes.....	17
2.03	Insulations/Underlayments.....	21
2.04	Related Materials.....	28
2.05	Fastening Components.....	31
2.06	Insulation Securement Adhesive.....	32
2.07	Vapor/ Air Barrier .....	32
2.08	Edgings/Terminations .....	33
2.09	Roof Walkways .....	35
2.10	Other Carlisle Accessories.....	36

**Part III – Execution**

3.01	General.....	37
3.02	Roof Deck/Substrate Criteria .....	37
3.03	Insulation/Underlayment .....	39
3.04	Insulation Attachment .....	40
3.05	Membrane Placement and Securement Criteria.....	42
3.06	Heat Welding Procedures .....	46
3.07	Welding Problems/Repairs.....	47
3.08	Flashings .....	48
3.09	Roof Walkways .....	50
3.10	Daily Seal .....	50

**ATTACHMENTS**

Attachment I – Induction Welding Attachment Method.....	53
Installation Details .....	71

Note: In addition to information listed in this section Specifiers and Authorized applicators should reference Spec Supplement and Design Reference Sections for other pertinent information.



**Sure Weld®/Sure-Flex™**  
**Mechanically Fastened and Adhered Roofing Systems**

January 2026

*The information contained in this generic specification represents a part of Carlisle's requirements for obtaining a roofing system warranty. Construction materials and practices, building siting and operation, climatic conditions, and other site-specific factors will have an impact on the performance of the roofing system. Carlisle recommends that the building owner retain a design professional to determine appropriate design measures to be taken in order to address these factors.*

*This section is to serve as criteria for Specifiers and Authorized Applicators regarding the design and installation of Carlisle's Adhered and Mechanically Fastened Sure-Flex PVC Membrane Roofing Systems. Additional information essential for the design and installation of the roof system mentioned herein are also included in the Design Reference Section and also listed in the form of a Specification Supplement at the end of the Technical Manual. Specifiers and Authorized Applicators are advised to reference all applicable sections.*

**Various Warranty Tables have been included in Paragraph 1.05 citing various requirements by which specific warranty coverage can be obtained. Appropriate Warranty Table should be referenced to ensure proper warranty coverage.**

**Part I – GENERAL**

**1.01 Description**

**A. Mechanically Fastened Systems (Sure-Flex)**

1. **The Sure-Flex Mechanically Fastened Roofing System** incorporates 50, 60 or 80-mil Polyester Reinforced Sure-Flex Polyvinyl Chloride (PVC) membrane (white, gray, light gray, slate gray and tan) or Polyester Reinforced Sure-Flex KEE HP Polyvinyl Chloride (PVC) Membrane (white, gray, light gray or tan). Either membrane is available in 10' wide field sheets and 5' perimeter sheets. Standard Polyester Reinforced membrane is also available in 81" wide field sheets and 40.5" perimeter sheets. Sure-Flex sheets are available in rolls in 75' or 100' rolls. All sheets are mechanically fastened over an approved insulation/underlayment to an acceptable roof deck with the appropriate Carlisle Fasteners and Fastening Plates. Adjoining sheets of Sure-Flex membrane are overlapped and joined together with a minimum 1-1/2" wide heat weld. Membrane fastening requirements are outlined in Warranty Tables in Paragraph 1.05 of this Specification.

**NOTE:** Either Roofing System may be specified using over an existing standing seam, flat seam or corrugated metal roof (mechanically fastened systems incorporate membrane securement into the structural purlins). **Refer to the Metal Retrofit Roofing System Specification**, published separately, for applicable requirements.

**B. Adhered Roofing Systems (Sure-Flex)**

1. The **Sure-Flex Adhered Roofing System** incorporates maximum 10' wide, 50-mil, 60-mil or 80-mil thick Polyester or Fiberglass reinforced Sure-Flex Polyvinyl Chloride (PVC) membrane (white, gray, light gray, slate gray and tan). Carlisle Insulation is mechanically fastened to the roof deck or secured with an approved adhesive and the membrane is fully adhered to the substrate with Sure-Flex Low-VOC Bonding Adhesive, CAV-GRIP PVC aerosol contact adhesive or HydroBond Water-Based Adhesive. Adjoining sheets of membrane are overlapped and joined together with a minimum 1-1/2" wide heat weld.

A KEE HP enhanced (white, gray, light gray, and tan) Sure-Flex PVC membrane with Polyester Reinforcement is available in 5' and 10' width.

Polyester Reinforced membrane is available in widths of 40.5", 5', 81" and 10' wide (white, gray, light gray, slate gray and tan).

Fiberglass Reinforced membrane is available in widths of 10' (white, gray, light gray and tan).

**1.02 General Design Considerations**

Various Warranty Tables have been included in Paragraph 1.05 citing various requirements by which specific warranty coverage can be obtained. Appropriate Warranty Table should be referenced to ensure proper warranty coverage.

- A. The maximum roof slope for Mechanically Fastened Roofing Systems is 18" in one horizontal foot. There are no maximum slope restrictions for the application of the Adhered Roofing System.
- B. The mechanically fastened roofing system is **not acceptable** for installations on steel decks lighter than 22 gauge unless the steel deck is used in conjunction with lightweight concrete and a minimum of 360 pounds pullout per fastener is achieved with HP-X Fasteners into the steel deck below. An Adhered Roofing System may be specified or refer to the Metal Retrofit Roofing System Specification, published separately for other roofing options.
- C. Certain petroleum based products, chemicals, and waste products may not be compatible with this roofing system. Contact Carlisle for verification of compatibility and recommendations concerning an acceptable roofing assembly.
- D. Metal-Edge Systems and Copings should be designed in compliance with Section 1504.5 of the International Building Code and shall be tested in accordance with ANSI/SPRI ES-1.
- E. Concentrated loads from rooftop equipment may cause deformation of insulation/underlayment and possible damage to the membrane if proper protection is not provided. A protection course or sleepers must be specified.
- F. It is the responsibility of the specifier to review local, state and regional codes to determine their impact on the specified Carlisle Roofing System.
- G. It is the responsibility of the building owner or his/her designated representative to verify structural load limitation. In addition, a core cut may be taken to verify weight of existing components when the roofing system is to be specified on an existing facility.
- H. For information regarding CRRC (Cool Roof Rating Council) and LEED™, refer to the applicable Product Data Sheets and [Design Reference DR 07 "CRRC/LEED Information"](#).

I. **Construction Generated Moisture / Vapor Drive**

- 1. On new construction projects, especially in cold climate regions, moisture generated due to the construction process could adversely impact various components within the roofing assembly if not addressed. Refer to [Design Reference DR-01 "Construction Generated Moisture"](#) included in the Carlisle Technical Manual.
- 2. On structural concrete decks, when a vapor retarder is not used, gaps in the deck along the perimeter and around penetrations must be sealed along with vertical joints between tilt-up panels, if present, to prevent infiltration of hot humid air and possible moisture contamination resulting from condensation. This is specifically important when adhesive is used to attach the roof insulation.

**NOTE:** If left unaddressed, collected moisture could weaken insulation boards and facers resulting in a blow-off or increase the probability of mold growth.

J. **Drainage**

- 1. Drainage must be evaluated by the specifier in accordance with all applicable codes. Slopes may be provided by tapering the structure or through the use of tapered insulation; a sufficient number of roof drains should also be specified and properly located to allow for positive drainage. Significant ponding that could remain after 48 hours should be eliminated with the addition of auxiliary drains in low areas where ponding is anticipated.

**Carlisle specifically disclaims responsibility for the design and selection of an adequate drainage system and drain accessories. Selection must be made by the building owner or the owner's design professional.**

- 2. Small incidental areas of ponded water will not impact the performance of this roofing system; however, in accordance with industry standards, the roofing assembly **should be designed to prevent ponding** of water on the roof for prolonged periods (longer than 48 hours). Good roofing practice dictates proper drainage to prevent possible excessive live load and, in the event of a roof leak, to minimize potential interior damage to the roofing assembly and to the interior of the building.
- 3. **Tapered edge strips, crickets or saddles** are recommended where periodic ponding of water may occur. When the slope of the taper exceeds 2 inches to one horizontal foot, additional membrane securement at the

base of the tapered edge strip will be required.

4. Subject to code requirement, it is recommended that a minimum roof slope of 1/8" per horizontal foot be provided to serve long-term aesthetics. On new construction projects, roof drains should be positioned in areas where maximum deflection is anticipated. Slopes greater than 1/8" per foot should be considered due to possible roof deflection.

#### K. Vapor Retarders

1. Carlisle does not require a vapor retarder for the protection of the membrane; however, it should be considered by the specifier for the protection of the roofing assembly including insulation, underlayment and adhesives.
2. The following criteria should be considered by the specifier:
  - 1) In the generally temperate climate of the United States, during the winter months, water vapor flows upward from a heated, more humid interior toward a colder, drier exterior. Vapor retarders are more commonly required in northern climates than in southern regions, where downward vapor pressure may be expected and the roofing membrane itself becomes the vapor retarder.
  - 2) When a vapor retarder is specified, Carlisle VapAir Seal 725TR or VapAir Seal MD Air and Vapor Barrier may be used. Refer to Part II "Products" for necessary information and Spec Supplement G-08 "Application Procedures for 725TR Air and Vapor Barrier" for product installation.
  - 3) On cold storage/freezer facilities, the perimeter and penetration details must be selected to provide an air seal and prevent outside air from infiltrating and condensing within the roofing assembly. Consult latest publications by ASHRAE (American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc.) and NRCA (National Roofing Contractors Association) for specific information.
  - 4) All Carlisle roofing membranes are tested and pass in accordance with ASTM E 2178 and shall qualify as an air barrier when following Carlisle specifications and details for roofing applications.

#### L. Retrofit - Recover Projects (when the existing roofing material is left in place)

1. The removal of existing wet insulation and membrane must be specified. The specifier shall select an appropriate and compatible material as filler for voids created by removal of old insulation or membrane.
2. Entrapment of water between old and new membrane can damage and deteriorate new insulation/underlayment between the two membranes. **If a vapor retarder or air barrier is not specified**, Carlisle recommends existing membrane be perforated to avoid potential moisture accumulation to allow for detection of moisture to enable the building owner to take corrective action. This can be accomplished by drilling approximately 3/4" diameter holes every 100 square feet in the existing built-up roof or single-ply membrane (excluding non-reinforced PVC membrane).
3. If total removal of existing non-reinforced PVC membrane is not specified, existing membrane may be cut into maximum 10' x 10' sections, when the new insulation or membrane underlayment is to be mechanically fastened.
4. Regardless of the type of membrane or assembly selected, any loose flashings at the perimeter, roof drains and roof penetrations must be removed.

### 1.03 Quality Assurance

Building codes are above and beyond the intended purpose of this specification. The building **owner, owner's representative or Specifier** should verify local codes for applicable requirements and limitations. It is the responsibility of the specifier to review local, state and regional codes to determine their impact on the specified Carlisle Roofing System.

**NOTE: For code approvals** achieved with the Carlisle Roofing Systems, refer to the Carlisle Code Approval Guide, DORA (Directory of Roof Assemblies), Factory Mutual (FM) Approval Guide or Underwriters Laboratories (UL) Fire Resistance or Roofing Materials and Systems Directories.

- A. When recovering or retrofitting an existing roof system, the addition of new insulation (type and thickness) may alter the fire performance characteristics of the assembly. Building owners or their designated

representatives shall consult the local code enforcement agency to avoid potential code violation.

- B. Carlisle recommends the use of Carlisle supplied products for use with Sure-Flex Roofing Systems. The performance or integrity of products by others, **when selected by the specifier and accepted as compatible by Carlisle**, is not the responsibility of Carlisle and is **expressly disclaimed** by the Carlisle warranty.
- C. This roofing system must be installed by a Carlisle Authorized Roofing Applicator in compliance with drawings and specifications as approved by Carlisle SynTec.
- D. There must be no deviations made from Carlisle's specifications or Carlisle's approved shop drawings without the **PRIOR WRITTEN APPROVAL** of Carlisle SynTec.
- E. After completion of the installation, upon request, an inspection shall be conducted by a Field Service Representative (FSR) of Carlisle SynTec to ascertain that the membrane roofing system has been installed according to Carlisle's published specifications and details applicable at the time of bid. This inspection is to determine whether a warranty shall be issued. It is not intended as a final inspection for the benefit of the owner.
- F. Coordination between various trades is essential to avoid unnecessary rooftop traffic over completed sections of the roof and to prevent subsequent damage to the membrane roofing system.
- G. Provide polyisocyanurate insulation that meets PIMA Quality Mark Certified LTTR value through third party verification meeting ASTM C 1289, Type II, Class 1, Grade 2.
- H. The solar reflectance of this roofing product may decrease over time due to environmental defacement such as dirt, biological growth, ponded water, etc. The roof should be monitored at regular intervals and maintained or cleaned when necessary to assure the maximum solar reflectance.
- I. Refer to the [Design Reference DR-07 "CRRC/LEED Information"](#) for information. (i.e. solar emittance, solar reflectance and recycled content.)

#### **1.04 Submittals**

- A. To ensure compliance with Carlisle's minimum warranty requirements, the following projects should be forwarded to Carlisle for review prior to installation, preferably prior to bid:
  - 1. Air pressurized buildings, canopies and buildings with large openings where the total wall openings exceed 10% of the total wall area on which the openings are located (such as airport hangars, warehouses and large maintenance facilities).
  - 2. Cold storage buildings and freezer facilities.
  - 3. Adhered Roofing System over 250' in height for projects with warranties up to 15 years.
  - 4. Adhered Roofing System over 100' in height for projects with warranties greater than 15 years.
  - 5. Mechanically Fastened Roofing System projects over 100' in height regardless of warranty duration.
  - 6. Projects where the Sure-Flex membrane is expected to come in direct contact with petroleum-based products or other chemicals.
  - 7. Mechanically Fastened systems specified with a fastener length exceeding 12 inches.
- B. Along with the project submittals (shop drawings and Request for Warranty), the roofing contractor must include pullout tests when results are below the requirements identified in this specification.
- C. Shop drawings must be submitted to Carlisle by the Carlisle Authorized Roofing Applicator along with a completely executed Notice of Award (Page 1 of Carlisle's Request for Warranty form) for approval. Approved shop drawings are required for inspection of the roof and on projects where on-site technical assistance is requested.

##### **Shop drawings must include:**

- 1. Outline of roof and size
- 2. Deck type (for multiple deck types)
- 3. Location and type of **all** penetrations

4. Perimeter and penetration details
5. Key plan (for multiple roof areas) with roof heights indicated
6. Sheet width and number of perimeter sheets for Mechanically Fastened systems
7. Fastener type, length and maximum spacing (for membrane securement) for Reinforced Mechanically Fastened systems.

**Along with the project submittals** (shop drawing and Request for Warranty), the roofing contractor must include **pullout test** results when the results are below the requirements identified in, Table included in **Design Reference DR-06 “Withdrawal Resistance Criteria”**.

When field conditions necessitate modifications to originally approved shop drawings, a copy of the shop drawing outlining all modifications must be submitted to Carlisle for revision and approval prior to inspection and warranty issuance.

**D. As-Built Projects** (roofing systems installed prior to project approval by Carlisle)

The Carlisle Authorized Applicator may supply Carlisle with an As-Built drawing for a project completed prior to Carlisle's approval. The As-Built drawings:

1. Must conform to Carlisle's most current published specifications and details applicable at the time of bid.
2. Must be submitted along with a completely executed Notice of Completion.
3. Must include the items identified in Paragraph 1.04.C.

**NOTE:** As-Built projects are not recommended for those projects referenced in Paragraph 1.04A in order to ensure Carlisle warranty requirements have been met.

**E. Notice of Completion** (Page 2 of the Carlisle Request for Warranty form)

After project completion, a Notice of Completion must be submitted to Carlisle to schedule the necessary inspection of the project prior to issuance of the Carlisle Warranty.

**1.05 Warranty**

- A. A Total System Warranty is available for roofing systems on commercial buildings within the United States and applies only to **products manufactured or marketed by Carlisle SynTec**. The total system is defined as membrane, flashings, adhesives, sealants and other Carlisle brand products utilized in the installation. For a complete description of these products, refer to the Part II “Products” Section in this Specification and **Spec Supplement “Related Products” P-01**.

See Tables Below for information regarding Warranted Systems and Design Criteria:

**TABLE I - Minimum Membrane Thickness for Various Warranty Options** Identifies minimum membrane thickness for Reinforced membranes used in adhered or mechanically fastened roofing systems.

**TABLE II - Mechanically Fastened Roofing Systems – PVC / KEE HP PVC Membrane Fastening Criteria - Steel/Concrete Decks** Identifies fastening density, field membrane width and number perimeter sheets required for the various wind zones. The assemblies are categorized based on various building height and specific wind speed warranty coverage.

**TABLE III - Mechanically Fastened Roofing Systems – PVC / KEE HP PVC Membrane Fastening Criteria – Plywood / OSB Decks** Identifies fastening density, field membrane width and number perimeter sheets required for the various wind zones. The assemblies are categorized based on various building height and specific wind speed warranty coverage.

**TABLE IV - Mechanically Fastened Roofing Systems – PVC / KEE HP PVC Membrane Fastening Criteria – Up to 20 Yrs - Lightweight Insulating Concrete over Steel / Gypsum / Cementitious Wood Fiber Decks** Identifies fastening density, field membrane width and number perimeter sheets required for the various wind zones. The assemblies are categorized based on various building height and specific wind speed warranty coverage.

**TABLE V – Adhered Roofing Systems - Underlayment and Fastening Density for PVC / KEE HP PVC Assemblies with Warranties Up to 20 Yrs** Identifies required underlayments for adhered roofing systems with Warranties up to 20 year based on the various wind speed coverages available. The Table also identifies fastening density or adhesive bead spacing and required edge terminations.

**TABLE VI - Adhered Roofing Systems - Underlayment and Fastening Density for PVC / KEE HP PVC Assemblies with Warranties - 25 to 30 YR**

Identifies required underlayments for adhered roofing systems with Warranties from 25 to 30 year based on the various wind speed coverages available. The Table also identifies fastening density or adhesive bead spacing and required edge terminations.

**Table I Mechanically Fastened or Adhered Membrane Systems Warranty Options (9)**

Warranty Duration	Sure-Flex PVC or KEE HP PVC Membranes								
	Warranty Wind Speed Coverage						Minimum Membrane Thickness (2)	Additional Membrane Coverage	
	55, 72, 80 or 90 mph		100 mph		110 to 120 mph			Puncture	Hail
	Adhered	Mech. Fastened	Adhered	Mech. Fastened	Adhered	Mech. Fastened			
5, 10, or 15 year	√	√	√	N/A(1)	√	N/A	Sure-Flex 50-mil (4)	See Below	See Below
20 year	√(3)	√	√	N/A	√	N/A	Sure-Flex 60 mil (4)(5)	See Below	See Below
25 year (7)	√	√	√	N/A	N/A	N/A	Sure-Flex 80-mil (4)(6)(8)	See Below	See Below
30 year (7)	√	√	√	N/A	N/A	N/A	Sure-Flex KEE HP PVC 80-mil	See Below	See Below

Notes: N/A = Not Acceptable √= Acceptable

- (1) Contact Carlisle for specific requirements.
- (2) All "T-Joints" must be overlaid with appropriate flashing material when using 80-mil PVC/KEE HP membrane.
- (3) HydroBond Adhesive (PVC Only) may be used for projects with 20 year maximum warranty and wind speed coverage up to 90 mph.
- (4) Sure-Flex FRS membrane can be used in lieu of Sure-Flex Polyester reinforced membrane for Adhered Roofing Systems Only.
- (5) Sure-Flex KEE HP PVC 50-mil membrane can be used in lieu of Sure-Flex 60-mil membrane for Warranties Up to 20 Year.
- (6) Sure-Flex KEE HP PVC 60-mil membrane can be used in lieu of Sure-Flex 80-mil membrane for Warranties Up to 25 Year.
- (7) Enhancements may be required for certain flashing details. Published details must be referenced for applicable requirements.
- (8) Sure-Flex PVC 60- or 80-mil membranes in Slate Gray are limited to Warranties Up to 20 Year.
- (9) Low-VOC PVC Bonding Adhesive must be utilized.

**Sure-Flex PVC and KEE HP PVC Membrane**

**Hail**

- 1" Dia. Hail Coverage requires a minimum of 60-mil PVC or KEE HP PVC Adhered to cover board.
- 2" Dia. Hail Coverage requires 80-mil PVC or KEE HP PVC Adhered to cover board.

**Additional Design Requirement:**

- Cover board (SecurShield HD, SecurShield HD Eco, SecurShield HD Plus, SecurShield HD or StormBase Composite, DensDeck Prime, Dens Deck StormX Prime, Securock, DEXcell® Glass Mat, DEXcell FA™, DEXcell FA VSH®, DEXcell® Cement Board – Adhered Only).

**Puncture**

- Minimum 80-mil PVC with Reinforcement: 16 hours of Puncture Coverage.
- Carlisle's Accidental Puncture Warranty covers labor hours and material used during the repair. Maximum labor and material hours are dependent upon system design. Refer to the Warranty Availability Quick Reference Guide for coverage.

**PVC / KEE HP PVC Membrane Fastening Criteria (All Warranties)  
for Mechanically Fastening Roofing Systems  
22 GA. Steel Deck or Structural Concrete Only**

**Table II**

**Caution:** Projects with 25 or 30 year warranties an additional perimeter sheet is required beyond those listed in the table below.

-+Peak Gust Wind Speed Warranty	Max. Building Height	Min. Number of Perimeter Sheets			Field* Membrane Width	Perimeter* Sheet Width	Fastening Density* (Field & Perimeter Sheets)
		Building Distance from Coastline					
		Greater than 7 miles	3 to 7 miles	Less than 3 miles			
55 MPH	Up to 60'	1	2	3	10'	5'	12" O.C.
					81"	40.5"	12" O.C.
	61' to 100'	2	2	3	10'	5'	** See Note
					81"	40.5"	12" O.C.
72 MPH	Up to 60'	2	2	3	10'	5'	12" O.C.
					81"	40.5"	12" O.C.
	61' to 100'	3	4	4	10'	5'	** See Note
					81"	40.5"	12" O.C.
80 MPH	Up to 60'	3	3	4	10'	5'	12" O.C.
					81"	40.5"	12" O.C.
	61' to 100'	3	4	4	10'	5'	** See Note
					81"	40.5"	12" O.C.
90 MPH	Up to 60'	3	4	4	10'	5'	6" O.C.
					81"	40.5"	12" O.C.
	61' to 100'	4	5	5	10'	5'	** See Note
					81"	40.5"	12" O.C.

\*Using HP-X Fasteners for steel decks, wood plank decks and minimum ¾" thick plywood decks and HD 14-10 or CD-10 for structural concrete decks.

\*\* Structural Concrete Decks use 12" O.C. spacing utilizing HD 14-10 or CD-10. Steel Decks use 6" O.C. utilizing HP-X Fasteners. Steel decks use 12" O.C. spacing utilizing HP-Xtra Fasteners.

**PVC / KEE HP PVC Membrane Fastening Criteria  
(Up to 20 Year Warranty – Up to 60' Building Height)  
for Mechanically Fastening Roofing Systems - Plywood or OSB Decks**

**Table III**

Wood (Plywood or OSB) Decks Peak Gust Wind Speed Warranty	Deck Type	Projected Pull-Out Values	Min. Number of Perimeter Sheets			Field Membrane Width	Perimeter Sheet Width	Fastening Density (Field & Perimeter Sheets)
			Building Distance from Coastline					
			Greater than 7 miles	3 to 7 miles	Less than 3 miles			
<b>55 MPH</b>	7/16" OSB	210 lbs	2	3	3	10'	5*	9" O.C.
			2	3	3	81"	5*	12" O.C.
	15/32" 3-Ply Plywood	240 lbs	2	2	3	81"	5*	12" O.C.
	15/32" 5-Ply Plywood	530 lbs	1	2	3	10'	6.5'	12" O.C.
	5/8" OSB	310 lbs	2	3	3	10'	5*	12" O.C.
			2	3	3	81"	5*	12" O.C.
<b>72 MPH</b>	15/32" 3-Ply Plywood	240 lbs	2	2	3	81"	5*	12" O.C.
	15/32" 5-Ply Plywood	530 lbs	2	2	3	10'	6.5'	12" O.C.
	5/8" OSB	310 lbs	2	3	3	10'	5*	12" O.C.
			2	3	3	81"	5*	12" O.C.
<b>80 MPH</b>	<i>Contact Carlisle for Approval and Evaluation</i>							

\*Maximum duration for OSB NOT to exceed 20 Years.

**Table IV PVC / KEE HP PVC Membrane Fastening Criteria  
Up to 20 Warranty for Mechanically Fastening Roofing Systems  
Lightweight Insulating Concrete over Steel / Gypsum / Cementitious Wood Fiber**

Peak Gust Wind Speed Warranty	Building Height 50' Max.	Min. Number of Perimeter Sheets			Field Membrane Width	Perimeter Sheet Width	Fastening Density (Field & Perimeter Sheets)
		Local Wind Speed					
	Deck Type	Greater than 7 miles	3 to 7 miles	Less than 3 miles			
55 MPH	Lightweight Concrete over Steel Deck	1	2	4	10'	5'	12" O.C.(1)
		2	3	4	81" (3)	40.5"	12" O.C.(2)
	Gypsum Deck or Cementitious Wood Fiber	2	3	N/A	10'	5' or 6'	9" O.C.
		2	3	4	81"	4'	12" O.C.

**N/A is Not Acceptable**

- (1) For Buildings 51' to 75' with 10' field sheets – Fastening Density must be increased to 9" O.C. for field and perimeter sheets.
- (2) Fasteners may be spaced at 18" O.C. in the field for buildings Up to 50' in height.
- (3) Building Height may be Up to 75' in height.

**Table IV - Additional Design Considerations (Up to 20 YR Warranty)**

1- Membrane configuration and fastening density in Table above is based on HP-X Fasteners penetrating metal pan below Lightweight Insulating Concrete and for Polymer Gyptec Fasteners engaging into Gypsum and Cementitious Fiber Decks.

2-See [Design Reference DR-06 "Withdrawal Resistance Criteria"](#) for more information.

**Underlayment/Insulation & Required Attachment  
Assemblies Up to 20 YR Warranty  
for Adhered PVC / KEE HP PVC Roofing**

**Table V**

Other Requirements are Listed in Additional Design Considerations following this Table.  
All Carlisle Products listed for higher wind speed coverage can also be used for Warranties for a lower speed coverage.  
(i.e. 72 MPH underlayment may be used for 55 MPH underlayment)

Peak Gust Wind Speed Warranty	Minimum Membrane Underlayment*	Insulation Attachment		Metal Edging	
		# of Fasteners per 4' x 8' board size	Adhesive Ribbon Spacing for 4' x 4' size board		
			Field		Perimeter
55 or 72 MPH	1" (20 psi) Polyisocyanurate or 1" Polyisocyanurate Eco	16	12"(5)(6)	6"(5)	SecurEdge Drip Edge
	1-1/2" (20 psi) Polyisocyanurate or 1-1/2" Polyisocyanurate Eco	10			
	2"(20 psi) Polyisocyanurate or 2" (20 psi) Polyisocyanurate Eco	8			
	1/2" SecurShield HD or 1/2" SecurShield HD Eco (1)(2)	12			
	1/4" DensDeck Prime, 1/4" Securock, 1/4" Securock Ultralight Coated Glass Mat, 1/4" DEXcell® Glass Mat or 1/4" DEXcell FA™ Glass Mat (1)	12			
80 MPH	1/2" SecurShield HD Plus (2)	8	12"(5)(6)(7)	6"(5)(7)	SecurEdge Drip Edge (11)
	1/2" HP Recovery Board (1)	16			
	1/2" SecurShield HD or 1/2" SecurShield HD Eco	16			
	2" SecurShield HD Composite	6			
	1/2" DensDeck Prime, 1/2" Securock, 1/2" Securock Ultralight Coated Glass-Mat Board, 1/2" DEXcell® Glass Mat, 7/16" DEXcell® Cement Board or 1/2" DEXcell FA™ Glass Mat (1)	8			
	1-1/2" (25 psi) Polyisocyanurate or 1-1/2" (25 psi) Polyisocyanurate Eco	10			
	2" (25 psi) Polyisocyanurate or 2" (25 psi) Polyisocyanurate Eco	8			
90 MPH	1/2" DensDeck Prime, 1/2" Securock, 1/2" Securock Ultralight Coated Glass-Mat, 1/2" DEXcell® Glass Mat, 7/16" DEXcell® Cement Board or 1/2" DEXcell FA™ Glass Mat (1)	12	6"(9)	6"(7)(8)	SecurEdge Drip Edge (3) or SecurEdge EX Drip Edge
	1/2" SecurShield HD, 1/2" SecurShield HD Eco, 1-1/2" (20 psi) SecurShield Polyiso or 1-1/2" SecurShield Eco (1)(2)	16			
	1/2" SecurShield HD Plus or 1/2" EcoStorm VSH (1)	12			
	2" (20 psi) SecurShield Polyiso, 2" (20-psi) SecurShield Eco or 2" SecurShield HD Composite	8			
	1-1/2" StormBase (OSB/Polyiso Composite)	8			
	1-1/2" Insulfoam HD Composite	16			
100 MPH	2" (25-psi) SecurShield Polyiso or 2" (25-psi) SecurShield Eco	16	FS	FS	SecurEdge Drip Edge (3), or SecurEdge EX Drip Edge
110 MPH	1-1/2" StormBase (OSB/Polyiso Composite) or 1/2" EcoStorm VSH (1)	16	FS	FS	SecurEdge EX Drip Edge
	1/2" SecurShield HD Plus (1)(2)				
120 MPH	5/8" DensDeck Prime, 5/8" DensDeck StormX Prime, 5/8" Securock, 5/8" Securock Ultralight Coated Glass-Mat, 5/8" DEXcell FA™ Glass Mat, 5/8" DEXcell® Cement Roof Board or 5/8" DEXcell FA VSH® (1)	16	FS	FS	SecurEdge EX Drip Edge
	1-1/2" StormBase (OSB/Polyiso Composite) or 1/2" EcoStorm VSH (1)	17			
	1/2" SecurShield HD Plus (1) (2)	24			
	2" SecurShield HD Composite	16			

**FS = Full Spray or Ribbons @ 4" O.C.**

**\*For Direct Application over Wood Decks and Lightweight Cellular Concrete, Refer to Roof Deck & Substrate Criteria Table.**

- (1) For Steel decks (New or tear-off) cover boards must be installed over a min. 1" thick approved Carlisle Insulation.
- (2) 1/2" SecurShield HD or 1/2" SecurShield HD Eco limited to 90 mph. 1/2" SecurShield HD Plus limited to 120 mph.
- (3) Carlisle HP or HP-X Fasteners must be used to secure Carlisle Drip Edge or SecurEdge 200 Metal Fascia to perimeter wood nailers.
- (4) Membrane securement is required at the base of the SecurEdge 200 waterdam.
- (5) Gravel Surface BUR - Field @ 6" O.C. / Perimeter @ 4" O.C.
- (6) Steel Decks - Field & Perimeter @ 6" O.C.
- (7) Cementitious Wood Fiber - Field @ 6" O.C. / Perimeter @ 4" O.C.
- (8) Smooth BUR - Field @ 6" O.C. / Perimeter @ 4" O.C.
- (9) Gravel Surface BUR – FS
- (10) Not used.
- (11) May be fastened with ring shank nails staggered 4" on center. Carlisle HP or HP-X Fasteners may also be used fastened 12" on center.
- (12) Gypsum Deck Bead Spacing @ 6" O.C. for 80 mph.

### **Table V - Additional Design Considerations (Up to 20 YR Warranty)**

- 1 - Minimum membrane thickness 60-mil PVC or 50-mil KEE HP PVC
- 2 - Building height shall not exceed 100\*
- 3 - All "T-Joints" must be overlaid with Carlisle "T-Joint" Covers.
- 4 - For Building heights between 51-100', enhance the 12'-wide perimeter with 50% more fasteners and plates.
- 5 - See DR-05 for insulation fastening patterns.

\* Projects where building height exceeds 100' shall be submitted to Carlisle for review.

\*\* 16 fasteners per 4' x 8' board are required for the following decks: OSB, gypsum, cementitious, wood fiber (Tectum), lightweight insulated concrete over steel roof deck thinner than 22-gauge and steel roof deck thinner than 22-gauge. Warranties are limited to a 20-year, 72-mph wind speed.

**Underlayment/Insulation & Required Attachment  
Assemblies 25 YR or 30 YR Warranty  
for Adhered PVC / KEE HP PVC Roofing Systems**

**Table VI**

Other Requirements are Listed in Additional Design Considerations following this Table.

All Carlisle Products listed for higher wind speed coverage can also be used for Warranties for a lower speed coverage. (i.e. 72 MPH underlayment may be used for 55 MPH underlayment)

Peak Gust Wind Speed Warranty	Minimum Membrane Underlayment	Insulation Attachment		Metal Edging	
		# of Fasteners per 4' x 8' board size	Adhesive Ribbon Spacing for 4' x 4' size board (3)		
			Field		Perimeter
55 or 72 MPH	1" to 2" (25 psi) Polyisocyanurate or Polyisocyanurate Eco	16	6" (3)(5)	6" (5)	SecurEdge Drip Edge
	1/2" HP Recovery Board (9)				
	1/4" DensDeck Prime, 1/4" Securock, 1/4" Securock Ultralight Coated Glass-Mat, 1/4" DEXcell® Glass Mat or 1/4" DEXcell FA™ Glass Mat (2)				
	1/2" SecurShield HD or 1/2" SecurShield HD Eco (2)				
80 MPH	1-1/2" to 2" (25-psi) SecurShield Polyisocyanurate or SecurShield Eco	20	6" (4)(5)(6)	6" (5)(6)	SecurEdge Drip Edge (7), SecurEdge Snap-On Canted Fascia (7) (8) or SecurEdge EX Drip Edge
	1/2" DensDeck Prime, 1/2" Securock, 1/2" Securock Ultralight Coated Glass-Mat, 1/2" DEXcell® Glass Mat or 1/2" DEXcell FA™ Glass Mat (2)	16			
	1/2" SecurShield HD Plus (2)	20			
	1/2" SecurShield HD or 1/2" SecurShield HD Eco (2)				
90 MPH	1/2" SecurShield HD or 1/2" SecurShield HD Eco (2)	24	FS	FS	SecurEdge EX Drip Edge
	1/2" SecurShield HD Plus (2)	20			
	1/2" DensDeck Prime, 1/2" Securock, 1/2" Securock Ultralight Coated Glass-Mat, 1/2" DEXcell® Glass Mat or 1/2" DEXcell FA™ Glass Mat (2)				
100 MPH	5/8" DensDeck Prime, 5/8" Dens Deck StormX Prime, 5/8" Securock, 5/8" Securock Ultralight Coated Glass-Mat, 5/8" DEXcell® Glass Mat, 5/8" DEXcell FA™ Glass Mat, or 5/8" DEXcell® Cement Roof Board or 5/8" DEXcell FA VSH® (2)	16	FS	FS	SecurEdge EX Drip Edge
	1-1/2" StormBase (OSB/Polyiso Composite) or 1/2" EcoStorm VSH (2)				
	2" SecurShield HD Composite (2)				
	1/2" SecurShield HD Plus (2)	24			

**FS = Full Spray or Ribbons @ 4" O.C.**

- (1) Not Used.
- (2) Hail coverage offered with substrate.
- (3) Structural Concrete - Field @ 12" O.C. / Perimeter @ 6" O.C.
- (4) 80 mph over Structural Concrete - Field & Perimeter @ 6" O.C.
- (5) Cementitious Wood Fiber & Wood – FS
- (6) 80-mph warranty wind speed coverage over Gypsum Decks – Adhesive Ribbon spacing shall be at 4" O.C.
- (7) Carlisle HP or HP-X Fasteners must be used to secure Carlisle Drip Edge or SecurEdge200 Metal Fascia to perimeter wood nailers.
- (8) Membrane securement is required at the base of the SecurEdge 200 waterdam.
- (9) 1/2" Recovery Board limited to 55 mph.

**Table VI - Additional Design Considerations (25 YR or 30 YR Warranty)**

1 - Minimum membrane thickness 80-mil PVC or KEE HP PVC

- 2 - Building height shall not exceed 100'
  - 3 - Acceptable decking: 22-gauge or heavier steel, structural concrete, 1-1/2" wood plank, or 15/32" plywood.
  - 4 - All "T-joints" must be overlaid with Carlisle "T-Joint" Covers.
  - 5 - New construction or complete tear-off of existing roofing material.
  - 6- See DR-05 for insulation fastening patterns.
  - 7 - For Building heights between 51-100 feet, enhance 12'-wide perimeter with 50% more fasteners and plates.
- \* Projects where building height exceeds 100' or warranty wind speed exceeds 100 mph, shall be submitted to Carlisle for review.

**Table VII Minimum Perimeter Width for Insulation Attachment For All Warranties**

Width of Perimeter	Building Height
4 feet	25 feet
8 feet	26 to 50 feet
12 feet	51 to 75 feet
16 feet	76 to 100 feet
24 feet	Greater than 100 feet

**Note: This Table is for reference for Carlisle System Warranties and does not replace FM requirements for FM insured projects.**

**B. Access for warranty service**

It shall be the owner's responsibility to expose the membrane in the event that warranty service is required when access is impaired. Such impairment includes, but is not necessarily limited to:

1. Design features, such as window washer systems, which require the installation of traffic surface units in excess of 100 pounds per unit.
2. Any equipment, ornamentation, building service units and other top surfacing materials which are not defined as part of this specification.
3. Photovoltaic and Mounting systems or other Rooftop equipment that does not provide Carlisle with reasonable access to the membrane system for purposes of warranty investigation and related repairs.
4. Severely ponded conditions.

**CAUTION:** APPLICATIONS SUCH AS WALKING DECKS, TERRACES, PATIOS OR AREAS SUBJECTED TO CONDITIONS NOT TYPICALLY FOUND ON ROOFING SYSTEMS WILL **NOT** BE ELIGIBLE FOR A MEMBRANE SYSTEM WARRANTY.

- C. The formation or presence of mold or fungi in a building is dependent upon a broad range of factors including, but not limited to, the presence of spores and nutrient sources, moisture, temperatures, climatic conditions, relative humidity, and heating/ventilating systems and their maintenance and operating capabilities. These factors are beyond the control of Carlisle and Carlisle shall not be responsible for any claims, repairs, restoration or damages relating to the presence of any irritants, contaminants, vapors, fumes, molds, fungi, bacteria, spores, mycotoxins, or the like in any building or in the air, land, or water serving the building.

## 1.06 Job Conditions

- A. On phased roofing, temporary closures should be provided to prevent moisture infiltration. When a temporary roof is specified, Carlisle 725-TR in conjunction with CCW-702, CCW 702LV or CAV-GRIP III Low-VOC Adhesive/Primer may be used. Refer to Product Section Part II for additional product information and [Specification Supplement G-08](#).
- B. When possible on multiple level roofs, begin the installation on the highest level to avoid or minimize construction traffic on completed roof sections.
- C. On projects at high altitudes (6,000' and above) rapid flash-off (drying) of Adhesives will occur due to low atmospheric pressure.
- D. When roof slopes exceed 5 inches per horizontal foot, use of an Automatic Heat Welder may be more difficult. A Hand Held Hot Air Welder should be specified.
- E. Wood nailers are required for the securement of metal edgings, scuppers, and insulated pipes. Wood nailer shall be secured per specifier recommendation or in accordance with Factory Mutual's property Loss Prevention Data Sheet 1-49. Refer to [Design Reference DR-08 "Wood Nailers Securement Criteria"](#) in Carlisle Technical Manual shall be referenced.
- F. When any of the Roofing Systems are specified on a portion of a roof, tie-ins to existing roofing membranes will be required. Depending on the type of the existing roofing system, the tie-in method will vary. Total isolation between two roofing systems or weep holes may be required to address moisture migration from one roofing system to the other. Prior to the selection of any tie-in detail, ensure the selected detail will not restrict drainage.
- G. On new construction projects, located in colder climates, special consideration should be given to construction practices and the possible migration of hot, humid air and moisture generated during construction. Refer to Paragraph 1.02 I and [Design Reference DR-01 "Construction Generated Moisture"](#).

## 1.07 Product, Delivery, Storage and Handling

- A. Deliver materials to the job site in the original, unopened containers.
- B. When loading materials onto the roof, the Carlisle Authorized Roofing Applicator must comply with the requirements of the specifier/owner to prevent overloading and possible disturbance to the building structure.
- C. Job site storage temperatures in excess of 90° F (32° C) may affect shelf life of curable materials (i.e., adhesives and sealants).
- D. When the temperature is expected to fall below 40° F (4° C), outside storage boxes should be provided on the roof for temporary storage of liquid adhesives and sealants. Adhesive and sealant containers should be rotated to maintain their temperature above 40° F (4° C). Refer to Product Data Sheets for individual products for temperature restrictions.
- E. Do not store adhesive or cleaner containers with opened lids due to the loss of solvent that will occur from flash-off.
- F. Store Carlisle membrane on provided pallets in the original undisturbed plastic wrap in a cool, shaded area and cover with light-colored, breathable tarpaulins.
- G. Insulation/underlayment must be stored so that it is kept dry and is protected from the elements. Store bundles flat and upright with the bottom of the bundles elevated (2" or more) above the finished surface.
- H. Slit the insulation bundle packaging vertically down the center of the two short sides to prevent moisture accumulation within the package. Completely cover the bundle with a waterproof tarp and secure to prevent wind damage and / or displacement.

## Part II – PRODUCTS

### 2.01 General

The components of this roofing system are to be products of Carlisle or accepted by Carlisle as compatible. The installation, performance or integrity of products by others, **when selected by the specifier and accepted by Carlisle**, is not the responsibility of Carlisle and is expressly disclaimed by the Carlisle warranty.

### 2.02 Membranes

#### A. Sure-Flex Membranes

##### 1. General

- a. The Sure-Flex PVC membrane (white) meets the ENERGY STAR requirement for reflectance and emittance. When tested in accordance with ASTM C1549, the material has an initial reflectance of 0.86 and a 3-year aged reflectance of 0.63. The material has also been tested for emittance in accordance with ASTM C1371. An initial emittance of 0.89 and a 3-year aged emittance of 0.87 were achieved.
- b. The Sure-Flex KEE HP PVC membrane (white) meets the ENERGY STAR requirement for reflectance and emittance. When tested in accordance with ASTM C1549, the material has an initial reflectance of 0.82 and a 3-year aged reflectance of 0.71. The material has also been tested for emittance in accordance with ASTM C1371. An initial emittance of 0.89 and a 3-year aged emittance of 0.84 were achieved.
- c. The Sure-Flex PVC membrane (white) meets the emittance requirements set forth by the USGBC (US Green Building Council) for their LEED (Leadership in Energy and Environmental Designs) Program. When tested in accordance with ASTM E408, an emittance of 0.89 was achieved and an SRI (solar reflectance index) of 108 was calculated using ASTM E1980.
- d. The Sure-Flex KEE HP PVC membrane (white) meets the emittance requirements set forth by the USGBC (US Green Building Council) for their LEED (Leadership in Energy and Environmental Designs) Program. When tested in accordance with ASTM E408, an emittance of 0.89 was achieved and an SRI (solar reflectance index) of 103 was calculated using ASTM E1980.

##### 2. Sure-Flex 50-mil, 60-mil or 80-mil thick **Polyester Reinforced PVC** (Polyvinyl Chloride) Membrane conforms to the following physical properties

- a. Physical properties of the membrane are enhanced by a strong, polyester fabric that is encapsulated between the PVC based top and bottom plies. The combination of the fabric and PVC plies provide Sure-Flex Reinforced PVC membranes with high breaking strength, tearing strength, and puncture resistance.
- b. Field membrane sheets are packaged in rolls 81" or 120" wide. Perimeter membrane sheets are available in a width of 40.5" or 60" wide. 50-mil thick membrane is available in lengths of 100', 60-mil is available in 100' lengths and 80-mil is available in 75' lengths. Sure-Flex PVC Membrane is available in white, gray, light gray, slate gray and tan. Sure-Flex PVC KEE HP Membrane is available in white, gray, light gray, and tan.

**OPTION:** 60-mil Sure-Flex PVC or 60-mil Sure-Flex KEE HP (white color only) reinforced membrane is available with an optional APEEL Protective Film. APEEL Protective Film can be left in place for up to 90 days without affecting the integrity of the film, guarding the PVC/KEE HP membrane's surface from scuffs and dirt accumulation during installation. Durable and easy to remove, APEEL Protective Film improves aesthetics and long-term reflectivity. Available 5' and 10' widths by 100' long rolls. Also available, APEEL 6" Cover Tape, allowing 100% coverage of the PVC surface.

<b>Sure-Flex Polyester Reinforced PVC Membrane</b>				
<b>Physical Property</b>	<b>ASTM D4434 Requirement</b>	<b>50-mil Min.</b>	<b>60-mil Min.</b>	<b>80-mil Min.</b>
<b>Thickness Over Scrim</b> , in. (mm) ASTM D4434 optical method average of 3 areas	0.016 min. (0.40)	0.022 (0.559)	0.028 (0.711)	0.038 (0.965)
<b>Weight</b> , lbs/ft <sup>2</sup> (kg/m <sup>2</sup> )	No requirement	0.33 (1.61)	0.40 (1.95)	0.55 (2.68)
<b>Breaking Strength</b> (MD X CD), lbf/in (kN/m) ASTM D751 grab method	275 min. (48)	320 x 300 (56 x 53)	330 x 300 (58 x 55)	360 x 330 (63 x 58)
<b>Elongation</b> break of reinforcement (MD x CD), % ASTM D751 grab method	25 min.	30 x 30	30 x 30	30 x 30
<b>Seam Strength</b> , min. ASTM D751 grab method (% of breaking strength)	>75	PASS	PASS	PASS
<b>Tearing Strength</b> (MD x CD), lbf (N) ASTM D751 proc. B, 8 in. x 8 in.	90 min. (400)	100 x 120 (445 x 534)	100 x 130 (445 x 578)	100 x 132 (445 x 587)
<b>Low Temperature Bend</b> , ASTM D2135, no cracks 5x at -40°C	PASS	PASS (-40°C)	PASS (-40°C)	PASS (-40°C)
<b>Linear Dimensional Change</b> , % ASTM D1204, 6 hours at 176°F	+/- 0.5 max.	0.4	0.4	0.4
<b>Ozone Resistance</b> , no cracks 7x ASTM D1149, 100pphm, 168 hrs	PASS	PASS	PASS	PASS
<b>Water Absorption Resistance</b> , mass % ASTM D570, 166 hours at 158°F	+/- 3.0 max.	2.0	2.0	2.0
<b>Field Seam Strength</b> , lbf/in. (kN/m) ASTM D1876 tested in peel	No Requirement	25 (4.4) min. 60 (10.5) max.	25 (4.4) min. 60 (10.5) max.	25 (4.4) min. 60 (10.5) max.
<b>Water Vapor Permeance</b> , perms, ASTM E96 proc. B	No Requirement	0.10 max. 0.05 typ.	0.10 max. 0.05 typ.	0.10 max. 0.05 typ.
<b>Puncture Resistance – Federal</b> , lbf (kN) FTM 101C, method 2031	No Requirement	280	320	380
<b>Puncture Resistance – Dynamic</b> , J (ft-lbf) ASTM D5635	20 (14.7)	PASS	PASS	PASS
<b>Puncture Resistance – Static</b> , lbf (N) ASTM D5602	33 (145)	PASS	PASS	PASS
<b>Xenon-Arc Resistance</b> , no cracks/crazing 10x, ASTM G155 0.35 W/m <sup>2</sup> at 340-nm, 63°C B.P.T. 12,600 kJ/m <sup>2</sup> total radiant exposure 10,000 hours	PASS	PASS	PASS	PASS
<b>Properties After Heat Aging</b> , ASTM D3045, 56 days at 176°F Breaking Strength, % retained Elongation reinf., % retained	90 min. 90 min.	90 min. 90 min.	90 min. 90 min.	90 min. 90 min.
B.P.T. is black panel temperature				

3. Sure-Flex 50-mil, 60-mil or 80-mil thick Reinforced FRS PVC (Polyvinyl Chloride) Membrane is designed specifically for Fully Adhered applications and conforms to the following physical properties.
  - a. Dimensional stability of the membrane is enhanced by fiberglass that is encapsulated between the PVC based top and bottom plies. The combination of fiberglass and PVC plies provide Sure-Flex FRS PVC membranes with enhanced dimensional stability for fully adhered roof systems using liquid applied bonding adhesives.
  - b. Membrane sheets are packaged in 10' wide rolls. 50-mil thick membrane is available in lengths of 100', 60-mil is available in 80' lengths and 80-mil is available in 65' lengths. Sure-Flex Reinforced FRS PVC Membrane is available in white, gray, light gray, and tan.

Sure-Flex Reinforced FRS PVC Membrane			
Physical Property	Test Method	Property of Unaged Sheet	Property After ASTM D3045 aging 56 days @ 176° F
Tolerance on Nominal Thickness, %	ASTM D 638	± 10	
Thickness over scrim, in. (mm) 50-mil & 60-mil 80-mil	ASTM D 4434 Optical Method (avg. of 3 areas)	0.016 (0.406) min. 0.025 (0.635) min.	
Tensile Strength, psi (MPa) (machine & cross-machine direction)	ASTM D 638 (Grab Method)	1500 (10.4) min. 1900 (13.1) typical	90% min. retention of original breaking strength
Elongation at Break, % Machine direction Cross-machine direction	ASTM D 638	250 min. (270 typical) 220 min. (250 typical)	90% min. retention of original elongation
Tear Resistance, lbf (N)	ASTM D 1004	10 (45) min. 12 (53) typical	
Low Temperature Bend at -40° F (-40° C)	ASTM D 2136	Pass	
Linear Dimensional Change (shrinkage), % After 6 hours at 176° F (80° C)	ASTM D 1204	+/- 0.5 max. 0.1 typical	
Ozone resistance, 100 pphm, 168 hours	ASTM D1149	No cracks	
Resistance to water absorption After 7 days immersion 158° F (70° C) Change in mass, %	ASTM D 570	3.0 max. 0.5 typical	
Seam strength, % of tensile strength	ASTM D638	75 min. 80 typical	
Water vapor permeance, Perms	ASTM E 96	0.10 max. 0.05 typical	
Puncture resistance (see supplemental section for additional puncture data)			
Resistance to xenon-arc weathering Xenon-Arc, 12,600 kJ/m <sup>2</sup> total radiant exposure, visual condition at 10X (ASTM D 4434 light & spray cycle)	ASTM G155 0.35 W/m <sup>2</sup> 63 ° C B.P.T. (10,000 hours)	No cracks No crazing	
B.P.T. is black panel temperature			

4. Sure-Flex 50-mil, 60-mil or 80-mil thick **KEE HP PVC Polyester Reinforced Membrane** is designed for **Fully Adhered or Mechanically Fastened applications** and conforms to the following physical properties.
  - a. Physical properties of the membrane are enhanced by a strong, polyester fabric that is encapsulated between the KEE HP based top and bottom plies. The combination of the fabric and KEE HP plies provide Sure-Flex KEE HP Polyester Reinforced membranes with high breaking strength, tearing strength, and puncture resistance.
  - b. Field membrane sheets are packaged in 5' and 10' wide rolls. 50-mil thick membrane is available in lengths of 100', 60-mil is available in 100' lengths and 80-mil is available in 75' lengths. Sure-Flex KEE HP Membrane is available in white, gray, light gray, slate gray and tan.

<b>Sure-Flex KEE HP Polyester Reinforced Membrane</b>				
<b>PHYSICAL PROPERTY</b>	<b>ASTM D4434 Requirement</b>	<b>50-mil</b>	<b>60-mil</b>	<b>80-mil</b>
<b>Thickness Over Scrim</b> , in. (mm) ASTM D4434 optical method average of 3 areas	0.016 min. (0.40)	0.024 (0.61)	0.029 (0.74)	0.036 (0.91)
<b>Weight</b> , lbs/ft <sup>2</sup> (kg/m <sup>2</sup> )	No requirement	0.33 (1.61)	0.40 (1.95)	0.55 (2.68)
<b>Breaking Strength</b> (MD X CD), lbf/in (kN/m) ASTM D751 grab method	275 min. (48)	290 x 290 (51 x 51)	320 x 300 (56 x 52)	330 x 320 (58 x 56)
<b>Elongation</b> break of reinforcement (MD x CD), % ASTM D751 grab method	25 min.	30 x 30	30 x 30	30 x 30
<b>Tearing Strength</b> (MD x CD), lbf (N) ASTM D751 proc. B, 8 in. x 8 in.	90 min. (400)	120 x 125 (534 x 556)	120 x 125 (534 x 556)	140 x 150 (623 x 667)
<b>Low Temperature Bend</b> , ASTM D2135, no cracks 5x at -40°C	PASS	PASS (-46°C)	PASS (-46°C)	PASS (-46°C)
<b>Linear Dimensional Change</b> , % ASTM D1204, 6 hours at 176°F	+/- 0.5 max.	0.4 typ.	0.4 typ.	0.4 typ.
<b>Ozone Resistance</b> , no cracks 7x ASTM D1149, 100pphm, 168 hrs	PASS	PASS	PASS	PASS
<b>Water Absorption Resistance</b> , mass % ASTM D570, 166 hours at 158°F	+/- 3.0 max.	1.25	0.87	0.89
<b>Puncture Resistance – Dynamic</b> , J (ft-lbf) ASTM D5635	20 (14.7)	PASS	PASS	PASS
<b>Puncture Resistance – Static</b> , lbf (N) ASTM D5602	33 (145)	PASS	PASS	PASS
<b>Xenon-Arc Resistance</b> , no cracks/crazing 10x, ASTM G155 0.35 W/m <sup>2</sup> at 340-nm, 63°C B.P.T. 12,600 kJ/m <sup>2</sup> total radiant exposure 10,000 hours	PASS	PASS	PASS	PASS
<b>Properties After Heat Aging</b> , ASTM D3045, 56 days at 176°F Breaking Strength, % retained Elongation reinf., % retained	90 min. 90 min.	90 min. 90 min.	90 min. 90 min.	90 min. 90 min.
B.P.T. is black panel temperature				

## 2.03 Insulations/Underlayments

### A. General

1. Roof insulation thickness must be determined by the thermal value required for each project and may be subject to code approval limitations. On projects where a vapor retarder is used, the specifier must calculate insulation thickness to ensure the temperature at the vapor retarder will not fall below the calculated dew point.
2. Multiple layers of insulation are recommended with all joints staggered between layers.
3. For minimum recommended R-Values, previously published by American Society of Heating and Air-Conditioning Engineers (ASHRAE), consult local building code official for applicable requirements.
4. For Insulation fastening pattern and densities refer to Carlisle Applicable Details and [Design Reference DR-05 "Insulation Fastening Patterns"](#).
5. Carlisle Insulation/underlayment must be specified for all Total System Warranty projects or when the insulation is to be covered by the Carlisle Warranty. Any of the Carlisle Insulation/Underlayment may be specified subject to design restrictions included with each table.

### B. Carlisle Polyisocyanurate

<b>Table B1 Polyisocyanurate</b> (See below for product descriptions)					
Insulations / Underlayment	Minimum Thickness	ASTM	Roofing System Acceptability		
			Adhered	Mechanically Fastened	Ballasted
Carlisle InsulBase Polyisocyanurate, Carlisle InsulBase Eco	*1.5"	C1289, Type II, Class 1, Grade 2 or 3	√	√	√
Carlisle InsulBase NH Polyisocyanurate	*1.5"	C1289, Type II, Class 1, Grade 2 or 3	√	√	√
Carlisle SecurShield Polyisocyanurate, Carlisle SecurShield Eco	*1.5"	C1289, Type II, Class 2, Grade 2 or 3	√	√	√
Carlisle SecurShield NH Polyisocyanurate	*1.5"	C1289, Type II, Class 2, Grade 2 or 3	√	√	√
Carlisle SecurShield HD Composite Polyisocyanurate (SS HD)	2"	C1289, Type IV, Grade 2 or 3	√	√	N/A
Carlisle StormBase Composite (OSB)	1.5"	C1289, Type V, Grade 2 or 3	√	√	N/A
<b>Design Restrictions</b>					
<ul style="list-style-type: none"> <li>- Extended Warranty, those with longer duration, higher wind speed, or puncture coverage, may require the use of a cover board over Polyiso Insulation, refer to Warranty Tables in Paragraph 1.04 for applicable requirements.</li> <li>- Maximum Flute Spanability shall be limited to 2-5/8" when 1" Minimum Polyiso Insulation is to be used.</li> <li>- Minimum thickness of insulation board may be restricted by wind speed coverage and warranty duration, refer to Tables V and VI in Paragraph 1.05.</li> <li>- The use of HD Polyiso Composite roof insulation is not recommended for Ballasted Applications.</li> </ul> <p>*1.5" minimum for adhered systems. 1" minimum for mechanically fastened systems or as a base layer for adhered.</p>					
Notes: N/A = Not Acceptable    √ = Acceptable					

SecurShield HD is listed in Paragraph E4 below.

1. **Carlisle InsulBase Polyisocyanurate** – A foam core insulation board covered on both sides with a medium weight fiber-reinforced felt facer meeting ASTM C 1289, Type II, Class 1, Grade 2 (20 psi) or Grade 3 (25 psi). The product is available in 4' x 8' standard size with a thickness from 1 to 4 inches. 4' x 4' tapered panels are also available.
2. **Carlisle InsulBase Eco** – A rigid roof insulation panel with 5% ISCC-certified bio-attributed content composed of a closed-cell polyisocyanurate foam core bonded to glass-reinforced felt (GRF) facers, meeting ASTM C 1289, Type II, Class 1, Grade 2 (20 psi) or Grade 3 (25 psi). The product is available in 4' x 8' standard size with a thickness from 1 to 4 inches. 4' x 4' tapered panels are also available. UL and FM approved for direct application over steel decks, polyiso provides the highest R-value per inch of any commercially available insulation product.
3. **Carlisle InsulBase HD Eco** – A rigid-roof insulation cover board with 5% ISCC-certified bio-attributed content composed of a high-density closed-cell polyisocyanurate foam core bonded on each side to glass-reinforced felt (GRF), meeting ASTM C1289, Type II, Class 1, Grade 3. UL and FM approved for direct application over steel decks. Available in 1/2" thick, 4' x 4' and 4' x 8' panels with an R-value of 2.5. Suitable for both re-roofing and new construction applications, InsulBase HD is specifically designed for use as a cover board in mechanically-attached single-ply systems only. InsulBase HD delivers an R-value of 2.5.
4. **Carlisle InsulBase NH Polyisocyanurate** - A foam core insulation board covered on both sides with a glass-reinforced felt meeting ASTM C 1289, Type II, Class 1, Grade 2 (20 psi) or Grade 3 (25 psi). The product is available in 4' x 4' and 4' x 8' standard size with a thickness from 1/2" to 4 inches. InsulBase NH contains zero halogenated flame retardants.
5. **Carlisle SecurShield Polyisocyanurate**– A foam core insulation board covered on both sides with a coated glass fiber mat facer meeting ASTM C 1289, Type II, Class 2, Grade 2 (20 psi) or Grade 3 (25 psi). The product is available in 4' x 8' standard size with a thickness from 1 to 4 inches. 4' x 4' tapered panels are also available. These flat board products feature a dark-colored coated-glass facer (CGF) on one side of the insulation board and a light-colored CGF on the other, labeled Ready Flash. Ready Flash Technology allows applicators to manage adhesive flash-off times by choosing between two different-colored facers on every board.
6. **Carlisle SecurShield Eco** – A rigid roof insulation panel with 5% ISCC-certified bio-attributed content composed of a closed-cell polyisocyanurate foam core bonded to high performance coated glass facers (CGF). ASTM C 1289, Type II, Class 2, Grade 2 (20 psi) or Grade 3 (25 psi), available in 4' x 8' standard size with a thickness from 1 to 4 inches. 4' x 4' tapered panels are also available. Ideal for use in adhered membrane systems. Achieves a UL Class A fire rating direct to combustible deck.
7. **Carlisle SecurShield NH Polyisocyanurate** - A foam core insulation board covered on both sides with a coated glass fiber mat facer meeting ASTM C 1289, Type II, Class 2, Grade 2 (20 psi) or Grade 3 (25 psi). The product is available in 4' x 4' and 4' x 8' standard size with a thickness from 1/2 inch to 4 inches. SecurShield NH contains zero halogenated flame retardants.
8. **Carlisle SecurShield HD Composite Polyisocyanurate** – Composite insulation panel comprised of 1/2-inch high-density (109 psi max) Polyiso cover board laminated during the manufacturing process to SecurShield rigid Polyiso roof insulation meeting ASTM C1289 Type IV, Grade 2 (20 psi) or Grade 3 (25 psi). Available in 4' x 8' boards with thickness from 2" to 4.5". 4' x 4' panels are also available.
9. **Carlisle StormBase Polyisocyanurate Composite (OSB)** – Polyiso insulation bonded on the bottom side with a medium weight fiber-reinforced felt facer and laminated with a top surface of 7/16" or 5/8" thick Oriented Strand Board (OSB) meeting ASTM C1289, Type V, Grade 2 (20 psi) or Grade 3 (25 psi). Available in 4' x 8' boards with thickness from 1-1/2" to 4".

C. EPS: Expanded Polystyrene

Table C1 EPS: Expanded Polystyrene (See below for product descriptions)					
Insulations / Underlayment	Minimum Thickness	ASTM	Roofing System Acceptability		
			Adhered	Mechanically Fastened	Ballasted
InsulFoam I	1"	C578 Type I	N/A	N/A	√
InsulFoam VIII	.75"	C578 Type VIII	N/A	N/A	√
InsulFoam II	.75"	C578 Type II	N/A	N/A	√
InsulFoam IX	.75"	C578 Type IX	N/A	N/A	√
InsulFoam HD Composite (SecurShield HD)	1.5"	C578 Type (I, VIII, II, or IX)	√	√	N/A
InsulLam (Various Cover Boards)	1.5"	C578 Type (I, VIII, II, or IX)	√	N/A	N/A
InsulFoam SP	1"	C578 Type VIII	√	√	√
Design Restrictions					
<ul style="list-style-type: none"> <li>- Local Codes must be consulted regarding the acceptance of expanded insulation directly over steel decks. When specified, minimum thickness shall be designated by the manufacturer.</li> <li>- Expanded polystyrene roof insulations cannot be installed directly over coal-tar pitch roof surfaces or existing PVC membranes. A separation layer of minimum 1/2" SecurShield HD, HP Recovery Board or Polyiso Insulation shall be used.</li> </ul>					
Notes: N/A = Not Acceptable √ = Acceptable					

R-Tech Fanfold Recover Board is listed in Paragraph E4 below.

1. **InsulFoam I** – A closed-cell lightweight expanded polystyrene (EPS) that meets ASTM C578, Type I. Nominal density of 1.0 lbs/cubic ft (pcf) available in 4' x 4' or 4' x 8' sizes with thickness from 1/4" to 40". Custom lengths, widths and tapered boards are available. May be specified beneath Sure-Seal HP Recovery Board, DensDeck Prime, DensDeck StormX Prime, Securock or DEXcell.
2. **InsulFoam VIII** – A closed-cell lightweight expanded polystyrene (EPS) that meets ASTM C578, Type VIII. Nominal density of 1.25 lbs/cubic ft (pcf) available in 4' x 4' 4' x 8' sizes with thickness from 1/4" to 40". Custom lengths, widths and tapered boards are available. May be specified beneath Sure-Seal HP Recovery Board, DensDeck Prime, DensDeck StormX Prime, Securock or DEXcell.
3. **InsulFoam II** – A closed-cell lightweight expanded polystyrene (EPS) that meets ASTM C578, Type II. Nominal density of 1.5 lbs/cubic ft (pcf) available in 4' x 4' or 4' x 8' sizes with thickness from 1/4" to 40". Custom lengths, widths and tapered boards are available. May be specified beneath Sure-Seal HP Recovery Board, DensDeck Prime, DensDeck StormX Prime, Securock or DEXcell.
4. **InsulFoam IX** – A closed-cell lightweight expanded polystyrene (EPS) that meets ASTM C578, Type IX. Nominal density of 2.0 lbs/cubic ft (pcf) available in 4' x 4' or 4' x 8' sizes with thickness from 1/4" to 40". Custom lengths, widths and tapered boards are available. May be specified beneath Sure-Seal HP Recovery Board, DensDeck Prime, DensDeck StormX Prime, Securock or DEXcell.
5. **InsulFoam HD Composite** – InsulFoam expanded polystyrene (EPS) insulation laminated with a top surface of 1/2" thick SecurShield HD. Available in 4' x 8' boards with thickness from 1-1/2" to 7".
6. **InsulLam** – InsulFoam expanded polystyrene (EPS) insulation laminated with a top surface of 7/16" or 5/8" thick Oriented Strand Board (OSB). Available in 4' x 8' boards with thickness from 1-1/2" to 7".
7. **InsulFoam SP** – A closed-cell lightweight expanded polystyrene (EPS) with a factory-laminated fiber glass facer. Nominal density of 1.25 lbs/cubic ft (pcf), and meets ASTM C578, Type VIII. Designed for low-sloped roof applications that employ mechanically fastened or ballasted membranes. Can also be used in Adhered systems using Sure-Seal or Sure-Tough SAT Membranes.

- D. **XPS: Extruded Polystyrene** – Available through Carlisle is dimensionally stable with high thermal and low water absorption performance capability. XPS is available in varying compressive strengths thicknesses and sizes. Refer to specific product data sheets for physical properties and additional technical information.

<b>Table D1</b>					
<b>XPS: Extruded Polystyrene</b> (See below for product descriptions)					
<b>Insulations / Underlayment</b>	<b>Minimum Thickness</b>	<b>ASTM</b>	<b>Roofing System Acceptability</b>		
			<b>Adhered</b>	<b>Mechanically Fastened</b>	<b>Ballasted</b>
Thermapink 18	.75"	Refer to Product Data Sheet	N/A	N/A	√
Thermapink 25	1"	Refer to Product Data Sheet	N/A	N/A	√
Foamular 400	1"	Refer to Product Data Sheet	N/A	N/A	√
Dow Styrofoam Deckmate Plus	1"	Refer to Product Data Sheet	N/A	N/A	√
<b>Design Restrictions</b>					
<ul style="list-style-type: none"> <li>- Local Codes must be consulted regarding the acceptance of expanded insulation directly over steel decks. When specified, minimum thickness shall be designated by the manufacturer.</li> <li>- Expanded polystyrene roof insulations cannot be installed directly over coal-tar pitch roof surfaces or existing PVC membranes. A separation layer of minimum 1/2" SecurShield HD, HP Recovery Board or Polyiso Insulation shall be used.</li> <li>- Refer to related products listed in <a href="#">Spec Supplement P-01 "Related Products"</a> for other products which may be suitable for use. Carlisle must be contacted for specific requirements.</li> </ul>					
Notes: N/A = Not Acceptable    √ = Acceptable					

1. **Thermapink 18 or 25 Extruded Polystyrene**
2. **Foamular 400 Extruded Polystyrene**
3. **Dow Styrofoam Deckmate Plus Extruded Polystyrene**

E. Carlisle Vacuum Insulated Panel (VIP)

<b>Table E1 Vacuum Insulated Panel (VIP) (See below for product descriptions)</b>				
<b>Insulations / Underlayment</b>	<b>Minimum Thickness</b>	<b>ASTM</b>	<b>Roofing System Acceptability</b>	
			<b>Adhered</b>	<b>Mechanically Attached</b>
Carlisle OPTIM-R® VIP	*1.6"	C1484	√	N/A
ADVANC-R® VIP	0.94"	C1484	√	N/A
<b>Design Restrictions</b>				
*2.6" minimum for total installed system including an additional 2 layers of 1/2" SecurShield HD panels; 1 layer on top and 1 layer on bottom of OPTIM-R®. For adhered systems only. Note: OPTIM-R® VIP & ADVANC-R® VIP cannot be cut or punctured. Notes: N/A = Not Acceptable    √ = Acceptable				

1. **OPTIM-R® Vacuum Insulated Panel (VIP)** – a high R-Value vacuum insulated panel (VIP) used to provide a low-profile solution when height restrictions exist, such as windows, doors, equipment curbs, etc. Provides an R-38 insulating value in a 2.6" system thickness with up to 35% infill (non-VIP material). Available in 23.6" x 23.6" and 23.6" x 47.2" board sizes.
2. **ADVANC-R® VIP** – a thin, rigid, high R-value, non-structural vacuum insulated panel. Provides a low-profile solution for height restricted roof conditions such as penthouse doors, windowsills, equipment curbs and parapet walls. Provides a R-66 insulating value in a 0.94" thick panel. Available in 22.4" x 24.0" and 22.4" x 48.0" panel sizes.

F. Cover Boards / Slip Sheets

Table F1 Cover Boards (See below for product descriptions)					
Insulations / Underlayment	Minimum Thickness	ASTM	Roofing System Acceptability		
			Adhered	Mechanically Fastened	Ballasted
SecurShield HD, SecurShield HD Eco	.5"	C1289-06, Type II, Class 4 (109 psi max)	√	√	N/A(2)
SecurShield HD Plus	.5"	C1289-06, Type II, Class 4 (109 psi max)	√	√	N/A(2)
InsulBase HD, InsulBase HD Eco	.5"	C1289-06, Type II, Class 1, Grade 3	N/A	√	N/A
Securock Roof Board	.25"	C1177	√	√	N/A
Securock Glass-Mat Roof Board	.25"	C1177	N/A	√	N/A
Securock UltraLight Glass-Mat Roof Board	.25"	C1177	N/A	√	N/A
Securock UltraLight Coated Glass-Mat Roof Board	.25"	C1177	√	√	N/A
EcoStorm VSH	.5"	Refer to Product Data Sheet	√	√	N/A
HP Recovery Board	.5"	C208 Grade 2	√	√	√
DensDeck StormX Prime	.625"	C1177	√	√ (1)	N/A
DensDeck Prime	.25"	C1177	√	√ (1)	N/A
DensDeck	.25"	C1177	N/A	√ (1)	N/A
R-Tech Fanfold Recovery Board	.5"	C578 Type (I, VIII, II. or IX)	N/A	√	√
HP Protection Mat	6 oz	Refer to Product Data Sheets	N/A	√	√
DEXcell® Glass Mat	.25"	C1177	N/A	√	N/A
DEXcell FA™	.25"	C1177	√	√	N/A
DEXcell® Cement Roof Board	.4375"	C1325	√	√	N/A
DEXcell FA VSH®	.625"	C1177	√	√ (1)	N/A
<b>Design Restrictions</b>					
<ul style="list-style-type: none"> <li>- HP Recovery Board and R-Tech Fanfold not recommended for direct use over Type B and F steel decks.</li> <li>- Securock Roof Board, HP Recovery Board, DensDeck Prime, DensDeck StormX Prime, DensDeck or DEXcell may not be used directly over New or Existing Lightweight Insulating Concrete Decks OR Structural Concrete.</li> <li>- Due to some warranty restrictions, DensDeck Prime, DensDeck StormX Prime, DensDeck and DEXcell not recommended for use directly over existing roofing membrane without prior written approval from Carlisle. Contact Carlisle for specific requirements.</li> <li>- R-Tech Fanfold primarily for use in existing roof re-covers applications or directly over structural or lightweight insulating concrete.</li> <li>- HP Protection Mat may be used for Ballasted systems over Lightweight Insulating Concrete with a Maximum Warranty duration of up to 15 years. To be used for Mechanically fastened on new construction projects with Lightweight Insulating Concrete, Fiber Cement or Gypsum Deck a Maximum Warranty duration of up to 15 years.</li> </ul> <p>(1) Permitted with roofs with slopes greater than 2" per foot for compliance with external fire codes, refer to UL listings or contact Carlisle.            (2) Acceptable for some roof system designs, Contact Carlisle for recommendations.</p>					
Notes: N/A = Not Acceptable    √ = Acceptable					

1. **SecurShield HD** - a rigid insulation panel composed of a high-density (109 psi max), closed-cell polyisocyanurate foam core laminated to coated-glass fiber-mat facer meeting ASTM C1289, Type II, Class 4, Grade 1, for use as a cover board or recover board. Available 1/2" thick 4' x 4' (5.5 lbs) and 4' x 8' (11 lbs) panels with an R-value of 2.5.

Features Ready Flash, a dark-colored coated-glass facer (CGF) on one side of the insulation board and a light-colored CGF on the other. Ready Flash Technology allows applicators to manage adhesive flash-off times by choosing between two different colored facers on every board.

2. **SecurShield HD Eco** – A rigid roof insulation panel with 5% ISCC-certified bio-attributed content composed of 1/2" high-density, closed-cell polyisocyanurate foam core bonded to a premium performance coated glass facer (CGF)

specifically designed for use as a cover board, meeting ASTM C1289, Type II, Class 4, Grade 1. Provides 5 times the R-value at one-fifth the weight of traditional gypsum cover boards. Achieves a UL Class A fire rating direct to combustible deck. Available in 1/2" thick, 4' x 4' (5.5 lbs) and 4' x 8' (11 lbs) panels with an R-value of 2.5.

3. **SecurShield HD Plus** - a rigid insulation panel composed of a high-density (109 psi max), closed-cell polyisocyanurate foam core laminated to premium-performance coated-glass fiber-mat facer, meeting ASTM C1289, Type II, Class 4, Grade 1. Specifically designed for use as a cover board or recover board. Available 1/2" thick 4' x 4' (6.5 lbs) and 4' x 8' panel (13 lbs) with an R-value of 2.5. Meets an FM 1-90 using only 8 fasteners per 4' x 8' board.
4. **InsulBase HD** – a closed-cell polyisocyanurate foam core insulation board covered on both sides with glass-reinforced felt (GRF) facer meeting ASTM C 1289, Type II, Class 1, Grade 3. The product is available in 4' x 4' and 4' x 8' standard sizes with a thickness of one-half inch with an R-value of 2.5. ASTM C1289, Type II, Class 1, Grade 3.
5. **InsulBase HD Eco** – A rigid-roof insulation cover board with 5% ISCC-certified bio-attributed content composed of a high-density closed-cell polyisocyanurate foam core bonded on each side to glass-reinforced felt (GRF), meeting ASTM C1289, Type II, Class 1, Grade 3. UL and FM approved for direct application over steel decks. Available in 1/2" thick, 4' x 4' and 4' x 8' panels with an R-value of 2.5.. Suitable for both re-roofing and new construction applications, InsulBase HD is specifically designed for use as a cover board in mechanically-attached single-ply systems only. InsulBase HD delivers an R-value of 2.5.
6. **Securock Roof Board** – A uniform composition of fiber-reinforced gypsum, without a facer, for use as a cover board or a thermal barrier in mechanically fastened and fully adhered roofing systems. Meets ASTM E84 for flame spread and smoke development; Class A fire performance per UL 790. Available in 1/4" to 5/8" thick and 4' x 4' or 4' x 8' size boards. 5/8" meets requirements of Type X per ASTM C1177. Long uninterrupted runs (>200') may require slight gapping due to thermal expansion.
7. **Securock Glass-Mat Roof Board** – A fire-resistant, moisture and mold-resistant roof board used in mechanically fastened, low-slope roofing systems, featuring a specially treated core and high-performance glass-mat facer. Meets ASTM E84 for flame spread and smoke development; Class A fire performance per UL 790. Available in 1/4", 1/2" and 5/8" (Type X) and 4' x 8' size boards. 5/8" meets requirements of Type X per ASTM C1177.
8. **Securock UltraLight Glass-Mat Roof Board** – A fire-resistant, moisture and mold-resistant roof board used in mechanically fastened, low-slope roofing systems, featuring a specially treated lightweight core and high-performance glass-mat facer. Meets ASTM E84 for flame spread and smoke development; Class A fire performance per UL 790. Available in 4' x 8' size boards; 1/4", 1/2" and 5/8" thicknesses available. 5/8" meets requirements of Type X per ASTM C1177.
9. **Securock UltraLight Coated Glass-Mat Roof Board** - A fire-resistant, moisture and mold-resistant roof board used in fully adhered or mechanically fastened, low-slope roofing systems, featuring a specially treated lightweight core. The special coating on the high-performance glass-mat facer provides an exceptional adhesive bond and reduces facer delamination. Meets ASTM E84 for flame spread and smoke development; Class A fire performance per UL 790. Available in 1/4", 1/2" and 5/8" Type X and 4' x 8' size boards. 5/8" meets requirements of Type X per ASTM C1177.
10. **EcoStorm VSH Cover Board** – an engineered composite building material made from a proprietary blend of plastic and cellulose fiber sourced from post-industrial and post-consumer waste streams. EcoStorm VSH is a durable, extremely moisture and mold resistant building material with a core that does not disintegrate or delaminate in the presence of water. Available in 1/2" thick and 4' x 8' size board.
11. **DensDeck StormX Prime** – a reinforced gypsum cover board with an enhanced, moisture-resistant core and coated glass mat facers on the top and bottom side. The top surface is pre-primed and provides excellent bond strength for adhered membrane for use as a cover board. DensDeck StormX Prime is extremely durable and is approved for use in assemblies meeting FM's Very Severe Hail (VSH) Classification. Available in 5/8" thickness and 4' x 4' or 4' x 8' size boards.
12. **DensDeck Prime** – gypsum core that incorporates glass-mat facings on the top and bottom side. The top surface is pre-primed and provides excellent bond strength for adhered membrane for use as a cover board. Available in 1/4" to 5/8" and 4' x 4' or 4' x 8' size boards.
13. **DensDeck Cover Board** – gypsum core that incorporates glass-mat facings on the top and bottom side for use as a cover board. Available in 1/4" to 5/8" and 4' x 4' or 4' x 8' size boards.
14. **R-Tech FanFold Recover Board** – Closed-cell lightweight expanded polystyrene (EPS) with polymeric laminated faces which meets ASTM C 578, while metallic side used with EPDM. Available in thicknesses of 3/8" to 3/4" with

coverage 4' x 50' (2 squares). 4' x 8' units are also available.

15. **HP Protection Mat** – A nominal 6-oz per square yard UV resistant polypropylene needle punched fabric used either above the membrane as a slip-sheet for ballast or as an underlayment to the membrane. Available 15' x 300' roll (4500 square foot) weighing 0.06 lbs per square foot.
16. **DEXcell® Glass Mat** – A mold & mildew resistant, gypsum substrate board with coated fiberglass facers, used for thermal protection and acoustical enhancement of roof systems. May be used as a substrate for a vapor retarder and /or the continuous substrate for the application of commercial roofing applications. Available in 1/4", 1/2" and 5/8" thicknesses in 4' x 8' boards.
17. **DEXcell FA™ Glass Mat**– A mold & mildew resistant, gypsum substrate board with heavy duty, coated fiberglass facers, used for thermal protection and acoustical enhancement of roof systems. May be used as a substrate for a vapor retarder and /or the continuous substrate for the application of commercial roofing applications. The pre-coated, fiberglass facers are designed to increase adhesive coverage and enhance performance of the bond strength of the system. Available in 1/4", 1/2" and 5/8" thicknesses in 4' x 4' and 4' x 8' boards.
18. **DEXcell® Cement Roof Board** – A mold & mildew resistant, Portland Cement, lightweight aggregate roof board with heavy-duty fiberglass mesh facers used as a substrate board, thermal barrier and cover board for commercial roofing applications. Available in 7/16" and 5/8" thicknesses in 4' x 4' and 4' x 8' boards.
19. **DEXcell FA VSH®** – A reinforced gypsum panel with enhanced moisture resistant gypsum core and heavy duty coated glass facers used as a substrate board, thermal barrier and cover board for commercial roofing applications, approved for use in single-ply and multi-ply assemblies meeting FM Very Severe Hail rating. Available in 5/8" thickness in 4' x 4' and 4' x 8' boards.

## 2.04 RELATED MATERIALS

### A. **Sure-Flex Flashing (for use with Sure-Flex PVC Polyester Reinforced, FRS, and KEE HP Membrane Assemblies)**

1. **Sure-Flex PVC non-reinforced Flashing** is 60-mil thick (white, gray, light gray, slate gray and tan) and available in rolls **12" and 24" wide by 50' long**. Flashing is used for inside/outside corners and field fabricated pipe flashings when use of pre-molded accessories is not feasible.
2. **Sure-Flex PVC Reinforced Cover Strip:** A 8" wide, nominal 60-mil and 80-mil thick, polyester reinforced PVC membrane. Used for stripping in rows of fasteners and plates and covering the butt joints of Sure-Flex PVC membranes. Available in rolls 8" wide by 75' long in colors of white, gray or tan. Also available in 60-mil in rolls of 8" wide by 100' long in white only.
3. **Sure-Flex KEE HP Reinforced Cover Strip:** A 8" wide, nominal 60-mil and 80-mil thick, polyester reinforced KEE HP PVC membrane. Used for stripping in rows of fasteners and plates and covering the butt joints of Sure-Flex KEE HP PVC membranes. Available in rolls 8" wide by 75' long in colors of white, gray or tan, also available in 60-mil in rolls of 8" wide by 100' long in white only.
4. **Sure-Flex PVC Pressure-Sensitive Cover Strip:** A 6" wide, nominal 35-mil thick non-reinforced KEE HP flashing laminated to a nominal 35-mil, fully cured, pressure-sensitive, synthetic rubber adhesive. Used for stripping in flat metal edgings (i.e. drip edge) of Sure-Flex PVC and KEE HP PVC membranes. Available in rolls 6" wide by 100' long in colors of white, gray or tan. Used in conjunction with PVC Step 1 Activator and PVC Step 2 Primer.
5. **Sure-Flex PVC "T" Joint Cover:** A 4-1/2" diameter, 60-mil thick (white) or 40-mil (gray or tan), pre-cut non-reinforced PVC flashing used to overlay "T" joints at field splices when 80-mil Sure-Flex PVC membrane is used.
6. **APEEL Cover Tape:** A 6"-wide, 1,640' long roll of APEEL Protective Film used to protect areas of Sure-Flex PVC/KEE HP membranes where APEEL Protective Film has been removed (around details) or was not factory applied (seams). APEEL Cover Tape allows contractors to keep 100 percent of the PVC/KEE HP surface clean during installation and is applied using the APEEL Cover Tape Applicator.
7. **Sure-Flex PVC Yellow Pressure-Sensitive Warning Strip:** a nominal 30-mil-thick, non-reinforced membrane flashing laminated to a nominal 30-mil-thick, fully cured, synthetic rubber, pressure-sensitive

adhesive and is available in 6"-wide by 100'-long rolls. Pressure-Sensitive Warning Strip can be applied to Sure-Flex PVC or KEE HP systems to provide a visual warning of an impending hazard (e.g., roof edge, deep drain sump, skylight, etc.).

8. **Sure-Flex PVC Contour Rib Profile:** Used to obtain the appearance of standing seam metal roofing with the performance of a PVC single-ply membrane. The Contour Rib Profile measures 1-1/4" tall and 2-1/8" wide, including the welding flanges, while the vertical profile is a substantial 3/8" thick. The profile has a continuous 1/8" diameter alignment hole, for use with fiberglass connecting pins, as well as a 1/8" fiberglass reinforcing cord for added strength. The Contour Rib Profile is available in white, gray, light gray, slate gray and tan, 10' lengths and packaged 20 per carton.
9. **Pre-Molded Accessories:**
  - a. **Sure-Flex PVC Inside Corners:** A pre-molded flashing for inside corners. Available in white, gray or tan; 60-mil thick.
  - b. **Sure-Flex PVC Outside Corners:** A pre-molded flashing for outside corners. Available in white, gray or tan; 60-mil thick.
  - c. **Sure-Flex PVC Curb Wrap Corners:** Fabricated flashings are made of 60-mil thick reinforced Sure-Flex KEE HP PVC Detail membrane designed to reduce installation time to flash a curb when compared to conventional methods. Each corner is fabricated with a 6" wide base flange and a 12" overall height. Three sizes are available to fit curbs up to 3' by 3' in size. One curb requires 4 corners for a complete installation. PVC Curb Wrap Corners are packaged in boxes containing twelve corners. Custom sizes are available as a special order product requiring lead time.
  - d. **PVC Universal Corners:** a pre-molded flashing for use in a variety of corner details, including inside and outside corners. Available in white, tan, gray, and light gray; 60-mil thick.
  - e. **Sure-Flex PVC Pipe Flashings:** A pre-molded (white, tan, gray and light gray) pipe flashing used for pipe penetrations. Available for 3/4" – 8" diameter pipes with clamping rings included.
  - f. **Sure-Flex PVC Split Pipe Seals:** A prefabricated flashing consisting of 60-mil thick reinforced Sure-Flex Membrane for pipes 1" – 6" in diameter. A split (cut) and overlapped tab are incorporated to allow the pipe seal to be opened and wrapped around the pipe when it is not possible to pull a standard pipe flashing over a round penetration. Available in white, gray or tan.
  - g. **Sure-Flex PVC Square Tubing Wraps:** Fabricated flashings made of 60-mil thick reinforced Sure-Flex membrane for square tubing. A split (cut) and overlap tab are incorporated into these parts to allow the seals to be opened and wrapped around a square penetration. Available for 3", 4" and 6" diameter square tubing. Available in white and gray.
  - h. **Sure-Flex PVC Molded Sealant Pockets:** A pre-fabricated, interlocking, 2-piece, injection molded, flexible pocket with a rigid PVC vertical wall and pre-formed deck flanges. Used in conjunction with White One-Part Pourable Sealer for waterproofing pipe clusters or other odd shaped penetrations. Pockets can be adjusted from 11.5" to 7.5" in length by 6" in width by following the cutting lines molded in the pocket. Available in white only.

## B. PRIMERS, ADHESIVES, SEALANTS AND CLEANERS

Refer to Product Data Sheets for material coverage rates and proper usage. Prior to the use of any of the products listed below, consult the Safety Data Sheets for applicable cautions and warnings.

### 1. Sure-Flex Products

- a. **Low-VOC PVC Bonding Adhesive:** A high-strength solvent based adhesive that allows bonding of PVC and KEE-enhanced PVC membrane to various porous and non-porous substrates. The adhesive is applied to both the membrane and the substrate at a coverage rate of approximately 60 square feet per gallon per finished surface (includes coverage on both surfaces).
- b. **Hydrobond Water-Based Adhesive:** A wet lay-in, one-sided dispersion adhesive. Compatible with only Sure-Flex PVC smooth-backed and FleeceBACK membranes, this product is ideal for bonding only PVC

membranes to various porous and non-porous substrates (cannot be used with any KEE or KEE HP PVC bareback membranes). Coverage rates vary between 100-133 square foot per gallon using roller or spray applications.

- c. **CAV-GRIP PVC Aerosol Contact Adhesive:** a low-VOC, methylene chloride-free adhesive that can be used for a variety of applications including: adhering PVC bareback membranes to a variety of horizontal substrates and vertical walls (cannot be used with any KEE or KEE HP bareback membranes), as well as adhering FleeceBACK membranes to vertical walls. Coverage rate is approximately 1,500-2,000 sq. ft. per #40 cylinder and 3,000-4,000 sq. ft. per #85 cylinder as a primer, in a single sided application; 400 sq. ft. per #40 cylinder and 800 sq. ft. per #85 cylinder as an adhesive for vertical walls, in a double-sided application; 750 sq. ft. per #40 cylinder and 1,500 sq. ft. per #85 cylinder as an adhesive, horizontally, for the field of the roof, in a double-sided applications.
- d. **Sure-Flex PVC Cut-Edge Sealant:** A clear-colored sealant used to seal cut edges of reinforced Sure-Flex membrane. A coverage rate of approximately 225 - 275 linear feet per squeeze bottle can be achieved when a 1/8" diameter bead is applied. Use of Cut-Edge Sealant to seal cut edges of PVC or KEE HP PVC Membranes is not required.
- e. **Water Cut-Off Mastic:** Used as mastic to prevent moisture migration at drains, compression terminations and beneath conventional metal edging (at a coverage rate of approximately 10' per tube or 100' per gallon).
- f. **Universal Single-Ply Sealant:** A 100% solids, solvent free, one-part, polyether sealant that provides a weather tight seal to a variety of building substrates. Can be used as a termination bar sealant or for use in counterflashing, coping, and scupper details.
- g. **White One-Part Pourable Sealer:** A one-part, moisture curing, elastomeric polyether sealant used to fill Molded Sealant Pockets. Packaged in four 1/2 gallon pouches per plastic bucket. One pouch will fill 122 cubic inches of volume within a molded sealant pocket.
- h. **PVC and KEE HP Membrane Cleaner:** Used to prepare PVC and KEE HP PVC membranes that have been exposed to the elements for approximately 7 days prior to heat welding or to remove general construction dirt. Approximate coverage rate of 400 square feet per gallon (one surface).
- i. **Sure-Flex Low-VOC PVC Step 1 Activator:** A high-strength, solvent-based activator that allows PVC Pressure-Sensitive (PS) Cover Strip to be bonded to Sure-Flex PVC or KEE HP membranes. Low-VOC PVC Step 1 Activator meets the < 250 gpl VOC content requirements of the OTC Model Rule. It is specially formulated using a blend of VOC-exempt and non-exempt solvents and follows the state of California Clean Air Act of 1988 (updated in 1997) as further regulated by California's Air Quality Control Districts listing VOC limitations.
- j. **Sure-Flex Low-VOC PVC Step 2 Primer:** A high-solids-content, polymer based splice primer. This product is applied to KEE HP and PVC membranes to improve the adhesion of PVC Pressure-Sensitive Cover Strip. Low-VOC PVC Step 2 Primer meets the < 250 gpl VOC content requirements of the OTC Model Rule.
- k. **Sure-Flex PVC Step 2 Primer:** A high-solids-content, clear (translucent color), polymer-based splice primer used to prepare KEE HP and PVC membranes to be bonded to PVC Pressure-Sensitive Cover Strip.

## 2.05 Fastening Components

### A. Fasteners

The following Table illustrates criteria for fastening of Carlisle Insulation with the referenced roof deck and includes minimum penetration requirements and pilot hole criteria.

**Insulation Fastening Criteria**

Deck Type	Carlisle Fasteners (1)	Min. Penetration	Pilot Hole Depth	Pilot Hole Diameter
Steel or Lightweight Insulating Concrete over Steel	HP, HP-X, ASAP or InsulFast™	3/4"	N/A	N/A
Structural Concrete, rated 3,000 psi or greater	CD-10	1"	Note (2)	7/32"
	HD 14-10	1"	Note (2)	3/16"
Wood Plank, min. 15/32" thick Plywood or min. 7/16" OSB	HP, HP-X, ASAP or InsulFast	Min. 1" (3)	N/A	N/A
Cementitious Wood Fiber	Polymer Gyptec or Lite-Deck Fastener	1-1/2"	Note (4)	N/A
Gypsum	Polymer Gyptec or Lite-Deck Fastener	1-1/2"	Note (2)	7/16", 1/2" or 9/16" (5)

Notes: N/A = Not Applicable

(1) For Adhered Systems, only 3" diameter insulation fastening plates can be used for insulation attachment.

(2) The pilot hole must be predrilled to a sufficient depth to prevent contact between the fastener point and any accumulated dust in the predrilled hole. This will help prevent bottoming out of the fastener during installation.

(3) For wood planks only, fastener penetration shall not exceed 1-1/2".

(4) Most cementitious wood fiber decks do not require pre-drilling; however, Carlisle should be contacted prior to installation for verification of specific types that may require a pilot hole to be predrilled.

(5) Pilot hole size may be varied to maximize pullout resistance.

All Fasteners listed below can be used with Sure-Flex Roofing Systems. Refer to the applicable specification for specific requirements.

- HP-X Fastener:** A heavy duty #15 threaded fastener with a #3 Phillips drive used with Carlisle's Piranha™ Fastening Plate to secure Mechanically Fastened Roofing Systems. It is used on minimum 22 gauge steel decks or minimum 15/32" CDX plywood decks. It is also designed to offer an optimum combination of driving performance, back-out and corrosion resistance with excellent pullout performance.
- HP-Xtra Fastener:** An oversized diameter #22 (.315") steel, threaded fastener used in conjunction with Piranha Xtra Plates for membrane securement into minimum 22 gauge steel or wood decks on Mechanically Fastened Roofing Systems.
- HP Fastener:** A threaded E-coat square head fastener **for insulation attachment only**. Used into steel, wood plank, minimum 15/32" thick plywood or minimum 7/16" thick oriented strand board (OSB).
- Pre-Assembled ASAP Fastener:** Carlisle's InsulFAST Fastener pre-assembled with a 3" diameter plastic plate used for **insulation attachment only** on Adhered and Mechanically Fastened Roofing Systems. Installed using OMG Roofing Products Fastening Tool.
- InsulFast Fastener:** A threaded Phillips drive fastener used with Carlisle Insulation Plates for **insulation attachment** to steel or wood decks.
- CD-10 Fastener:** A hammer-driven, non-threaded E-Coat fastener for use with structural concrete decks rated 3,000 psi or greater.
- HD 14-10 Concrete Fastener:** A #14 threaded fastener with a #3 Phillips drive used for minimum 3,000 psi concrete decks.
- Polymer Gyptec Fastener:** A glass-filled nylon auger fastener designed for securing insulation and/or membrane to specialty decks such as cement wood fiber or gypsum.

9. **Lite-Deck Fastener:** A deep, coarse threaded fastener used to secure insulation to gypsum and cementitious wood fiber decks in conjunction with Lite-Deck Plates.

## B. Fastening Plates

1. **Piranha Plate:** A 2-3/8" diameter metal barbed fastening plate used with Carlisle HP-X, CD-10 or HD 14-10 Fasteners for membrane or insulation securement. This plate can be used for membrane or insulation securement on Mechanically Fastened Roofing Systems.
2. **Piranha Xtra Plate:** A 2-3/8" diameter metal barbed fastening plate with an oversized hole for use with Carlisle HP-Xtra Fasteners for membrane securement on Mechanically Fastened Roofing Systems.
3. **Seam Fastening Plate:** A 2" diameter metal plate used for insulation attachment on Mechanically Fastened Systems or membrane securement at angle changes on Adhered Systems in conjunction with the appropriate Carlisle Fastener.
4. **Insulation Fastening Plate:** A nominal 3-inch metal plate used for insulation attachment in conjunction with the appropriate Carlisle Fastener.
5. **SecurFast Insulation Fastening Plates:** A nominal 2-7/8" hexagon metal plate used for insulation attachment in conjunction with the appropriate Carlisle Fastener.
6. **Accutrac Insulation Plates:** A nominal 3" square, recessed or flat bottomed, metal plate used for insulation attachment in conjunction with the appropriate Carlisle Fastener. Flat bottom plate is used with manufactured Philips Head fasteners only.
7. **Sure-Flex PVC Oval Barbed Plate:** A 2-3/4" x 1-1/2" oval metal barbed fastening plate for use with Carlisle HP-X fasteners for securement of 10' wide PVC and KEE HP PVC membranes on Mechanically Fastened Roofing Systems.

## 2.06 Insulation Securement Adhesive

- A. **Flexible FAST Adhesive:** A spray (full coverage) or bead-applied, two-component polyurethane, construction grade, low-rise expanding foam adhesive used for attaching approved insulations to compatible roof decks or existing smooth or gravel surfaced BUR, modified bitumen or cap sheets.
- B. **Flexible FAST Dual Tank:** A two component (Part A and B), extrusion applied, low rise adhesive for bonding insulation to various surfaces. FAST Dual Tanks utilize an HFO blowing agent. HFO (hydrofluoroolefin) blowing agents are widely recognized as the next-generation environmentally friendly blowing agent, replacing their HFC (hydrofluorocarbon) predecessor. When extruded at 12" on center the coverage rate is 3,500 to 3,700 sq.ft. per set of Dual Tanks.
- C. **Flexible FAST Dual Cartridge and 5-gallon Jug Adhesive:** A two component (Part A and B), extrusion applied, low rise adhesive for bonding insulation to various surfaces. When extruded at 12" on center the coverage rate is 400-600 sq.ft. per carton of Dual Cartridges or 2,000-2,500 sq.ft. per set of 5-gallon Jug Adhesive.
- D. **OlyBond 500 Bag in a Box** – A two-component, polyurethane, low-rise expanding adhesive used to bond insulation to various substrates. Packaged in 5-gallon boxes of Part A and Part B formulations that are applied using a mechanical dispenser system. Applied in 1/2" to 3/4" beads or ribbons at the rate of 1 gallon per 150-250 square feet for 12" o.c. bead spacing. Perimeter bead spacing patterns and acceptable insulation and deck types are listed in the applicable Product Data Sheet.
- E. **OlyBond 500 BA Spot Shot** - A two-component, polyurethane construction grade, low-rising expanding adhesive designed for bonding insulation to various substrates. Applied in 1/2" to 3/4" beads or ribbons using a portable 1:1 applicator (oversized, dual-cartridge caulking gun). Refer to the Product Data Sheet for bead spacing with reference to building height.

## 2.07 Vapor/Air Barrier

### A. General

1. The use of a vapor retarder to protect insulation and reduce moisture accumulation within an insulated roofing

assembly should be investigated by the specifier, especially on projects with high interior humidity, such as, swimming pools, breweries, pulp mills, etc.

2. If insulation is to be adhered to the vapor retarder with Flexible FAST Adhesive, the vapor retarder must be compatible and shall be fully adhered to the substrate. Available products include Carlisle's VapAir Seal 725TR Air and Vapor Barrier, VapAir Seal MD Air and Vapor Barrier and spray or roller applied butyl coatings. Installation requirements for Carlisle's VapAir Seal 725TR Air and Vapor Barrier are identified in [Spec Supplement G-08 "Application Procedures for Carlisle's VapAir Seal 725TR Air and Vapor Barrier/Temporary Roof"](#) and Carlisle's VapAir Seal MD Air and Vapor Barrier are identified in [Spec Supplement G-12 "Application Procedures for Carlisle's VapAir Seal MD Air and Vapor Barrier"](#) in the Carlisle Technical Manual.
- B. **Carlisle VapAir Seal 725TR Air and Vapor Barrier** - A 40-mil thick composite consisting of 35-mil self-adhering rubberized asphalt membrane laminated to a 5-mil UV resistant poly film with an anti-skid surface which is fully compatible with Flexible FAST Adhesive. 725TR can also function as a temporary roof for up to 120 days. Available in rolls 39" wide by 100' long (325 square feet).
  - B. **Carlisle VapAir Seal MD Air and Vapor Barrier** – a reinforced composite aluminum foil with self-adhesive SBS backing and removable poly release film. Used for direct application over metal decks. Available in rolls 42.5" wide by 131.23' long (460 square feet).
  - C. **Carlisle CAV-GRIP III Low-VOC Aerosol Contact Adhesive/Primer**: a low-VOC, methylene chloride-free adhesive that can be used for a variety of applications including: enhancing the bond between Carlisle's VapAir Seal 725TR and various substrates. Coverage rate is approximately 2,000-2,500 sq. ft. per 40 lb cylinder and 4,000-5,000 sq. ft. per 85 lb cylinder as a primer, in a single-sided application.
  - D. **CCW-702 Primer and 702LV Primer (Low-VOC)** - A single component, solvent based, high-tack primer used to provide maximum adhesion between Carlisle 725TR Air and Vapor Barrier and an approved substrate. Applied by spray or long nap roller with a coverage rating ranging from approximately 300 to 350 square feet per gallon on smooth finishes (i.e., concrete) to 75 square feet per gallon on porous surfaces (i.e., DensDeck Prime gypsum board). Available in 5-gallon containers. CCW-702LV Primer contains less than 250g/L VOCs and meets South Coast Air Quality Management District (SCAQMD) and Leadership in Energy and Environmental Design (LEED) Requirements for Volatile Organic Compounds.
  - E. **CCW-702WB** – a high-tack, water-based contact adhesive for promoting adhesion of Carlisle air/vapor barrier membranes and an approved substrate (i.e., concrete, DensDeck Prime, Securock, and DEXcell). Applied by roller, brush or spray with an application rate of approximately 200 sq. ft. per gallon. Available in 5-gallon containers. CCW-702WB Primer contains 57g/L VOCs and meets South Coast Air Quality Management District (SCAQMD) and Leadership in Energy and Environmental Design (LEED) Requirements for Volatile Organic Compounds.

## 2.08 Metal Accessories, Edgings, Coping, And Terminations

### A. General

Products listed below can be used with any of the available Carlisle Roofing Systems. Refer to the applicable Carlisle details and installation instruction manuals for specific installation criteria.

### B. Products

#### 1. Fascia Products

- a. **SecurEdge CF Snap-on Fascia**: A two-part snap-on assembly including a base plate and decorative snap-on cover. Includes a 20-gauge retainer base plate with pre-slotted holes for fasteners. The fascia is available in 0.040" or .050" aluminum with mill-finish, anodized-finish or Kynar® 500 finish or 22- or 24-gauge galvanized steel with Kynar® 500 finish or acrylic coated galvalume finish. Available in a variety of standard colors. Custom colors are available upon request. Available in sizes from 3-1/2" to 12-1/4" face heights. ANSI/SPRI/FM-4435 ES-1 certified.
- b. **SecurEdge One Fascia**: A snap-on edge system consisting of a 20-gauge galvanized steel formed rail with pre-punched slots, a 6" stainless steel spring clip, corrosion resistant fasteners with a 24 gauge galvanized steel or 0.040", 0.050" or 0.063" Kynar® finished aluminum fascia cover. Available in a variety of standard colors. Custom colors are available upon request. Available in 12' standard lengths with face sizes of 4", 5", 6" and 8". ANSI/SPRI/FM-4435 ES-1 certified.

- c. **SecurEdge Snap-On Canted Fascia:** A snap-on edge system consisting of a 24-gauge galvanized metal water dam with pre-punched holes, a 24-gauge stainless steel spring clip and a snap-on cover. The cover is available in 0.040", 0.050" or 0.063" thick mill-finish, anodized, or Kynar® 500 finish aluminum or 22- or 24-gauge steel with Kynar® 500 finish. The fascia is available in a variety of standard colors. Custom colors are available upon request. Available in 12' standard lengths and heights varying from 5" to 12-1/2". ANSI/SPRI/FM-4435 ES-1 certified.
- d. **SecurEdge Crimp-On Canted Fascia:** A crimp-on edge system featuring a 24-gauge, galvanized metal water dam with pre-punched holes, a 24-gauge stainless steel spring clip and a snap-on cover. The fascia cover is available in 0.040", 0.050" or 0.063" thick mill-finish, anodized, or Kynar® 500 finish aluminum or 22- or 24-gauge steel with Kynar® 500 finish. The fascia is available in a variety of standard colors. Custom colors are available upon request. Available in 12' standard lengths and heights varying from 5-1/4" to 12-3/4". ANSI/SPRI/FM-4435 ES-1 certified.
- e. **SecurEdge EX Snap-On Fascia:** An anchor bar roof edge fascia system consisting of heavy 0.100" thick extruded aluminum bar, corrosion resistant stainless-steel fasteners and snap-on fascia cover used with Adhered, Mechanically Fastened assemblies. The fascia cover is available in 0.040", 0.050" or 0.063" thick mill-finish, anodized, or Kynar® 500 finish aluminum or 22- or 24-gauge steel with Kynar® 500 finish. The fascia is available in a variety of standard colors. Custom colors are available upon request. Available in 12' standard lengths and 4", 5-1/2", 7" and 8-1/2" heights. ANSI/SPRI/FM-4435 ES-1 certified.

## 2. Coping Products

- a. **SecurEdge Snap-on Coping:** A snap-on coping system that incorporates 20-gauge anchor cleats with pre-slotted holes, a concealed joint cover and 10' or 12' continuous sections of coping cap consisting of 40, 50 or 63-mil thick clear and colored anodized, and Kynar 500 finish or 24-gauge steel with Kynar® 500 finish. The coping cap is available in a variety of standard colors. Custom colors are available upon request. Also available in a variety of widths including custom pieces such as tees, crosses, radius copings, etc. ANSI/SPRI/FM-4435 ES-1 certified.
- b. **SecurEdge Snap-on Gold Coping:** A snap-on coping system that incorporates 20-gauge, galvanized steel anchor clips and 12", 20-gauge, factory-applied stainless-steel springs. Available with 22- and 24-gauge steel with Kynar® 500 finish or 0.040", 0.050" and 0.063" mill-finish, anodized or Kynar® 500 coated aluminum. A variety of standard colors are available. Custom colors are available upon request. ANSI/SPRI/FM-4435 ES-1 Certified.
- c. **SecurEdge CF Snap-on Coping:** A snap-on coping system that incorporates 20-gauge, galvanized steel anchor cleats with pre-slotted holes, a concealed joint cover and 0.040", 0.050" and 0.063" thick mill-finish, anodized or Kynar® 500 finish or 22- or 24-gauge Kynar 500® coated steel. The coping cap is available in a variety of colors and widths, including custom pieces such as tees, crosses, and radius copings. Custom colors are available upon request. Available in standard 12' lengths with 6" to 16" wall heights. ANSI/SPRI/FM-4435 ES-1 certified.  
  
Also available in SecurEdge CF Gold Coping with 16-gauge anchor cleats for added performance.
- d. **SecurEdge One Coping:** A mechanically fastened coping system consisting of a 22-gauge retainer bar (face side only), corrosion resistant fasteners and a .040", .050" or .063" mill-finish, anodized or Kynar® 500 coated aluminum and 22- or 24-gauge, Kynar® 500 coated steel coping cover. A variety of standard colors are available. Custom colors are available upon request. Available for wall thicknesses up to 12". ANSI/SPRI/FM-4435 ES-1 Certified.
- e. **SecurEdge Continuous Cleat Coping:** An engineered coping system, featuring continuous, 20-gauge galvanized steel cleats on both the inside and outside face of the parapet. Available with 0.040", 0.050" and 0.063" mill-finish, anodized or Kynar® 500 coated aluminum and 22- and 24-gauge Kynar® 500 coated steel. A variety of standard colors are available. Custom colors are available upon request. Custom fabricated for specific project requirements. Cleat available in standard 12' lengths. ANSI/SPRI/FM 4435/ES-1 Certified. Miami-Dade approved.

## 3. Water Control Products

- f. **SecurEdge Gravel Stop:** A two-piece assembly that consists of a continuous 22-gauge steel cleat with pre-punched holes and snap-on gravel stop cover. The gravel cover is available in 0.040", 0.050", and 0.063" mill-finish, anodized or Kynar® 500 coated aluminum or 22- and 24-gauge steel with galvanized Kynar® 500 coated or acrylic coated galvalume finish. Available in a variety of standard colors. Custom colors are available upon request. Available in 12' standard lengths with 3" to 10" heights and 1" and 3" flange widths. ANSI/SPRI/FM-4435 ES-1 Certified.
  - g. **SecurEdge Drip Edge:** Designed for use on Adhered and Mechanically Fastened Roofing Systems. Includes a 22-gauge continuous 12' pre-punched, 90-degree angle cleat and 10' or 12' long fascia sections, including concealed joint covers. Available in 0.032" or 0.040" mill-finish, anodized or Kynar® 500 coated aluminum or 24-gauge Kynar 500 coated steel. A variety of standard colors are available. Custom colors are available upon request. ANSI/SPRI/FM-4435 ES-1 Certified.
  - h. **SecurEdge EX Drip Edge:** Featuring an extruded aluminum anchor bar with pre-punched holes for roof membrane securement. The cover is manufactured from 0.040" aluminum with mill-finish, anodized or Kynar® 500 finish or 24-gauge steel with Kynar® 500 finish. Available in standard 12' lengths with sizes ranging from 3" to 7.5" face heights. A variety of standard colors are available. Custom colors are available upon request. ANSI/SPRI/FM 4435/ES-1 Certified. Miami-Dade approved.
  - i. **SecurWeld PVC Coated Drip Edge:** Prefabricated, non-reinforced, PVC-coated metal edging featuring a 22-gauge, 90-degree, angle cleat with pre-slotted holes and PVC-coated, and a 24-gauge metal cover used to heat-weld the roofing membrane directly to the metal edge. Available in standard PVC colors including white, gray, tan, light gray and slate gray. Available in sizes up to 8" fascia height. Available in standard 10' lengths with a variety of sizes up to 8" fascia height. ANSI/SPRI/FM 4435/ES-1 Certified.
  - j. **SecurWeld PVC Skirted Drip Edge:** Prefabricated PVC-coated metal edging, featuring a 22-gauge, 90-degree, angle cleat with pre-slotted holes, a PVC coated, and a 24-gauge metal cover used to heat-weld the roofing membrane directly to the metal edge. Available in standard PVC colors of white, gray, tan, light gray, and slate gray. Available in 10' standard lengths with a variety of sizes up to 8" fascia height. ANSI/SPRI/FM 4435/ES-1 Certified.
  - k. **SecurEdge WR Gutter:** system incorporates 1" wide extruded internal gutter brackets and aluminum or galvanized steel gutter. Available in 0.040", 0.050 or 0.063" aluminum, and 22-gauge or 24-gauge with Kynar® 500 finish. Gutter support brackets are extruded aluminum. Available in box style, chamfer style, and offset profiles. ANSI/SPRI/FM 4435/ES-1 Certified.
  - l. **Sure-Seal Ballast Retaining Bar:** A ballast retaining perimeter securement system comprised of a slotted (4" on center) extruded mil aluminum retention bar with an integrated compression fastening strip. 1-1/2" stainless steel fasteners with Neoprene washers are provided for stable securement.
  - m. **Termination Bar:** A 1" wide and 98-mil thick extruded aluminum bar pre-punched 6" on center which incorporates a sealant ledge to support Lap Sealant and provide increased stability for membrane terminations.
  - n. **SureTite Snap-On Fascia Cleat:** Prefabricated, 22-gauge, Galvalume steel, continuous, snap-on cleat with pre-punched holes. Used for use on single ply roofing applications when Carlisle metal flat sheets are used to shop fabricate the fascia or coping cover. Available in 12' standard lengths and 4-1/4" to 8-1/4" face heights. ES-1 certified.
  - o. **SureTite Drip Edge Cleat:** Prefabricated, 22-gauge, Galvalume steel, continuous, cleat with pre-punched holes. Used for use on single ply roofing applications when Carlisle metal flat sheets are used to shop fabricate the drip edge, gravel stop or flat coping cover. Available in 12' standard lengths and 3", 5" 6" and 7" heights. ES-1 certified.
4. Other Carlisle Metal Edgings / Copings suitable for use with roofing system included in the section, can be found in the Specification Supplement G-11 Metal Edging.

## 2.09 Roof Walkways

Walkways are to be specified at all traffic concentration points (i.e., roof hatches, access doors, rooftop ladders, etc.), and if regular maintenance, once a month or more, is necessary to service rooftop equipment.

### 1. Walkway Types

- a. **Sure-Flex PVC Heat Weldable Walkway Rolls:** Manufactured from specially compounded PVC, offering superior tear, puncture and weather resistance. Designed to protect Sure-Flex (PVC/KEE HP) membrane in those areas exposed to repetitive foot traffic or other hazards. Walkway material may be heat welded to Sure-Flex (PVC/KEE HP) membranes using an automated heat welder or hand held heat welder. Walkway Rolls are 36" wide by 60' long and are nominal 80-mil and 110-mil thick. Available in gray only.
- d. **Sure-Flex PVC Crossgrip Walkway Rolls:** Manufactured from PVC and may be used in lieu of standard Sure-Flex PVC Walkway Rolls when a walkway is to be loose-laid and not secured to the membrane. Loose-laid Crossgrip PVC Walkway Rolls are effective for winds up to 55 mph. Rolls are 36" wide by 33' long, available in white, gray and yellow.
- e. **Carlisle's Interlocking™ Rubber Pavers:** 24" X 24" X 2" thick rubber paver weighing approximately 24 pounds per unit, 6 pounds per square foot manufactured from recycled rubber, which provides a resilient, shock absorbing, weather resistant surface. Designed primarily for use as a walkway or on terrace areas offering a unique, environmentally sound advantage over concrete pavers. Features include freeze/thaw stability, bi-directional drainage and no breakage concerns. Available in black and terra cotta.
- f. **Hanover Ballast and Lightweight Ballast Pavers:** The standard, 24" x 24" x 1-13/16" thick, Ballast Paver comes in a natural color and a non-slip Diamond finish and weighs 22 lbs/sq. ft. The Lightweight, 23-1/2" x 23-1/2" x 1-1/4" thick, Ballast Paver comes in a natural color and a non-slip diamond finish and weighs 15 lbs/sq. ft. Both pavers can be used as ballast or walkways.

## 2.10 OTHER CARLISLE ACCESSORIES

Refer to [Spec Supplement P-01 "Related Products"](#) for additional accessories.

## Part III – EXECUTION

***Prior to commencing with the installation of any of the Sure-Flex PVC Membrane Systems refer to Paragraph 1.05 “Warranty Tables” for applicable components and proper securement method suitable for the appropriate warranty coverage.***

***Requirements listed in this specification are considered minimum and are intended for the sole purpose of obtaining a Carlisle Warranty. Additional requirements dictated by Regulatory Agencies, Building Insurance or Specifiers must be complied with and are considered to be beyond the scope of this specification.***

### 3.01 General

- A. Safety Data Sheets (SDS) must be on location at all times during transportation, storage and application of materials. The applicator shall follow all safety regulations as recommended by OSHA and other agencies having jurisdiction.
- B. Subject to project conditions, it is recommended to begin the application of this roofing system at the highest point of the project area and work to the lowest point to prevent water infiltration. This will include completion of all flashings, terminations and daily seals.
- C. A proper substrate shall be provided by the building owner. The structure shall be sufficient to withstand normal construction loads and live loads.

### 3.02 Roof Deck/Substrate Criteria

- A. Proper decking shall be provided by the building owner. The building owner or its designated representative must ensure that the building structure is investigated by a registered engineer to assure its ability to withstand the total weight of the specified roofing system, as well as construction loads and live loads, in accordance with all applicable codes. The specifier must also designate the maximum allowable weight and location for material loading and storage on the roof.
- B. Withdrawal resistance tests are strongly suggested to determine the suitability of a roof deck. Refer to [Design Reference DR-06 “Withdrawal Resistance Criteria”](#) in the Carlisle Technical Manual proper procedures for conducting pullout tests.
- C. Defects in the substrate must be reported and documented to the specifier, general contractor and building owner for assessment. The Carlisle Authorized Applicator shall not proceed with installation unless defects are corrected.
- D. On structural concrete decks, when a vapor retarder is not used, gaps in the deck along the perimeter and around penetrations must be sealed along with vertical joints between tilt-up panels, if present, to prevent infiltration of hot humid air and possible moisture contamination resulting from condensation. This is specifically important when adhesive is used to attach the roof insulation. (Migrating warm air through gaps left unsealed can result in condensation and weakening of the insulation bottom facer leading to possible board dislodgement.)
- E. **For all projects** (new or retrofit), the substrate must be relatively even without noticeable high spots or depressions. Accumulated water, ice or snow must be removed to prevent the absorption of moisture in the new roofing components and roofing system.
- F. Prior to the placement of membrane underlayment, clear the substrate of debris and foreign material that may be harmful to the roofing system. Gaps greater than 1/4" must be filled with an appropriate material.
- G. For direct application over an acceptable roof deck/substrate or when HP Protective Mat is specified and approved by Carlisle as the membrane underlayment in accordance with the Roof Deck and Substrate Criteria Table, the substrate must be smooth, steel trowel finished (structural concrete), free of debris, protrusions, sharp edges and loose and foreign material. Cracks or voids in the substrate, greater than 1/4", must be filled with an appropriate material.
- H. The following chart identifies the acceptable roof decks/substrates and the minimum underlayment requirements, Tables in Paragraph 1.05 for specific acceptable underlayment types, based on warranty duration:

## Roof Deck & Substrate Criteria

Acceptable Roof Deck/Substrate	PVC / KEE HP PVC Membrane	
NEW CONSTRUCTION	Adhered	Mechanically Fastened
Steel (min. 22 gauge) (1)(2), Wood Plank (3/4" min.), or Fibrous Cement	Insulation	Insulation
Structural Concrete (min. 3000 psi)	Direct Application	Insulation
Plywood (min. 15/32" thick) or Oriented Strand Board (min. 7/16" thick)	Direct Application (5)	Direct Application (5)
Lightweight Insulating Concrete	Direct Application (10)	Insulation
RETROFIT / NO TEAR-OFF	Adhered	Mechanically Fastened
Existing Smooth Surface BUR (3)(8)(9) or Mineral Surface Cap Sheet	Insulation	Insulation
Gravel Surfaced BUR (3)(4) or Coal Tar Pitch (3)(4)(9)(12)	Insulation	Insulation
Modified Bitumen (7) (9) (11)	Insulation	Insulation
Existing Single-Ply (11)	Insulation	Direct Application (6)
Sprayed-in-place Urethane	Complete Tear-off Required	Complete Tear-off Required
RETROFIT / TEAR-OFF	Adhered	Mechanically Fastened
Existing roof material removed (regardless of deck type)	Insulation	Insulation

**Notes:**

- (1) Local codes must be consulted regarding thermal barrier requirements.
- (2) Mechanically Fastened Systems cannot be specified on steel decks less than 22 gauge or for corrugated steel decks, regardless of gauge. Refer to the Metal Retrofit Roofing System Specification, published separately, for installation options.
- (3) Loose gravel must be removed to avoid entrapment of moisture.
- (4) Existing coal tar could drip back into the building, especially when new insulation does not provide sufficient thermal value to prevent the surface of the coal tar from softening.
- (5) Maximum Warranty Duration of 20 Years.
- (6) An approved underlayment is required over existing ballasted (ballast removed) single-ply systems and PVC roofing systems of any type.
- (7) Direct application permitted over smooth surfaced modified bitumen. To reduce the probability of cold welds, membrane shall be positioned with length of sheets parallel to modified bitumen field seams. At end laps or other locations where splices intersect modified bitumen field seams, 6" wide Sure-Flex Flashing must be heat welded over intersections.
- (8) Existing Type III or IV smooth asphalt BUR Only.
- (9) Possible staining/discoloration of the membrane may result when installing this system directly over existing smooth surfaced BUR or modified bitumen. If aesthetics are critical, an approved insulation should be specified beneath the membrane.
- (10) New approved cellular lightweight insulating concrete must have a minimum compressive strength of 225 psi. Except when the lightweight concrete is poured over slotted steel decks, pressure relief vents must be installed every 2,000 square feet. Direct application is not permitted where lightweight concrete is poured over an existing roofing material. Equilibrium moisture content after hydration/curing shall not exceed 12%.
- (11) Maximum warranty available 20 YR with 55 MPH peak gust wind speed coverage. Carlisle may be contacted for other warranty options.
- (12) If insulation is specified to be secured to an existing coal tar pitch roof with Carlisle Flexible FAST Adhesive or hot asphalt, minimum 1.5" thick Polyisocyanurate is the required minimum thickness when white membrane is specified.

- I. **On retrofit - recover projects**, cut and remove wet insulation, as identified by the specifier, and fill all voids with new insulation of type specified so it is relatively flush (+/- 1/4") with the existing surface.
  1. Entrapment of water between the old and new membrane can damage and deteriorate new insulation/underlayment between the two membranes. **If a vapor retarder or air barrier is not specified**, Carlisle recommends the existing membrane be perforated to avoid potential moisture accumulation and to allow the detection of moisture to enable the building owner to take corrective action. This can be accomplished by drilling approximately 3/4" diameter holes every 100 square feet in the existing built-up roof or single-ply membrane (excluding non-reinforced PVC membrane).

2. If total removal of existing PVC membrane is not specified, existing non-reinforced membrane may be cut into maximum 10' x 10' sections, when the new insulation or membrane underlayment is to be mechanically fastened.
3. Regardless of the type of membrane or assembly selected, any loose flashings at the perimeter, roof drains and roof penetrations must be removed.
5. When installing this roofing system over an existing **gravel surfaced built-up roof, loose gravel must be removed**. Power brooming is recommended by Carlisle to remove the loose gravel, which may trap moisture. Any uneven areas of the substrate must be leveled to prevent insulation from bridging.
6. On retrofit projects, all existing phenolic insulation must be removed.
7. Refer to table above for other Recover/Retro-fit considerations.

**J. Vapor Retarder Installation**

For Carlisle's Vapor Retarder refer to [Spec Supplement G-08 "Application Procedures for 725TR Air and Vapor Barrier"](#). Follow the respective vapor retarder manufacturer's recommended installation procedures and the specifier's instructions for the installation of the product specified. When insulation is to be set in adhesive, verify compatibility with Carlisle when Vapor Retarder by others is specified.

**K. Wood Nailers**

- a. Install wood nailers in locations that have been designated by the specifier and as approved by Carlisle. Refer to [Design Reference DR-08 "Wood Nailers and Securement Criteria"](#) for Wood Nailer Criteria.
- b. Wood nailers are not covered by the Carlisle Warranty.

**3.03 Insulation/Underlayment**

**A. General**

1. Roof insulation thickness must be determined by the thermal value required for each project and may be subject to code approval limitations. On projects where a vapor retarder is used, the specifier must calculate insulation thickness to ensure the temperature at the vapor retarder will not fall below the dew point.
2. For new construction projects in cold climate regions, the use of vapor retarders or air barriers is strongly recommended to protect insulation from moisture generated during construction.
3. Multiple layers of insulation are recommended with all joints staggered between layers.
4. Do not install more insulation/underlayment than can be covered by membrane in the same day.
5. All insulation boards must be butted together with no gaps greater than 1/4". Gaps greater than 1/4" are not acceptable.
6. Restrictions:
  - a. Carlisle Roofing Systems cannot be specified in conjunction with Phenolic Insulation.
  - b. Fiberglass insulation cannot be specified even if overlaid with additional insulation or membrane underlayment.
  - c. For all Thermoplastic Roofing Assemblies, the use of insulation by others is not acceptable when a Carlisle Membrane System Warranty is specified. Carlisle insulation must be used.
  - d. The direct application of Sure-Flex Membrane over expanded or extruded polystyrene insulation is not permitted.

**3.04 Insulation Attachment**

## A. General

1. Prior to proceeding with insulation securement refer to Warranty Tables, Paragraph 1.05, for attachment method and appropriate fastening density required for the specific Carlisle Warranty.

## B. Adhered Roofing Systems

1. **Mechanical Attachment**, insulation fastening density will vary based on insulation type, thickness, and required warranty. Warranty Tables in Paragraph 1.05 should be referenced for fastening density and the appropriate Carlisle detail may be consulted to identify acceptable fastening pattern.
  - a. For code compliance, increased fastening density may be required depending upon project wind speed and wind uplift requirement. Refer to [Design Reference DR-05 “Insulation Fastening Patterns”](#) for fastening pattern reference.
  - b. When insulation securement is to comply with Factory Mutual (FM) approvals, follow the requirements of the specifier concerning additional securement at the roof perimeter and corners. Also refer to [Design Reference DR-05 “Insulation Fastening Patterns”](#) for various fastening patterns.
  - c. On Reroof/No Tear off projects with a maximum roof height of 40', 1/2" SecurShield HD requires 12 fasteners per board. HP Recovery Board and Polyisocyanurate less than 1-1/2" thick require 16 fasteners per board.
  - d. When Oriented strand board (OSB) is specified for membrane underlayment, utilize Stormbase OSB/Polyiso Composite, mechanically fastened to the deck at the rate 17 fasteners for 4 x 8 board in accordance with Carlisle Details. When positioning OSB, butt edges and stagger joints of adjacent panels.
2. **Adhesive attachment**, Carlisle Urethane Adhesive Full Spray (Flexible FAST) or Bead (Flexible FAST or Olybond) may be used. When bead adhesive is specified bead spacing will vary based on Warranty coverage, refer to Warranty Tables, Paragraph 1.05 and appropriate Carlisle Details. CAUTION: Apply adhesive bead so that the distance from the edge of the board does not exceed half the bead spacing (i.e. within 6" of bead spacing of 12" O.C.).
  - a. **CAUTION: Do not apply urethane adhesives directly to un-weathered asphalt, (new or residual).**
  - b. **CAUTION: Especially in cold regions on tear-off projects or new construction gaps between horizontal and vertical surfaces of the roof area as well as gaps around penetrations must be sealed to prevent interior warm air from infiltrating and condensing within the roofing assembly. Condensing moisture could weaken bottom insulation facer and eventually result in dislodgement or loose boards when adhesive is used.**
  - c. On FM Global insured projects, consult FM Global's local representative concerning the use of adhesive to attach insulation to steel decks.
  - d. Check to ensure the substrate is clean, free of debris, other contaminants, and dry. Adhesive cannot be applied to a wet or a damp surface.
  - e. Apply Adhesive over the dry substrate area at the coverage rates indicated in [Spec Supplement G-03 “Insulation Attachment with Flexible FAST Adhesive”](#).
  - f. Allow the adhesive to rise up approximately 1/8" and develop strings prior to setting insulation boards into adhesive.

**Note:** String-time is measured by touching the adhesive with a splice wipe and looking for development of “strings” of adhesive as you pull the splice wipe out of the adhesive. With Flexible FAST Adhesive, string time is generally around 1-1/2 – 2 minutes after application at room temperature.
  - g. **Walk the boards into the adhesive and roll using the 30" wide, 150 pound segmented steel roller** to ensure full embedment. Optimal set up time should be approximately 5 to 7 minutes.

**CAUTION:** Walking on the boards immediately after placement in adhesive can cause slippage/movement until the adhesive has started to set up.

On roofs with a slope greater than 1/2" in 12", begin adhering insulation at the low point and work upward to

avoid slippage.

**A person should be designated to walk/roll-in all boards and trim/slit or apply weight as needed to ensure adequate securement.**

- h. Refer to [Spec Supplement G-02 “Flexible FAST Adhesive Equipment and Set-Up Requirements”](#) and [G-03 “Insulation Attachment with Flexible FAST Adhesive”](#) for application procedures and coverage rates.
3. **Alternate attachment method**, the specifier may select an alternate insulation attachment that incorporates a solid mopping of the insulation with hot asphalt (ASTM D312, Type III or IV). If the attachment method is to be covered by the Carlisle Warranty, Carlisle must be contacted for specific requirements. Upon review and acceptance by Carlisle, the maximum warranty coverage available is limited to 15 Year with maximum Peak Gust Wind Speed Coverage of 55 mph, for other warranties contact Carlisle.
  - a. Extruded or Expanded Polystyrene insulation are not acceptable when this alternate attachment method is specified.
  - b. The existing gravel surfaced built-up roof must be scraped to remove all loose gravel. Large blisters that may prevent continuous embedment of insulation must be repaired. The surface of the substrate must also be dry and clear of foreign material.
  - c. On coal tar pitch, when deemed compatible by the specifier, minimum 1.5" Polyisocyanurate is the required membrane underlayment when using darker heat weldable membranes (tan or gray). If Sure-Flex white membrane is used, minimum 1" thick Polyisocyanurate is required.
  - d. For successful attachment, proper asphalt temperatures must be maintained and the specifier's requirements concerning the installation of a base sheet (where required) and quantity of hot asphalt must be followed.
  - e. The maximum insulation board size shall not exceed 4' X 4'. Trim insulation boards around crickets and saddles to ensure continuous embedment.
  - f. Care must be exercised to prevent contamination of the top surface of the insulation. Asphalt oozing through insulation joints must be wiped from the surface. Contact with fresh asphalt can result in discoloration of the Sure-Flex membrane.
  - g. A grid shall be installed subdividing the roof in individual sections of 2400 square feet. Required for warranties up to 10 year with wind speed coverage up to 55mph.
  - h. The wood nailers are installed relatively flush with the insulation surface and the membrane is to be fastened with seam fastening plates and Carlisle HP or HP-X fasteners on 12" o.c. For wood nailer installation, refer to [Design Reference DR-08 “Wood Nailers and Securement Criteria”](#).

### C. Mechanically Fastened Roofing Systems

1. **Carlisle Fasteners and Fastening Plates are required for insulation securement.** Refer to Insulation Fastening Criteria Table in Paragraph 2.05, for appropriate fastener and deck penetration. The fastener can be used with either a 2" diameter Seam Fastening Plate or 2-3/8" diameter Pirahna/Pirahna Xtra Plates OR 3" diameter Insulation Fastening plate.
2. **Any Carlisle approved insulation or cover board** shall be mechanically fastened to the roof deck at the minimum rate of **1.25 fasteners and plates per every 8 square feet** (5 fasteners in a 4 x 8 board) for minimum 1-1/2" thick insulation and coverboards. Insulation less than 1-1/2" thick requires the use of 8 fasteners and plates in a 4' x 8' board (1 per 4 square feet).

**CAUTION: Carlisle Polyisocyanurate Insulation with a thickness less than 1.5" installed over an existing roofing membrane without a tear-off** must be mechanically fastened to the roof deck with a minimum of **1 fastener and plate for every 4 square feet** or less of insulation.

3. Use of DensDeck, DensDeck Prime, Dens Deck StormX Prime and DEXcell should be limited to assemblies with slopes greater than 2" per foot to ensure compliance with external fire codes.

### 3.05 Membrane Placement and Securement

## A. General

1. **Ensure** that water does not flow beneath any completed sections of the membrane system by completing all flashings, terminations and daily seals by the end of each workday.
2. **Sweep** all loose debris from the substrate.
3. If aesthetics are of concern, protection should be specified to avoid discoloration of the white membrane surface resulting from adhesive residue or excess foot traffic.
4. In addition to the primary membrane securement (Bonding for Adhered and Fastening for Mechanically Fastened Assemblies), additional membrane securement is required at the perimeter of each roof level, roof section, curb, skylight, interior wall, penthouse, etc., at any inside angle change where slope or combined slopes exceed 2" in one horizontal foot, and at other penetrations in accordance with the applicable Carlisle details. Refer to Paragraph F for additional membrane securement.

## B. Membrane Placement

Maximum 10' wide Sure-Flex Membrane is fully adhered or mechanically fastened to an approved insulation or substrate.

1. **Position** Sure-Flex membrane over the acceptable substrate. For a mechanically fastened assembly, ensure proper number of perimeter sheets are positioned along the perimeter of the roof as outlined in Paragraph 1.05 "Warranty Tables".
2. **Position** field sheets perpendicular to the steel deck flutes in Mechanically Fastened Applications.
3. **Place** adjoining membrane sheets in the same manner, overlapping edges appropriately to provide for the minimum overlap width. It is recommended all overlaps be shingled to avoid bucking of water.

## C. Membrane Securement / Bonding - Adhered Roofing System

1. **Adhere** Sure-Flex membrane to an acceptable substrate with Carlisle Bonding Adhesive. CAV-GRIP PVC aerosol adhesive may be utilized with Sure-Flex PVC membranes (cannot be used with any KEE or KEE HP bareback membranes). Comply with Labels, Safety Data Sheet (SDS) and Product Data Sheets for installation procedures and use. Adhesive must be applied to both the membrane and the surface to which it is being bonded.
2. On projects at high altitudes (6,000' and above), rapid flash-off (drying) of Bonding Adhesive and Primers will occur due to low atmospheric pressure.
3. **Fold** membrane sheet back so half the underside is exposed. Sheet fold should be smooth without wrinkles or buckles.
4. **Stir** Bonding Adhesive thoroughly scraping the sides and the bottom of the can (minimum 5 minutes stirring is recommended). Bonding surfaces must be dry and clean.
5. **Apply** Bonding Adhesive to the exposed underside of the membrane and the corresponding substrate area. Do not apply Bonding Adhesive along the splice edge of the membrane to be heat welded over adjoining sheet.

When using **Sure-Flex Low-VOC Bonding Adhesive**, a coverage rate of approximately 120 square feet per gallon per one surface (membrane or substrate) or approximately 60 square feet per gallon per finished surface (includes coverage on both membrane and substrate) shall be achieved. **Apply** adhesive evenly, without globs or puddles with a plastic core, medium nap paint roller to achieve continuous coating of both surfaces. A 9-inch roller will easily fit into the 5-gallon containers.

A mechanical roller dispenser can be used to apply Bonding Adhesive when the continuous coating and coverage rate noted above are maintained. Backrolling is required.

**CAUTION:** Due to solvent flash-off, condensation may form on freshly applied Bonding Adhesive when the ambient temperature is near the dew point. If condensation develops, possible surface contamination may occur and the application of Bonding Adhesive must be discontinued. Allow

the surface to dry and apply a thin freshener coat at the coverage rate which is approximately half the coverage rate stated above to the previously coated surface when conditions allow for continuing.

**NOTE:** When Aqua Base 120 is specified refer to [Spec Supplement G-10 “Aqua Base 120 Bonding Adhesive”](#) for application methods and warranty requirements.

6. **Allow** adhesive to flash-off until it does not string but remains tacky to a dry finger touch.

**CAUTION:** Care must be exercised to ensure proper drying. Avoid thin areas of adhesive because over drying can occur and proper adhesion may not be achieved.

7. **Roll** the coated membrane into the coated substrate while avoiding wrinkles.
8. **Brush** down the bonded section of the membrane sheet immediately after rolling the membrane into the adhesive with a soft bristle push broom to achieve maximum contact.
9. **Fold** back the unbonded half of the sheet and repeat the bonding procedures. **Apply** Bonding Adhesive to the remaining exposed underside of membrane and adjacent substrate and complete this section as described above.
10. **Install** adjoining membrane sheets in the same manner, overlapping edges a minimum of 2 inches to provide for a minimum 1-1/2 inch heat weld. It is recommended that all splices be shingled to avoid bucking of water.

**CAUTION:** If aesthetics is of concern, protect completed sections of the roof so Bonding Adhesive will not discolor the membrane surface. Do not place Bonding Adhesive containers or their lids directly on the surface of the Sure-Flex membrane, to avoid rust stains.

**D. Membrane Securement / Fastening - Mechanically Fastened Roofing Systems**

1. Sure-Flex PVC and KEE HP membranes shall be mechanically attached to the structural deck with specified Carlisle Fasteners and designated Plates, for fastening densities and numbers of perimeter sheets refer to Warranty Tables, Paragraph 1.05.
2. Membrane Fastening Selection Table:

**Membrane Fastener Selection**

Deck Type	Carlisle Fasteners*	Carlisle Plate	Min. Penetration
Steel or Lightweight Insulating Concrete over Steel**	HP-X	Piranha Plates	3/4"
	HP-Xtra	Piranha-Xtra Plates	
Structural Concrete, rated 3,000 psi or greater	CD-10	Piranha Plates	1"
	HD 14-10	Piranha Plates	
Wood Plank, min. 15/32" thick Plywood or min. 7/16" OSB**	HP-X	Piranha Plates	Min. 1"
	HP-Xtra	Piranha-Xtra Plates	
Cementitious Wood Fiber Gypsum	Polymer Gyptec	Gyptec Plates – 2" Dia.	1-1/2"
	Polymer Gyptec	Gyptec Plates – 2" Dia.	1-1/2"

Refer to Warranty Tables in Paragraph 1.05 for fastening densities and number of perimeter sheets.

\*Determine proper fastener length for deck penetration, refer to Table 2.05B.

\*\* For Mechanically Fastened PVC and KEE HP PVC Assemblies, 2-3/4" x 1-1/2" Oval Metal Barbed Fastening Plates can be used in conjunction with HP-X Fasteners for membrane securement. (Not recommended for Insulation Securement)

3. On steel decks, membrane shall be positioned with seams perpendicular to the steel deck flutes. This allows the external forces on the roof assembly to be distributed between multiple steel deck panels. Refer to [Design Reference DR-06 “Withdrawal Resistance Criteria”](#) in the Carlisle Technical Manual.
4. Perimeter Sheets

The number of perimeter sheets and fastener spacing is dependent on the building height, wind zone location and warranty duration as outlined in Warranty Tables in Paragraph 1.05.

The roof perimeter is defined as all edges of each roof section (i.e., parapets, building expansion joints at

adjoining walls, penthouse walls, etc.). When multi-level roofs meet at a common wall, the adjacent edge of the upper roof is treated as a roof perimeter if the difference in height is greater than 10'. Perimeter sheets are not required at the base of the wall at the lower level.

**Note:** Expansion joints, control joints and fire walls in the field of the roof or roof ridges with slopes less than 3" to the horizontal foot are not considered as part of the roof perimeter.

For Sure-Flex membranes, perimeter sheets can be formed by using individual 40.5" or 5'-0" wide sheets.

a. **Individual perimeter sheets** (PVC - 40.5" or 5' wide)(KEE HP PVC – 5' wide)

Position membrane along the perimeter of the roof over the acceptable insulation/underlayment. The perimeter membrane width from line of securement to line of securement should be approximately 3'-6" to 4'-0" wide.

b. **Fastening Plates Method**

In lieu of the RUSS securement method, position a row of seam fastening plates in the locations identified in Paragraph 4.b.1 and 4.b.2, secure plates with appropriate fastener and overlay plates with 6" wide Pressure-Sensitive Sure-Weld Cover Strip (TPO Only) overlay the plates as follows:

- 1) Projects with Warranties greater than 20 Years OR Sure-Flex projects regardless of warranty duration center 6" wide section of PVC/KEE HP PVC membrane (equal thickness to the deck membrane) over the plates and heat weld the field sheets. Cut edge sealant is not required for PVC or KEE HP PVC.

**Note:** Perimeter sheets can also be formed by positioning Rhinobond plates placed along the center of a field membrane (if heat induction welder is available on job-site). Refer to "Attachment I" for additional information

c. **Building with Special Conditions:**


Air pressurized buildings, canopies and buildings with large openings where the total wall openings exceed 10% of the total wall area on which the openings are located (such as airport hangars, warehouses and large maintenance facilities) will typically require additional perimeter membrane securement, an increased fastening density or other enhancement.

d. **Buildings with large openings**

When any wall contains major openings with a combined area which exceeds 10% of the total wall area on which the openings are located, four (4) perimeter sheets (centered over the opening) must be specified as shown.

As an option to the above perimeter securement, an adhered membrane section may be used in lieu of the mechanically fastened membrane at large openings in accordance with the Carlisle Specification for the Sure-Flex Adhered Roofing System.


**NOTE:** Depth of perimeter area, noted above, shall not be less than 2.5 times the width of the opening.

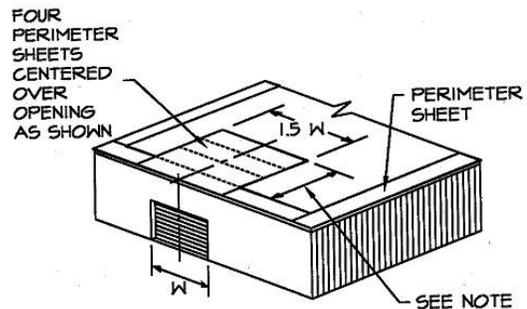

e. **Buildings with overhangs**

The membrane must be specified with perimeter sheets installed over the entire overhang area extending onto the main roof deck when at the same level.

As an option, an adhered membrane section may be used in lieu of the mechanically fastened membrane at building overhangs in accordance with the Carlisle Specification for the Sure-Flex Adhered Roofing System.

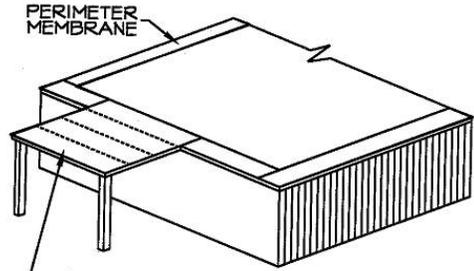

INSTALL PERIMETER SHEETS OVER THE ENTIRE OVERHANG AREA EXTENDING ONTO THE MAIN ROOF DECK WHEN AT THE SAME LEVEL AS SHOWN.

5. **Field Membrane**

- a. **Position** adjoining field membrane sheets to allow an approximate overlap of 5-1/2" at those locations where Fastening Plates are located (along the length of the membrane); at the same time overlap end roll sections (the width of the membrane) a minimum of 2".
- b. **Secure the membrane** at the approved fastening density with the required Carlisle Fastener and Fastening Plates.
- c. For installation of membrane with fullness, tighten the sheet between fasteners as follows:
  - 1) Unroll sheets and position.
  - 2) Place a fastener and plate in one end of the sheet on the appropriate fastener mark. Go to the opposite end of the sheet, pull it tight and place a fastener and plate at the appropriate mark. Place the remaining fasteners into the sheet.
  - 3) Proceed to weld the sheet in place and continue across the roof.

6. **Prevention of membrane distortion during windy conditions:**

- a. Unroll sheet approximately 5' and position edge of membrane with overlap line on adjacent sheet.
- b. Install fasteners along the 5' exposed edge.
- c. While the 5' of exposed membrane is being fastened, begin welding the overlapped edge using the Automatic Heat Welder.
- d. As sheet is being welded and fastened concurrently, unroll membrane. Unroll only enough membrane to stay a few feet ahead of welding and fastening process. This reduces amount of unsecured membrane to be distorted by wind.
- e. Continue this process for each adjoining sheet.

E. **Additional Membrane Securement**

1. Securement must be provided at the perimeter of each roof level, roof section, expansion joint, curb, skylight, interior wall, penthouse, etc., at any inside angle change where slope exceeds 2 inches to one horizontal foot, and at all penetrations as identified on the Carlisle details.
2. Securement may be achieved as follows:
  - a. On Mechanically Fastened Roofing Systems, Carlisle's Piranha Fastening Plates are used to secure the

membrane with the appropriate Carlisle Fastener at the base of walls and penetrations and flashed as shown on the applicable Carlisle detail (excluding OSB, cementitious wood fiber and gypsum decks where the required Carlisle Fastener is installed with the associated 2" diameter plate). On **Adhered Roofing Systems**, Carlisle standard 2" diameter Seam Fastening Plates may be used in lieu of Piranha Plates.

- b. Securement of the membrane shall be a maximum of 12 inches on center. Fasteners shall be positioned 6 inches minimum to 9 inches maximum from the inside or outside corner.
- c. On Mechanically Fastened assemblies, additional membrane securement is required around pipes and sealant pockets as shown on the applicable detail. The plates must be positioned a maximum of 12" away from the penetration, spaced a maximum of 12" on center and flashed in accordance with the applicable Carlisle Detail.
- d. After securing the membrane, flash in accordance with the appropriate detail.

### 3.06 Heat Welding Procedures

#### A. General

1. APEEL Protective Film should be removed from within areas that are to be heat-welded together. In areas that do not require heat welding, the APEEL Protective Film can be left in place for up to 90 days.
2. Heat weld the Sure-Flex membrane sheets using the Automatic Heat Welder or Hot Air Hand Welder and silicone roller.
3. When roof slope exceeds 5" per horizontal foot, use of the Automatic Heat Welding Machine may become more difficult; use of the Hand Held Hot Air Welder is recommended.
4. **Check the surfaces** of the membrane to be heat welded to ensure they are properly prepared.

The surfaces to be heat welded must be clean. Membrane overlaps that become contaminated with field dirt must be cleaned with Weathered or PVC and KEE HP Membrane Cleaner (Weathered Membrane Cleaner should not be used to clean Sure-Flex PVC or KEE HP). Weathered or PVC and KEE HP Membrane Cleaner should be wiped dry with a clean HP Splice Wipe prior to welding. No residual dirt or contaminants should be evident.

#### B. Automatic and/or Hand Held Heat Welder Equipment

1. Refer to [Supplemental Document T-01 "Heat Welding Equipment"](#) for:
  - a. Temperature Settings.
  - b. Equipment Set-up.
  - c. Additional Information.

#### C. Membrane Welding

1. Prepare the Automatic Heat Welder and allow it to warm for approximately 5 to 10 minutes to reach operating temperature.
2. Position the Automatic Heat Welder properly prior to seaming with the guide handle pointing in the same direction the machine will move along the seam.
3. Lift the overlapping membrane sheet and insert the blower nozzle of the Automatic Heat Welder between the overlap. Machine will begin moving along the seam immediately.
4. Weight plates provided on Automatic Welders must be utilized.
5. Proceed along the seam ensuring that the small guide wheel in front of the machine aligns with the edge of the top membrane sheet. Guide the machine from the front only.

**CAUTION:** Ensure the power cord has plenty of slack to prevent dragging the machine off course (which could result from a tightly stretched cord).

6. At all splice intersections, roll the seam with a silicone roller to ensure a continuous heat welded seam (the membrane should be creased into any membrane step-off with the edge of the silicone roller). A false weld may result due to surface irregularities created by multiple thicknesses of Sure-Flex membrane sheets.

When using **80-mil** Sure-Flex Membrane, a **PVC "T"-Joint Cover** must be applied over all "T" joint splice intersections.

7. To remove the Automatic Heat Welder from the finished splice, disengage and pull the nozzle from the seam area, the machine will stop automatically.
8. Mark the end of the heat welded seam with a water-soluble marker for easy identification. A Hand Held Welder will be necessary to complete the weld in the area between where the Automatic Heat Welder is stopped and restarted.
9. Perform a test weld, at least, at the start of work each morning and afternoon. Test welds should be made if any changes in substrate or weather conditions occur.

#### D. Preventing Membrane Creeping During Welding

1. The operator of automatic welding equipment must apply foot pressure to the membrane, keeping the membrane tight under the welder. Refer to [Supplemental Document T-01 "Heat Welding Equipment"](#) for additional information.

#### E. Test Cuts

1. Perform a test weld at least at the start of work each morning and afternoon. Refer to [Supplemental Document T-01 "Heat Welding Equipment"](#) for additional information.

#### F. Seam Probing

1. A cotter pin puller (blunt or dull for PVC or KEE HP PVC Membranes) or Carlisle Seam Probe is recommended to probe all heat-welded seams. Probing seams must be done once heat welds have thoroughly cooled. Refer to [Supplemental Document T-01 "Heat Welding Equipment"](#) for additional information.

#### G. Seam Sealing

Cut-Edge Sealant is not required on cut edges of Sure-Flex membrane (Horizontal or Vertical).

### 3.07 Welding Problems/Repairs

- A. A Hand Held Hot Air Welder and a 2" wide silicone roller must be used when repairing the Sure-Flex membrane. When the **entire** heat welded **seam** is to be **overlaid**, an **Automatic Heat Welder** may be used.
- B. Prior to proceeding with any repair procedure, the area to be repaired must be cleaned with Weathered or PVC and KEE HP Membrane Cleaner (Weathered Membrane Cleaner should not be used to clean Sure-Flex PVC or KEE HP PVC Membrane). The membrane can typically be repaired with standard cleaning methods. In cases where the standard cleaning method is not sufficient, the following procedures must be used.
  1. Scrub the area to be welded with a "Scotch Brite" Pad and Weathered or PVC and KEE HP Membrane Cleaner.
  2. Clean all residue from the area to be welded with a Splice Wipe or a clean natural fiber (cotton) rag.
  3. Weld the new membrane to the cleaned area using standard welding procedures.
- C. Clean all residue from the area to be welded with a Splice Wipe or clean natural fiber (cotton) rag.
- D. Weld the new membrane to the cleaned area using standard welding procedures.
- E. Voids in welded seams can be repaired using a Hand Held Hot Air Welder and a silicone roller. Depending on conditions, a splice overlay may be required.
- F. Position the hand held welder facing into void so hot air is forced between overlapping membranes. Roll the top

membrane surface using positive pressure toward the outer edge until the heated membrane surfaces are fused.

- G. Exposed scrim-reinforcement (resulting from scorching surface of membrane) and test weld areas must be repaired by overlaying the damaged area with a separate piece of Sure-Flex reinforced membrane with rounded corners. The overlay must extend a minimum of 2 inches past the area to be repaired.
- H. **Probe** all edges of the overlay once cooled to ensure a proper weld has been achieved.
- I. Cut-Edge Sealant is not required on cut edges of Sure-Flex Membranes.

**Note:** The same overlay repair procedures may be used for punctures in the Sure-Flex membrane.

### 3.08 Flashings

**For other requirements which must be complied with in order for Carlisle warranty to be issued, refer to [Spec Supplement G-05 "Flashing Considerations / Metal Work"](#).**

#### A. General Considerations

1. The height of new wall flashing must extend above the anticipated water level or slush line.
2. On 15 or 20-year Warranty projects, Carlisle's Termination Bar, in conjunction with Water Cut-Off Mastic, must be specified under all metal counterflashings and surface mounted reglets.
3. To comply with various warranty options, flashing material must equal the required minimum membrane thickness but shall not be less than 60-mils thick. For projects with 25 year or greater warranties Carlisle Pre-Fabricated accessories must be used unless prohibited by a specific field condition.

#### 4. On retrofit projects

Bitumen-based roof cement and asphaltic-based flashing material, if allowed to remain in contact with the membrane, will cause severe membrane discoloration and for PVC and KEE HP PVC membranes, promote premature plasticizer migration. Existing wall and curb flashing must be removed or concealed with a new acceptable substrate.

- a. The specifier must examine structural supports for rooftop equipment to determine if reasonable access to the membrane beneath the equipment is provided. Carlisle should be consulted for clarification when access to the membrane system will be restricted.
  - b. When hot pipes or other similar penetrations exceed 140° F (60° C) (PVC/KEE HP PVC), they must be designed to incorporate an insulated metal collar and rain hood designed to maintain a surface temperature less than 140° F (60° C) (PVC/KEE HP PVC).
5. Flashing of parapets, curbs, expansion joints and other parts of the roof must be performed using Sure-Flex **reinforced** membrane. Sure-Flex non-reinforced membrane can be used for flashing pipe penetrations, Sealant Pockets and scuppers as well as inside and outside corners when the use of pre-molded accessories is not feasible.
  6. When possible, all reinforced membrane splices are heat welded with the Automatic Heat Welder. The Hand Held Hot Air Welder should be utilized in hard to reach areas, smaller curbs, vertical splices and when using non-reinforced membrane.
    - a. The new Sure-Flex membrane flashing must not conceal weep holes or cover existing throughwall flashing.
    - b. Install surface mounted reglets and compression bar terminations directly to the wall surface.
  7. In areas where metal counterflashing or surface mounted reglets are used as vertical terminations, the counterflashing must be sealed with a rubber grade caulking to prevent moisture migration behind the new wall flashing.

#### B. Application of Bonding Adhesive

1. Membrane shall be adhered to vertical surfaces with Sure-Flex Bonding Adhesive. CAV-GRIP PVC aerosol

adhesive may be utilized with Sure-Flex PVC membranes (cannot be used with any KEE or KEE HP bareback membranes). Bonding Adhesive shall be applied continuously, without globs or puddles.

2. **Allow** adhesive to flash-off until it is tacky but will not string or transfer to a dry finger touch.
3. Roll the membrane into the adhesive.
4. Care must be taken when setting the flashing to avoid bridging greater than 3/4 inch at angle changes (i.e., where a parapet or roof penetration meets the roof deck). This can be accomplished by creasing the membrane into the angle change.
5. Terminate the edges of the installed membrane in accordance with Carlisle's applicable details.
6. When Carlisle termination bar is used beneath the counter-flashing, bonding adhesive can be eliminated when the flashing height is 18" or less.

**C. Walls, Parapets, Curbs, Skylights, etc.**

The flashing height must be calculated so that the Sure-Flex membrane flashing includes a minimum 1-1/2 inch heat weld beyond the Fastening Plates.

1. Fasten at angle change as identified in Paragraph 3.05, Additional Membrane Securement, with the required Carlisle Fastener and plate.
2. Flash the fasteners/plates with a separate piece of Sure-Flex reinforced membrane; apply heat and crease the flashing into the angle change before attaching it to the vertical surface.

**D. Metal Edge Terminations**

Factory-fabricated metal edge systems must be secured to the wood nailer as specified by the manufacturer. Shop-fabricated edging must be installed in compliance with appropriate Carlisle Detail using Carlisle PVC Coated Metal in order to achieve ES-1 Compliance. Refer to the appropriate Universal Details for other flashing options and requirements.

**E. Roof Drains**

1. Sure-Flex membrane may extend into the drain sump when the slope of the sump is less than 3" to one horizontal foot.  
  
When the drain sump is greater than 3" to one horizontal foot, additional membrane securement must be installed.
2. Only drain strainers that have been approved by the specifier in accordance with applicable codes may be used.

**F. Sure-Flex Contour Rib Profiles**

1. The Contour Rib Profile is recommended for use with FleeceBACK® PVC adhered roofing systems.
2. The Sure-Flex Contour Rib Profiles should be positioned parallel to the laps of the installed PVC roofing system and parallel with the roof slope where possible.
3. Ensure that all welding surfaces are clean and dry. Inspect all seam areas for proper weld prior to installing Sure Flex Contour Rib Profile.
4. Contour Rib Profile spacing can be individually determined to achieve the desired appearance.
5. Connecting multiple ribs is achieved by using fiberglass pins. Insert a pin half-way into the end of one profile. Connect the adjoining rib by inserting the exposed end of the pin into the alignment hole. Repeat previous steps for additional PVC Contour Rib profiles.
6. Consult the Sure Flex Contour Rib Profile installation guides for instructions on proper installation techniques.

**G. Other Penetrations**

On Mechanically Fastened assemblies, additional membrane securement is required around pipes and sealant pockets as shown on the applicable detail. The plates must be positioned a maximum of 12" away from the penetration, spaced a maximum of 12" on center and flashed in accordance with the applicable Carlisle Detail.

1. **Pipes, Round Supports, etc.**

- a. Flash pipes with Molded Pipe Flashings or Split Pipe Seals where their installation is possible. Molded pipe flashings cannot be cut and patched; deck flanges cannot be overlapped or installed over angle changes.
  - b. Where Molded Pipe Flashings or Split Pipe Seals cannot be installed, APPLY FIELD FABRICATED PIPE FLASHING using Sure-Flex non-reinforced membrane.
2. **Flexible Penetrations** (braided cables, conduits, wires, etc.) must be enclosed in a stable "goose neck." Apply a Split Pipe Seal or field fabricated pipe flashing to flash the goose neck.
3. **Hot pipes** that exceed 140° F (60° C) (PVC/KEE HP PVC), must utilize an insulated metal collar and rain hood, flashed with a field fabricated pipe flashing.
4. For **pipe clusters** or unusually shaped penetrations, a Molded Sealant Pocket and White One Part Sealant must be utilized.
5. **Existing Roof Tie-Ins** for PVC or KEE HP PVC membranes refer to applicable Carlisle details for tie-ins.
6. **Flashing of Difficult Penetrations**, refer to [Spec Supplement G-13 for "LIQUISEAL Liquid Flashing"](#) for additional information and specific requirements.

H. **APEEL Protective Film (Optional)**

When the optional APEEL Protective Film is utilized on PVC/KEE HP, remove and discard the APEEL Protective Film after the installation of the entire PVC/KEE HP Roofing System is complete.

**3.09 Roof Walkways**

Walkways are to be specified at all traffic concentration points (i.e., roof hatches, access doors, rooftop ladders, etc.), and if regular maintenance (once a month or more) is necessary to service rooftop equipment. Refer to [Spec Supplement G-06 "Roof Walkway Installation"](#).

**3.10 Daily Seal**

On phased roofing, when the completion of flashings and terminations is not possible by the end of each workday, provisions must be taken to temporarily close the membrane to prevent water infiltration. Refer to [Spec Supplement G-07 "Daily Seal & Clean Up"](#).



Copyright 2026 Carlisle Construction Materials Incorporated

APEEL, Carlisle, CAV-GRIP, Elastoform Flashing, Flexible FAST Adhesive, FAT and Factory Applied Tape, FleeceBACK, HPX Fasteners, HydroBond, InsulBase, InsulFast, LIQUISEAL, Piranha Plate, SAT/Self Adhering Technology, SecurEdge, Securfast, SecurShield, SecurTAPE, StormBase, Sure-Flex, Sure-Seal, Sure-White, VapAir Seal and X-Tenda Coat are Trademarks of Carlisle Construction Materials Incorporated

Insulfoam, InsulLam and R-Tech are Trademarks of Insulfoam

Thermapink, Foamular and Durapink are Trademarks of Owens Corning

DensDeck, Dens Deck Prime and DensDeck StormX Prime are Trademarks of Georgia-Pacific Corporation

Securock is a Trademark of USG

DEXcell® and DEXcell FA™ is a trademark of National Gypsum

OPTIM-R® is a registered trademark of Kingspan Group

ADVANCE-R® is a registered trademark of Panasonic Corporation

Styrofoam is Trademark of the DOW Chemical Company

Olybond is a Trademark of OMG, Inc.

This specification represents the applicable information available at the time of its publication. Owners, specifiers and Carlisle Authorized Roofing Applicators should consult Carlisle or their Carlisle Manufacturer's Representative for any information, which has subsequently been made available.

Review the appropriate Carlisle warranty for specific warranty coverage, terms, conditions and limitations.

# Specification ATTACHMENT

## PVC Mechanically Fastened Roofing Systems Induction Welding (RhinoBond / Isoweld) Attachment Method

### “Attachment I”

**January 2026**

This is an alternate method for securing the Carlisle’s Sure-Flex (PVC/KEE HP PVC) membrane and is intended to be used in conjunction with the Carlisle’s PVC Mechanically Fastened Specification and Details.

#### A. Description

The Induction Welding (RhinoBond/Isoweld) Attachment Method incorporates 3" diameter corrosion-resistant plates with a hot melt PVC coating. The RhinoBond or Isoweld Plates are installed with HP-X Fasteners to secure an acceptable insulation to minimum 22 gauge steel deck or minimum 15/32" thick plywood; HD 14-10 fasteners are required for concrete deck and Rhinobond or IsoWeld Plates.

Carlisle’s Polyester Reinforced PVC membrane is positioned over the secured RhinoBond or Isoweld plates and welded to the top surface of the plate with the RhinoBond or Isoweld Induction Welding Tool.

Induction Welding (Rhinobond/Isoweld) Attachment Method Limited to 30 Year Maximum Warranty and Wind Speed Coverage Up to 120 mph. Perimeter enhancements will be required on systems greater than 72 mph and/or projects over 50' in height. Contact Carlisle for requirements for enhancements.

**Table I Induction Welded - Membrane Systems Warranty Options**

Years	Sure-Flex PVC Membranes		
	Warranty Wind Speed	Minimum Membrane Thickness (1)	Additional Puncture Coverage (4)
	55, 72, 80, 90, 100, 110, or 120 mph		
5,10, or 15 year	√ (2)	Sure-Flex 50-mil	Not Available
20 year	√ (2)	Sure-Flex 60-mil	Not Available
25 or 30 year	√ (2)	Sure-Flex 80-mil	Available

Notes: √= Acceptable

- (1) All “T-Joints” must be overlaid with appropriate flashing material when using 80-mil PVC/KEE HP membrane.
- (2) Perimeter calculation is .4 x height of building. The minimum perimeter width is 8-feet up to a 20-year warranty and 16-feet for 25-30-year warranty.
- (3) Perimeter enhancements required for wind speed coverage greater than 72mph and/or projects over 50' in height. Contact Carlisle for requirements.

- (4) Carlisle's Accidental Puncture Warranty covers labor hours and material used during the repair. Maximum labor and material hours are dependent upon system design. Refer to the Warranty Availability Quick Reference Guide for coverage.

**Induction Welded – Induction Plate Density  
for Induction Welded Roofing Systems  
(Up to 20 YR Warranty)**

**Table II**

Peak Gust Wind Speed Warranty	Max. Building Height	Minimum Perimeter Width	Induction Weld Plate Density					
			Field		Perimeter		Corners	
			8 Ft. Boards	12 Ft. Boards	8 Ft. Boards	12 Ft. Boards	8 Ft. Boards	12 Ft. Boards
<b>55 MPH</b>	Up to 50'	8'	6	10	8	12	8	12
<b>72 MPH</b>	Up to 50'	8'	6	10	8	12	8	12
<b>80 MPH</b>	Up to 50'	8'	8	12	10	16	10	16
<b>90 MPH</b>	Up to 50'	8'	8	12	12	18	12	18
<b>100 MPH</b>	Up to 50'	8'	8	12	12	18	16	24
<b>110 MPH</b>	Up to 50'	8'	10	16	16	24	16	24
<b>120 MPH</b>	Up to 50'	8'	10	16	16	24	20	32

**Induction Welded – Induction Plate Density  
for Induction Welded Roofing Systems  
(Up to 30 YR Warranty)**

**Table III**

Peak Gust Wind Speed Warranty	Max. Building Height	Minimum Perimeter Width	Induction Weld Plate Density					
			Field		Perimeter		Corners	
			8 Ft. Boards	12 Ft. Boards	8 Ft. Boards	12 Ft. Boards	8 Ft. Boards	12 Ft. Boards
55 MPH	Up to 50'	16'	8	12	10	16	10	16
72 MPH	Up to 50'	16'	8	12	10	16	10	16
80 MPH	Up to 50'	16'	10	16	12	18	12	18
90 MPH	Up to 50'	16'	10	16	12	18	12	18
100 MPH	Up to 50'	16'	10	16	16	24	20	32
110 MPH	Up to 50'	16'	12	18	16	24	24	36
120 MPH	Up to 50'	16'	12	18	16	24	24	36

**B. Products/Heat Welding Equipment**

Products listed in "Part II" of the Carlisle Sure-Flex PVC Mechanically Fastened Roofing System Specification can be used as part of this alternate securement method in conjunction with the RhinoBond or Isoweld Welding Plates.

1. **RhinoBond or Isoweld PVC Welding Plate:** A 3" diameter, 0.028" thick, corrosion-resistant steel plate with hot melt coating on the top surface. The plate is used in conjunction with Carlisle's HP-X Fasteners to attach the roofing assembly and is activated using the RhinoBond or Isoweld Induction Welding Tool.
2. **RhinoBond or Isoweld Induction Welding Tool:** An induction heating tool is used to emit the magnetic field that activates the hot melt coating on the top surface of the RhinoBond or Isoweld Welding Plate to fuse with the roofing membrane. Refer to RhinoBond or Isoweld Owner's Manual for additional information.
3. **Magnet:** A stand-up device that allows the weld to cool as it holds the membrane to the heated plate. Refer to RhinoBond or Isoweld Owner's Manual for additional information.

### C. RhinoBond Induction Tool Calibration

Prior to proceeding with membrane attachment to the plate, the RhinoBond Induction Welding Tool must be calibrated with samples of the project specified insulation thickness and type and project specified membrane thickness. Refer to RhinoBond Owner's Manual for additional information.

1. Loose lay five RhinoBond Plates in a row about 12-24" apart on the specified membrane substrate.
2. Place membrane over the RhinoBond Plates.
3. Centering over the RhinoBond Plate under the membrane, place the Induction Welding Tool and use the device's default setting. Weld the membrane to the first plate, and when ready, completely remove Welding Tool. Immediately place the Magnet on the membrane over the plate and leave in place for 60 seconds.
4. Place Induction Welding Tool on the next plate as previously done and increasing induction energy one level by depressing the "up" button once. After welding, immediately place the Magnet.
5. Repeat above procedure for the remainder of the plates, increasing induction energy one level for each plate.
6. After allowing the membrane and plates to cool to ambient temperature, remove Cooling Clamp and use a pliers by apply force to peel RhinoBond Plate from underside of membrane to determine bonding strength. Desired result is welded ply of membrane stays fused to RhinoBond Plate.
7. Repeat trial process, if needed, adjusting energy level up or down until desired results are achieved.

**Note:** Recalibrate induction tool settings is necessary when ambient temperature changes more than +/- 15°F or power to device has been interrupted.

### D. Isoweld Induction Tool Calibration

Calibrate the Isoweld induction welding tool using the process outlined in the Owner's Manual.

### E. Installation

**Caution:** To avoid false welds and ensure adequate membrane attachment to the plates, induction tool calibration and test welds (along with the proper positioning of the induction welder over the plate and placement of the magnet) must be performed prior to the start of work each day. All test welds must be completed using the exact components of the assembly to be installed.

1. After placement of insulation on substrate, secure the insulation at a rate of six HP-X Fasteners and RhinoBond or Isoweld Plates per 4' x 8' board in the designated field and eight HP-X Fasteners and RhinoBond or Isoweld Plates around the perimeter. Refer to appropriate Carlisle detail for patterns and depth of perimeter area.

Note: Avoiding fastener overdrive to prevent plate from deforming.

2. Place Sure-Flex membrane over the appropriate RhinoBond or Isoweld Plates and allow membrane to relax.
3. Place RhinoBond Induction Tool over the RhinoBond PVC Welding Plate, under the roofing membrane OR Place the Isoweld Induction Tool over the Isoweld PVC Welding Plate, until the acoustic search mode signals the inductor is properly positioned.
4. Activate induction welding tool and leave in place until heating cycle is complete.
5. Immediately place Magnet on the membrane over the plate and leave in place for at least 60 seconds.
6. Resume process ensuring membrane is attached to all plates.

### F. Membrane Hot Air Welding Procedures & Additional Securement

1. Adjoin membrane sheets by overlapping and heat welding the seam following standard Hot Air Welding Procedures as outlined in the "Part III" of the PVC Mechanically Fastened Roofing System Specification.

2. Base wall securement and securement around roof penetrations as well as flashings of walls and penetrations must comply with Carlisle requirements for the PVC Mechanically Fastened Roofing System.


**G. Associated Installation Details**

RhinoBond Attachment Method – Number of Fasteners and Location .....	RB-1
Angle Change Securement Method with RhinoBond Plates .....	RB-2
Induction Welded Wall Attachment .....	RB-3
Isoweld Attachment Method – Number of Fasteners and Location .....	IW-1
Angle Change Securement Method with Isoweld Plates .....	IW-2
Induction Welded Wall Attachment .....	IW-3
Induction Welding Attachment Method – Fastening Patterns/Enhancements .....	FP-1
Induction Welding Attachment Method – Fastening Patterns/Enhancements .....	FP-2
Induction Welding Attachment Method – Fastening Patterns/Enhancements .....	FP-3
Induction Welding Attachment Method – Fastening Patterns/Enhancements .....	FP-4
Induction Welding Attachment Method – Fastening Patterns/Enhancements .....	FP-5


End of Section

NOTES:

1. RhinoBond METHOD OF MEMBRANE ATTACHMENT IS NOT FOR USE WITH NON-FACED EPS (EXPANDED POLYSTYRENE) OR XPS (EXTRUDED POLYSTYRENE) INSULATIONS.
2. PERIMETER ENHANCEMENTS REQUIRED FOR WIND SPEED COVERAGE GREATER THAN 72MPH. CONTACT CARLISLE FOR REQUIREMENTS.
3. ENHANCEMENTS SHOWN ARE FOR THE PURPOSE OF THE CARLISLE WARRANTY. FOR FM PROJECTS CONSULT FM GLOBAL FOR REQUIRED ENHANCEMENTS.

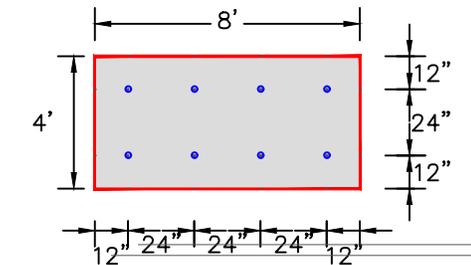

**(A) PERIMETER ZONE**  
8 FASTENERS PER 4'X8' BOARD

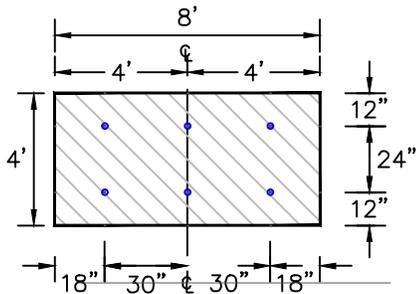


**(B) FIELD OF ROOF**  
6 FASTENERS PER 4'X8' BOARD



• • CARLISLE FASTENER & RhinoBond FASTENER PLATE

RAISED ROOF EDGE OR PARAPET WALL

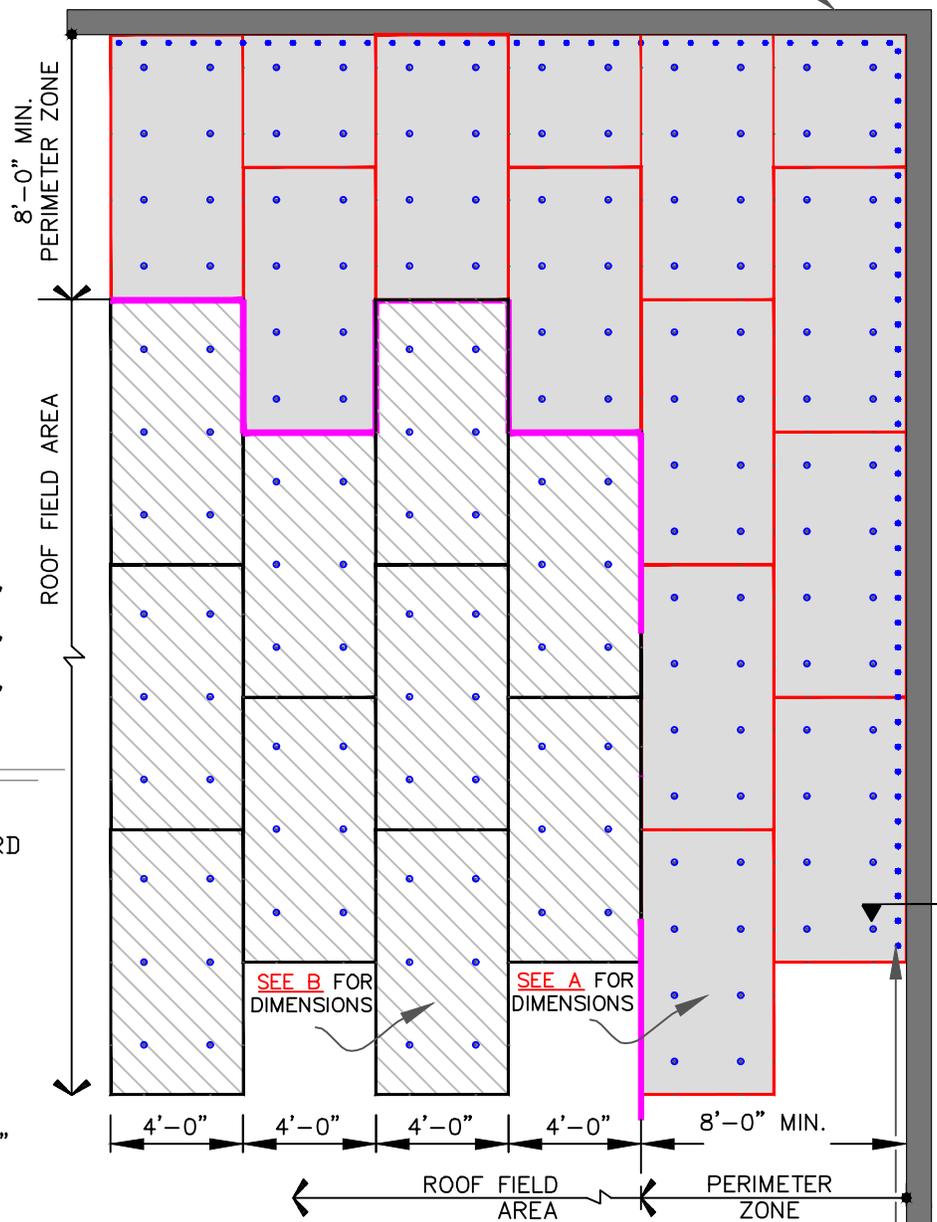

MEMBRANE FASTENED MINIMUM 12" O.C. AT ANGLE(S) CHANGES. FOR ADDITIONAL INFORMATION SEE DETAIL RB-2




DECK TYPE	DECK THICKNESS	FASTENER	THERMOPLASTIC COATED PLATE
STEEL	22 GAUGE(0.8mm)	CARLISLE HP-X FASTENER	3-1/8" (8cm) DIAMETER
PLYWOOD	15/32" (12mm)		

NOTE: AT IN-FILL MINOR PIECES, USE MIN. 2 FASTENERS.

INCHES TO CENTIMETERS							
inch	2"	3.5"	4"	12"	18"	24"	30"
cm	5	9	10	30	46	61	76

FEET TO CENTIMETERS			
FEET	1'	4'	8'
cm	30	120	250


→ THERMOPLASTIC MEMBRANE → APPROVED SUBSTRATE → SEE NOTE(S)	RhinoBond ATTACHMENT METHOD – NUMBER OF FASTENERS AND LOCATIONS For additional information, refer to Specifications		DETAIL NO. <b>RB-1</b>
			RhinoBond

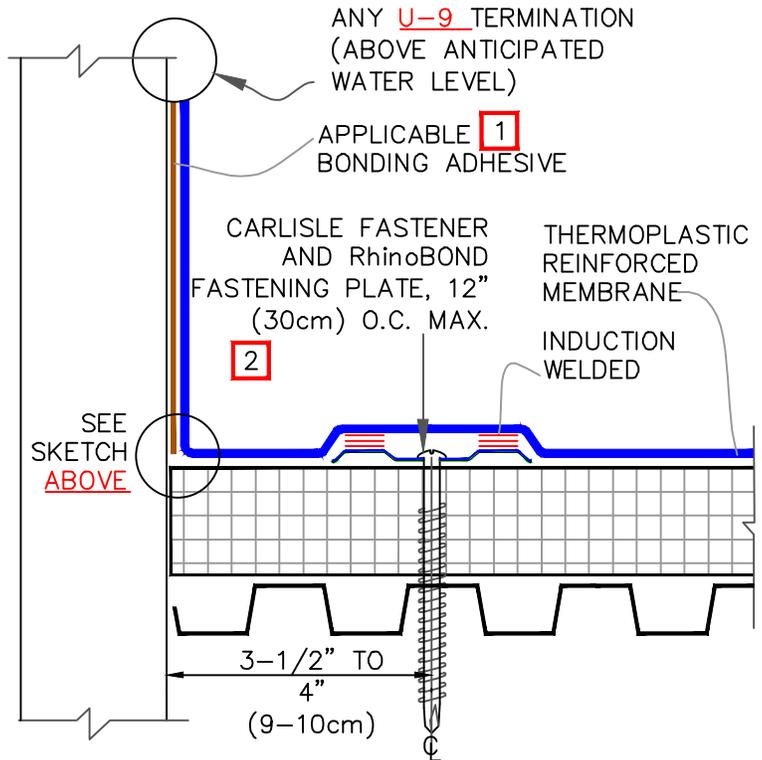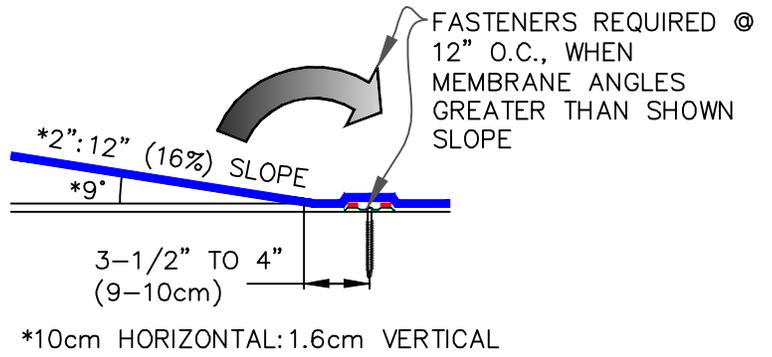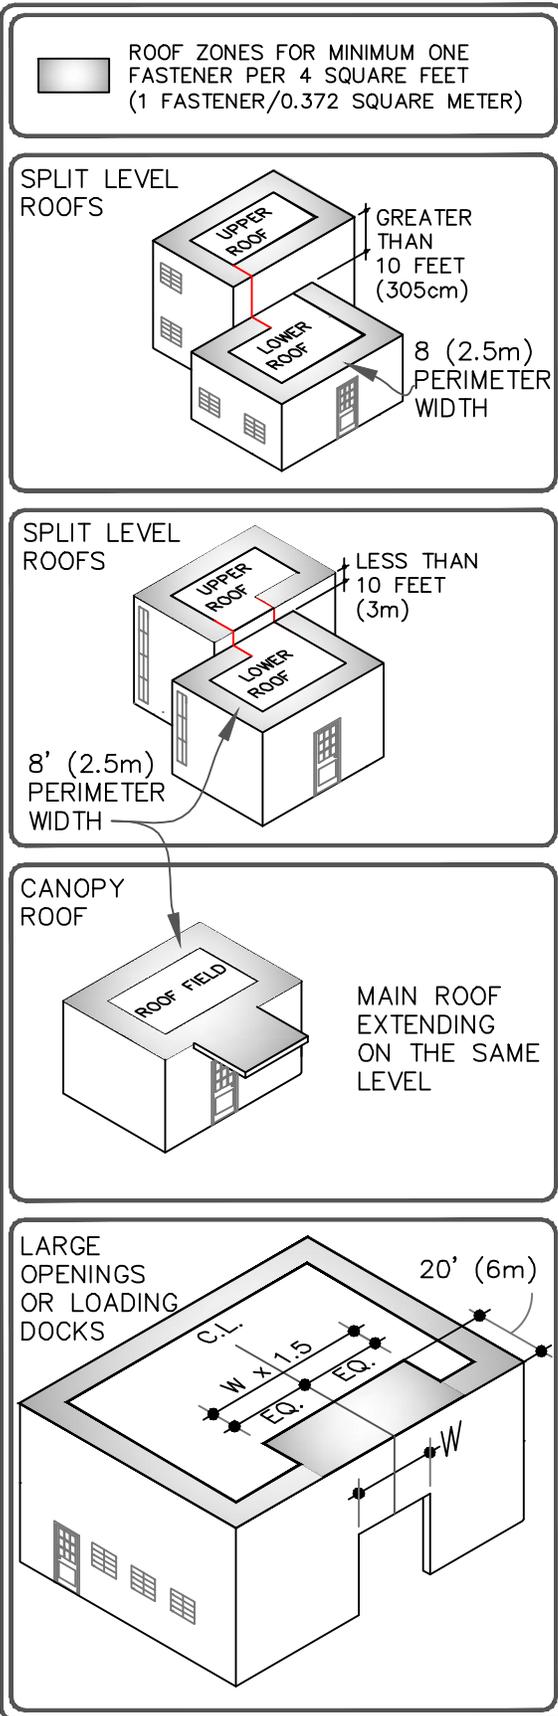

ANGLE CHANGE SECUREMENT

NOTES:

1. SURE-WELD MEMBRANE REQUIRES SURE-WELD BONDING ADHESIVE AND SURE-FLEX MEMBRANE REQUIRES SURE-FLEX BONDING ADHESIVE.
2. HP-X FASTENERS AND RhinoBOND PLATES ARE REQUIRED OVER STEEL AND WOOD DECKS. FOR WARRANTY WIND SPEEDS GREATER THAN 72 MPH PLEASE CONTACT CARLISLE FOR REQUIRED FASTENING ENHANCEMENTS.

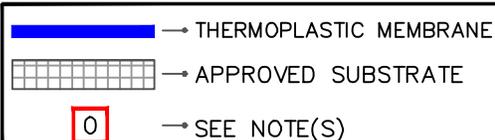

ANGLE CHANGE SECUREMENT METHOD WITH RhinoBond PLATES


For additional information, refer to Specifications



DETAIL NO.

RB-2

RhinoBond

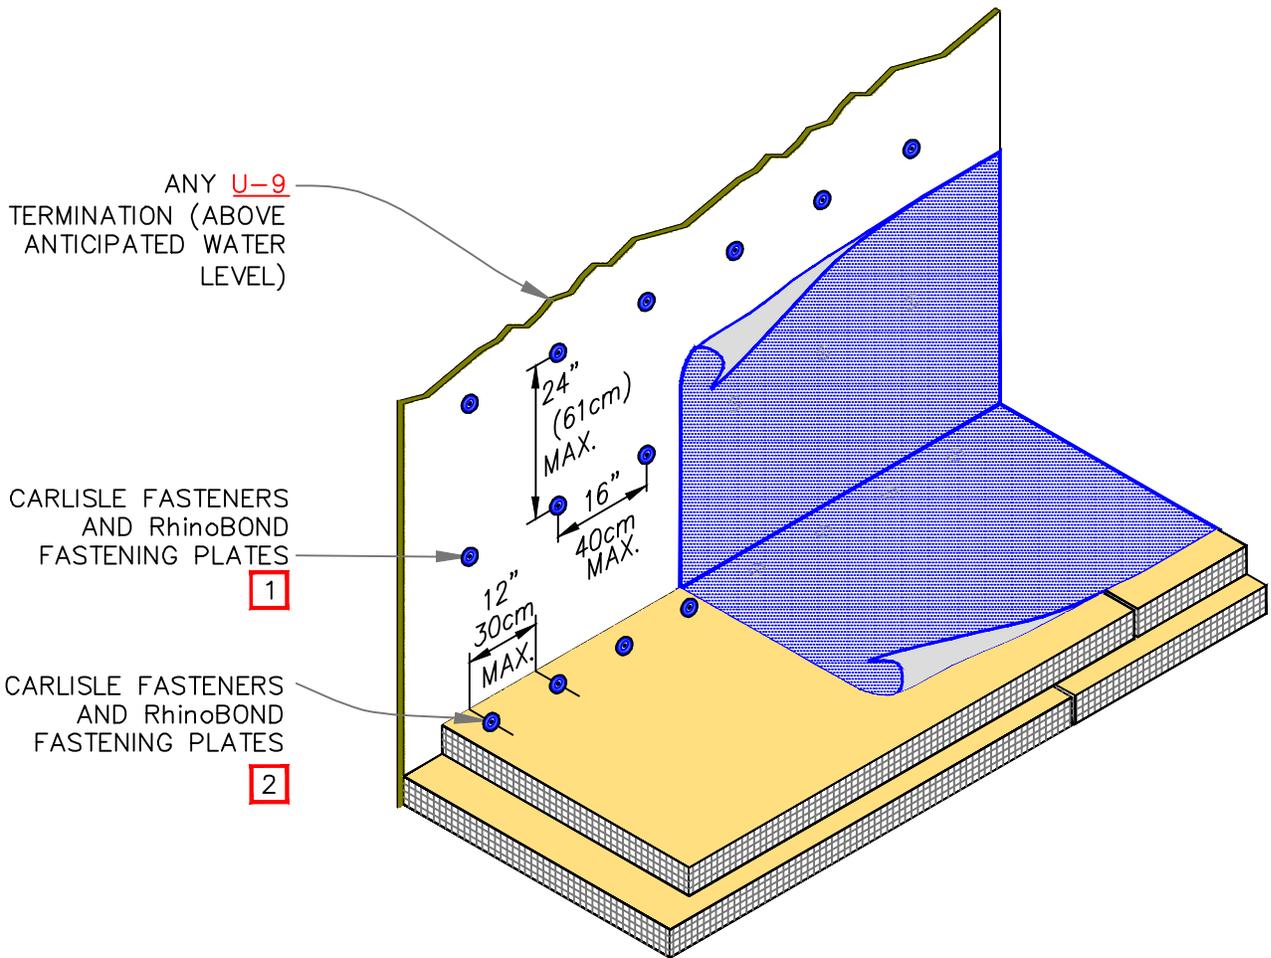


ANY U-9  
TERMINATION (ABOVE  
ANTICIPATED WATER  
LEVEL)

CARLISLE FASTENERS  
AND RhinoBOND  
FASTENING PLATES  
**1**

CARLISLE FASTENERS  
AND RhinoBOND  
FASTENING PLATES  
**2**


NOTES:

1. FASTENERS MUST PENETRATE INTO WOOD OR METAL STUDS, WHERE WALL IS BUILT WITH STUDS.
2. HP-X FASTENERS AND RhinoBOND PLATES ARE REQUIRED OVER STEEL AND WOOD DECKS.


 → THERMOPLASTIC MEMBRANE	RhinoBond WALL ATTACHMENT		DETAIL NO.
 → APPROVED SUBSTRATE			RB-3
 → SEE NOTE(S)	For additional information, refer to Specifications	RhinoBond	

NOTES:


1. Isoweld METHOD OF MEMBRANE ATTACHMENT IS NOT FOR USE WITH NON-FACED EPS (EXPANDED POLYSTYRENE) OR XPS (EXTRUDED POLYSTYRENE) INSULATIONS.
2. PERIMETER ENHANCEMENTS REQUIRED FOR WIND SPEED COVERAGE GREATER THAN 72MPH. CONTACT CARLISLE FOR REQUIREMENTS.
3. ENHANCEMENTS SHOWN ARE FOR THE PURPOSE OF THE CARLISLE WARRANTY. FOR FM PROJECTS CONSULT FM GLOBAL FOR REQUIRED ENHANCEMENTS.

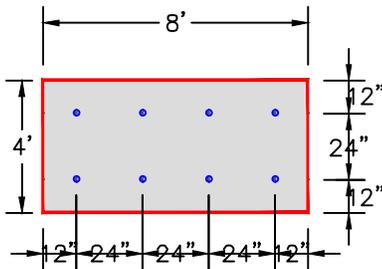

**(A) PERIMETER ZONE**  
8 FASTENERS PER 4'X8' BOARD

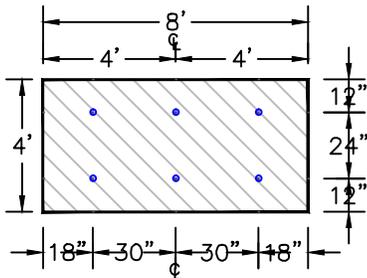

**(B) FIELD OF ROOF**  
6 FASTENERS PER 4'X8' BOARD

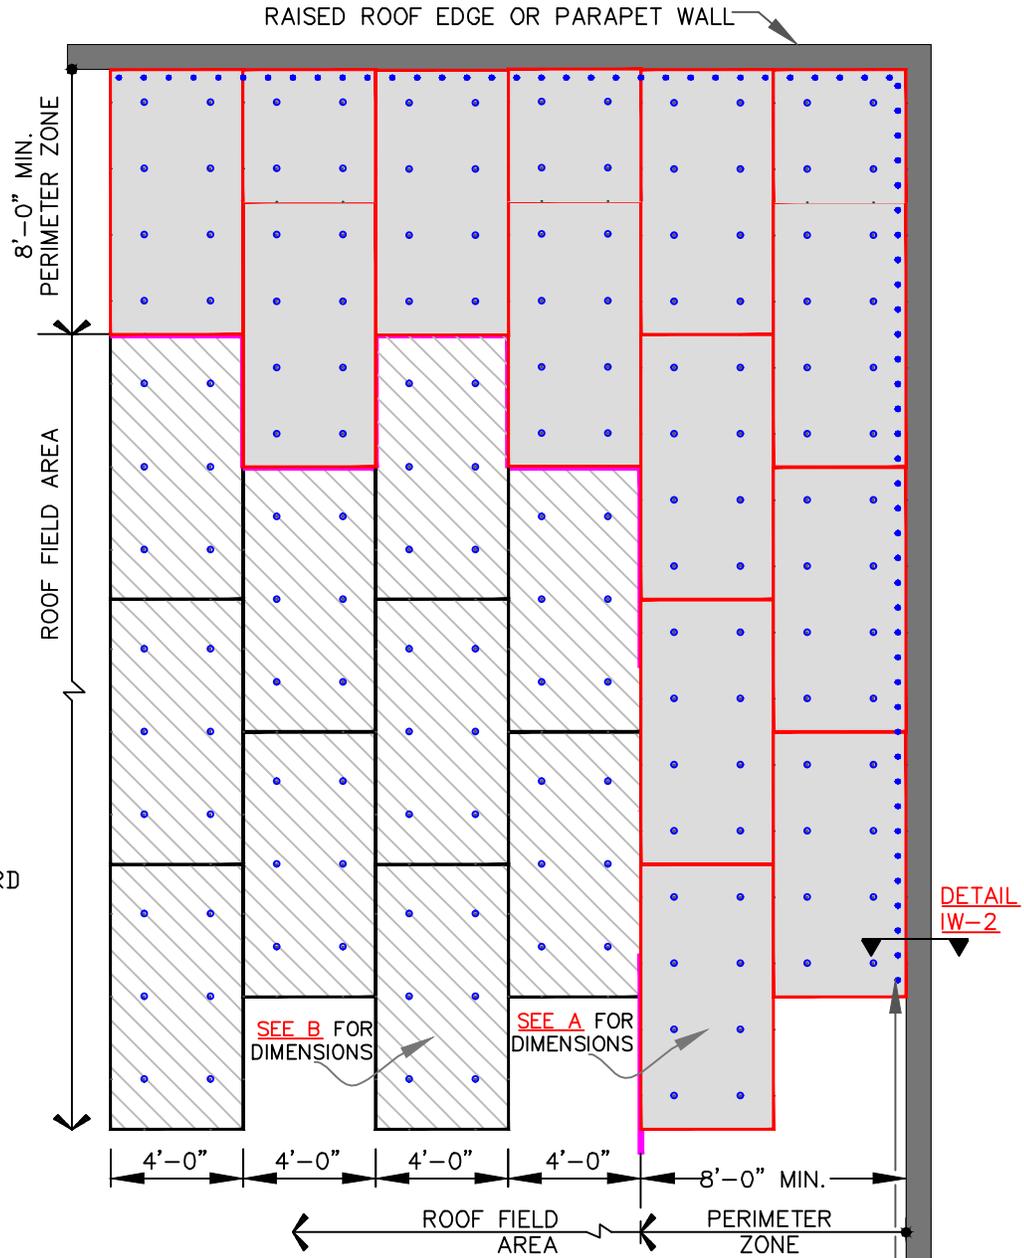

MEMBRANE FASTENED MINIMUM 12" O.C. AT ANGLE(S) CHANGES. FOR ADDITIONAL INFORMATION SEE DETAIL IW-2



DECK TYPE	DECK THICKNESS	FASTENER	THERMOPLASTIC COATED PLATE
STEEL	22 GAUGE(0.8mm)	CARLISLE HP-X FASTENER	3-1/8" (8cm) DIAMETER
PLYWOOD	15/32" (12mm)		

NOTE: AT IN-FILL MINOR PIECES, USE MIN. 2 FASTENERS.


INCHES TO CENTIMETERS							
inch	2"	3.5"	4"	12"	18"	24"	30"
cm	5	9	10	30	46	61	76

FEET TO CENTIMETERS			
FEET	1'	4'	8'
cm	30	120	250

→ THERMOPLASTIC MEMBRANE → APPROVED SUBSTRATE → SEE NOTE(S)	ISOWELD ATTACHMENT METHOD – NUMBER OF FASTENERS AND LOCATIONS For additional information, refer to Specifications		DETAIL NO. IW-1
			Isoweld Attachment

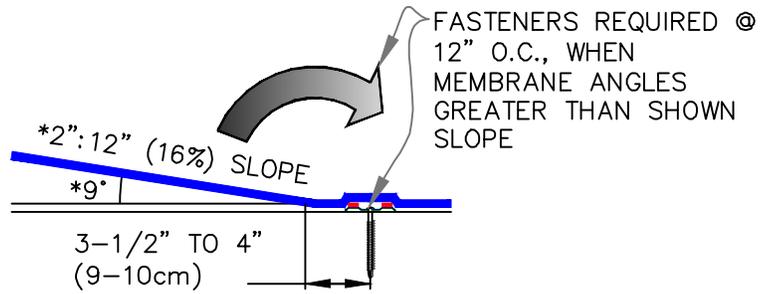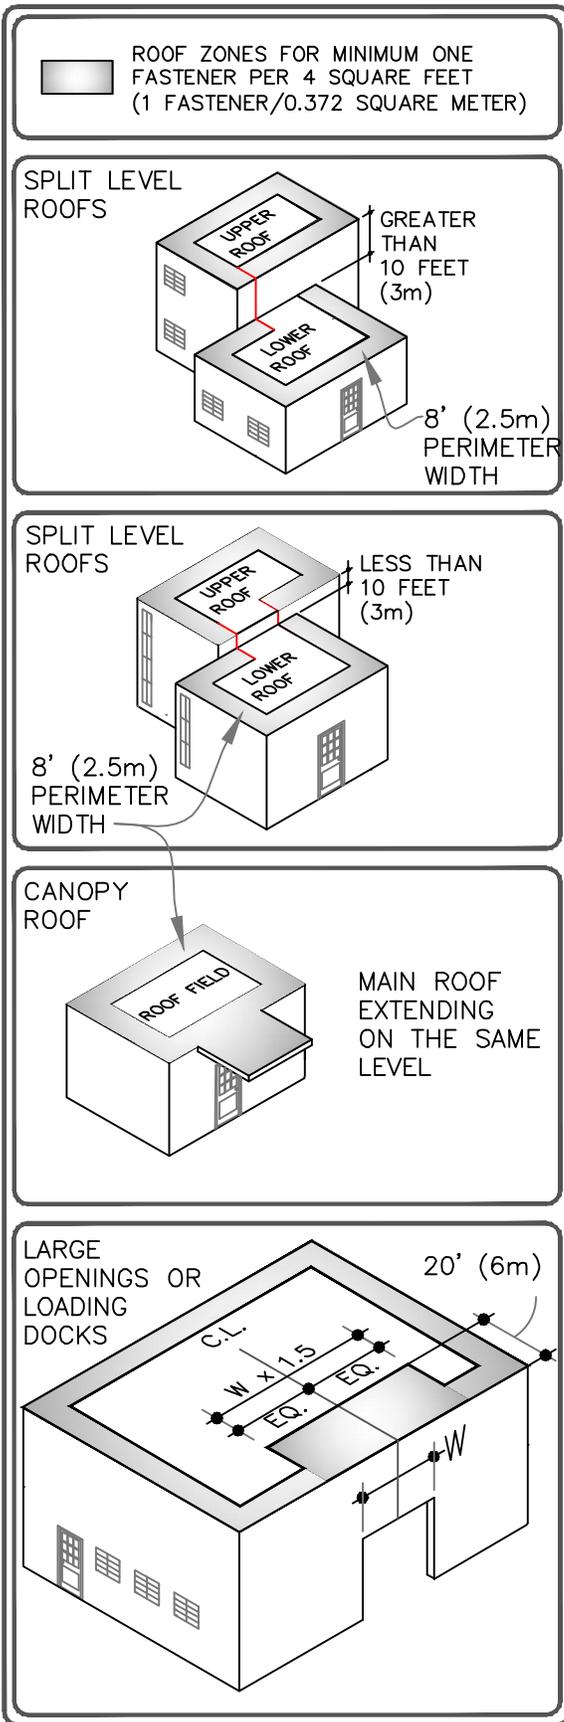


\*10cm HORIZONTAL:1.6cm VERTICAL

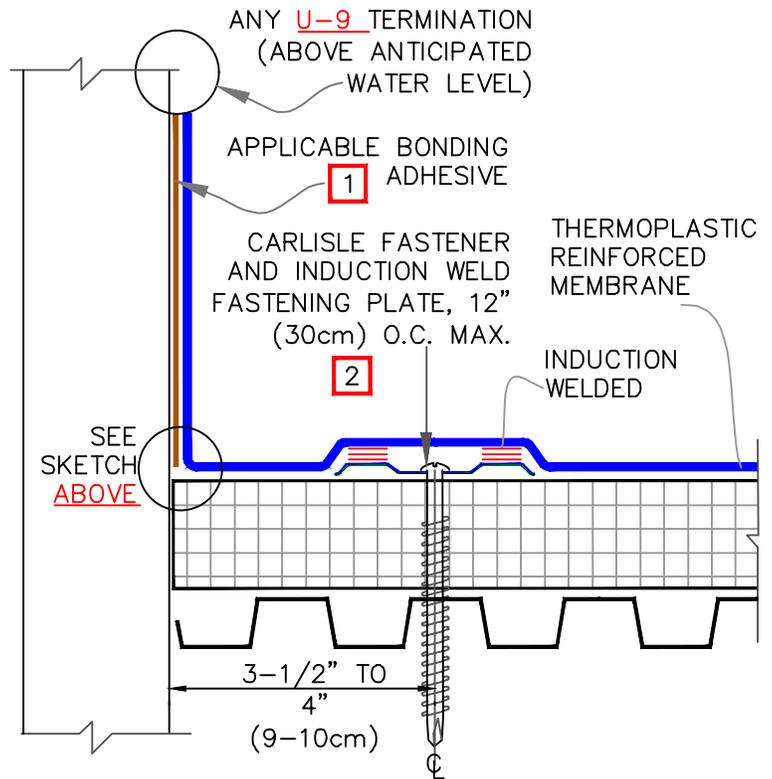

ANGLE CHANGE SECUREMENT


NOTES:

1. SURE-WELD MEMBRANE REQUIRES SURE-WELD BONDING ADHESIVE AND SURE-FLEX MEMBRANE REQUIRES SURE-FLEX BONDING ADHESIVE.
2. HP-X FASTENERS AND INDUCTION WELD PLATES ARE REQUIRED OVER STEEL AND WOOD DECKS. FOR WARRANTY WIND SPEEDS GREATER THAN 72 MPH PLEASE CONTACT CARLISLE FOR REQUIRED FASTENING ENHANCEMENTS.

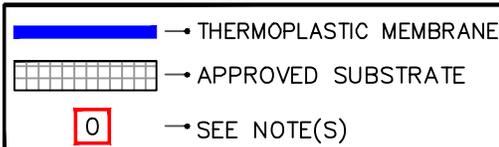

ANGLE CHANGE SECUREMENT METHOD WITH ISOWELD PLATES


For additional information, refer to Specifications



DETAIL NO.


IW-2


Isoweld Attachment

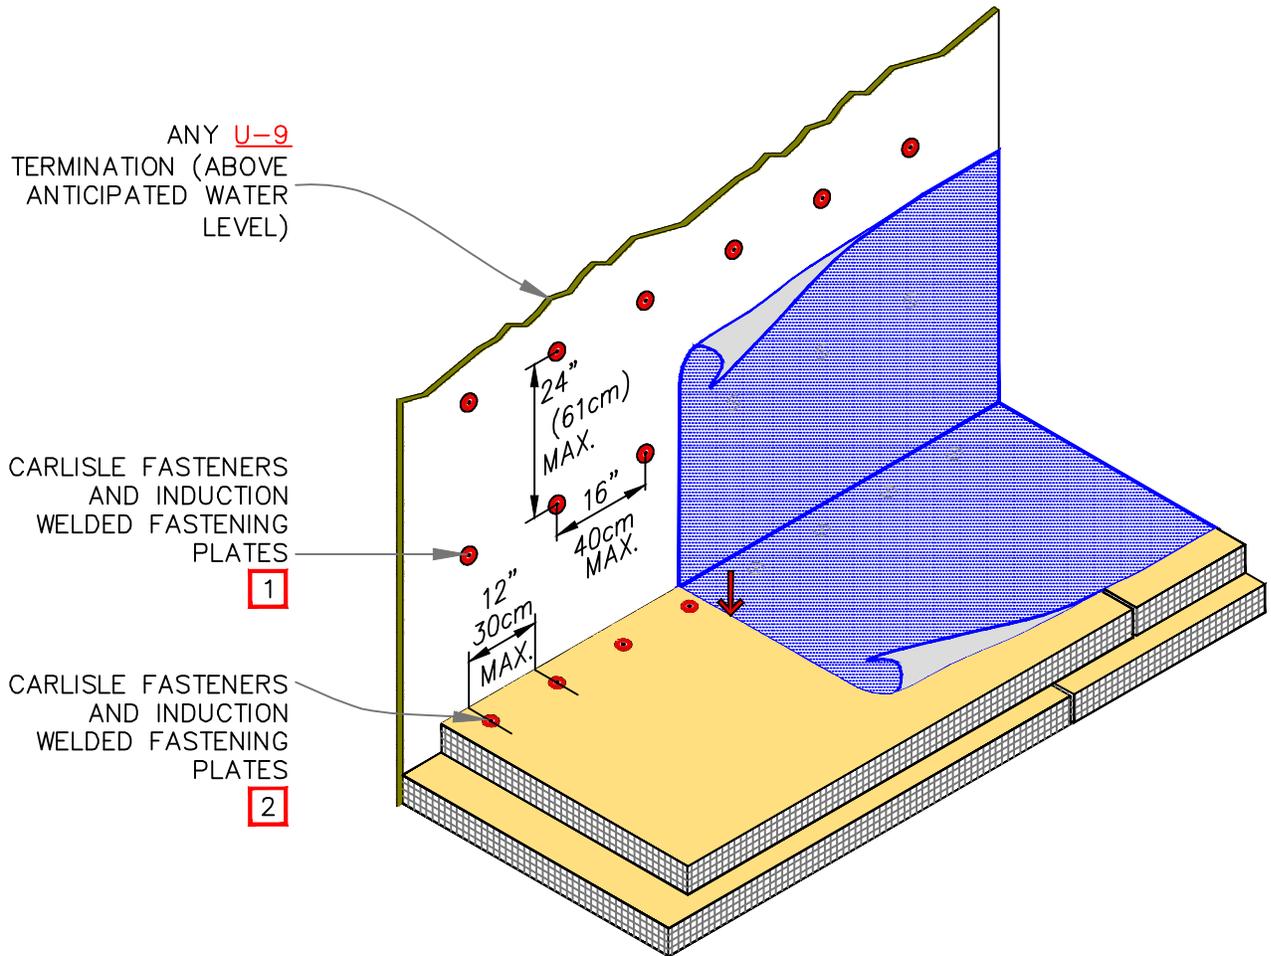


NOTES:

1. FASTENERS MUST PENETRATE INTO WOOD OR METAL STUDS, WHERE WALL IS BUILT WITH STUDS.
2. HP-X FASTENERS ARE REQUIRED OVER STEEL AND WOOD DECKS.


 → THERMOPLASTIC MEMBRANE	ISOWELD WALL ATTACHMENT	 → APPROVED SUBSTRATE	DETAIL NO.
[0] → SEE NOTE(S)			IW-3
For additional information, refer to Specifications		Isoweld Attachment	

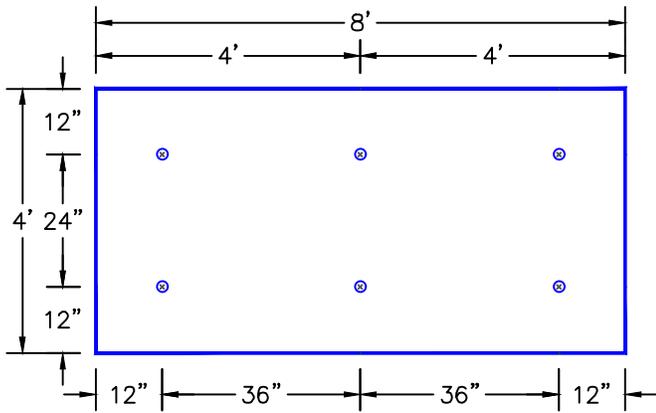


6 FASTENERS PER 4'X8' BOARD

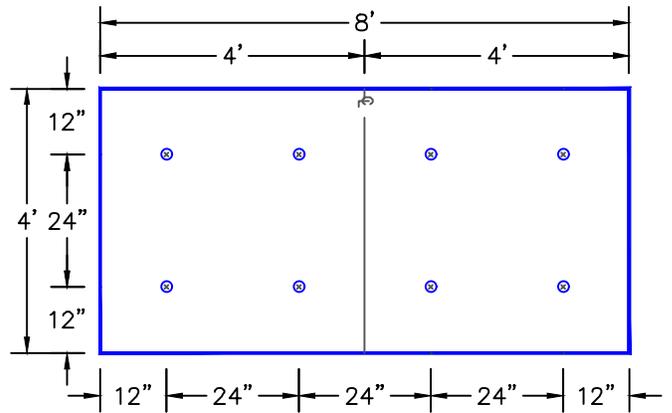


8 FASTENERS PER 4'X8' BOARD

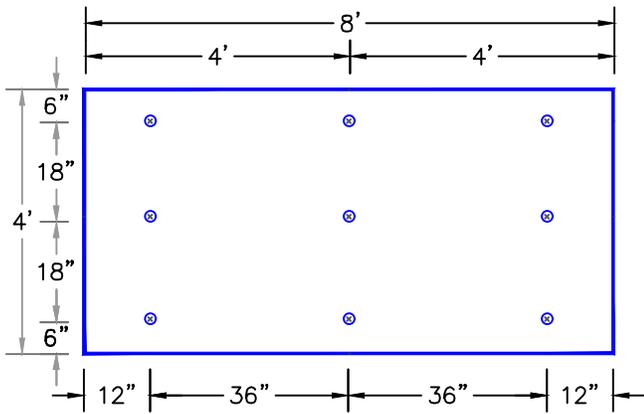


9 FASTENERS PER 4'X8' BOARD

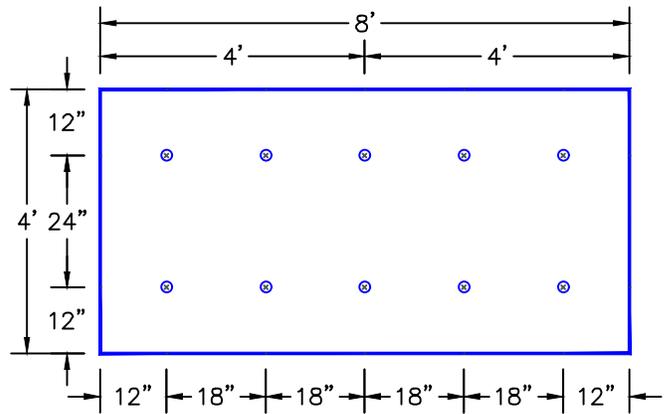

10 FASTENERS PER 4'X8' BOARD

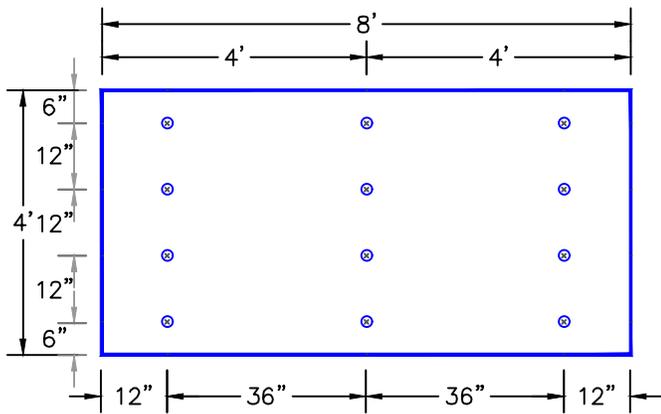


12 FASTENERS PER 4'X8' BOARD

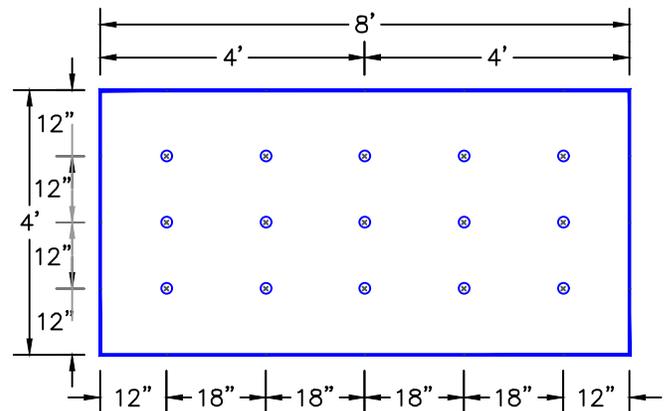


15 FASTENERS PER 4'X8' BOARD

NOTE: FOR FM INSURED PROJECTS, CONSULT FM GLOBAL PRIOR TO INSTALLATION.


 → THERMOPLASTIC MEMBRANE	INDUCTION WELDING ATTACHMENT METHOD – FASTENING PATTERNS/ENHANCEMENTS	DETAIL NO.
 → APPROVED SUBSTRATE		FP-1
 → SEE NOTE(S)	For additional information, refer to Specifications	Induction Welding

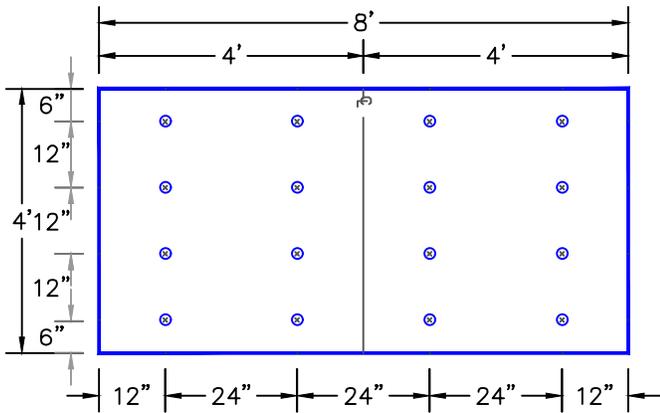


16 FASTENERS PER 4'X8' BOARD

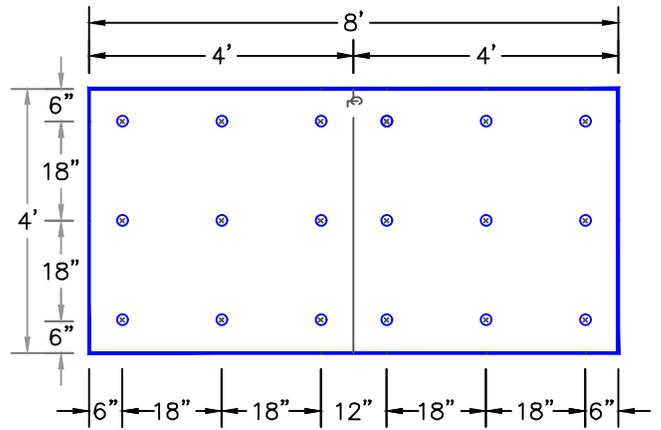


18 FASTENERS PER 4'X8' BOARD

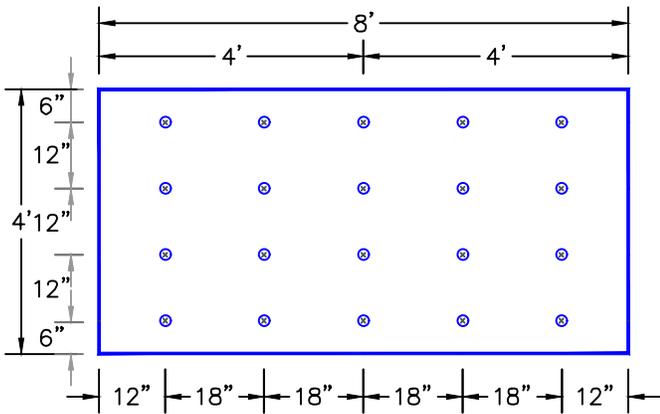


20 FASTENERS PER 4'X8' BOARD

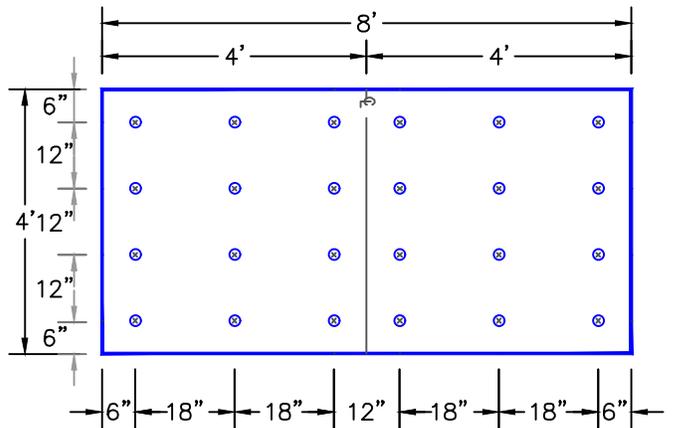


24 FASTENERS PER 4'X8' BOARD


 → THERMOPLASTIC MEMBRANE	INDUCTION WELDING ATTACHMENT METHOD – FASTENING PATTERNS/ENHANCEMENTS	DETAIL NO.
 → APPROVED SUBSTRATE		FP-2
 → SEE NOTE(S)	For additional information, refer to Specifications	Induction Welding

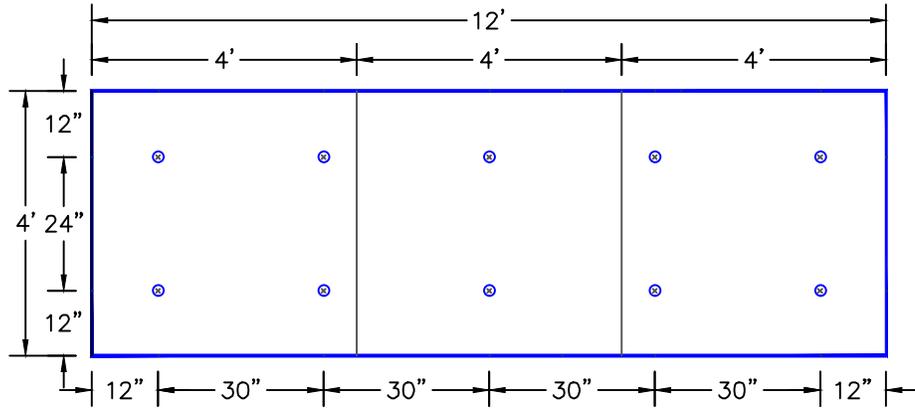

10 Fasteners per 4' x 12'

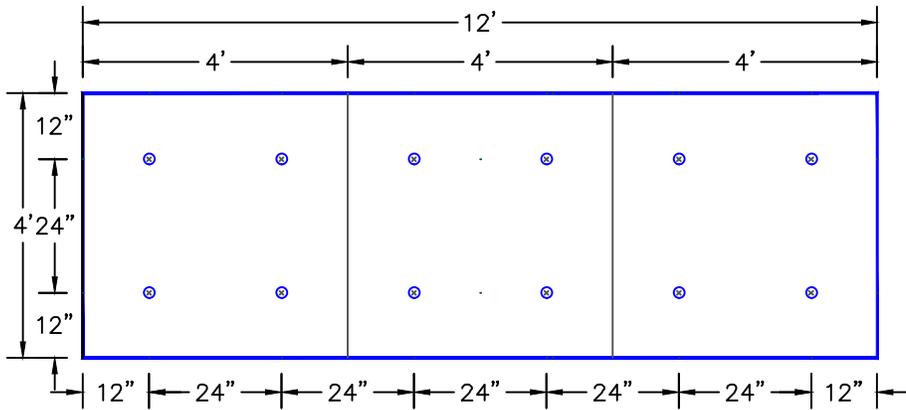


12 Fasteners per 4' x 12'

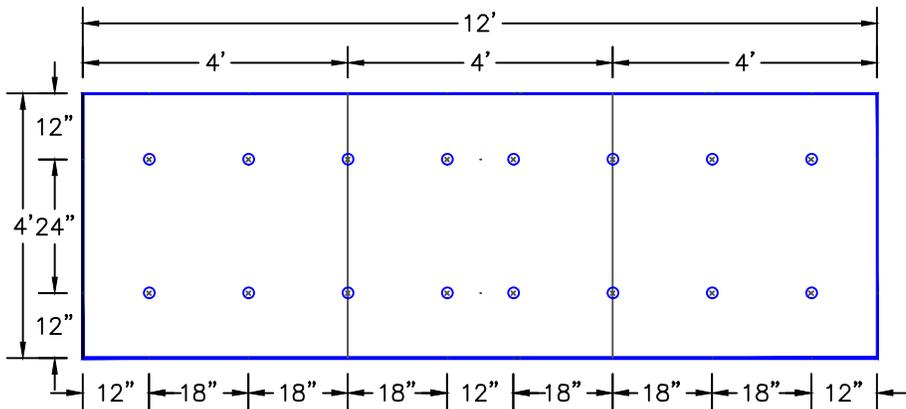


16 Fasteners per 4' x 12'


→ THERMOPLASTIC MEMBRANE	INDUCTION WELDING ATTACHMENT METHOD – FASTENING PATTERNS/ENHANCEMENTS	DETAIL NO.
→ APPROVED SUBSTRATE		FP-3
→ SEE NOTE(S)	For additional information, refer to Specifications	Induction Welding

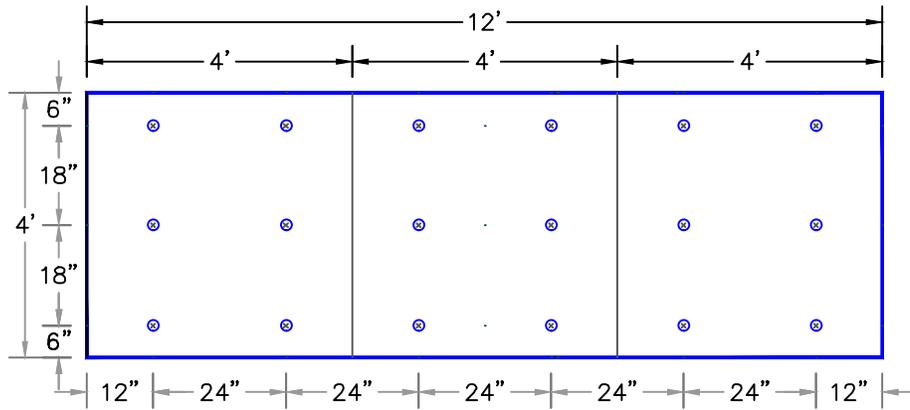

18 Fasteners per 4' x 12'

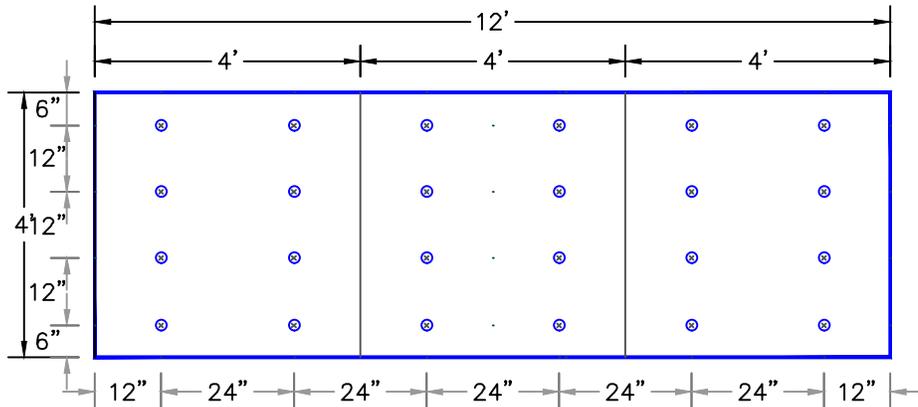


24 Fasteners per 4' x 12'

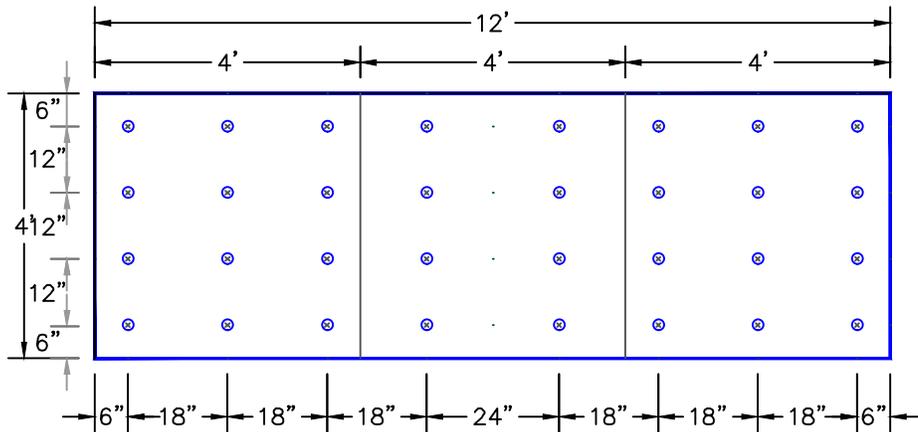

32 Fasteners per 4' x 12'

→ THERMOPLASTIC MEMBRANE	INDUCTION WELDING ATTACHMENT METHOD – FASTENING PATTERNS/ENHANCEMENTS	DETAIL NO.
→ APPROVED SUBSTRATE		FP-4
→ SEE NOTE(S)	For additional information, refer to Specifications	Induction Welding

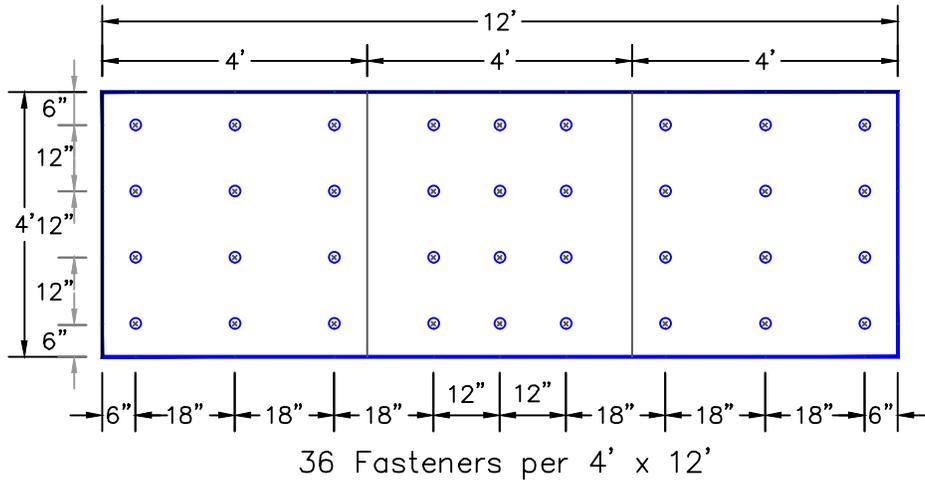

<p> → THERMOPLASTIC MEMBRANE</p> <p> → APPROVED SUBSTRATE</p> <p><span style="border: 1px solid red; padding: 2px;">0</span> → SEE NOTE(S)</p>	<p>INDUCTION WELDING ATTACHMENT METHOD – FASTENING PATTERNS/ENHANCEMENTS</p> <p>For additional information, refer to Specifications</p>	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="text-align: center;">DETAIL NO.</td> </tr> <tr> <td style="text-align: center; font-size: 1.5em;">FP-5</td> </tr> <tr> <td style="text-align: center; color: red;">Induction Welding</td> </tr> </table>	DETAIL NO.	FP-5	Induction Welding
DETAIL NO.					
FP-5					
Induction Welding					

# Sure-Flex™ Mechanically Fastened and Adhered Roofing Systems

## Installation Details

### TABLE OF CONTENTS

January 2026

<b>Mechanically Fastened</b>	<b>Detail</b>
Membrane Securement.....	MF-2
Mechanically Fastened Membrane Splice (1 of 2) .....	MF-2A
Fastener and Plate Placement (2 of 2).....	MF-2A
Ridge Membrane Attachment.....	MF-22
<b>Metal Edges and Gravel Stops</b>	
SecurWeld Coated Drip Edge Fascia.....	U-1B
Metal Bar Edge Termination.....	U-1C
Carlisle SecurEdge Snap-on Canted Fascia .....	U-1D
Carlisle SecurEdge EX Snap-on Fascia & SecurEdge Snap-on Fascia.....	U-1F
Pressure-Sensitive PVC/KEE HP Cover Strip.....	U-1G
<b>Membrane Splices</b>	
PVC/KEE HP Membrane Splice.....	U-2A
<b>Expansion Joints</b>	
Deck-to-Deck Expansion Joint .....	U-3A
Deck-to-Deck Curbed Expansion Joint.....	U-3A.1
Deck-to-Wall Expansion Joint .....	U-3B
<b>Curb Flashing</b>	
Curb Flashing with PVC Membrane .....	U-5A
Curb Flashing with PVC Coated Metal.....	U-5B
Curb Flashing with PVC Curb Wrap Corners .....	U-5C
Self-Flashing Curb with PVC Curb Wrap Corners.....	U-5D
<b>Drains</b>	
Roof Drain: Sump Slope Up to 3 inches to One Horizontal Foot.....	U-6A
Roof Drain: Sump Slope Greater than 3 inches to One Horizontal Foot (Option 1) .....	U-6B
Roof Drain: Sump Slope Greater than 3 inches to One Horizontal Foot (Option 2) Page 1 of 2 .....	U-6C
Roof Drain: Sump Slope Greater than 3 inches to One Horizontal Foot (Option 2) Page 2 of 2 .....	U-6C
Add-On Drain .....	U-6D
<b>Pipe Flashing</b>	
Pre-molded Flashing .....	U-8A
Field Fabricated Pipe Flashing .....	U-8B
CFA Certified Pre-Fabricated Square Tube Wrap.....	U-8C
Field Fabricated Square Tube Flashing .....	U-8D
CFA Certified Pre-Fabricated Split Pipe Seal.....	U-8E
CFA Certified Hot Pipe Flashing .....	U-8F
Flexible Penetration Detail .....	U-8G
<b>Terminations</b>	
Membrane Terminations, Page 1 of 3 .....	U-9

Membrane Terminations, Page 2 of 3 .....	U-9
Membrane Terminations, Page 3 of 3 .....	U-9

**Parapet Flashing**

Parapet Flashing Fastened Into Deck .....	U-12A
Coated Metal Wall Flashing .....	U-12C
Parapet Flashing / No Adhesion – Any Height Option .....	U-12F

**Tie-Ins**

PVC Tie-In To Existing Single-Ply Roof with Curb .....	U-13C
PVC Tie-In to Shingled Roof .....	U-13F
PVC/KEE HP Tie-In to Existing Single-Ply Roof Membranes on Concrete Deck .....	U-13G
PVC/KEE HP Tie-In to Existing Single-Ply Roof Membranes on Metal Deck .....	U-13H

**Inside / Outside Corners**

Pre-Molded Inside Corner Flashing .....	U-15A
Field Fabricated Inside Corner Flashing .....	U-15B
Inside Corner with Coated Metal Flashing .....	U-15C
Pre-Molded Outside Corner Flashing .....	U-15D
Field Fabricated Outside Corner Flashing .....	U-15E
Outside Corner with Coated Metal Wall Flashing .....	U-15F
PVC or TPO: Universal Corners .....	U-15G

**Sealant Pocket**

Molded Sealant Pocket .....	U-16A
Field Fabricated PVC Coated Metal Pocket .....	U-16B

**Through-Wall Scupper**

Prefabricated Scupper with PVC Coated Metal .....	U-18A
Scupper with Uncoated Metal - Pressure-Sensitive Cover Strip (Page 1 of 2) .....	U-18B
Scupper with Uncoated Metal - Pressure-Sensitive Cover Strip (Page 2 of 2) .....	U-18B
Scupper with Uncoated Metal - PVC Flashing .....	U-18B.1

**Lightning Rods**

Lightning Rod at Parapet (Vertical Attachment) .....	U-20A
Lightning Rod at Deck Level .....	U-20B

**Sleeper**

Sleeper .....	U-24
---------------	------


**Accessories**

Contour Rib – Typical Cross-Section .....	U-25A
Contour Rib – Various Applications .....	U-25B
Contour Rib – Example of Dome with Ribs Aligned Over Membrane Seams .....	U-25C

GUIDELINES FOR ROOF PERIMETER ZONES FOR MECHANICALLY ATTACHED ROOF SYSTEM


 PERIMETER ZONES

SAME LEVEL ROOF

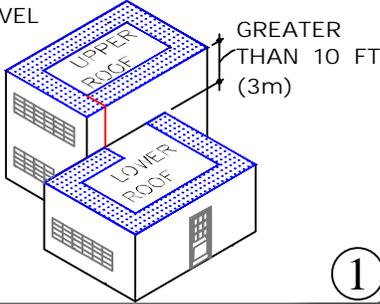


1

SPLIT LEVEL ROOFS

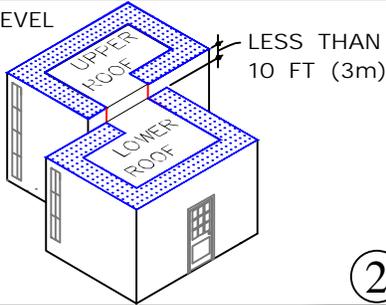

2


CANOPY ROOF



INSTALL PERIMETER SHEETS OVER THE ENTIRE OVERHANG (PROJECTION ROOF) AREA, EXTENDING ONTO THE MAIN ROOF DECK WHEN AT THE SAME LEVEL AS SHOWN.


3

LARGE OPENINGS OR LOADING DOCKS

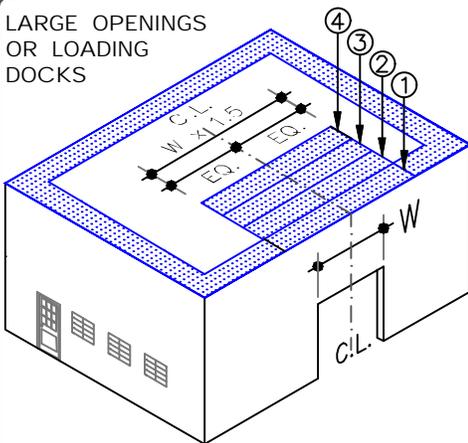

4 PERIMETER SHEETS CENTERED OVER LARGE OPENINGS

4

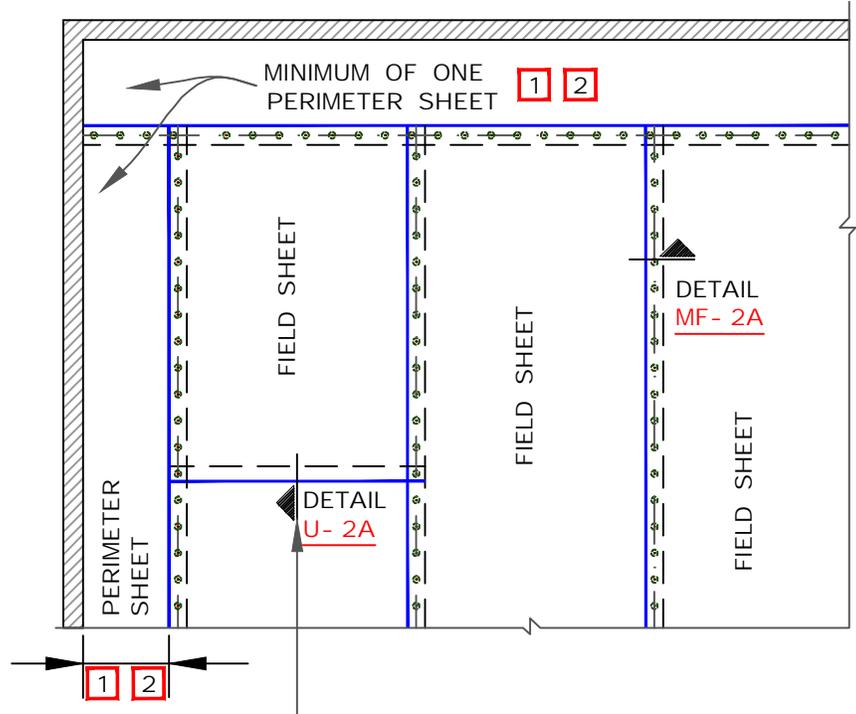

END LAPS DO NOT REQUIRE MECHANICAL FASTENING AND SHALL BE OVERLAPPED 2" (5cm) MINIMUM. PER [DETAIL U-2A](#)

NOTES:

1. PERIMETER SHEETS:

- 1.1. WHEN USING 10' (3m) WIDE FIELD SHEETS, 5' (1.5m) WIDE PERIMETER SHEETS ARE UTILIZED.
- 1.2. WHEN USING 81" (2.1m) WIDE FIELD SHEETS, 40.5" (1m) WIDE PERIMETER SHEETS ARE UTILIZED.

2. REFER TO CARLISLE SPECIFICATIONS FOR REQUIRED NUMBER OF PERIMETER SHEETS, SHEET WIDTH AND MEMBRANE FASTENING SPACING.



MEMBRANE SECUREMENT


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

MF-2

MF (Mechanically Fastened)

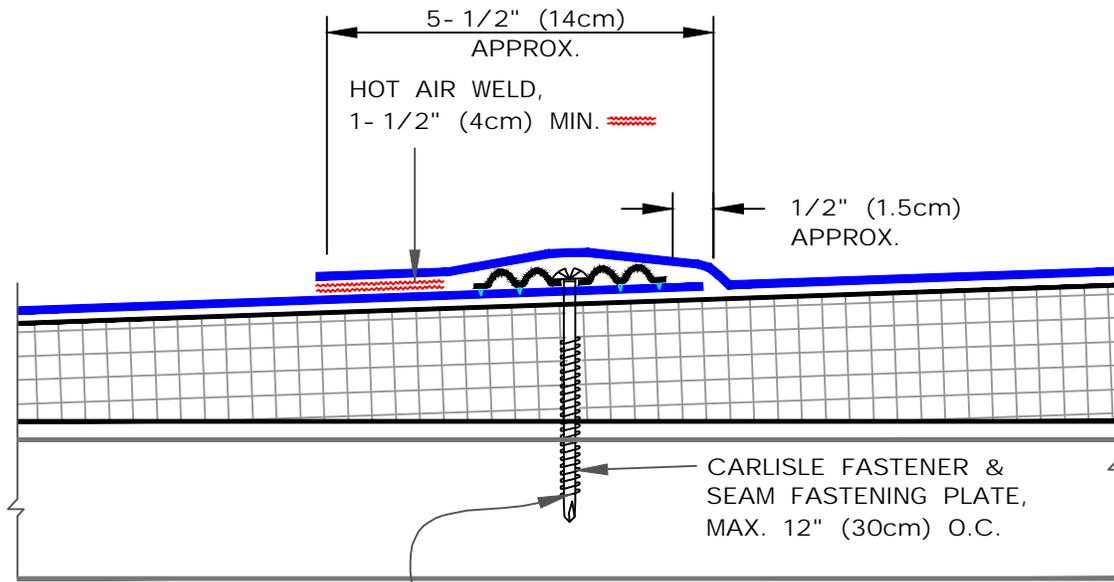


NOTE:

1. POSITION SEAM FASTENING PLATES BEYOND NON- REINFORCED ENCAPSULATED EDGE.

**FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY**

DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP- X	PIRANHA
	B	HP- XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD- 10	PIRANHA
	B	HD 14- 10	PIRANHA

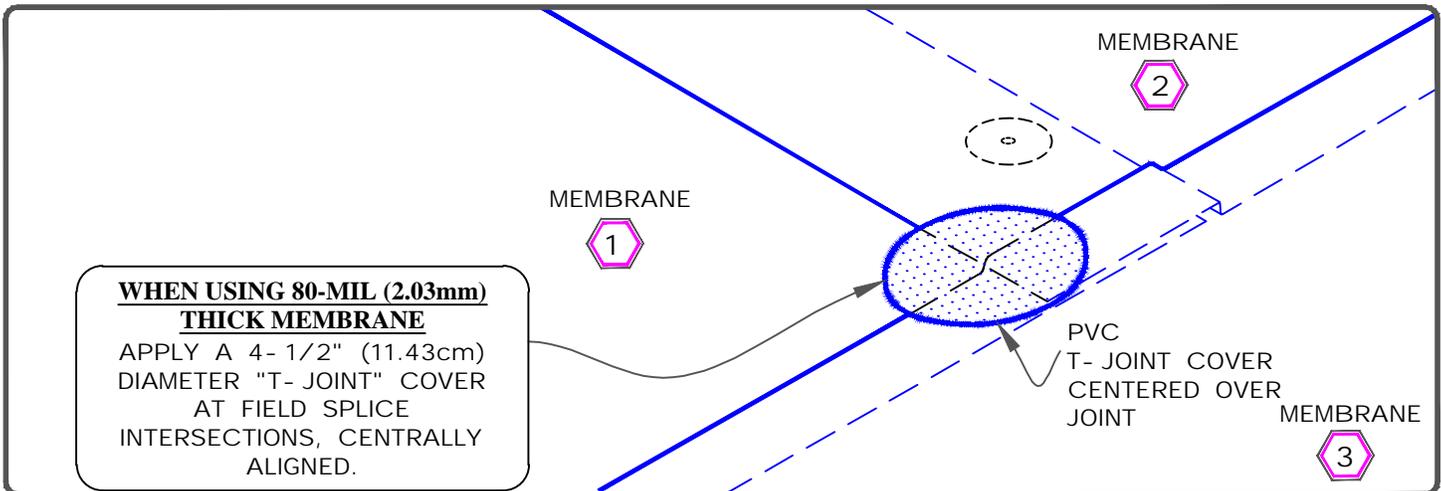

MECHANICALLY FASTENED SEAM  
PAGE 1 OF 2


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

MF - 2A


MF (Mechanically Fastened)

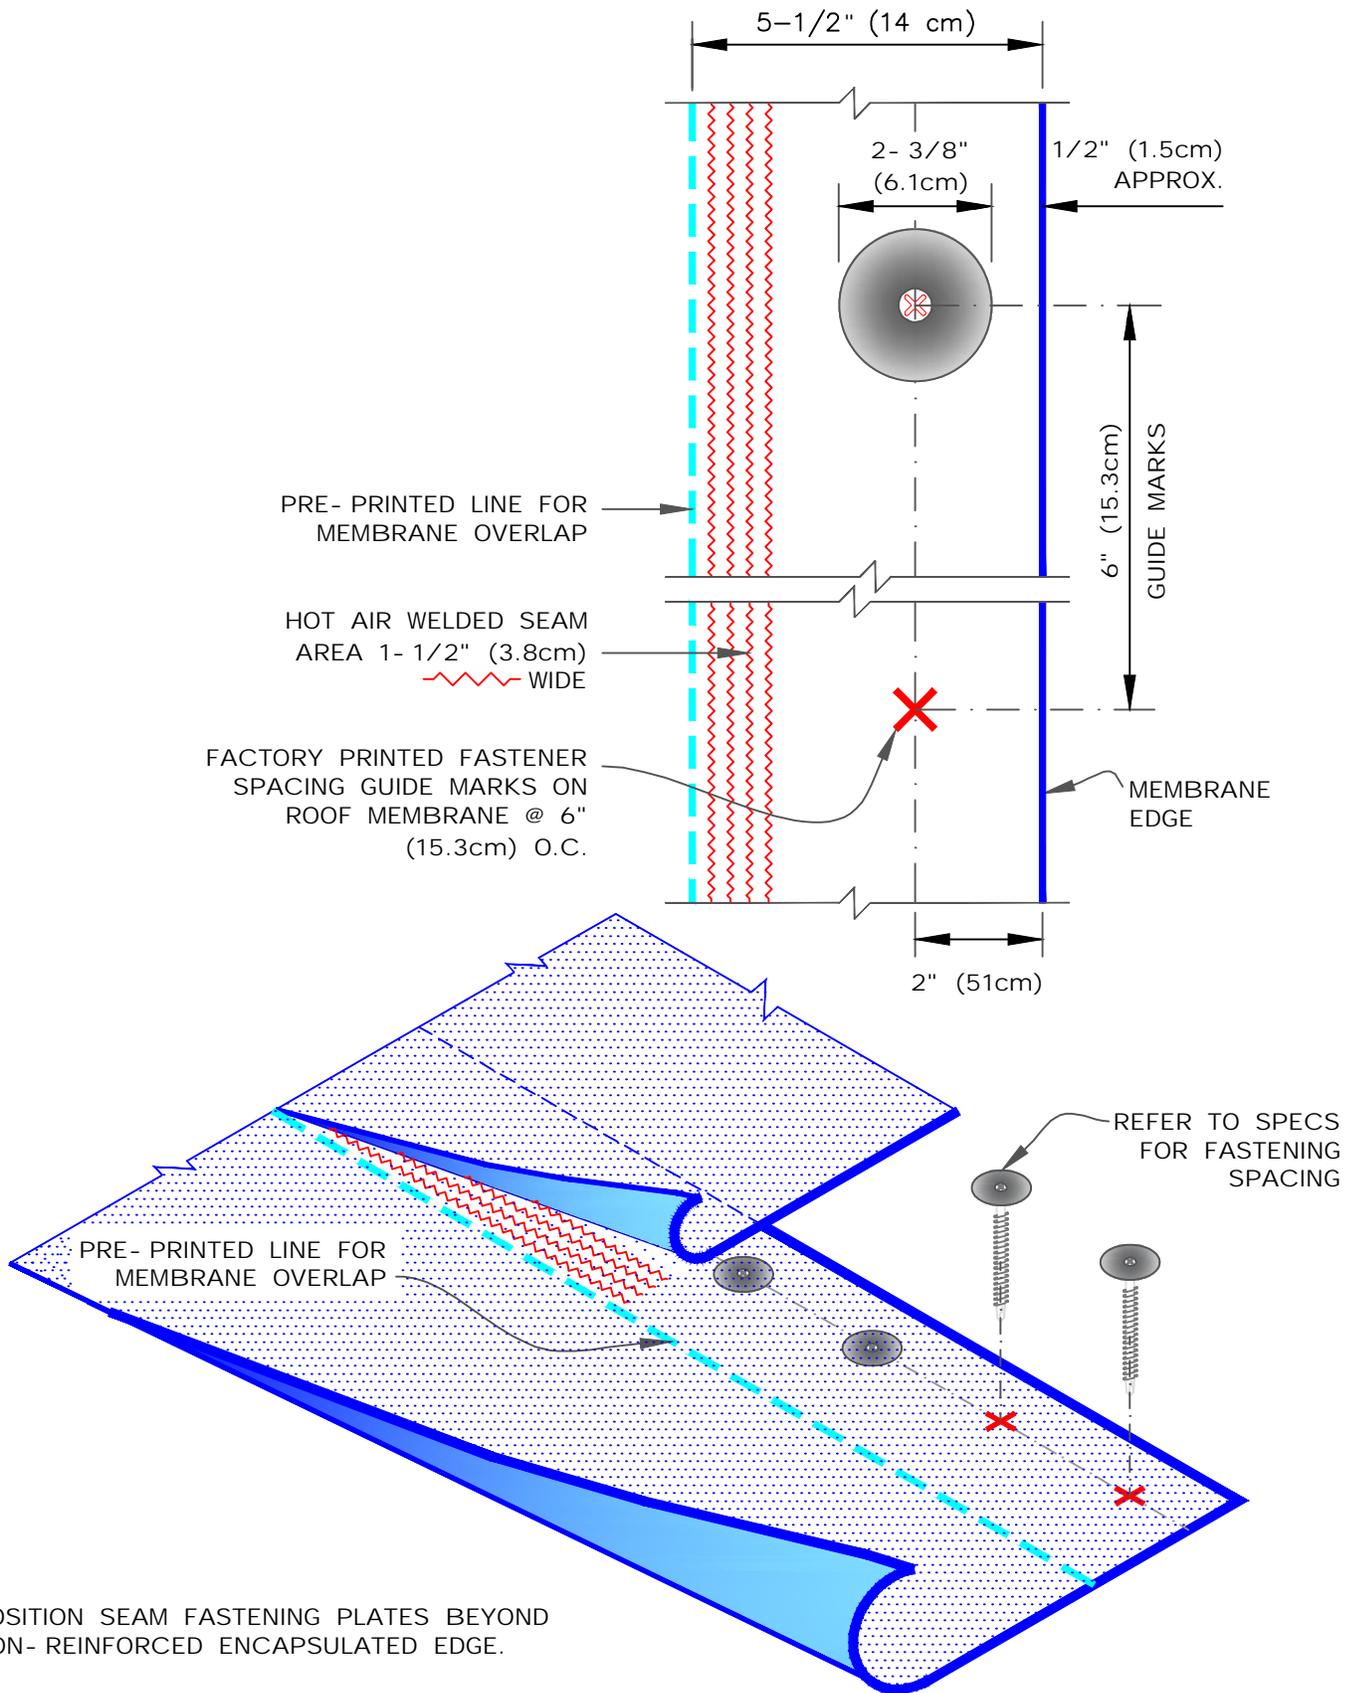

NOTE:


1. POSITION SEAM FASTENING PLATES BEYOND NON- REINFORCED ENCAPSULATED EDGE.

	MECHANICALLY FASTENED SEAM PAGE 2 OF 2		DETAIL NO. <b>MF- 2A</b>
	MAXIMUM WARRANTY: 30 YEARS		MF (Mechanically Fastened)

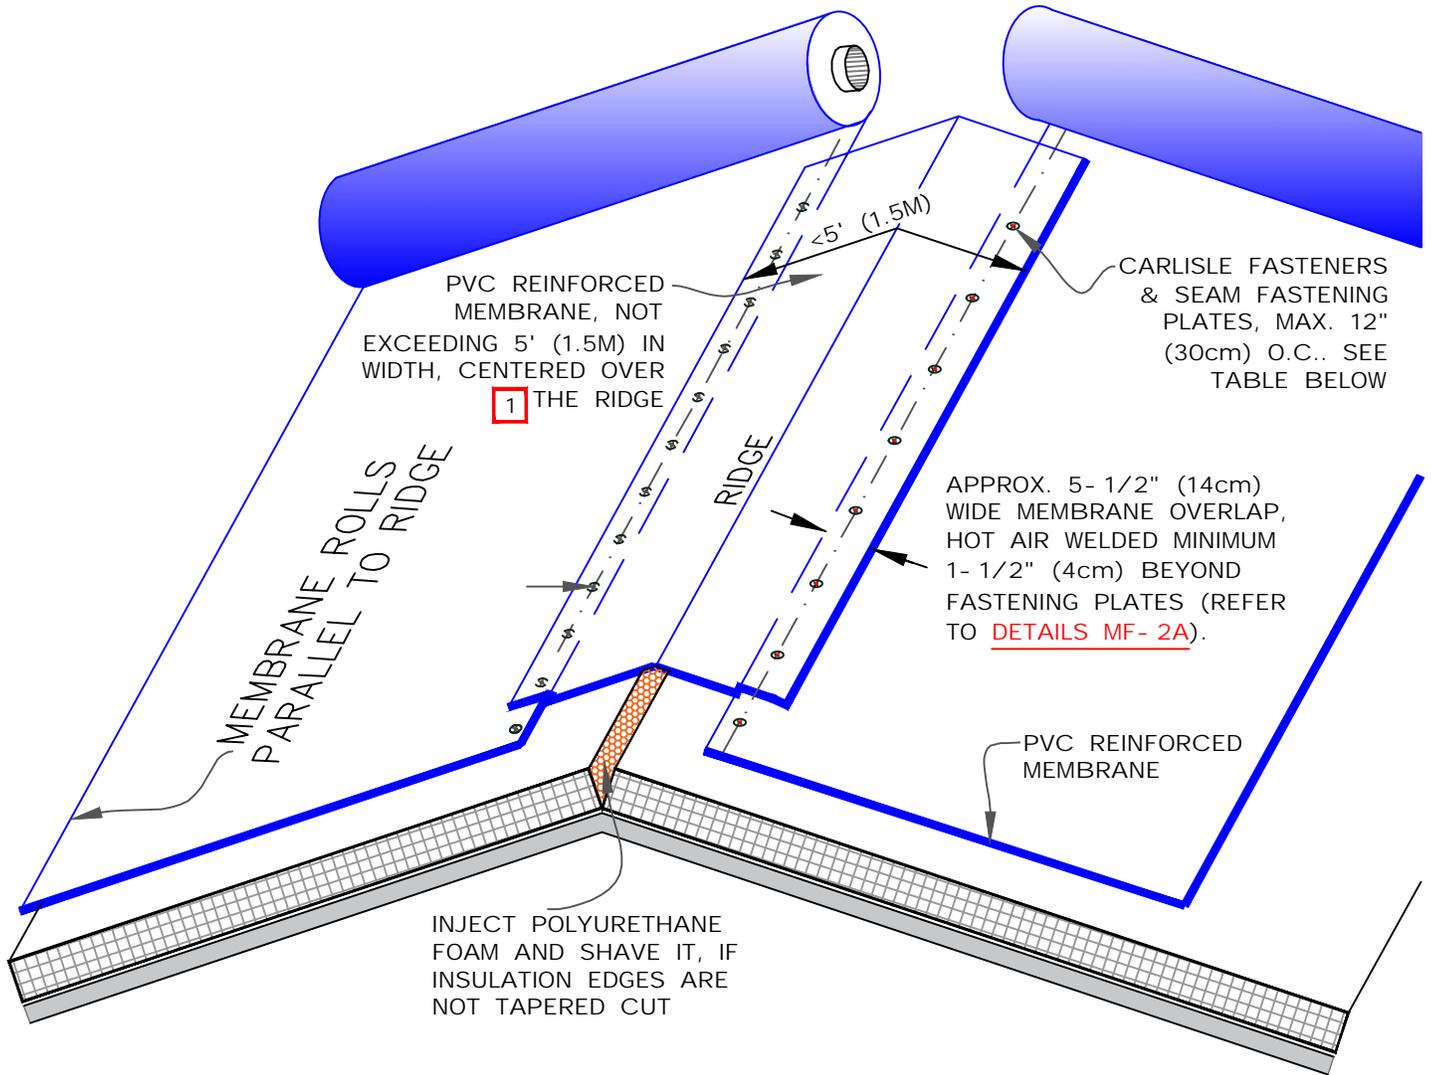

NOTES

1. RIDGE MEMBRANE ATTACHMENT IS ONLY REQUIRED WHEN ROOF SLOPE EXCEEDS 3" (7.5cm) TO 12" (30.5cm) HORIZONTAL.
2. POSITION FASTENING PLATES 1/2" (1.5cm) MINIMUM TO 1" (2.5cm) MAXIMUM FROM THE EDGE OF THE DECK MEMBRANE.
3. REFER TO CARLISLE SPECIFICATIONS FOR REQUIRED NUMBER OF PERIMETER SHEETS, SHEET WIDTH AND MEMBRANE FASTENING SPACING.

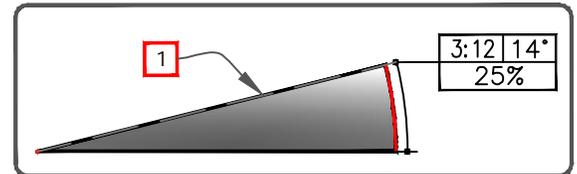

**FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY**

DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP- X	PIRANHA
	B	HP- XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD- 10	PIRANHA
	B	HD 14- 10	PIRANHA



RIDGE MEMBRANE ATTACHMENT


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.





MF- 22

MF (Mechanically Fastened)

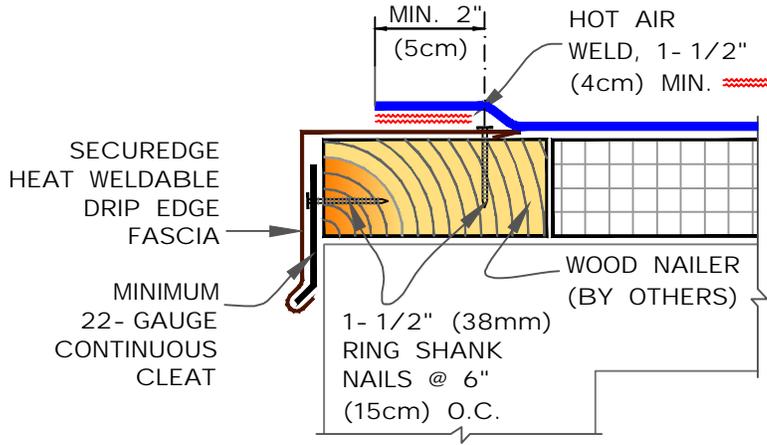

**SEQUENCE:**

1. 3" (7.6cm) REINFORCED MEMBRANE STRIPPING.
2. FIELD MEMBRANE.
3. TOP 6" (15.2cm) NON- REINFORCED MEMBRANE STRIPPING.

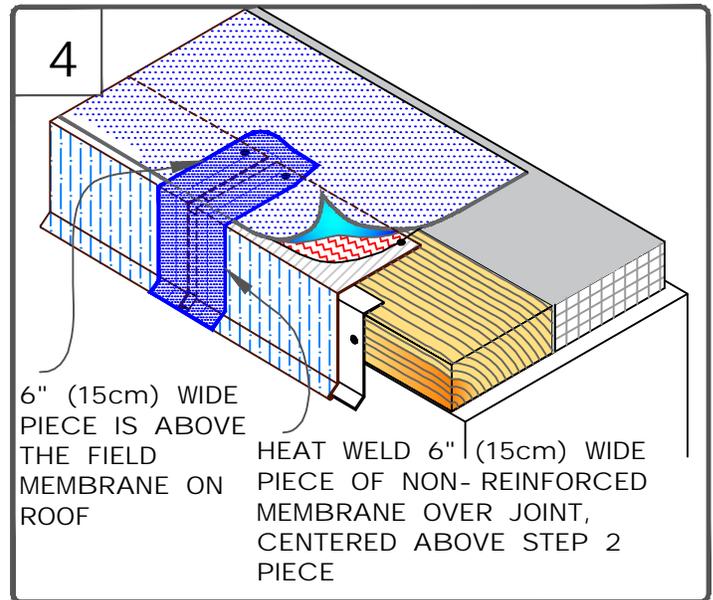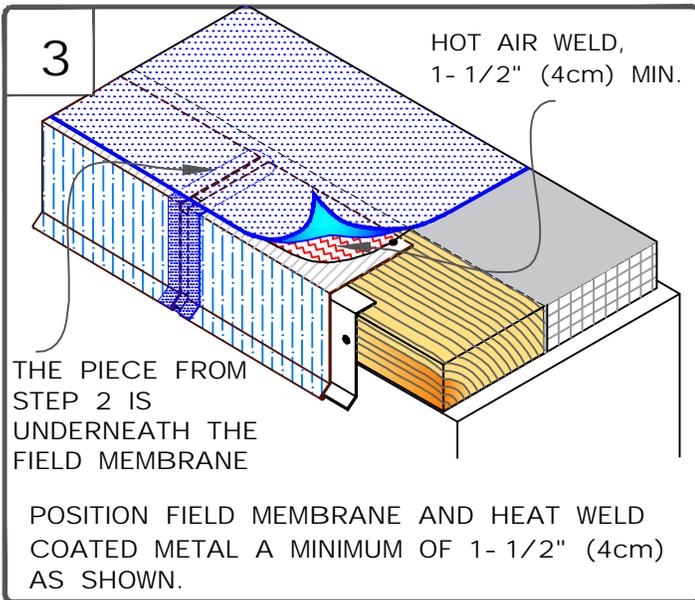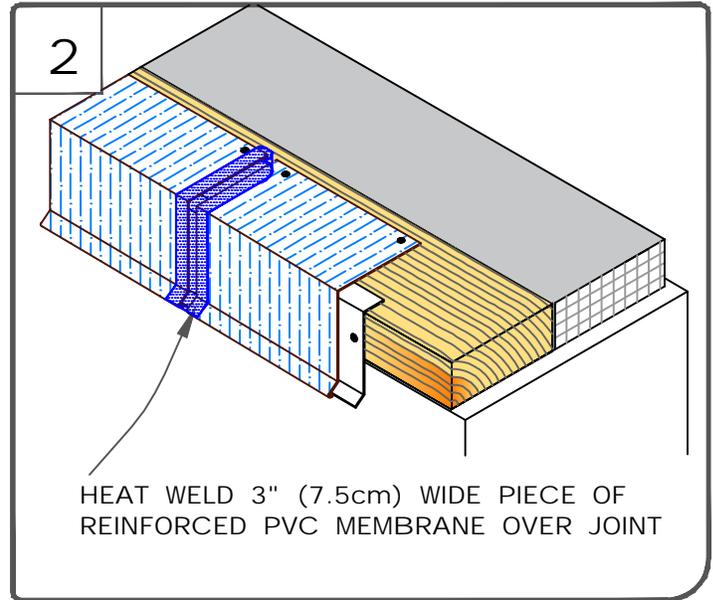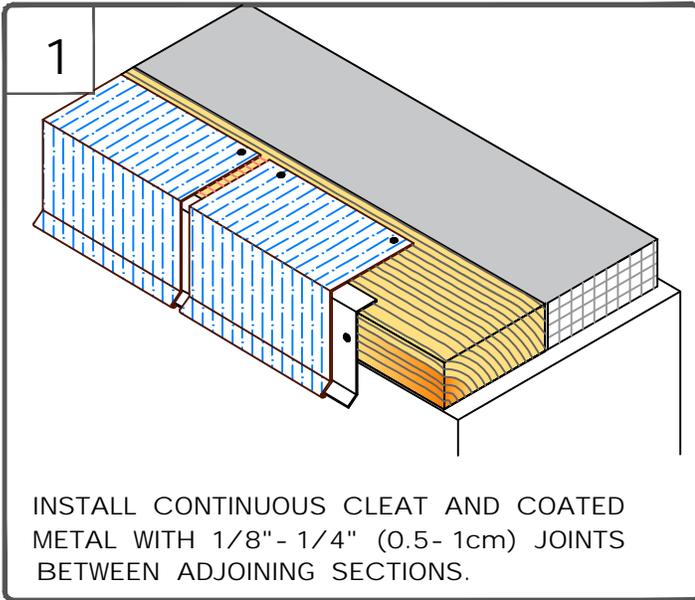

SecurWELD COATED DRIP EDGE FASCIA




MAXIMUM WARRANTY: 30 YEARS




DETAIL NO.

U- 1B

U (Universal Detail)

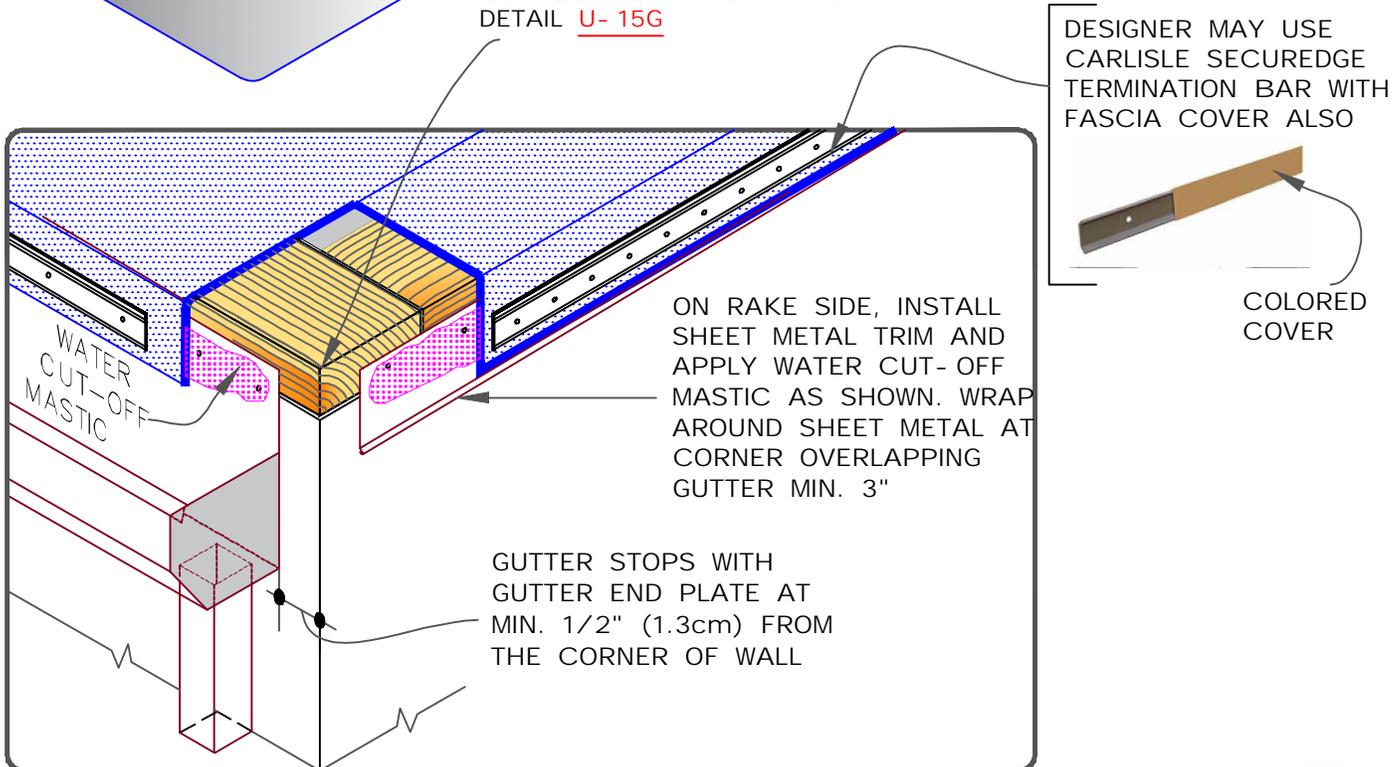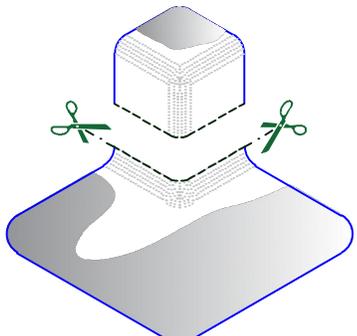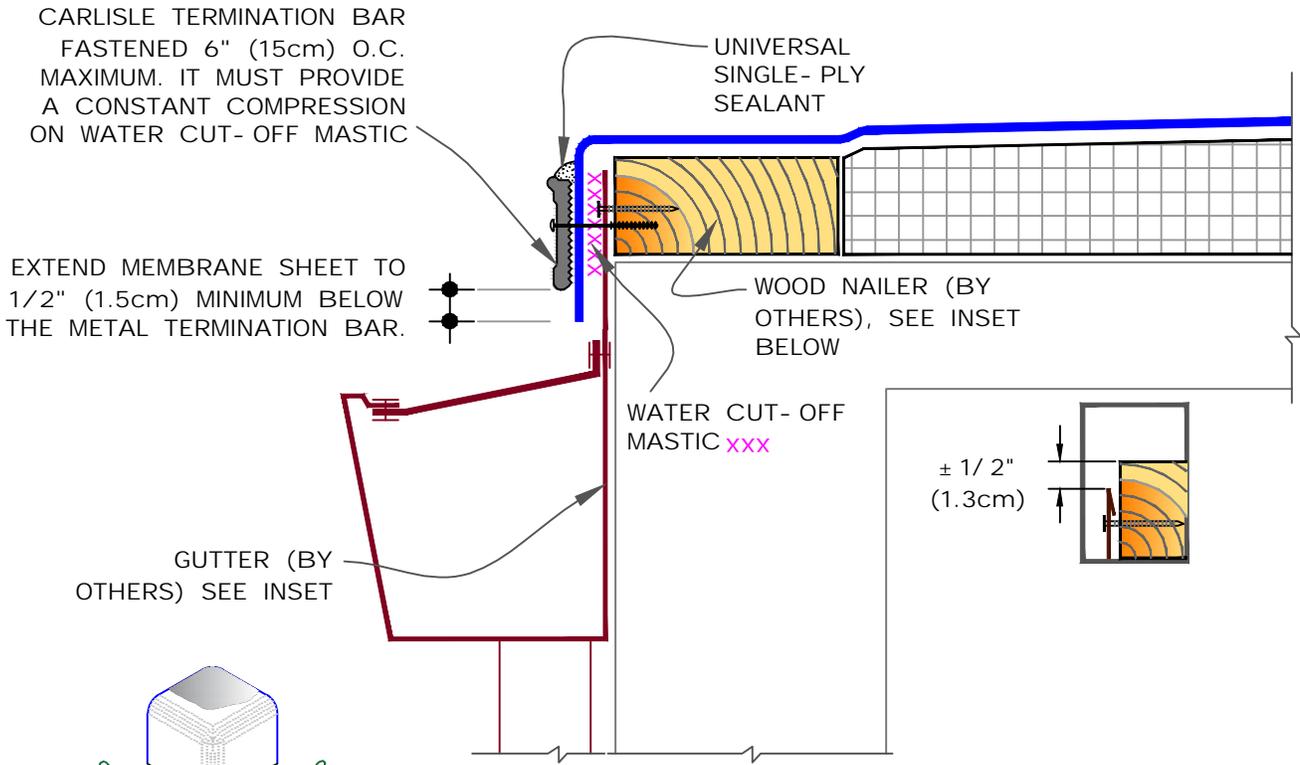


	METAL BAR EDGE TERMINATION		DETAIL NO.
	MAXIMUM WARRANTY: 30 YEARS		U- 1C
		U (Universal Detail)	

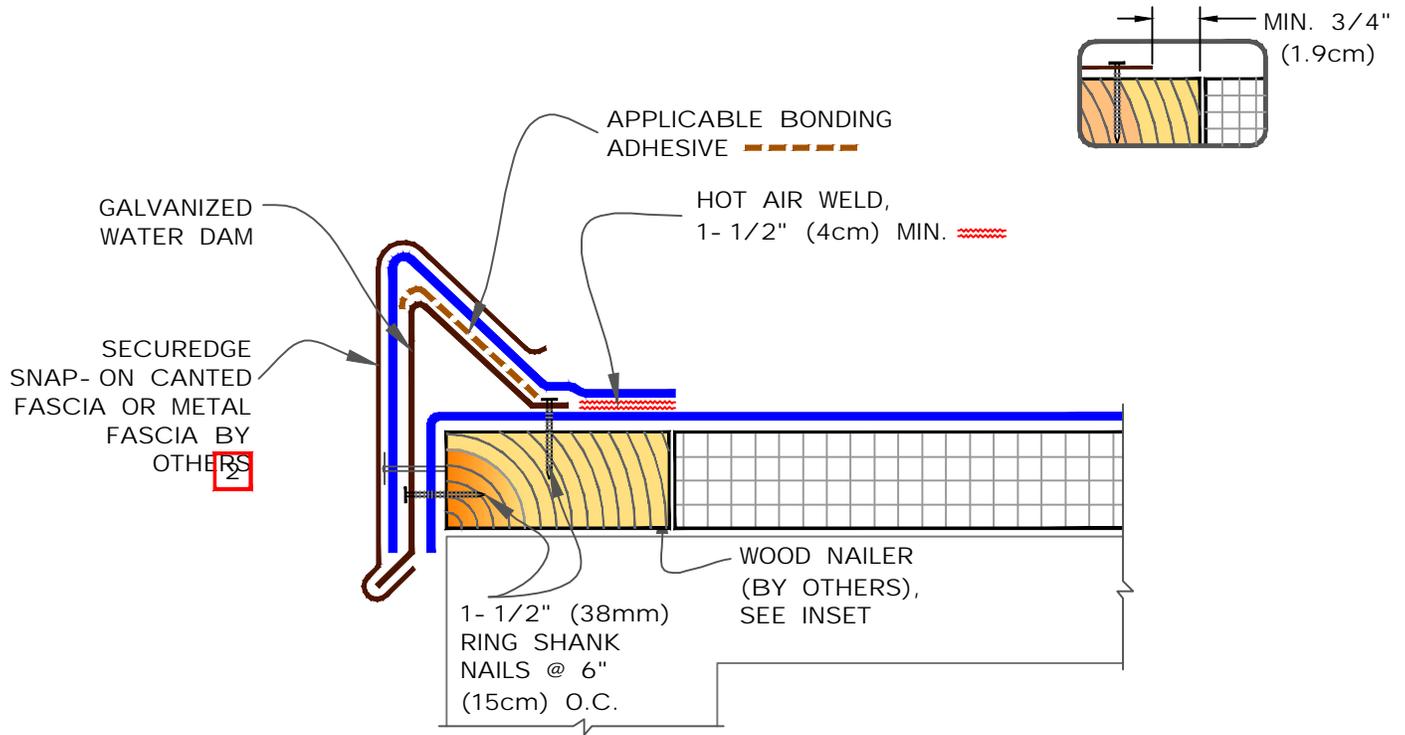

NOTES:

1. REFER TO [SecurEdge SNAP- ON CANTED FASCIA INSTRUCTION MANUAL](#) FOR STEP- BY- STEP INSTALLATION PROCEDURES.
2. WHEN METAL FASCIA BY OTHERS IS USED, FASTENER TYPE AND FASTENING FREQUENCY SHALL BE RECOMMENDED BY METAL EDGE MANUFACTURER.

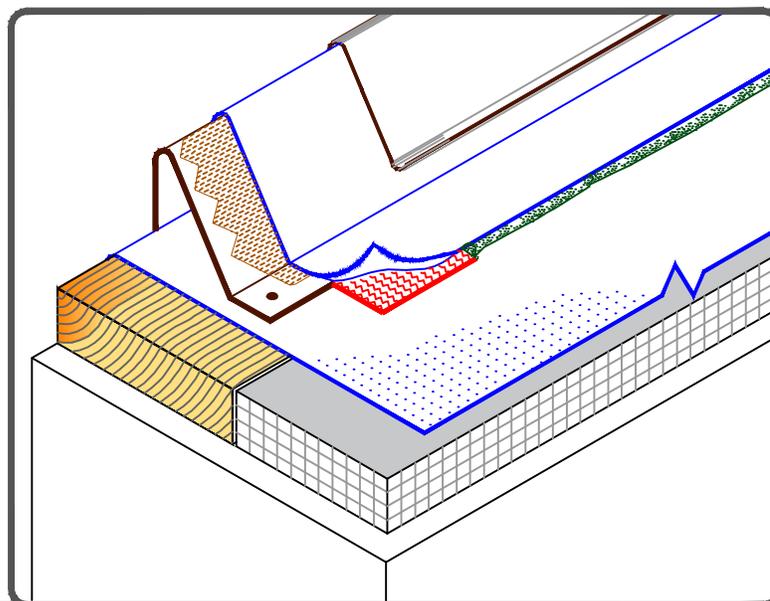

CARLISLE SecurEdge SNAP-ON CANTED FASCIA


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 1D


U (Universal Detail)

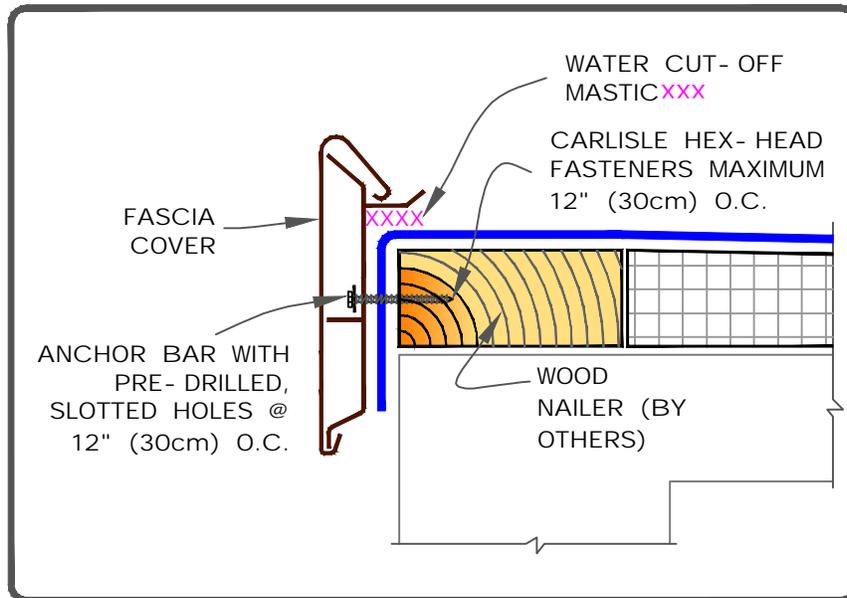

SecurEdge EX SNAP-ON FASCIA

NOTES:

1. REFER TO [SECUREDGE INSTALLATION INSTRUCTION MANUAL](#) FOR THE STEP BY STEP INSTALLATION PROCEDURES AND FOR THE VARIOUS PRODUCT FEATURES AVAILABLE.
2. IF INCIDENTAL/TEMPORARY PONDED WATER IS EXPECTED, THE SECUREDGE MUST BE ELEVATED AND SCUPPERS PROVIDED FOR DRAINAGE.
3. ENSURE ROOF SLOPES AWAY FROM SECUREDGE .

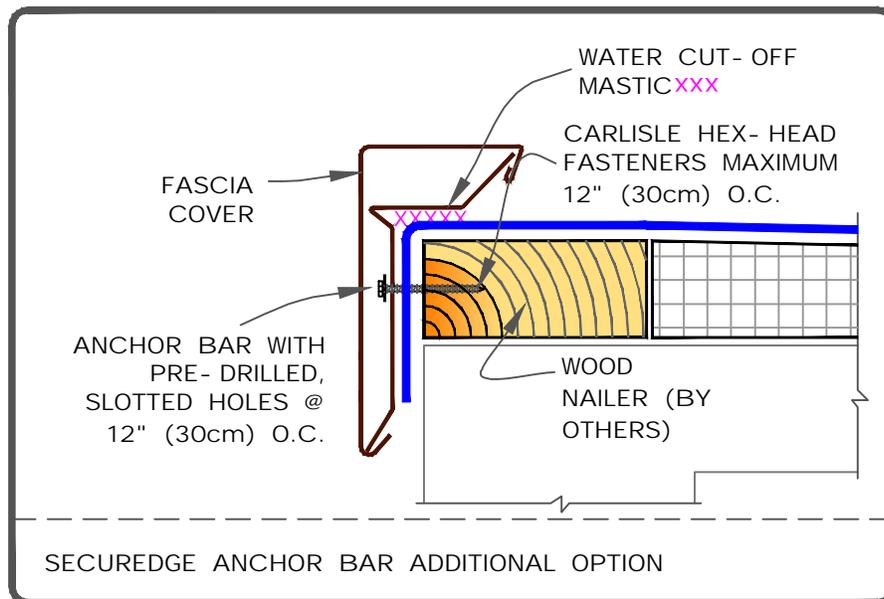

SecurEdge SNAP-ON FASCIA



CARLISLE SecurEdge EX SNAP-ON FASCIA & SecurEdge SNAP-ON FASCIA


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 1F



U (Universal Detail)

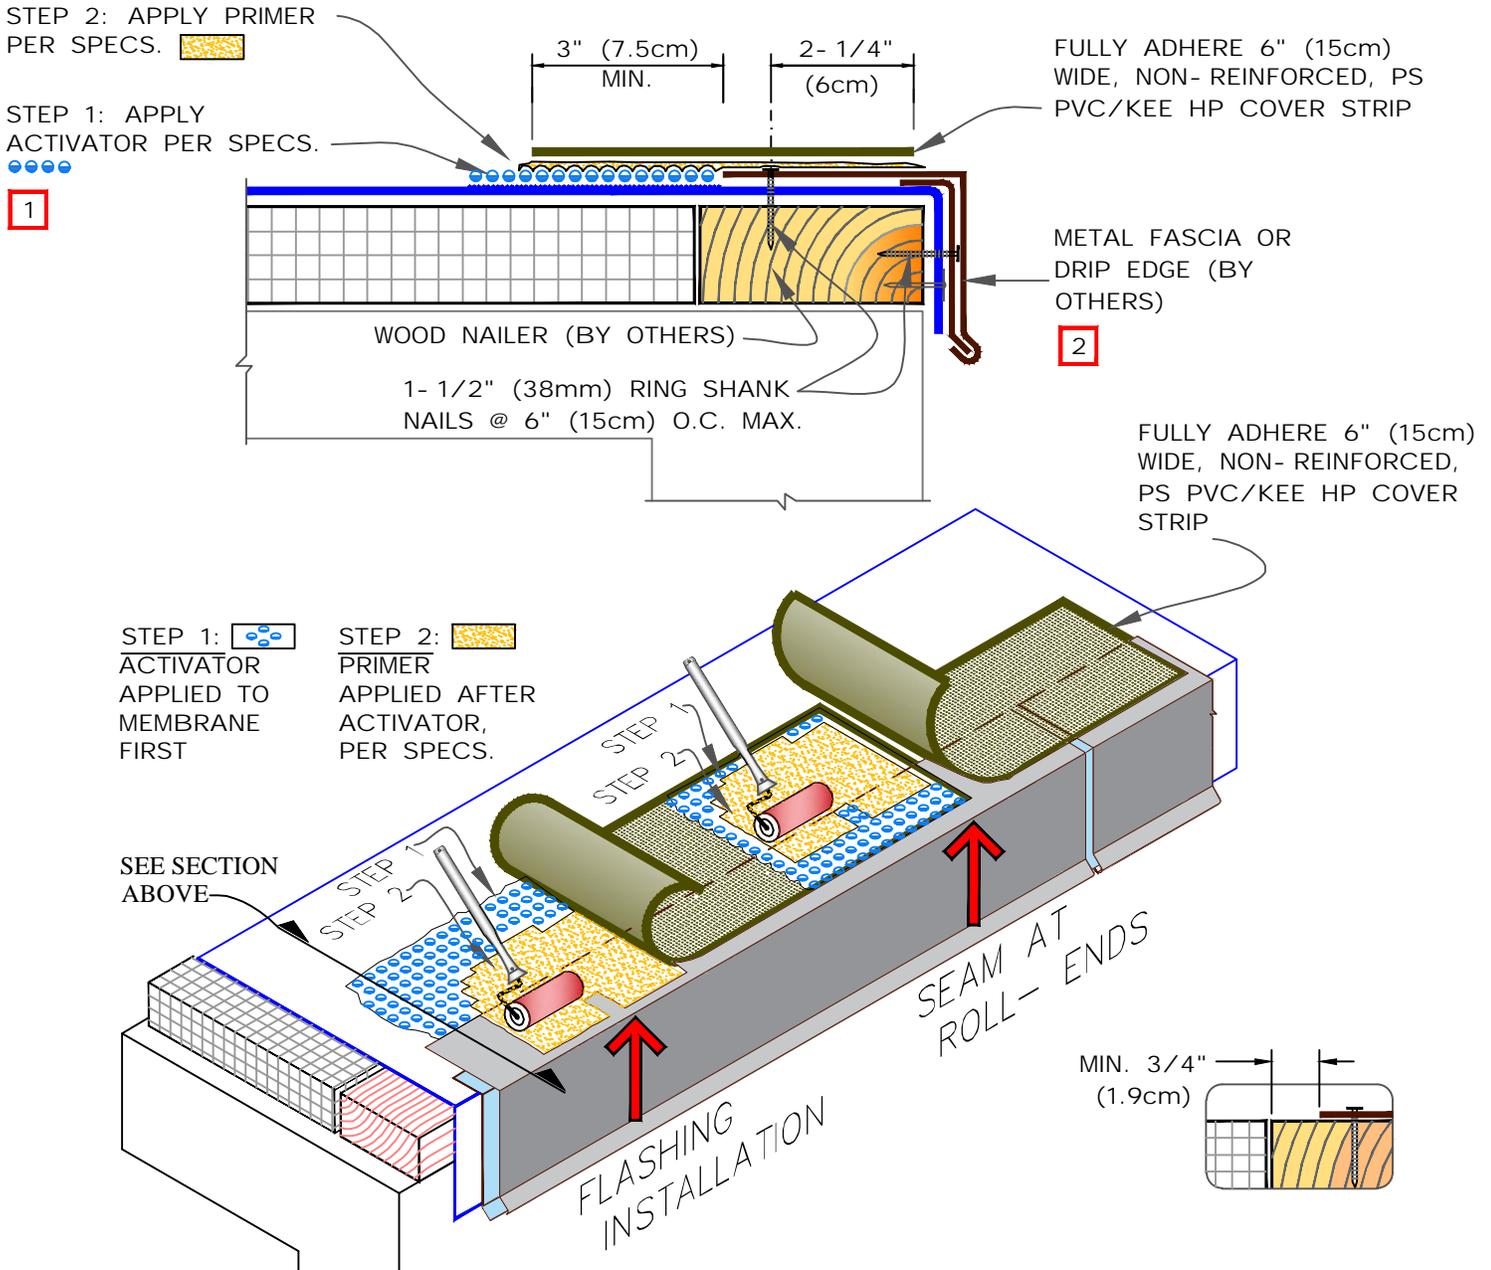

NOTES:

1. TO REMOVE FINISHING OILS, SCRUB METAL FLANGE WITH PVC & KEE HP MEMBRANE CLEANER; ALLOW TO DRY PRIOR TO APPLYING PRIMER.
2. WHEN METAL FASCIA BY OTHERS IS USED, FASTENER TYPE AND FASTENING FREQUENCY SHALL BE RECOMMENDED BY METAL EDGE MANUFACTURER.
3. TO ENSURE PVC PRESSURE- SENSITIVE COVER STRIP CONFORMS TO STEPS- OFF, HEAT COVER STRIP AT SPLICE INTERSECTIONS PRIOR TO ROLLING.
4. THIS DETAIL IS NOT RECOMMENDED FOR ROOFS THAT ARE LIKELY TO EXPERIENCE SIGNIFICANT SNOW AND ICE. REFER TO COATED EDGE METAL DETAILS.

	PRESSURE-SENSITIVE PVC/KEE HP COVER STRIP		DETAIL NO.
	MAXIMUM WARRANTY: 20 YEARS		U- 1G
			U (Universal Detail)

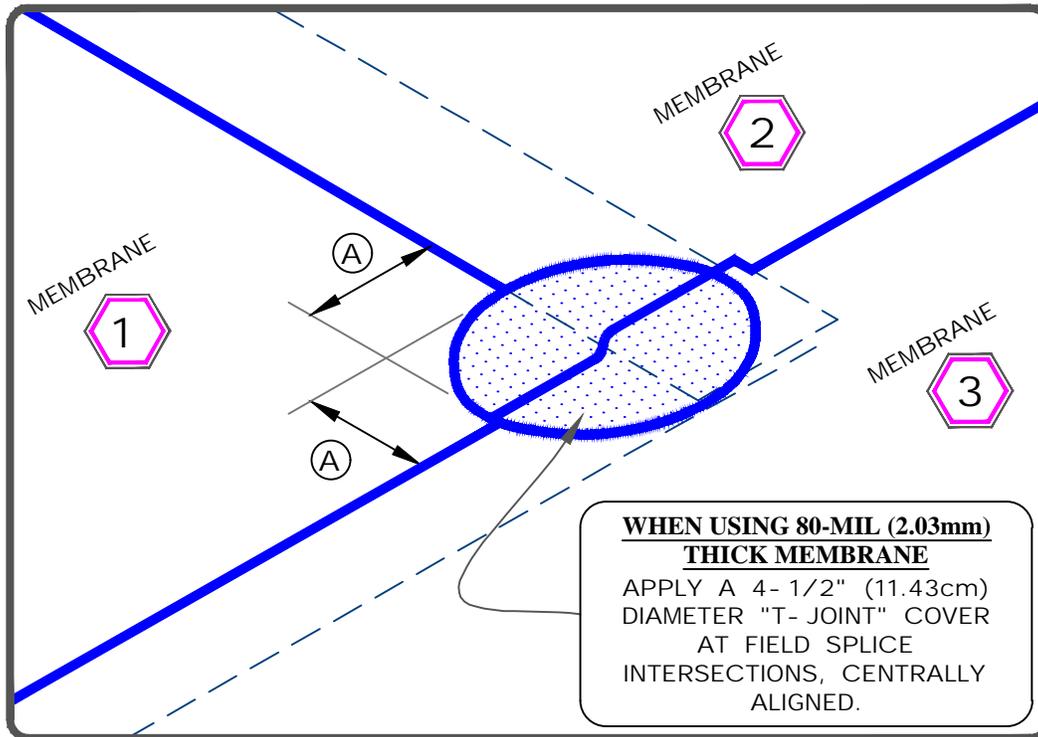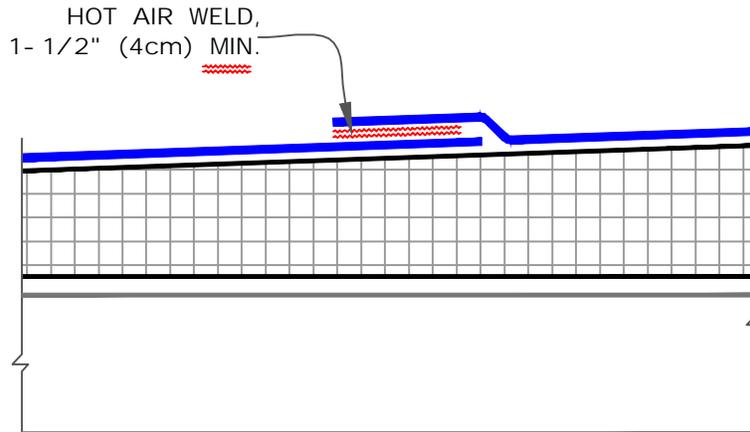

DIMENSIONS	cm	
(A)	2- 1/4"	6 MIN.

NOTE:

1. WHEN USING 60- MIL (1.52mm) MEMBRANE, MAXIMUM WARRANTY IS 20 YEARS.



PVC/KEE HP MEMBRANE  
SPLICE


MAXIMUM WARRANTY: 30 YEARS (SEE [NOTE 1](#))



DETAIL NO.

U- 2A

U (Universal Detail)

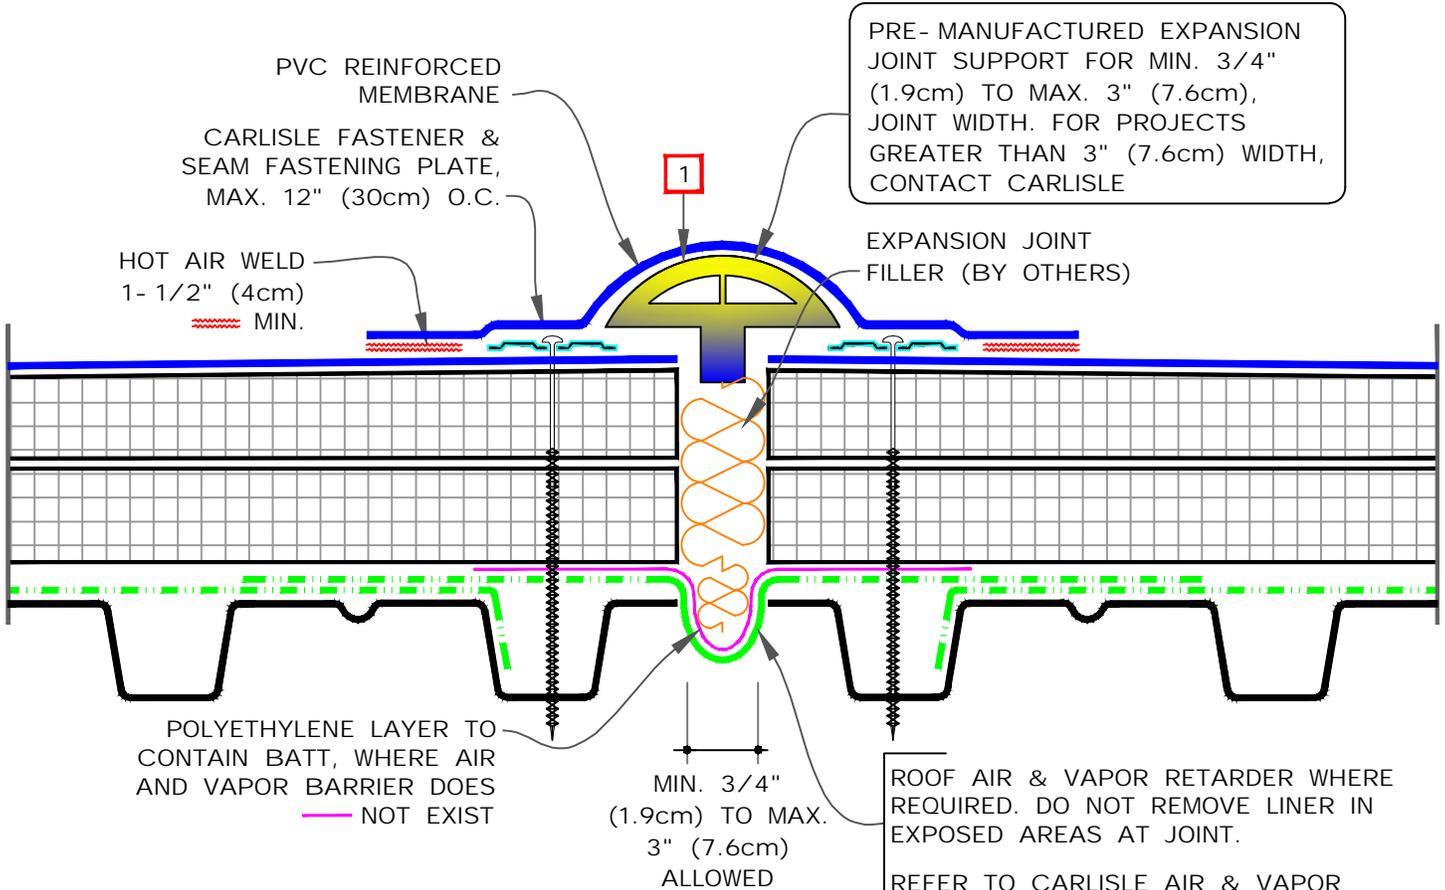


NOTES:

- MEMBRANE FLASHING SHALL NOT BE ADHERED OVER THE SPONGE TUBING (EXPANSION JOINT SUPPORT).
- WHEN THE EXPANSION JOINT INTERSECTS WITH A COATED METAL DRIP EDGE, THEN COATED METAL SHOULD BE GAPPED AND THE [U-1B](#) DETAIL BE FOLLOWED. DRIP EDGE BY OTHERS SHOULD ALSO BE GAPPED.

**FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY**

DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP- X	PIRANHA
	B	HP- XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD- 10	PIRANHA
	B	HD 14- 10	PIRANHA

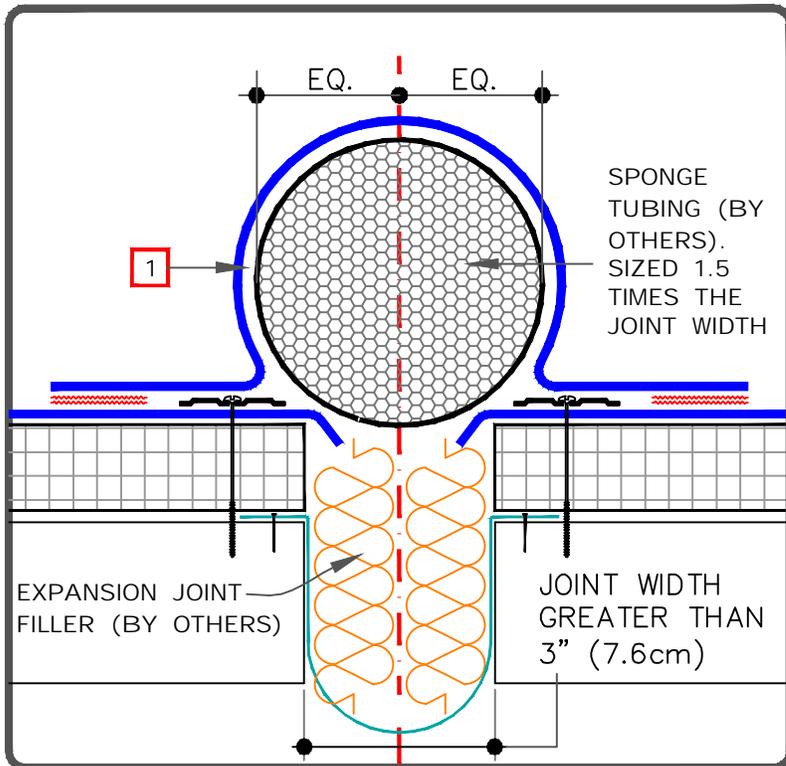

DECK-TO-DECK ROOF EXPANSION JOINT


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 3A

U (Universal Detail)

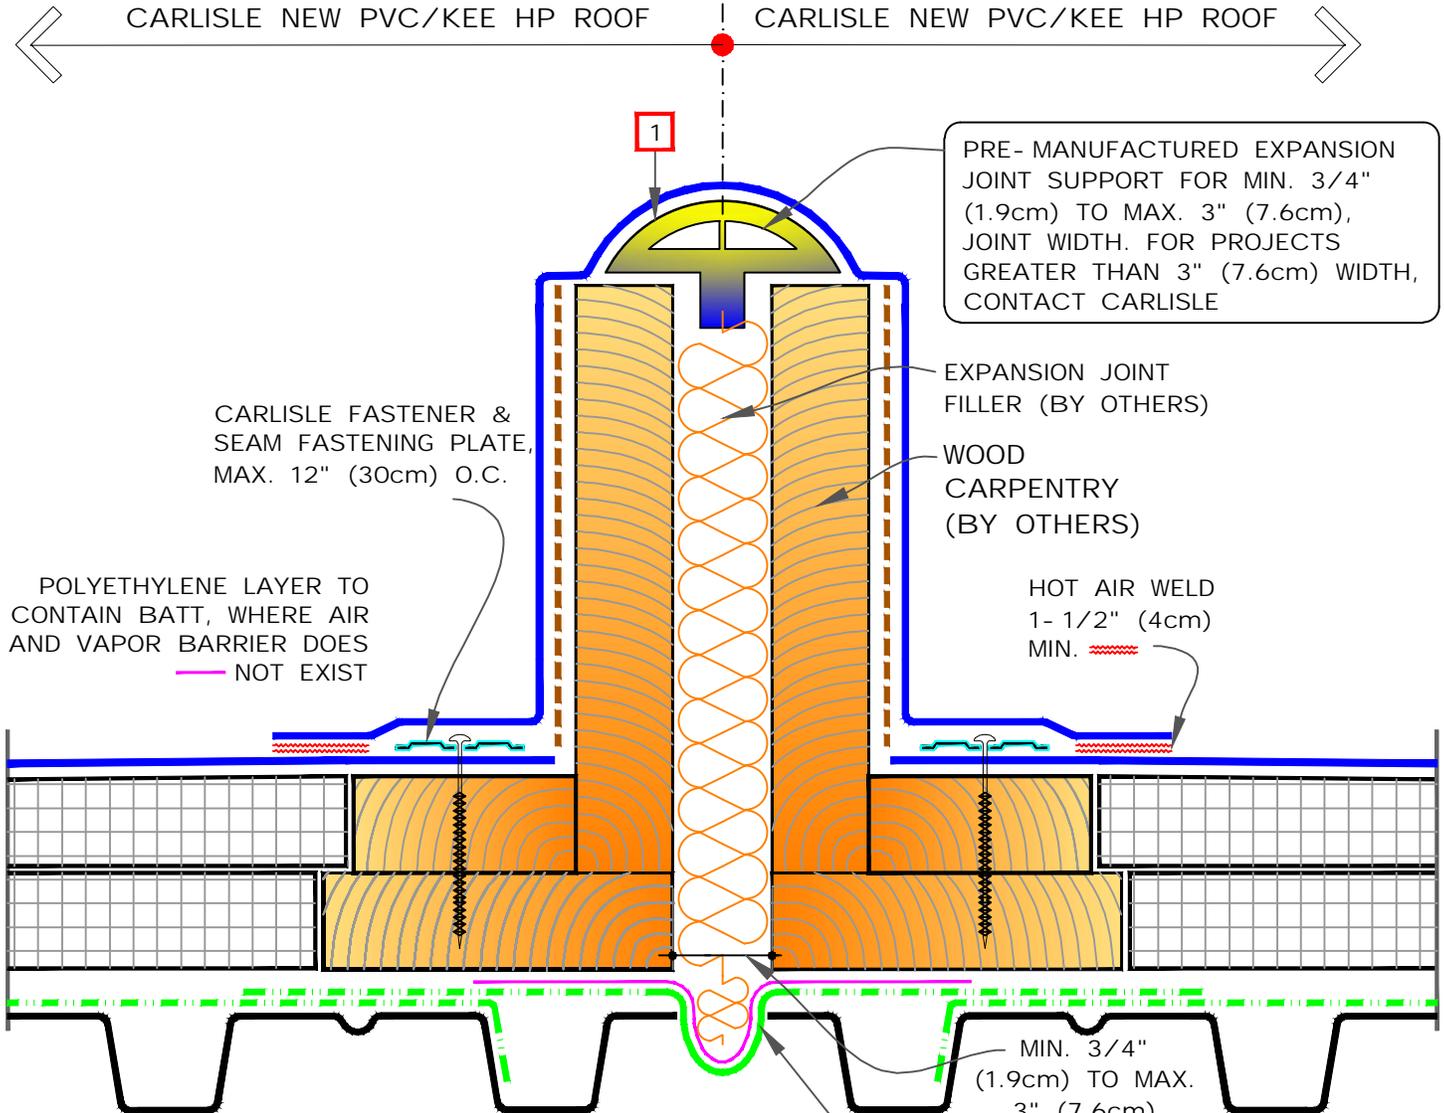

PRE-MANUFACTURED EXPANSION JOINT SUPPORT FOR MIN. 3/4" (1.9cm) TO MAX. 3" (7.6cm), JOINT WIDTH. FOR PROJECTS GREATER THAN 3" (7.6cm) WIDTH, CONTACT CARLISLE


EXPANSION JOINT FILLER (BY OTHERS)  
WOOD CARPENTRY (BY OTHERS)

CARLISLE FASTENER & SEAM FASTENING PLATE, MAX. 12" (30cm) O.C.

POLYETHYLENE LAYER TO CONTAIN BATT, WHERE AIR AND VAPOR BARRIER DOES NOT EXIST

HOT AIR WELD 1- 1/2" (4cm) MIN.

MIN. 3/4" (1.9cm) TO MAX. 3" (7.6cm) ALLOWED


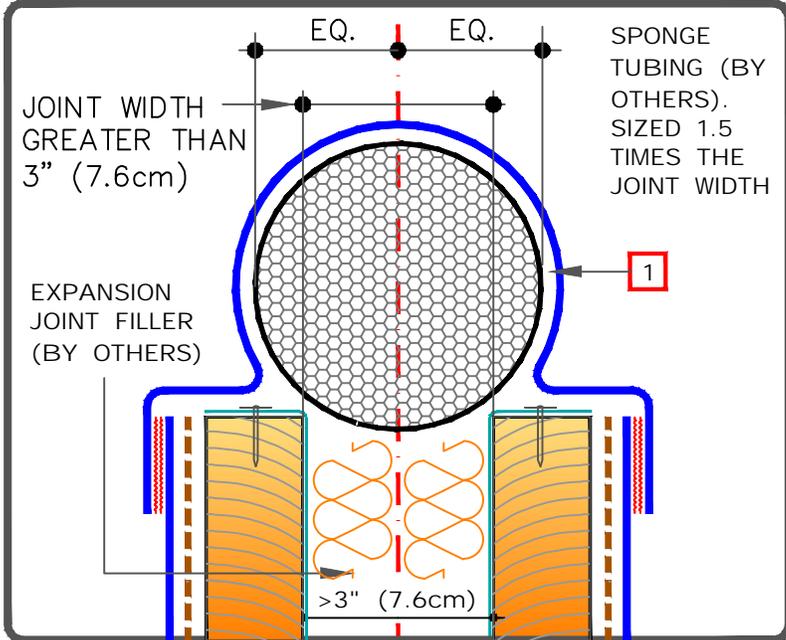


ROOF AIR & VAPOR RETARDER WHERE REQUIRED. DO NOT REMOVE LINER IN EXPOSED AREAS AT JOINT.  
REFER TO CARLISLE AIR & VAPOR BARRIER DETAILS. FOR METAL DECK SEE MD-0. FOR WOOD OR CONCRETE DECKS, SEE TR-0

- NOTES:
- MEMBRANE FLASHING SHALL NOT BE ADHERED OVER THE EXPANSION JOINT SUPPORT.

	DECK-TO-DECK CURBED ROOF EXPANSION JOINT		DETAIL NO.
	MAXIMUM WARRANTY: 30 YEARS		U-3A.1
		U (Universal Detail)	

**CAUTION** WHEN A WARRANTY WIND SPEED GREATER THAN 90MPH IS SPECIFIED, CARLISLE FASTENERS AND SEAM FASTENING PLATES SHALL NOT EXCEED 6" (15cm) ON CENTER FOR ADHERED MEMBRANE ASSEMBLIES.

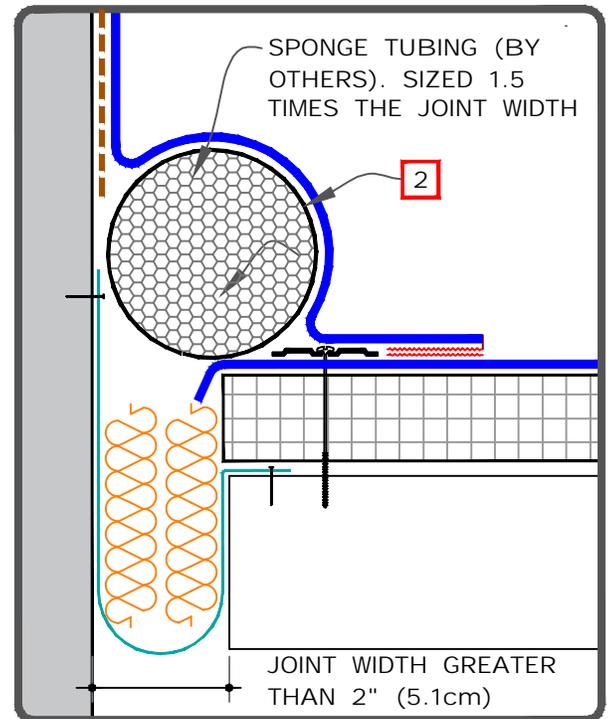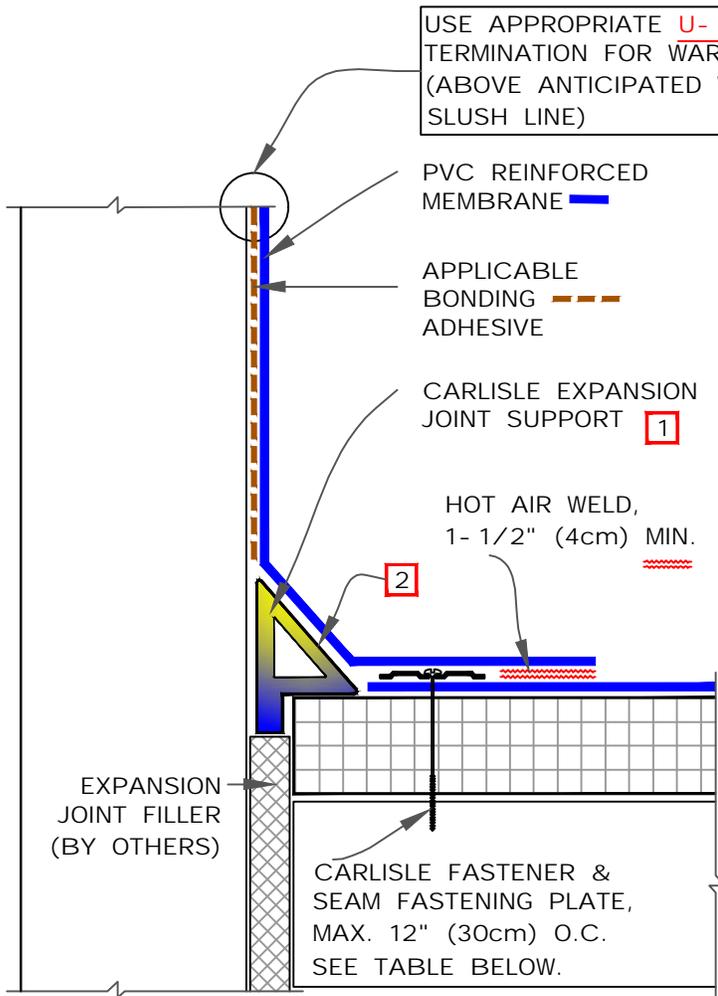

NOTES:

1. WHEN CARLISLE EXPANSION JOINT SUPPORT IS USED, WIDTH OF JOINT SHALL BE A MINIMUM OF 3/4" (2cm) AND SHALL NOT EXCEED 2" (5cm). SEE INSET FOR JOINTS GREATER THAN 2" (5cm)
2. MEMBRANE FLASHING SHALL NOT BE ADHERED OVER THE EXPANSION JOINT SUPPORT OR SPONGE TUBING.

**FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY**

DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP- X	PIRANHA
	B	HP- XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD- 10	PIRANHA
	B	HD 14- 10	PIRANHA



DECK-TO-WALL EXPANSION JOINT


MAXIMUM WARRANTY: 30 YEARS




DETAIL NO.

U- 3B


U (Universal Detail)

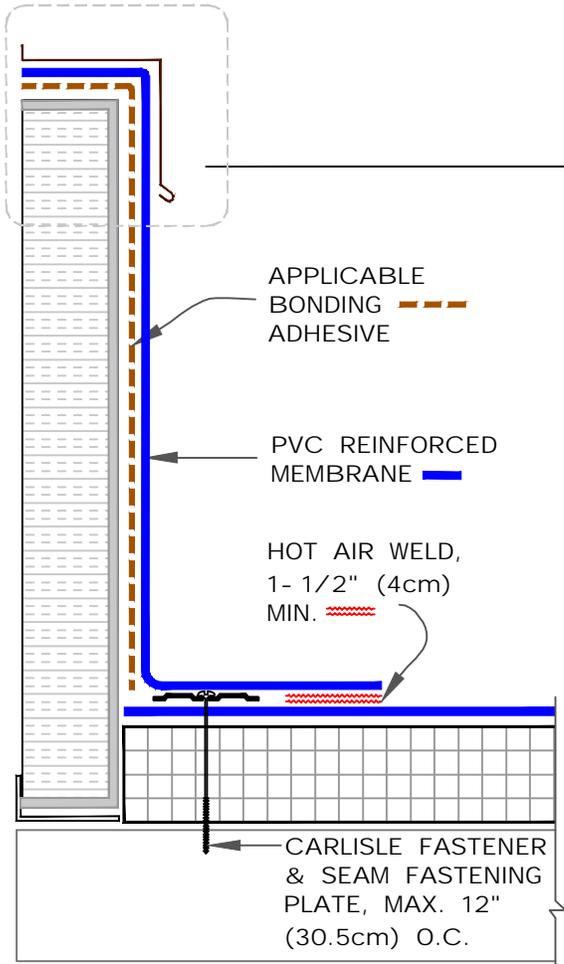

1 2

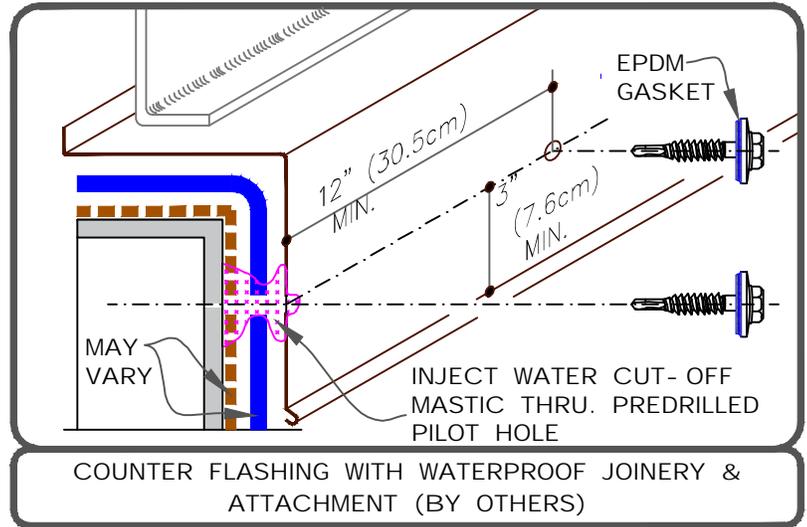



PVC ONLY (NOT KEE HP)  
 IN LIEU OF BONDING  
 ADHESIVE, THE CURB  
 FLASHING MAY BE INSTALLED  
 IN CAV GRIP PVC.

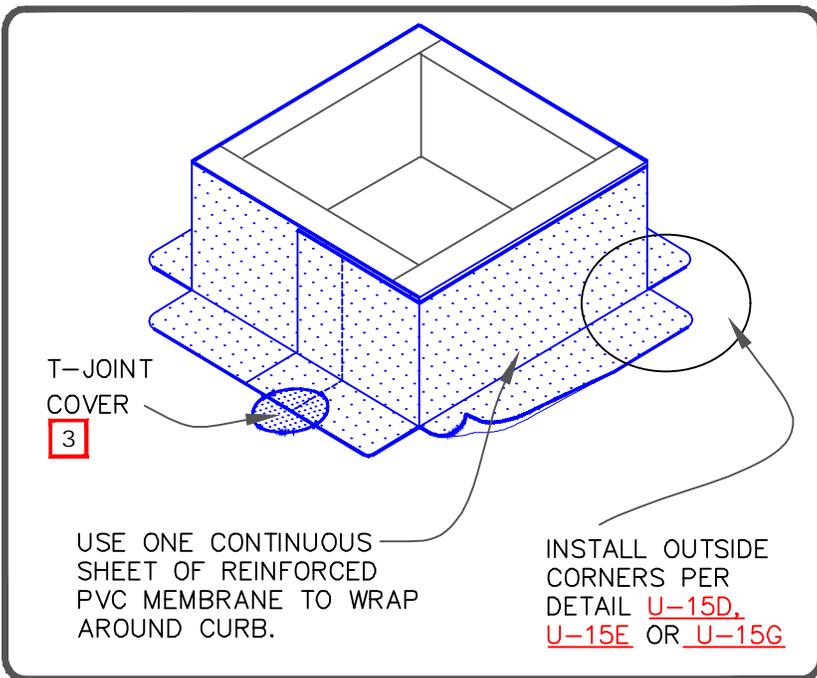


NOTES:

1. REFER TO CARLISLE SPECIFICATIONS FOR ACCEPTABLE CARLISLE FASTENERS AND PLATES.
2. MECHANICAL SECUREMENT MAY BE INSTALLED INTO THE VERTICAL SUBSTRATE.
3. WHEN USING 80 MIL (2.03mm) THICK CURB FLASHING, THE INTERSECTIONS BETWEEN SPLICES MUST OVERLAIED WITH A PVC "T- JOINT" COVER.

	CURB FLASHING WITH PVC MEMBRANE  MAXIMUM WARRANTY: 30 YEARS		DETAIL NO. <b>U- 5A</b>
		U (Universal Detail)	

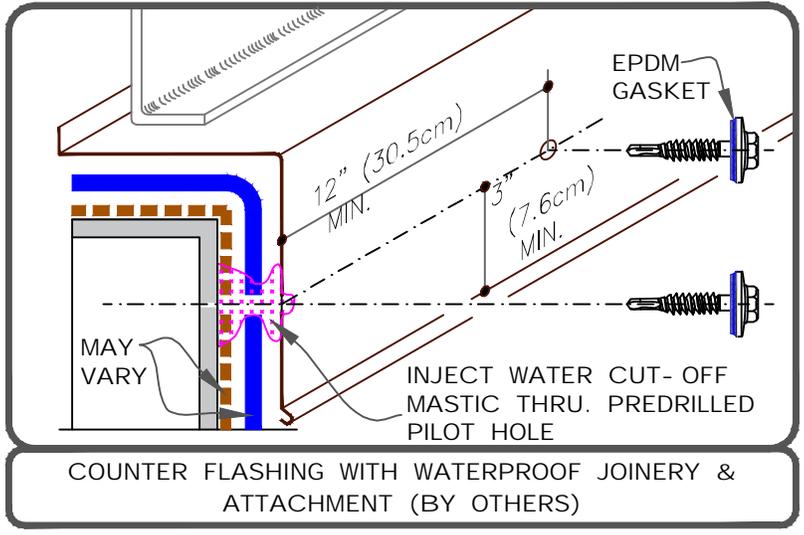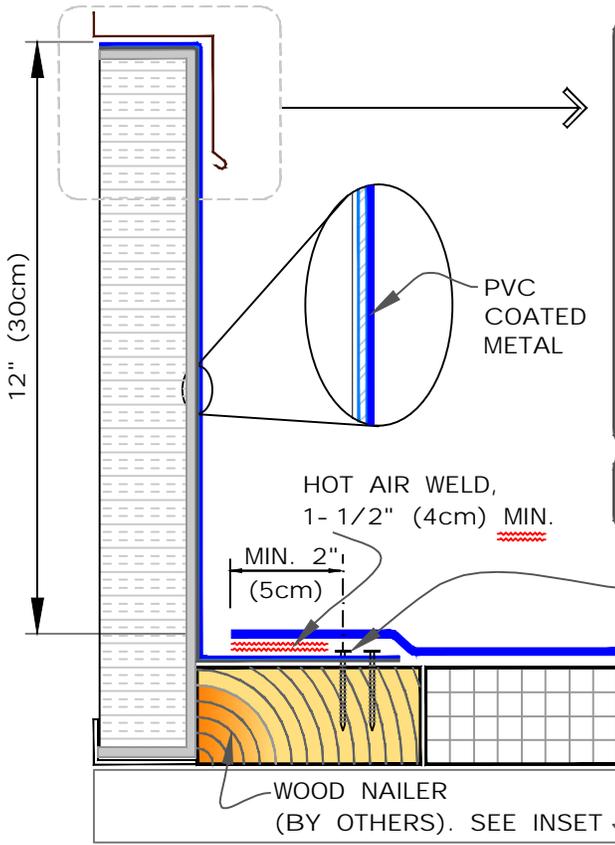




FASTEN COATED METAL USING 1- 1/2" (38mm) MIN. RING SHANK NAILS AT 6" (15cm) STAGGERED APPROX. 1/2" (1.5cm).

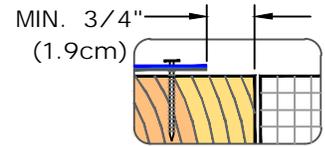

- SEQUENCE:**
1. 3" (7.6cm) REINFORCED MEMBRANE STRIPPING.
  2. FIELD MEMBRANE.
  3. TOP 6" (15.2cm) NON- REINFORCED MEMBRANE STRIPPING.


HEAT WELD 6" (15cm) WIDE PIECE OF UN- REINF. MEMBRANE OVER JOINT ON TOP OF ROOF MEMBRANE

INSTALL OUTSIDE CORNERS PER [DETAILU- 15.F](#)

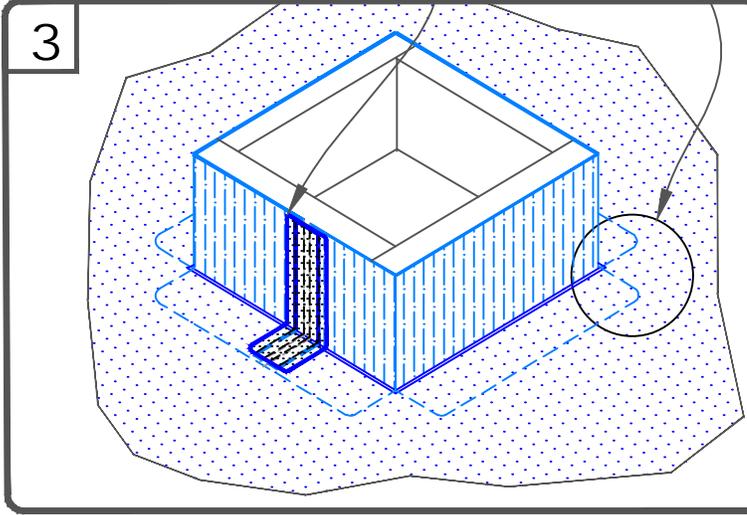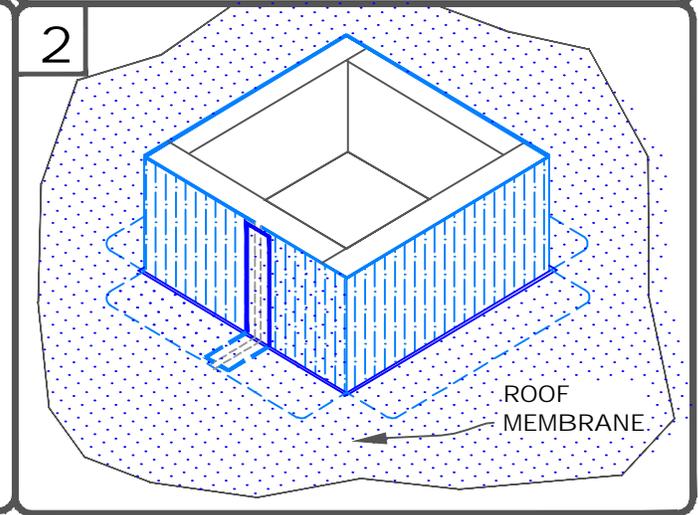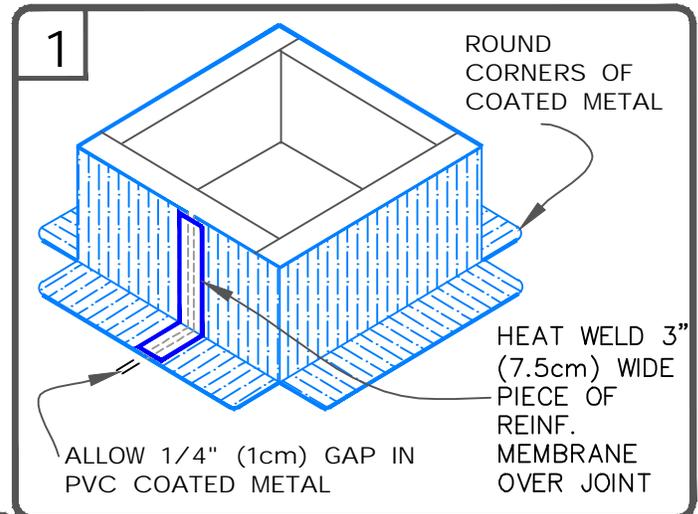


CURB FLASHING WITH PVC COATED METAL  
 MAXIMUM WARRANTY: 30 YEARS

DETAIL NO. U- 5B  
 U (Universal Detail)

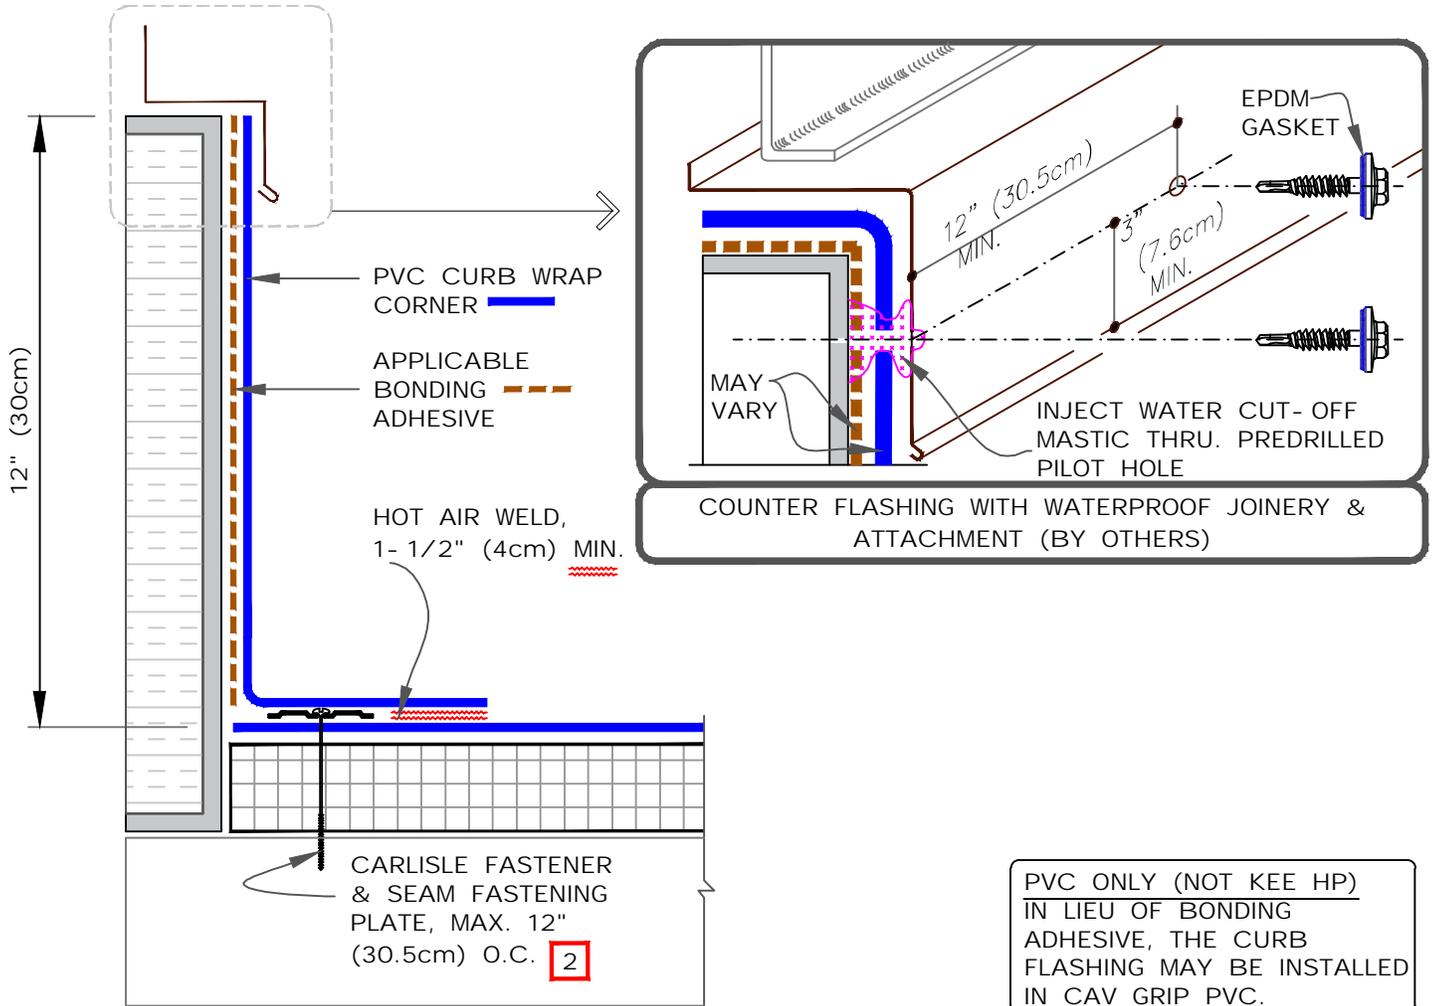


NOTES:

1. FOUR CURB WRAP CORNERS WILL COMPLETELY FLASH A MAXIMUM CURB SIZE OF 3'X3' (91cmX 91cm). FOR LARGER CURBS USE THE PVC CURB WRAP CORNERS IN CONJUNCTION WITH ADDITIONAL SECTIONS OF PVC MEMBRANE.
2. REFER TO CARLISLE SPECIFICATIONS FOR ACCEPTABLE CARLISLE FASTENERS AND PLATES.
3. CUSTOM SIZES ARE AVAILABLE FOR CURB FLASHING HEIGHTS GREATER THAN 12" (30cm).

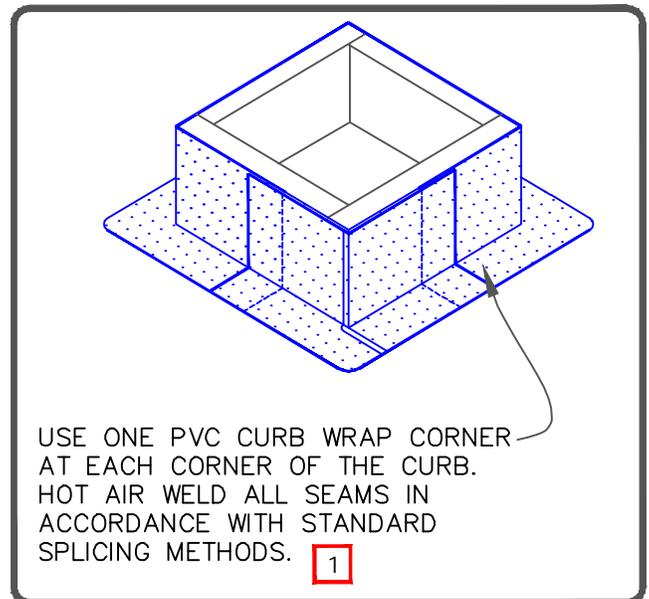

CFA (CERTIFIED FABRICATED ACCESSORIES)


	CURB FLASHING WITH CFA PVC CURB WRAP CORNERS		DETAIL NO. <b>U5- C</b>
	MAXIMUM WARRANTY: 30 YEARS	U (Universal Detail)	

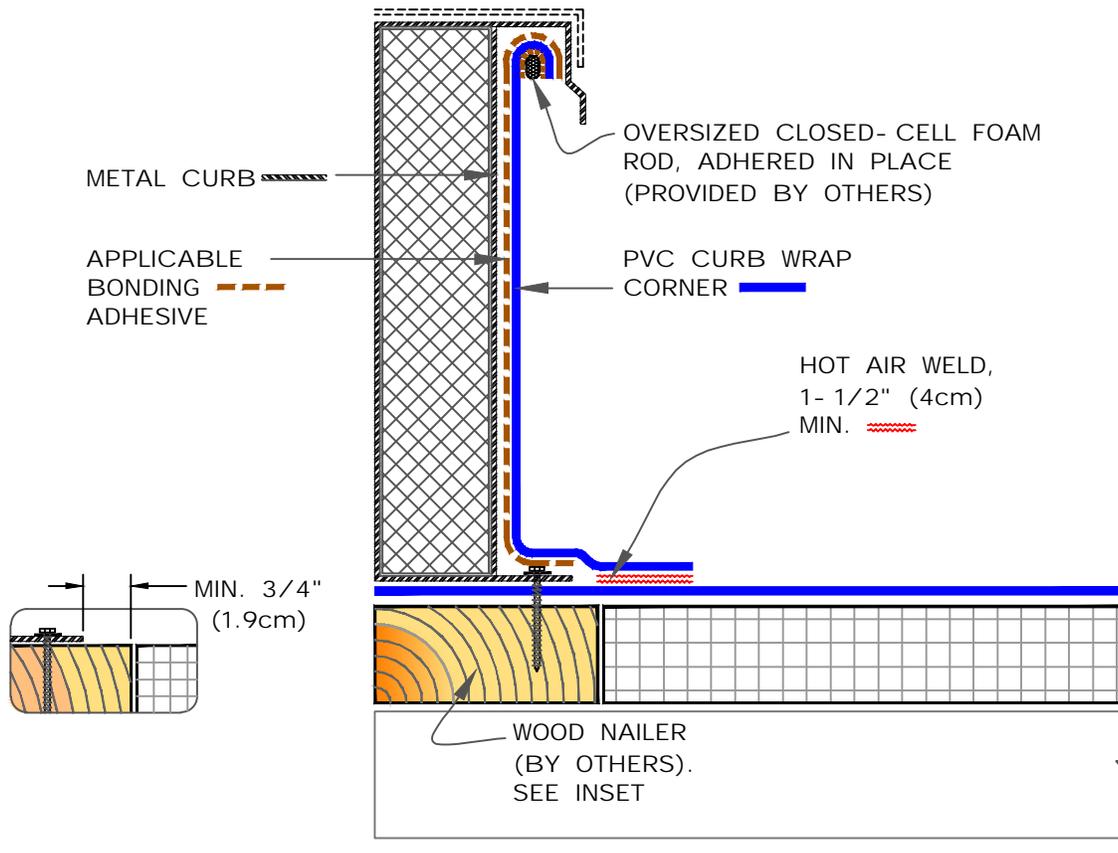



PVC ONLY (NOT KEE HP)  
 IN LIEU OF BONDING  
 ADHESIVE, THE CURB  
 FLASHING MAY BE INSTALLED  
 IN CAV GRIP PVC.

NOTES:

1. FOUR (4) CURB WRAP CORNERS WILL COMPLETELY FLASH A MAXIMUM CURB SIZE OF 3'X3' (90cmX 90cm). FOR LARGER CURBS USE THE PVC CURB WRAP CORNERS IN CONJUNCTION WITH ADDITIONAL SECTIONS OF PVC.
2. IF CURB WRAP CORNER IS NOT USED, THEN USE DETAIL [U-15G](#) FOR OUTSIDE CORNERS.
3. REFER TO CARLISLE SPECIFICATIONS FOR ACCEPTABLE CARLISLE FASTENERS AND PLATES.
4. CUSTOM SIZES ARE AVAILABLE FOR CURB FLASHING HEIGHTS GREATER THAN 12" (30cm).

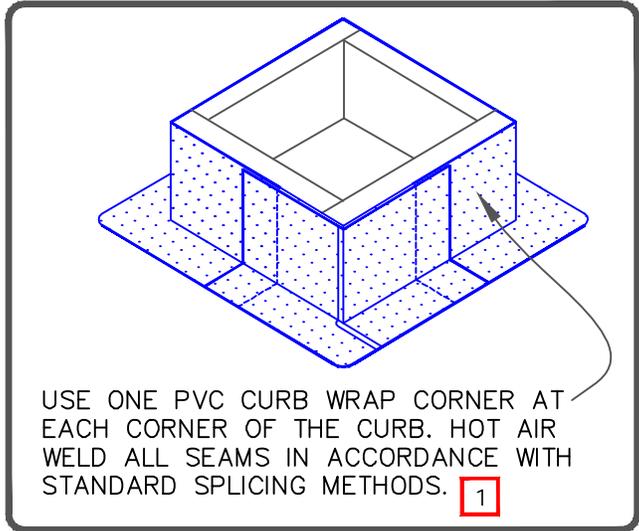


	SELF-FLASHING CURB WITH CFA PVC CURB WRAP CORNERS		DETAIL NO.
	MAXIMUM WARRANTY: 30 YEARS		U- 5D
U (Universal Detail)			

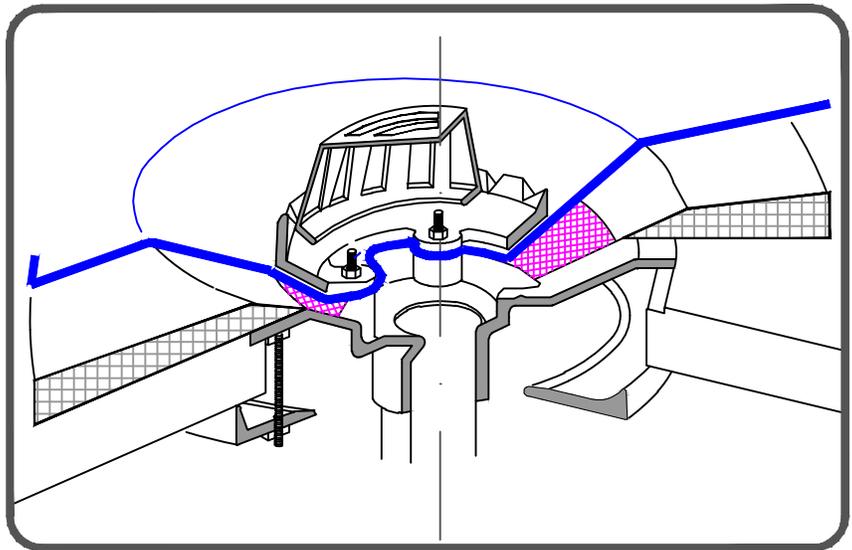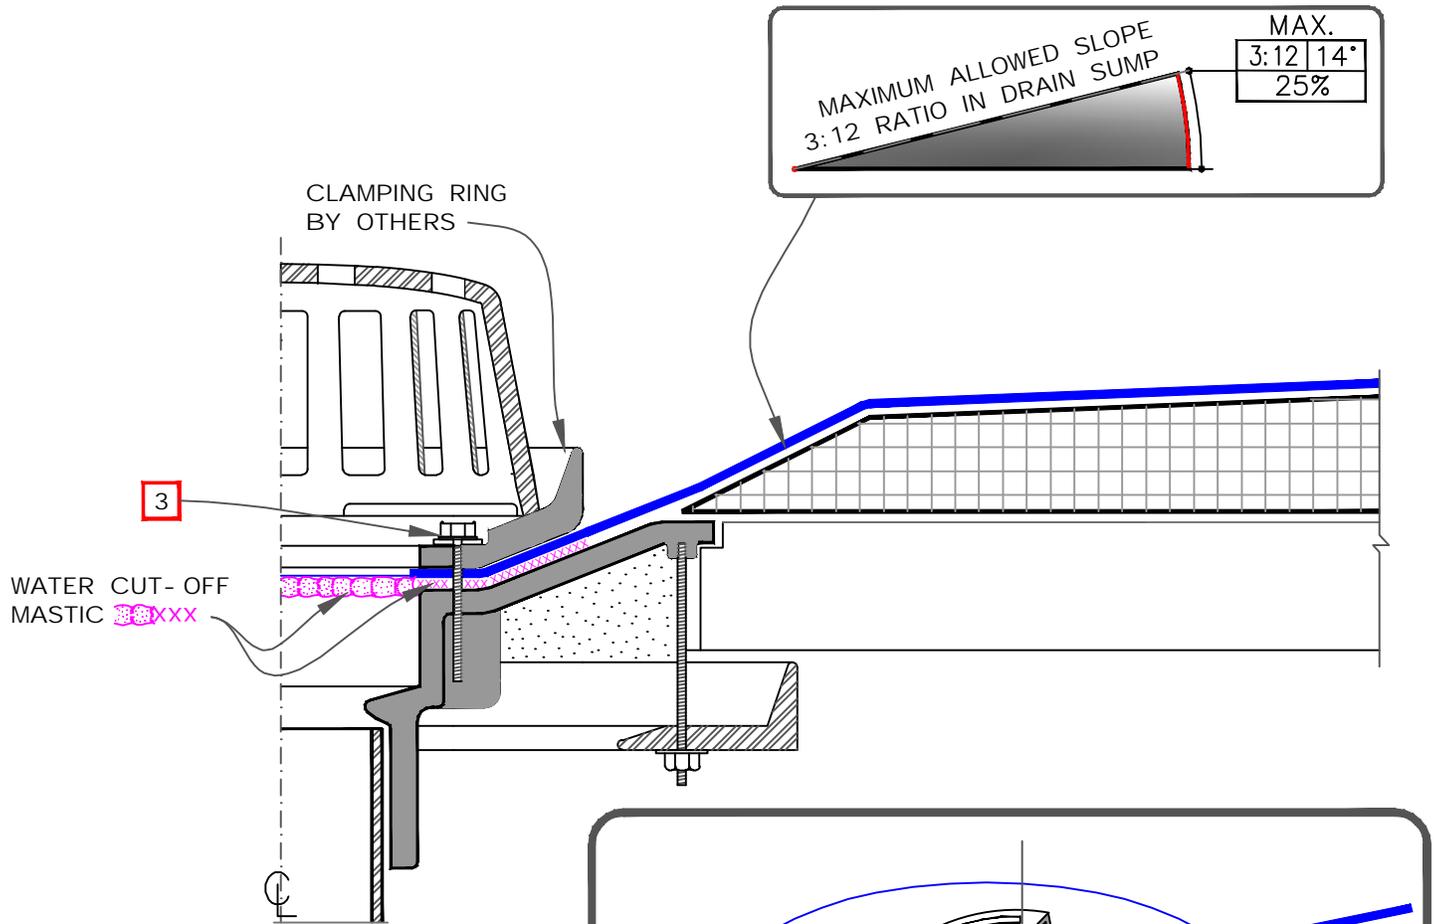

NOTES:

1. ROOF DRAIN SIZE AND NUMBER OF DRAINS SHALL BE IN ACCORDANCE WITH THE LOCAL CODES.
2. THE HOLE IN THE MEMBRANE SHALL EXCEED THE DIAMETER OF THE DRAIN PIPE, BUT SHALL BE NO LESS THAN 1/2" (1.5cm) FROM THE ATTACHMENT POINTS OF THE DRAIN CLAMPING RING.
3. ALL BOLTS OR CLAMPS MUST BE IN PLACE TO PROVIDE CONSTANT COMPRESSION ON WATER CUT-OFF MASTIC.
4. REMOVE EXISTING LEAD, FLASHING MATERIAL & ENSURE THE DRAIN RING IS COMPLETELY CLEAN DOWN TO BARE METAL.

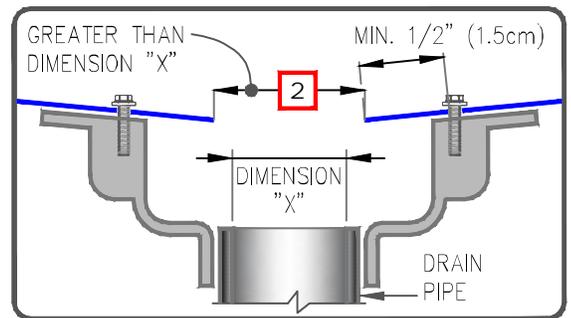

ROOF DRAIN: SUMP SLOPE LESS THAN 3" TO ONE HORIZONTAL FOOT


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.



U- 6A

U (Universal Detail)

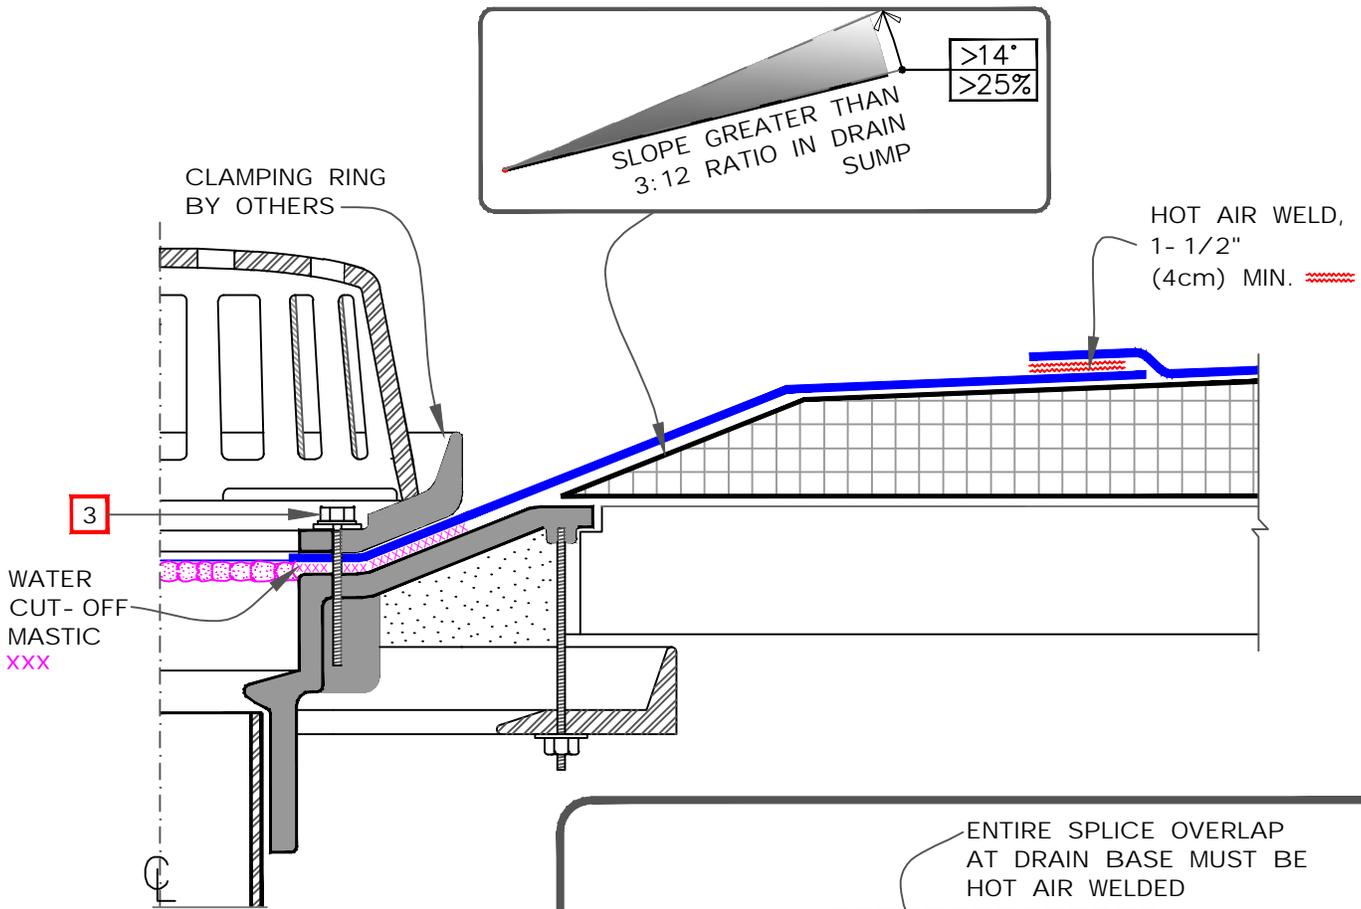

NOTES:

1. ROOF DRAIN SIZE AND NUMBER OF DRAINS SHALL BE IN ACCORDANCE WITH THE LOCAL CODES.
2. THE HOLE IN THE MEMBRANE SHALL EXCEED THE DIAMETER OF THE DRAIN PIPE, BUT SHALL BE NO LESS THAN 1/2" (1.5cm) FROM THE ATTACHMENT POINTS OF THE DRAIN CLAMPING RING.
3. ALL BOLTS OR CLAMPS MUST BE IN PLACE TO PROVIDE CONSTANT COMPRESSION ON WATER CUT-OFF MASTIC.
4. REMOVE EXISTING LEAD, FLASHING MATERIAL & ENSURE THE DRAIN RING IS COMPLETELY CLEAN DOWN TO BARE METAL.

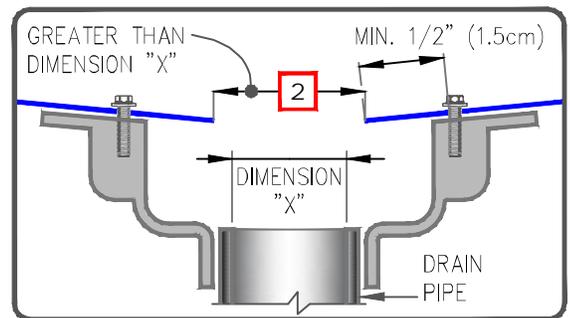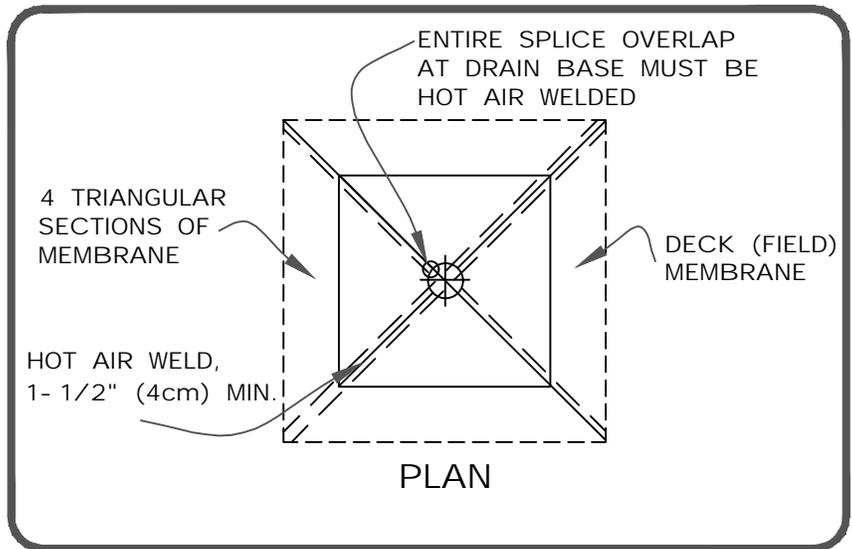

ROOF DRAIN: SUMP SLOPE GREATER THAN 3" TO ONE HORIZONTAL FOOT (OPTION 1)


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.


U- 6B

U (Universal Detail)

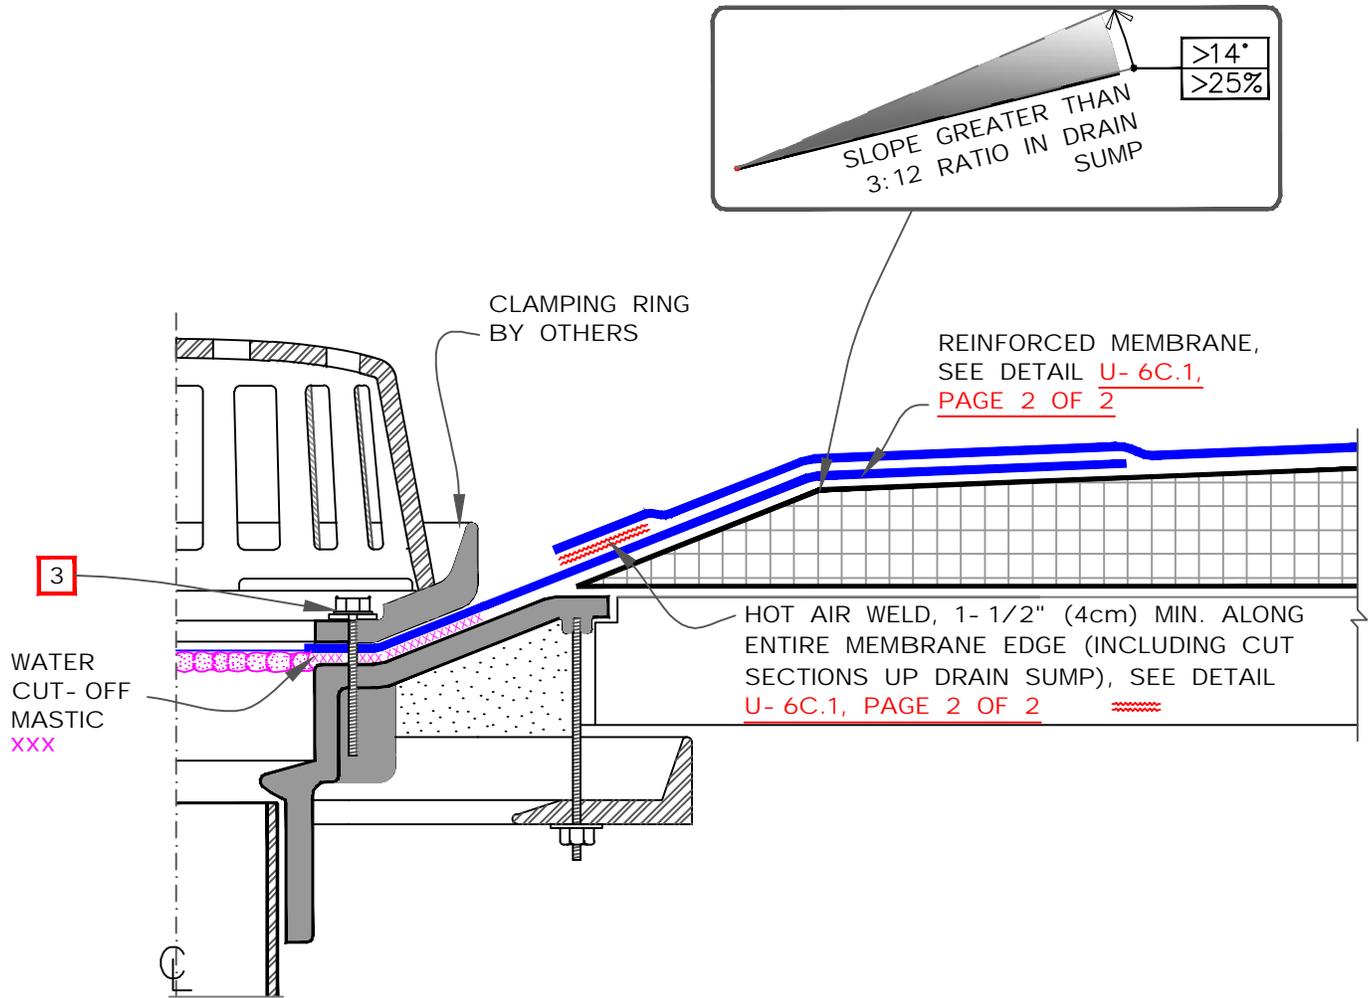

NOTES:

1. ROOF DRAIN SIZE AND NUMBER OF DRAINS SHALL BE IN ACCORDANCE WITH THE LOCAL CODES.
2. THE HOLE IN THE MEMBRANE SHALL EXCEED THE DIAMETER OF THE DRAIN PIPE, BUT SHALL BE NO LESS THAN 1/2" (1.5cm) FROM THE ATTACHMENT POINTS OF THE DRAIN CLAMPING RING.
3. ALL BOLTS OR CLAMPS MUST BE IN PLACE TO PROVIDE CONSTANT COMPRESSION ON WATER CUT-OFF MASTIC.
4. REMOVE EXISTING LEAD, FLASHING MATERIAL & ENSURE THE DRAIN RING IS COMPLETELY CLEAN DOWN TO BARE METAL.

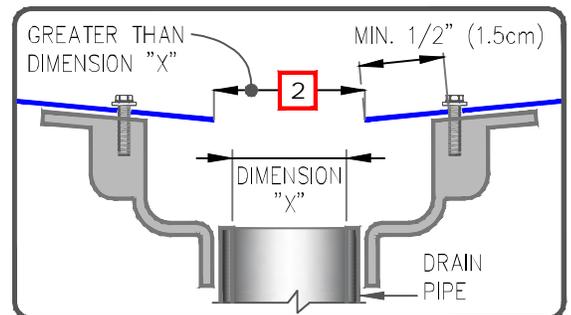

ROOF DRAIN: SUMP SLOPE GREATER THAN 3" TO ONE HORIZONTAL FOOT (OPTION 2), PAGE 1 OF 2



MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 6C



U (Universal Detail)

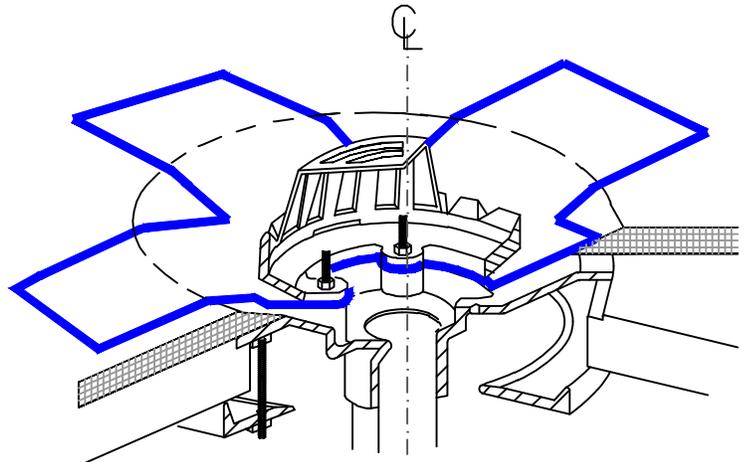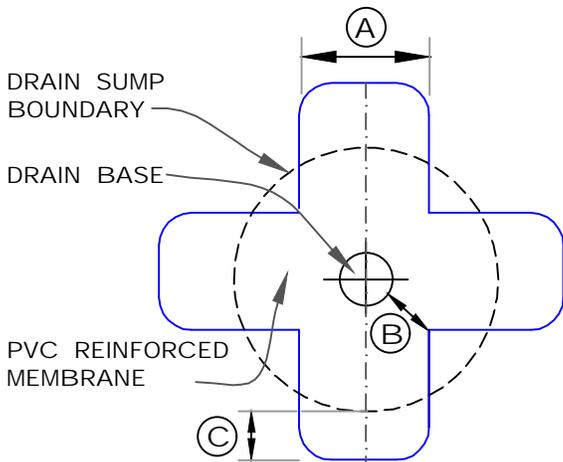

EXTEND PVC MEMBRANE ONTO MEMBRANE SECTION POSITIONED AT DRAIN SUMP AND CUT AS SHOWN TO LAY FLAT IN SUMP. HOT AIR WELD A MINIMUM OF 1- 1/2" (4cm) COMPLETELY SURROUNDING AREA.

CUT SECTION OF PVC REINFORCED MEMBRANE AS SHOWN AND POSITION INTO DRAIN SUMP. EXTEND MEMBRANE OUT OF DRAIN SUMP APPROXIMATELY 6" (15cm) (ROUND CORNERS).

DIMENSIONS		cm	
(A)	12"	30	MIN.
(B)	6"	15	MIN.
(C)	6"	15	APPROX.
(D)	3"	7.5	MIN.

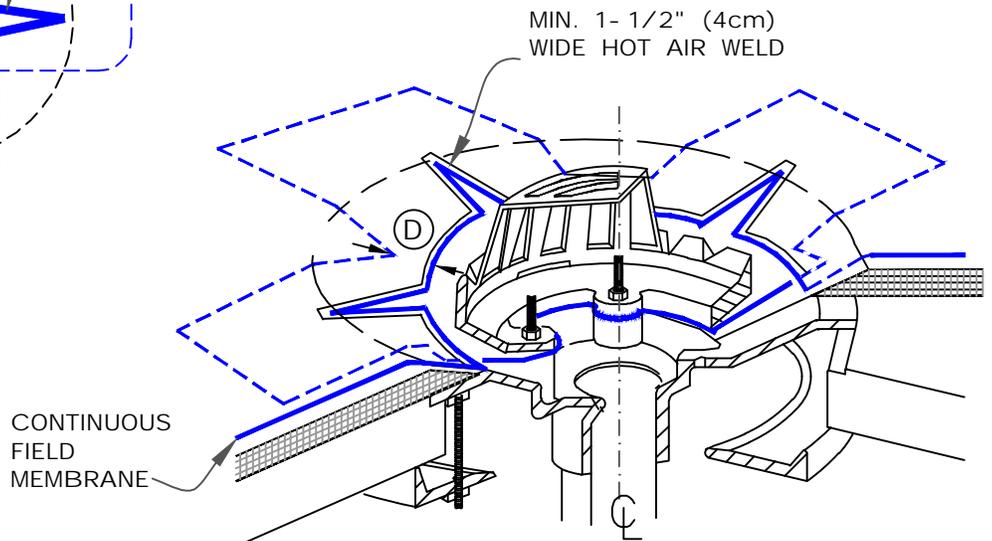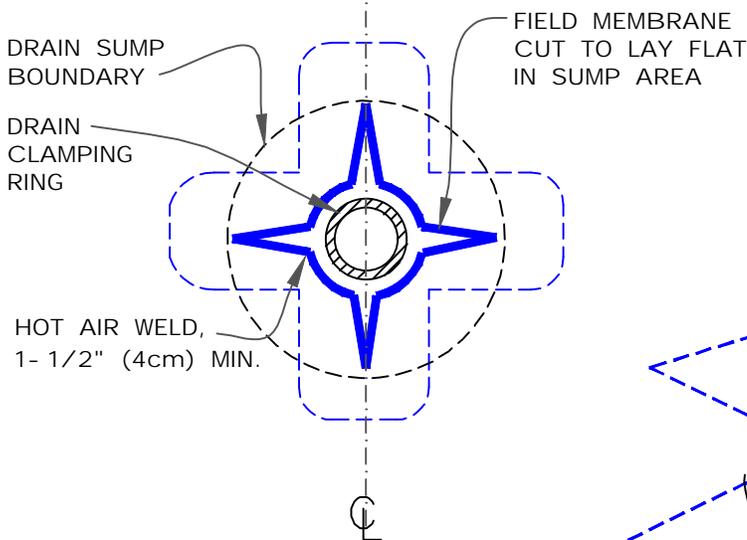

ROOF DRAIN: SUMP SLOPE GREATER THAN 3" TO ONE HORIZONTAL FOOT (OPTION 2), PAGE 2 OF 2


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.


U- 6C

U (Universal Detail)

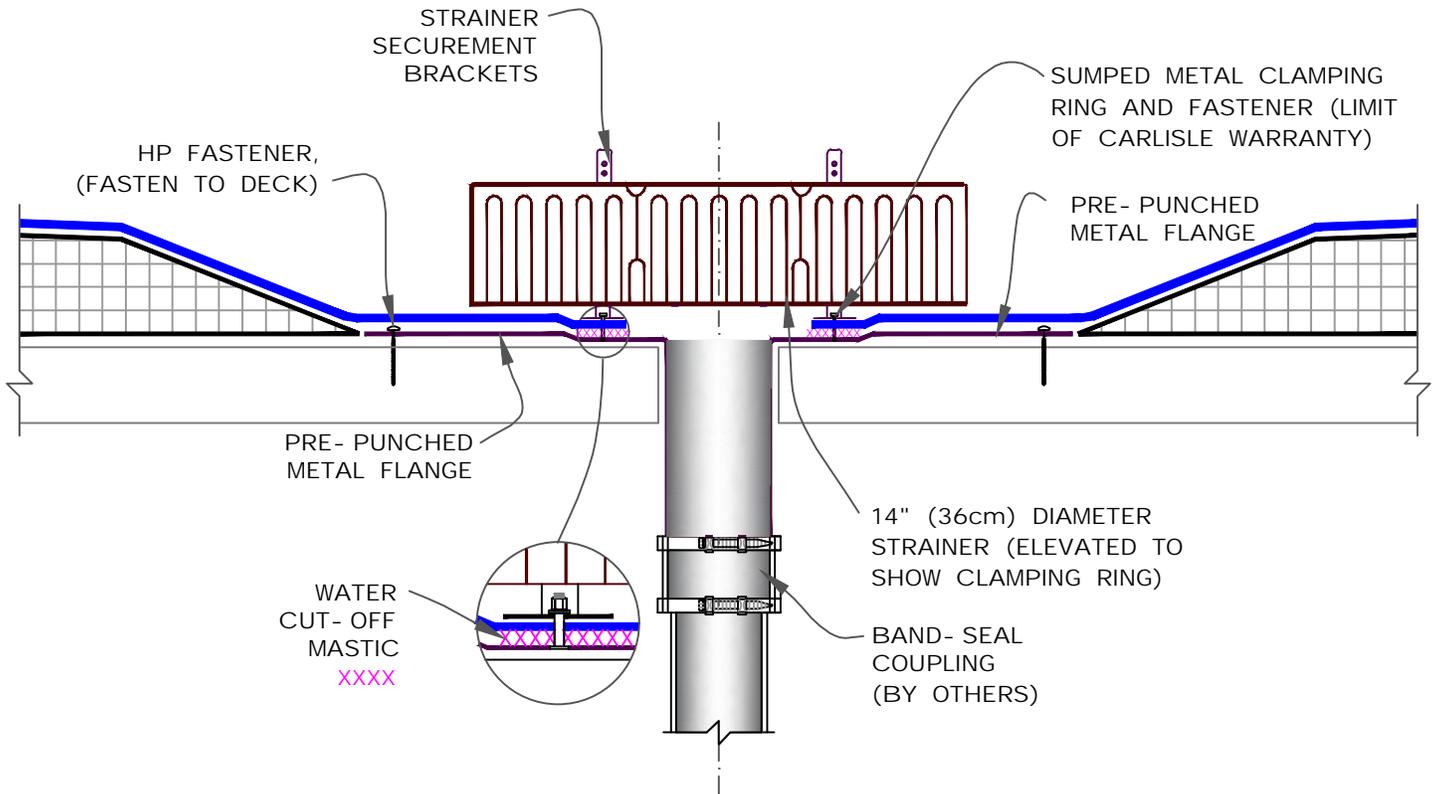

NOTES:

1. ROOF DRAIN SIZE AND NUMBER OF DRAINS SHALL BE IN ACCORDANCE WITH THE LOCAL CODES.
2. ALL BOLTS OR CLAMPS MUST BE IN PLACE TO PROVIDE CONSTANT COMPRESSION ON WATER CUT-OFF MASTIC.
3. THE HOLE IN THE MEMBRANE SHALL EXCEED THE DIAMETER OF THE DRAIN PIPE, BUT SHALL BE NO LESS THAN 1/2" (1.5cm) FROM THE ATTACHMENT POINTS OF THE DRAIN CLAMPING RING.
4. INSULATION TAPER SHALL NOT BE GREATER THAN 6" (15cm) IN 12" (30cm) HORIZONTAL.

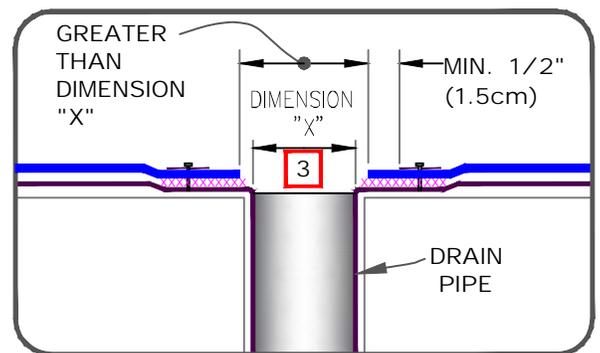

ADD-ON DRAIN


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 6D

U (Universal Detail)

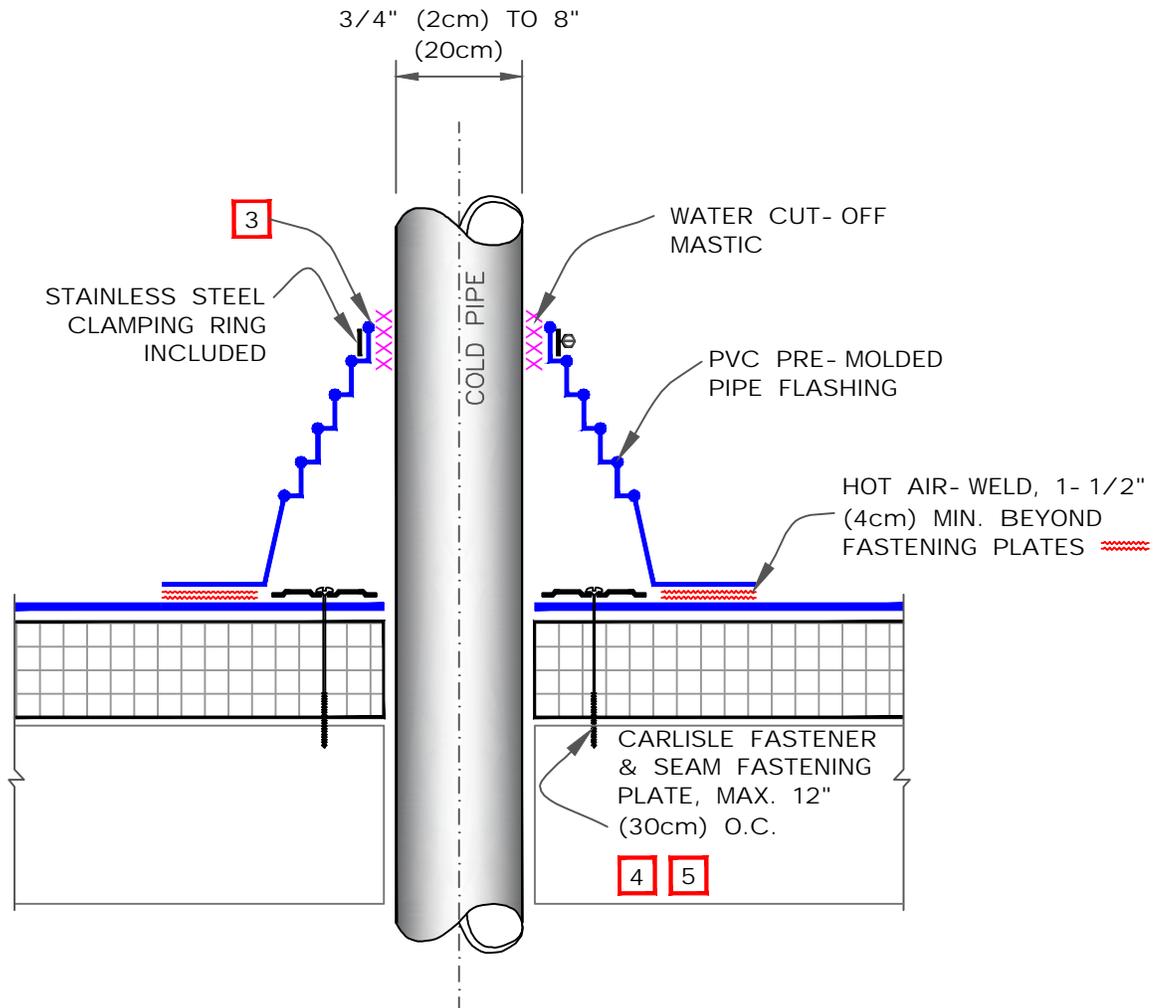

NOTES:


1. REMOVE ALL EXISTING LEAD AND FLASHING MATERIAL BEFORE INSTALLING PRE- MOLDED PIPE FLASHING.
2. TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 140° F (60° C).
3. PRE- MOLDED PIPE FLASHING MUST HAVE INTACT RIB AT THE TOP EDGE REGARDLESS OF PIPE DIAMETER.
4. INSTALL A MINIMUM OF 4 FASTENERS AND PLATES AROUND THE PIPE, EQUALLY SPACED. IF FASTENERS AND PLATES CANNOT BE INSTALLED AS SHOWN, THEY MAY ALSO BE POSITIONED OUTSIDE THE PIPE MAXIMUM 12" (30cm) O.C. AND FLASHED WITH PVC REINFORCED MEMBRANE / PVC CUT- EDGE SEALANT. REFER TO [DETAIL U8B](#).
5. FASTENERS AND PLATES ARE NOT REQUIRED ON ADHERED SYSTEMS UNLESS PIPE DIAMETER EXCEEDS 18" (46cm).

FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY			
DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP- X	PIRANHA
	B	HP- XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD- 10	PIRANHA
	B	HD 14- 10	PIRANHA

	PRE-MOLDED PIPE FLASHING		DETAIL NO.
	MAXIMUM WARRANTY: 30 YEARS		U- 8A
			U (Universal Detail)

CAUTION

DETAIL NOT FOR USE ON 25 OR 30-YEAR WARRANTY PROJECTS, PRE-FABRICATED/PRE-MOLDED ACCESSORIES MUST BE UTILIZED. ACCEPTABLE PIPE FLASHINGS SHALL CONFORM WITH PVC UNIVERSAL DETAILS [U-8A](#), [U-8E](#)

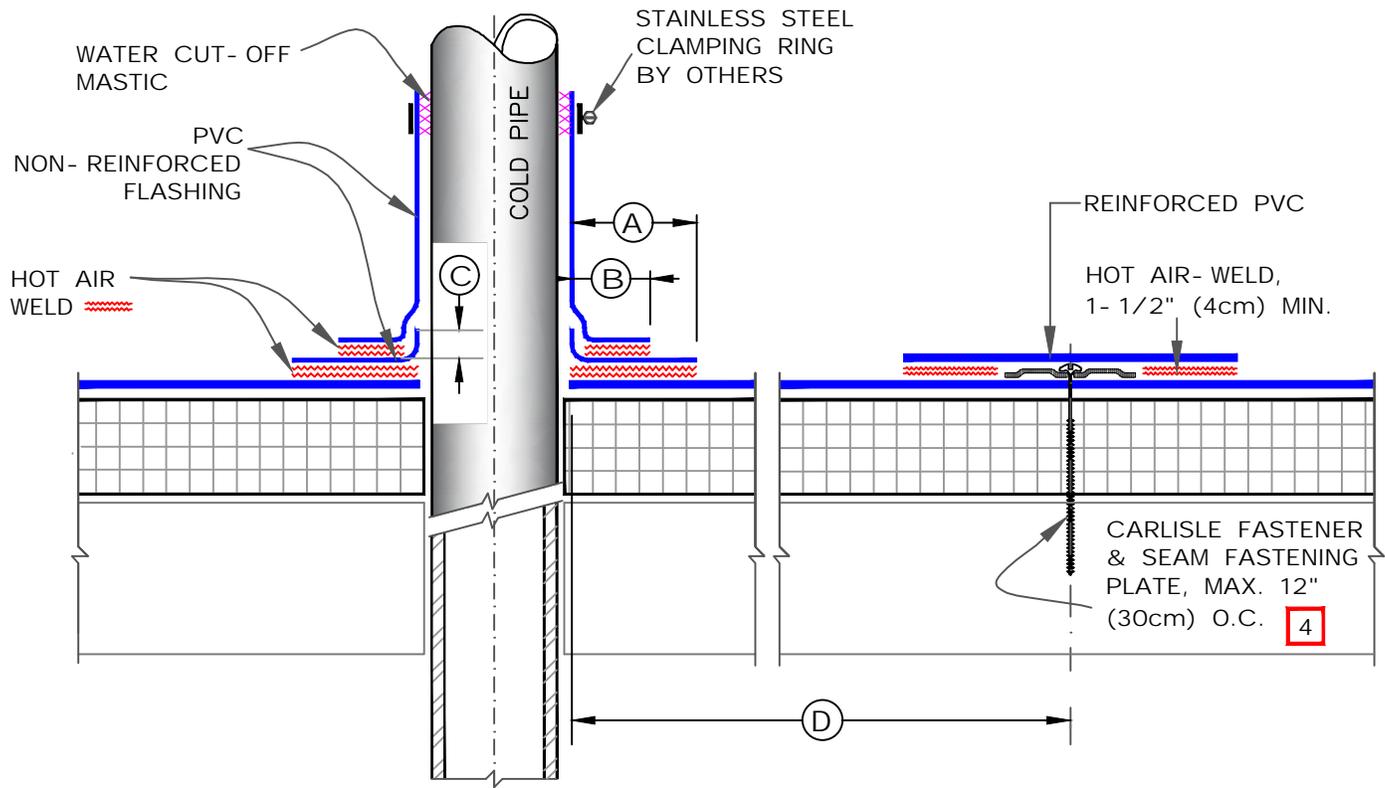

NOTES:

1. REMOVE ALL EXISTING LEAD AND FLASHING MATERIAL BEFORE INSTALLING FIELD FABRICATED PIPE FLASHING.
2. TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 140° F (60° C).
3. PVC NON-REINFORCED FLASHING WRAPPED AROUND PIPE SHALL HAVE MINIMUM 1- 1/2" (4cm) VERTICAL HOT AIR WELD. INSTALL A MINIMUM OF 4 SEAM FASTENING PLATES FOR PIPES WITH A DIAMETER UP TO 6" (15cm). ADDITIONAL SEAM FASTENING PLATES WILL BE REQUIRED FOR PIPES GREATER THAN 6" (15cm) IN DIAMETER AND SHALL BE SPACED 12" (30cm) ON CENTER MAXIMUM.
4. FASTENERS/PLATES ARE NOT REQUIRED ON ADHERED SYSTEMS UNLESS PIPE DIAMETER EXCEEDS 18" (50cm).

DIMENSIONS	cm	
(A)	1- 1/2"	4 TO
	2"	5
(B)	1"	2.5 MIN.
(C)	1/2"	1.5 MIN.
(D)	12"	30 APPROX.

**FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY**

DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP- X	PIRANHA
	B	HP- XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD- 10	PIRANHA
	B	HD 14- 10	PIRANHA



FIELD-FABRICATED PIPE FLASHING


WARRANTY: SEE WARRANTY NOTE



DETAIL NO.

U- 8B

U (Universal Detail)

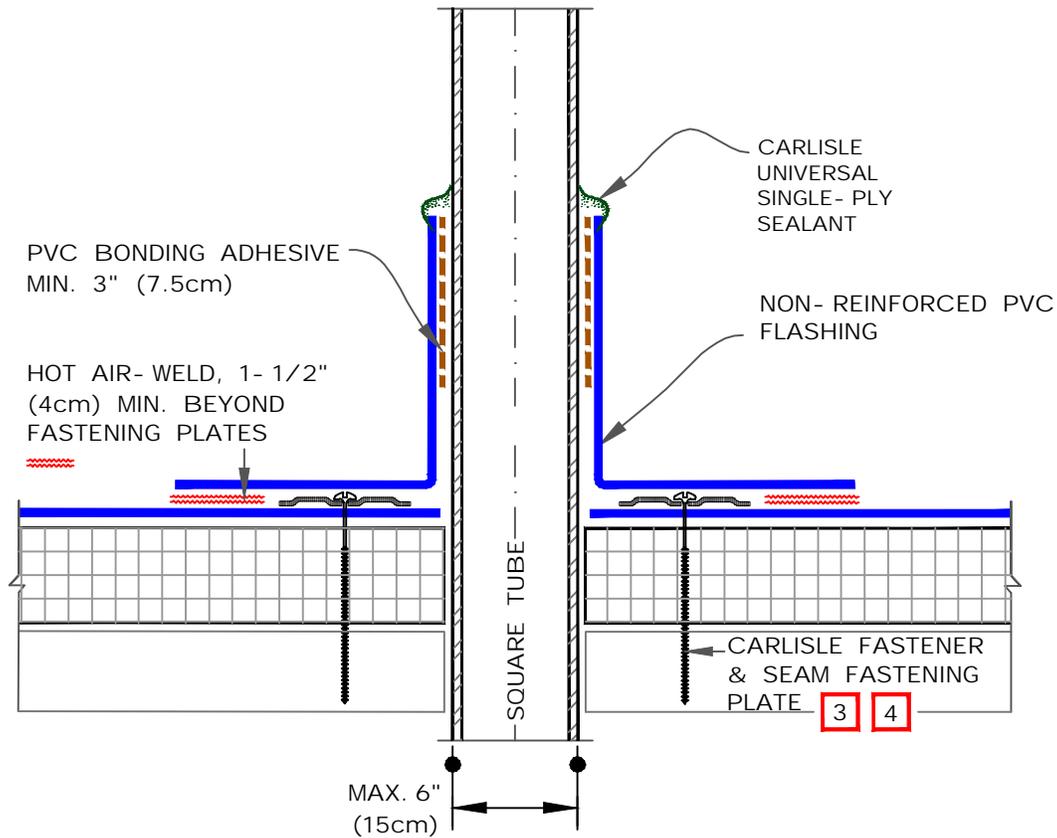


**FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY**

DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP- X	PIRANHA
	B	HP- XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD- 10	PIRANHA
	B	HD 14- 10	PIRANHA

NOTES:

1. REMOVE ALL EXISTING LEAD AND FLASHING MATERIAL BEFORE INSTALLING PRE- FABRICATED SQUARE TUBE WRAP.
2. TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 140° F (60° C).
3. INSTALL A MINIMUM OF 4 SEAM FASTENING PLATES FOR TUBE SIDE DIMENSIONS UP TO 6" (15cm).
4. FASTENERS AND PLATES ARE NOT REQUIRED ON ADHERED SYSTEM. SEE TABLE FOR MECHANICALLY FASTENED ROOF ASSEMBLY.

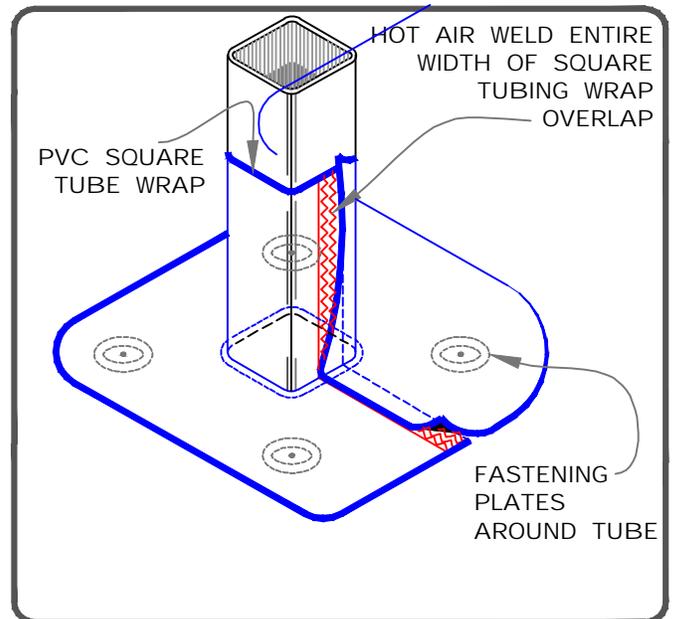

CFA CERTIFIED PRE-FABRICATED SQUARE TUBE WRAP

MAXIMUM WARRANTY: 30 YEARS




DETAIL NO.

U- 8C

U (Universal Detail)

DIMENSIONS		cm	
(A)	6"	15	MAX.
(B)	1- 1/2"	4	MIN.
(C)	1/2"	1.5	MIN.
(D)	1"	2.5	MIN.
(E)	12"	30	APPROX.

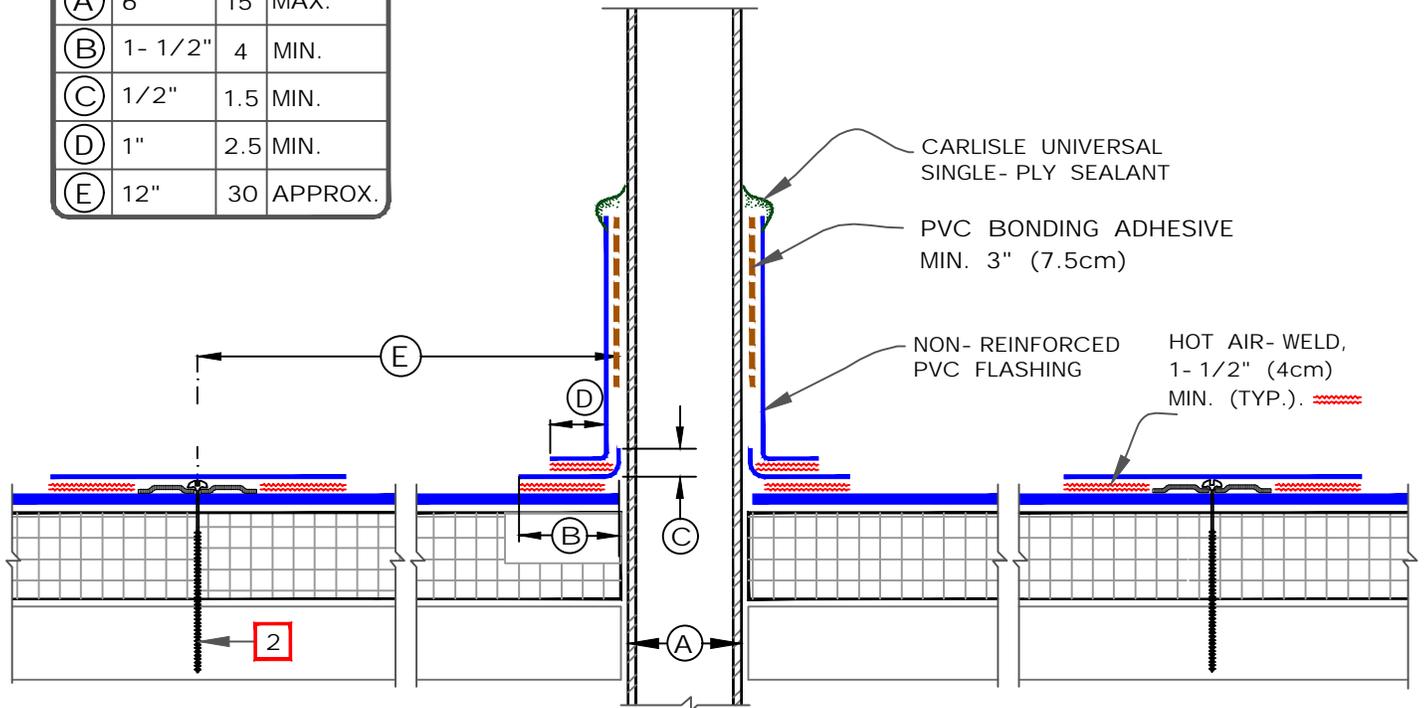


**FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY**


DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP- X	PIRANHA
	B	HP- XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD- 10	PIRANHA
	B	HD 14- 10	PIRANHA

**NOTES:**

1. REMOVE ALL EXISTING LEAD AND FLASHING MATERIAL BEFORE INSTALLING PRE- FABRICATED SQUARE TUBE WRAP.
2. CARLISLE FASTENERS & SEAM FASTENING PLATES FOR MECHANICALLY FASTENED SYSTEM (NOT REQUIRED ON ADHERED SYSTEM). SEE TABLE ABOVE.

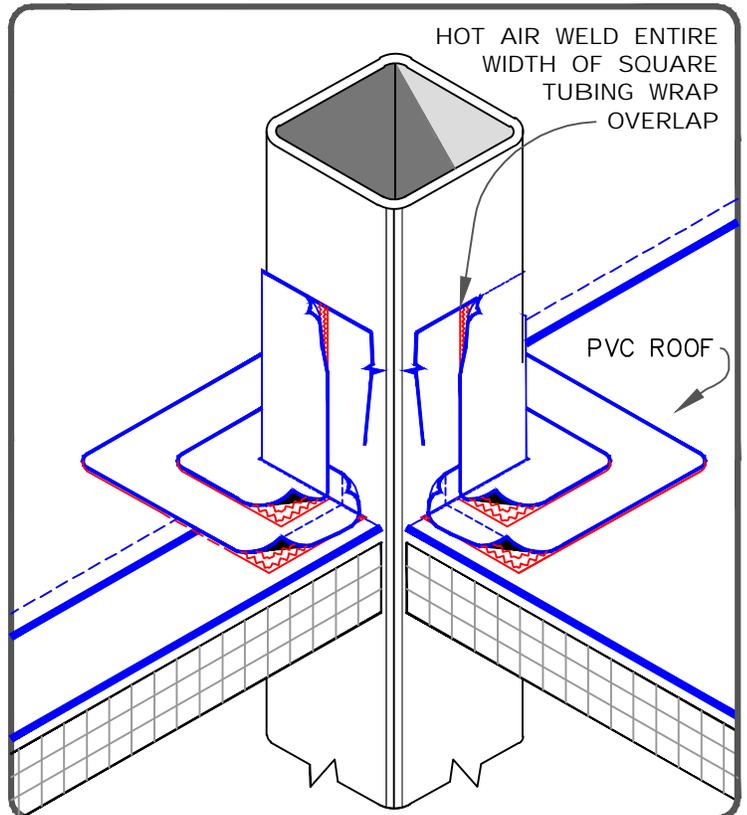

	FIELD-FABRICATED SQUARE TUBE FLASHING		DETAIL NO.
	MAXIMUM WARRANTY: 20 YEARS		U- 8D
		U (Universal Detail)	

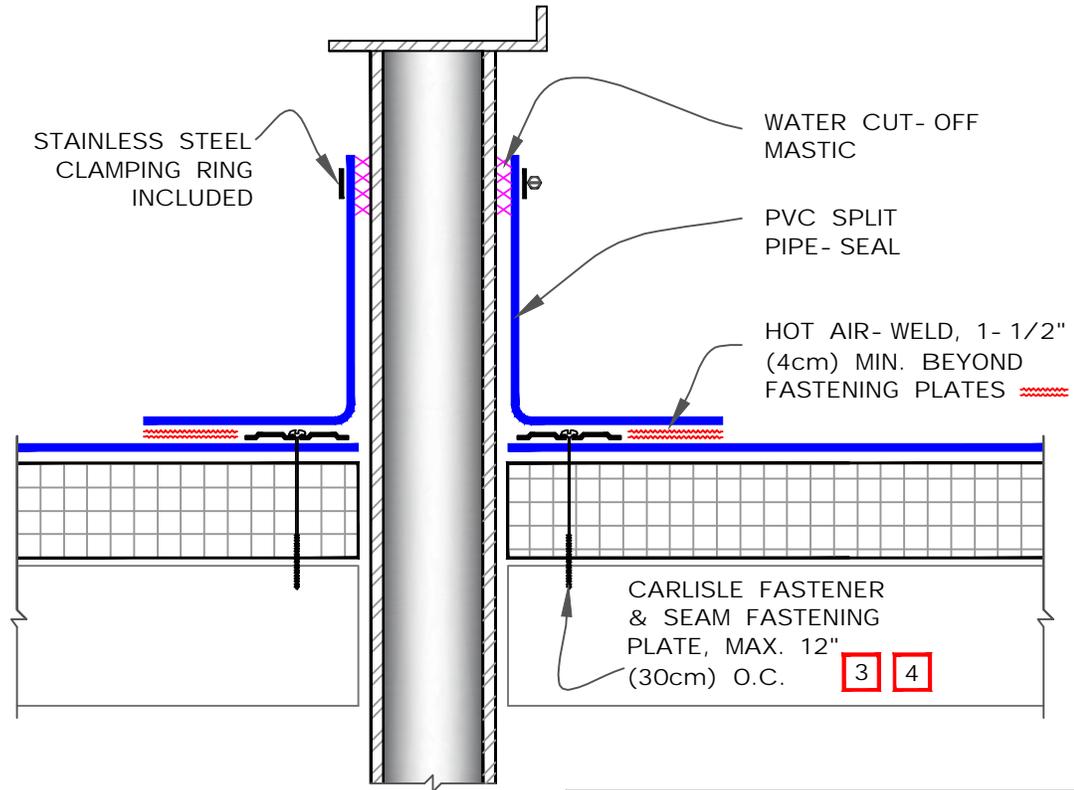


NOTES:

1. REMOVE ALL EXISTING LEAD AND FLASHING MATERIAL BEFORE INSTALLING SPLIT PIPE FLASHING.
2. TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 140° F (60° C).
3. INSTALL A MINIMUM OF 4 FASTENERS AND PLATES AROUND THE PIPE, EQUALLY SPACED. IF FASTENERS AND PLATES CANNOT BE INSTALLED AS SHOWN, THEY MAY ALSO BE POSITIONED OUTSIDE THE PIPE MAXIMUM 12" (30cm) O.C. AND FLASHED WITH PVC REINFORCED MEMBRANE/CUT- EDGE SEALANT. REFER TO [DETAIL U- 8B](#).
4. FASTENERS AND PLATES ARE NOT REQUIRED ON ADHERED SYSTEMS UNLESS PIPE DIAMETER EXCEEDS 18" (46cm).
5. T- JOINT COVERS ARE NOT REQUIRED ON WHITE, TAN OR GRAY PREFABRICATED ACCESSORIES. FOR ALL ADDITIONAL COLORS IT IS REQUIRED TO COVER T- JOINTS.

**FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY**

DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP- X	PIRANHA
	B	HP- XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD- 10	PIRANHA
	B	HD 14- 10	PIRANHA

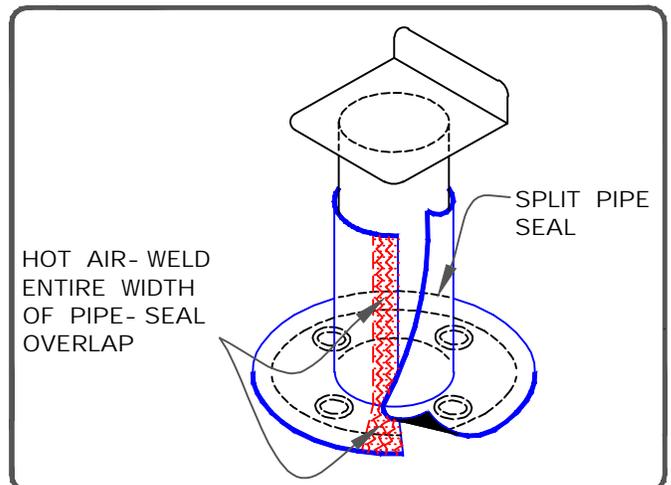

CFA CERTIFIED PRE-FABRICATED SPLIT PIPE SEAL


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 8E


U (Universal Detail)

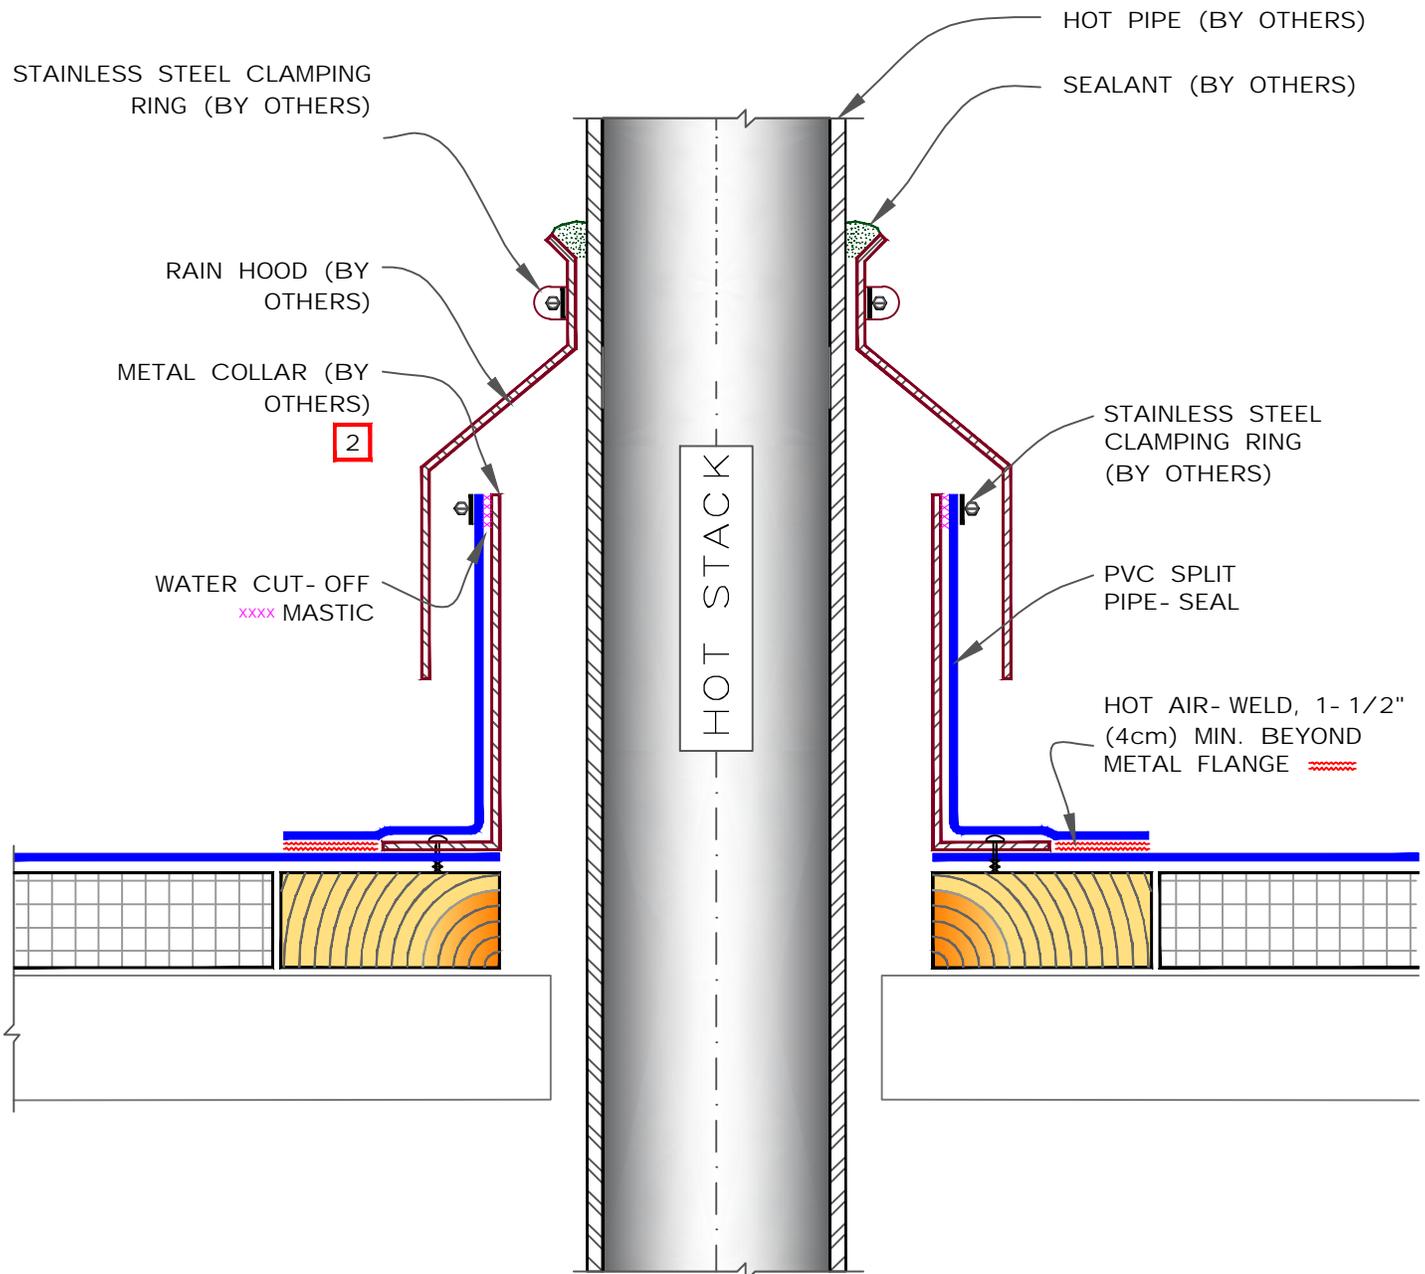

NOTES:

1. REMOVE ALL EXISTING LEAD AND FLASHING MATERIAL BEFORE INSTALLING PIPE FLASHING.
2. TEMPERATURE OF THE METAL COLLAR MUST NOT EXCEED 140° F (60° C).
3. ENSURE, NO HOT GASES OR STEAM LEAK OR INFILTRATE INTO ROOF ASSEMBLY.

	CFA CERTIFIED HOT PIPE FLASHING		DETAIL NO.
	MAXIMUM WARRANTY: 30 YEARS		U- 8F U (Universal Detail)

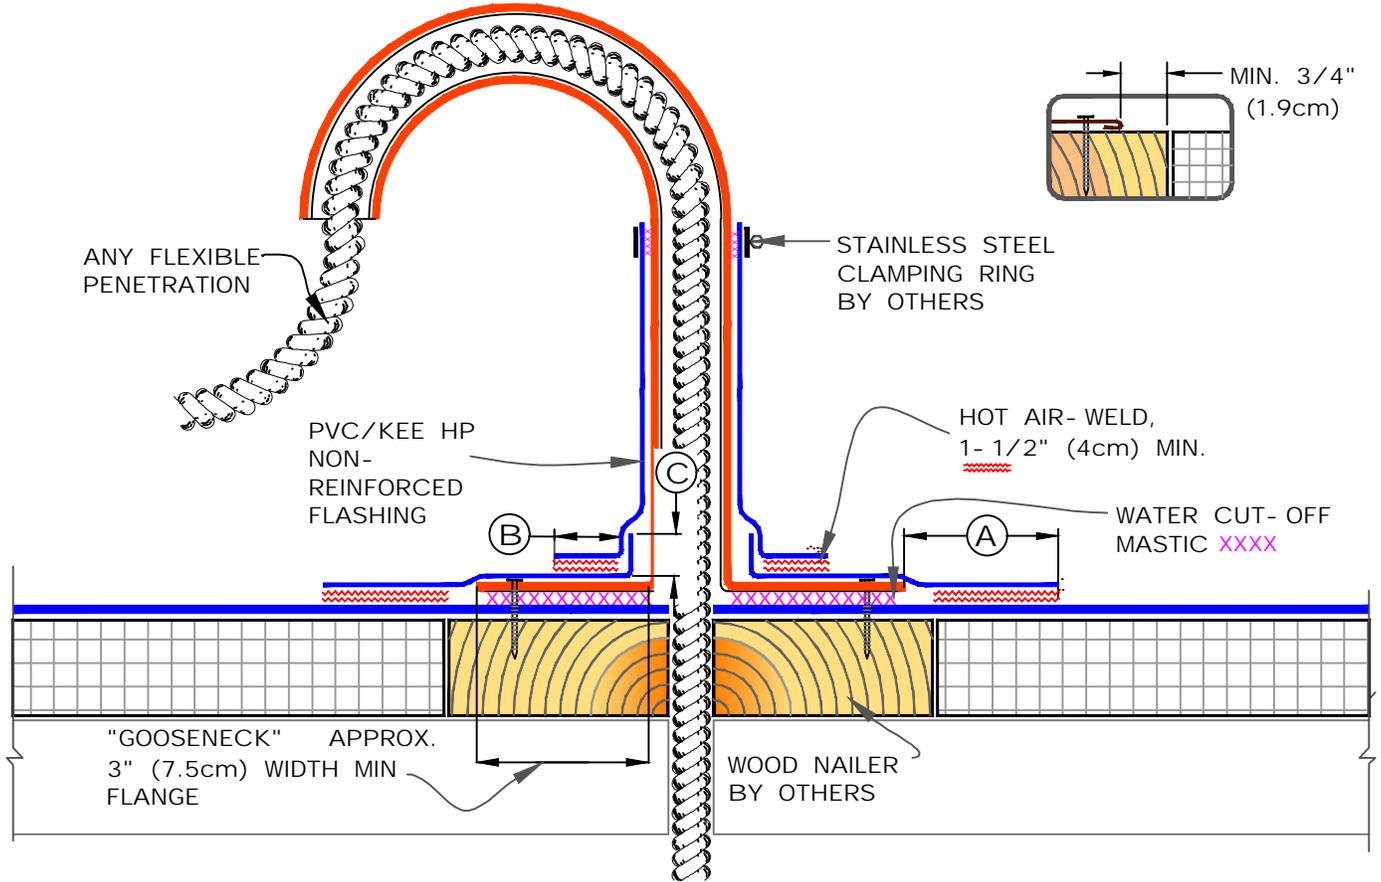


NOTES:

1. REMOVE ALL EXISTING LEAD AND FLASHING MATERIAL BEFORE INSTALLING FIELD FABRICATED PIPE FLASHING.
2. TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 160° F (71° C).
3. PVC/KEE HP NON- REINFORCED FLASHING WRAPPED AROUND PIPE SHALL HAVE MINIMUM 1- 1/2" (4cm) VERTICAL HOT AIR WELD. INSTALL A MINIMUM OF 4 SEAM FASTENING PLATES FOR PIPES WITH A DIAMETER UP TO 6" (15cm). ADDITIONAL SEAM FASTENING PLATES WILL BE REQUIRED FOR PIPES GREATER THAN 6" (15cm) IN DIAMETER AND SHALL BE SPACED 12" (30cm) ON CENTER MAXIMUM.
4. FASTENERS/PLATES ARE NOT REQUIRED ON ADHERED SYSTEMS UNLESS PIPE DIAMETER EXCEEDS 18" (50cm).

DIMENSIONS		cm	
(A)	1- 1/2"	4	TO
	2"	5	
(B)	1"	2.5	MIN.
(C)	1/2"	1.5	MIN.


	FLEXIBLE PENETRATION MAXIMUM WARRANTY: 20 YEARS		DETAIL NO. <b>U- 8G</b>
		U (Universal Detail)	

**9A MECHANICAL TERMINATION WITH COUNTER FLASHING**

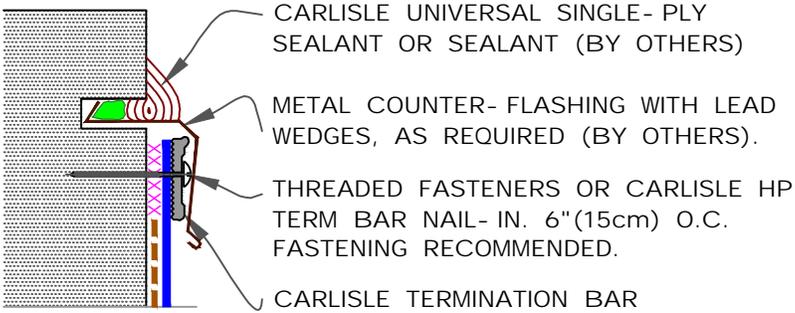


WARRANTY UP TO 30 YEARS SEE INSET A

**9B MECHANICAL TERMINATION**

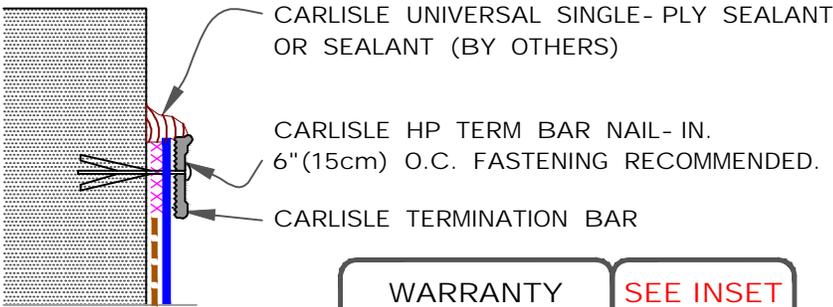

WARRANTY UP TO 20 YEARS SEE INSET A

**9C COUNTER FLASHING TERMINATION**

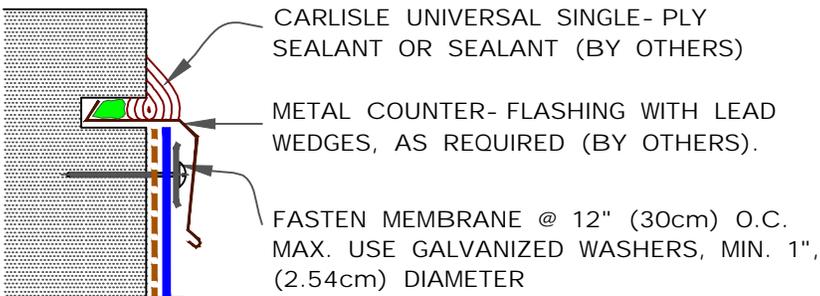

WARRANTY UP TO 10 YEARS

**INSET A**

MIN. 1/4" (1cm) MAX. 1/2" (1.5cm)

CORNER

NOTES:


1. APPLY ON HARD SMOOTH SURFACE ONLY; NOT FOR USE ON EXPOSED WOOD.
2. DO NOT WRAP TERMINATION BAR AROUND CORNERS.
3. DETAIL **9D** MUST BE USED AT VERTICAL JOINTS IN PANEL WALLS.

- NOTE:
1. WHEN MECHANICAL FASTENERS ARE USED TO PENETRATE THE METAL COUNTER-FLASHING, USE EPDM WASHERS, APPLY WATER CUT-OFF MASTIC UNDER THE COUNTER-FLASHING OR CAULK THE FASTENER HEADS.

--- APPLICABLE BONDING ADHESIVE      **xxx** WATER CUT-OFF MASTIC- MUST BE HELD UNDER CONSTANT COMPRESSION.

	MEMBRANE TERMINATIONS (PAGE 1 OF 3)		DETAIL NO.
	WARRANTY AS NOTES FOR EACH DETAIL		U-9 U (Universal Detail)

9D MECHANICAL TERMINATION AT VERTICAL JOINTS

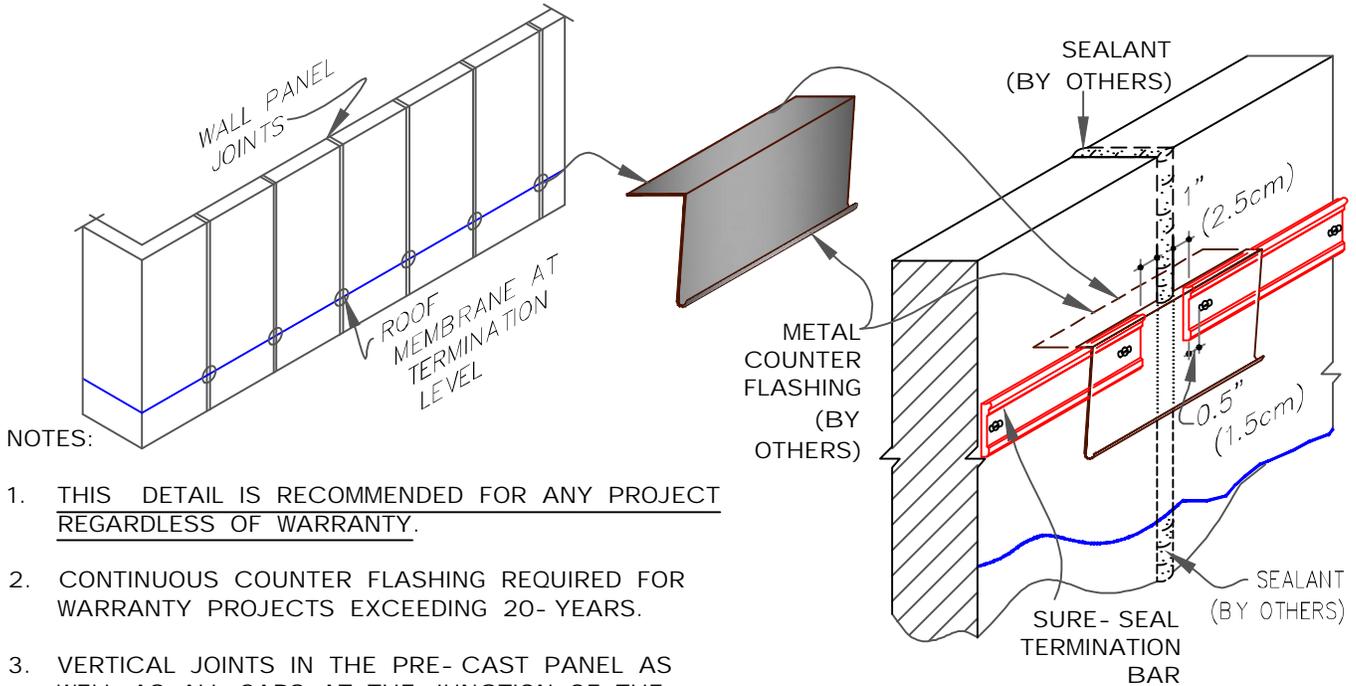


NOTES:

1. THIS DETAIL IS RECOMMENDED FOR ANY PROJECT REGARDLESS OF WARRANTY.
2. CONTINUOUS COUNTER FLASHING REQUIRED FOR WARRANTY PROJECTS EXCEEDING 20- YEARS.
3. VERTICAL JOINTS IN THE PRE- CAST PANEL AS WELL AS ALL GAPS AT THE JUNCTION OF THE TILT- UP PANEL AND ROOF DECK MUST BE FULLY SEALED TO PREVENT AIR INFILTRATION.
4. APPLY ON HARD SMOOTH SURFACE ONLY.

9E SecurEdge & SecurEdge 300 COPINGS

NOTES:

1. MEMBRANE MUST BE EXTENDED AT CORNERS TO PROVIDE COMPLETE COVERAGE OF THE TOP WALL SURFACE. REFER TO [3D DETAIL](#) ON [DETAIL U- 9F](#).
2. REFER TO [SecurEdge COPING INSTALLATION INSTRUCTION MANUAL](#) FOR STEP- BY- STEP INSTRUCTION PROCEDURES.

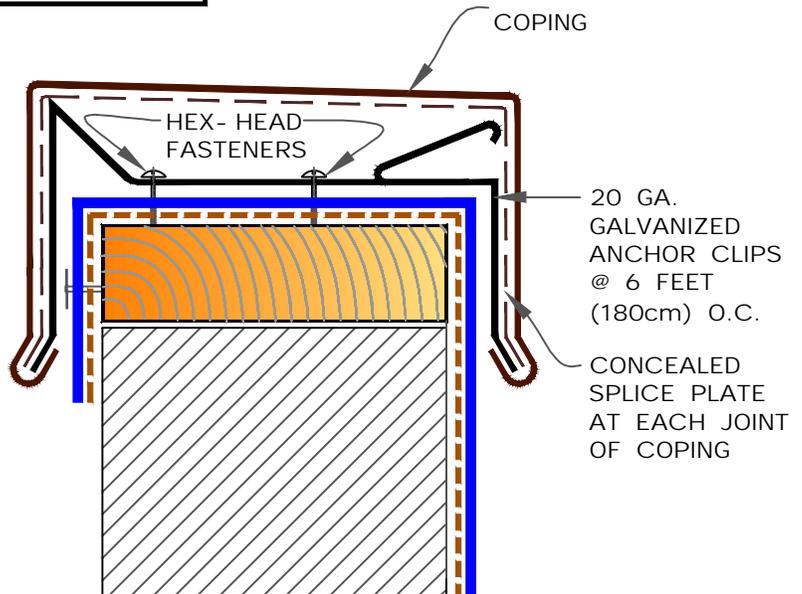

MAXIMUM WARRANTY: 30 YEARS

--- APPLICABLE BONDING ADHESIVE

xxx WATER CUT- OFF MASTIC- MUST BE HELD UNDER CONSTANT COMPRESSION.



MEMBRANE TERMINATIONS  
(PAGE 2 OF 3)

WARRANTY AS NOTES FOR EACH DETAIL





DETAIL NO.

U- 9

U (Universal Detail)


9F SHEET METAL COPING (BY OTHERS)

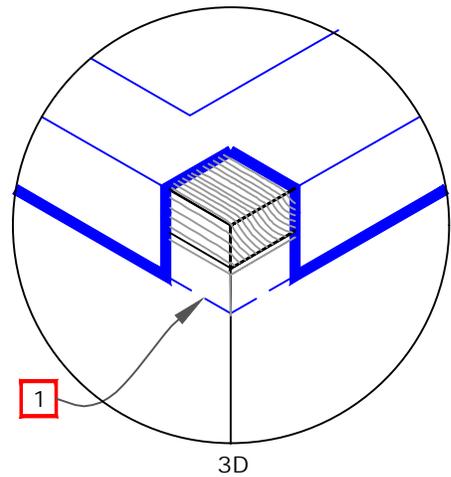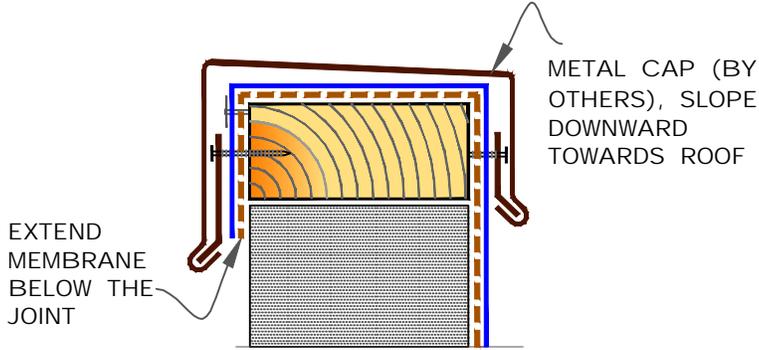

NOTES:

- MEMBRANE MUST BE EXTENDED TO CORNERS TO PROVIDE COMPLETE COVERAGE OF THE TOP WALL SURFACE.
- WARRANTY AS PROVIDED (BY OTHERS).

9G MASONRY COPINGS (BY OTHERS)

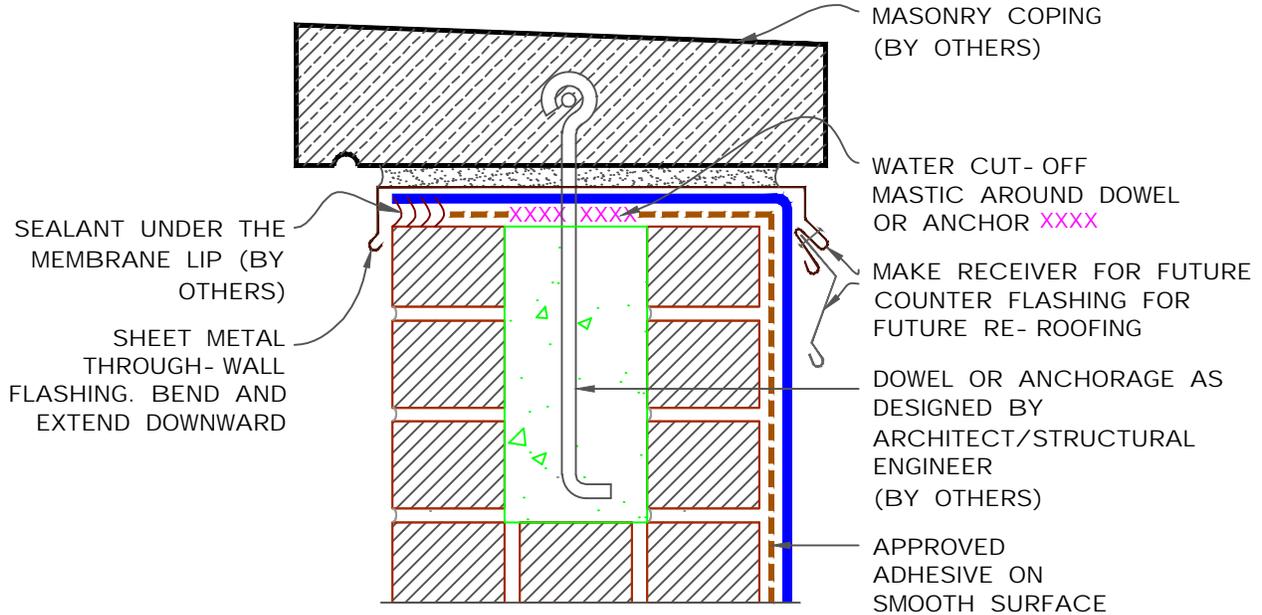

MAXIMUM WARRANTY: 30 YEARS

--- APPLICABLE BONDING ADHESIVE

XXX WATER CUT-OFF MASTIC- MUST BE HELD UNDER CONSTANT COMPRESSION.



MEMBRANE TERMINATIONS  
(PAGE 3 OF 3)

MAXIMUM WARRANTY: 30 YEARS




DETAIL NO.

U-9

U (Universal Detail)

**CAUTION** FASTENERS AND PLATES ARE REQUIRED AT 6" (15cm) O.C. FOR ALL SYSTEMS WITH WARRANTY WIND SPEED COVERAGE GREATER THAN 90 MPH AND FOR ALL PROJECTS WITH WARRANTIES GREATER THAN 20 YEARS.

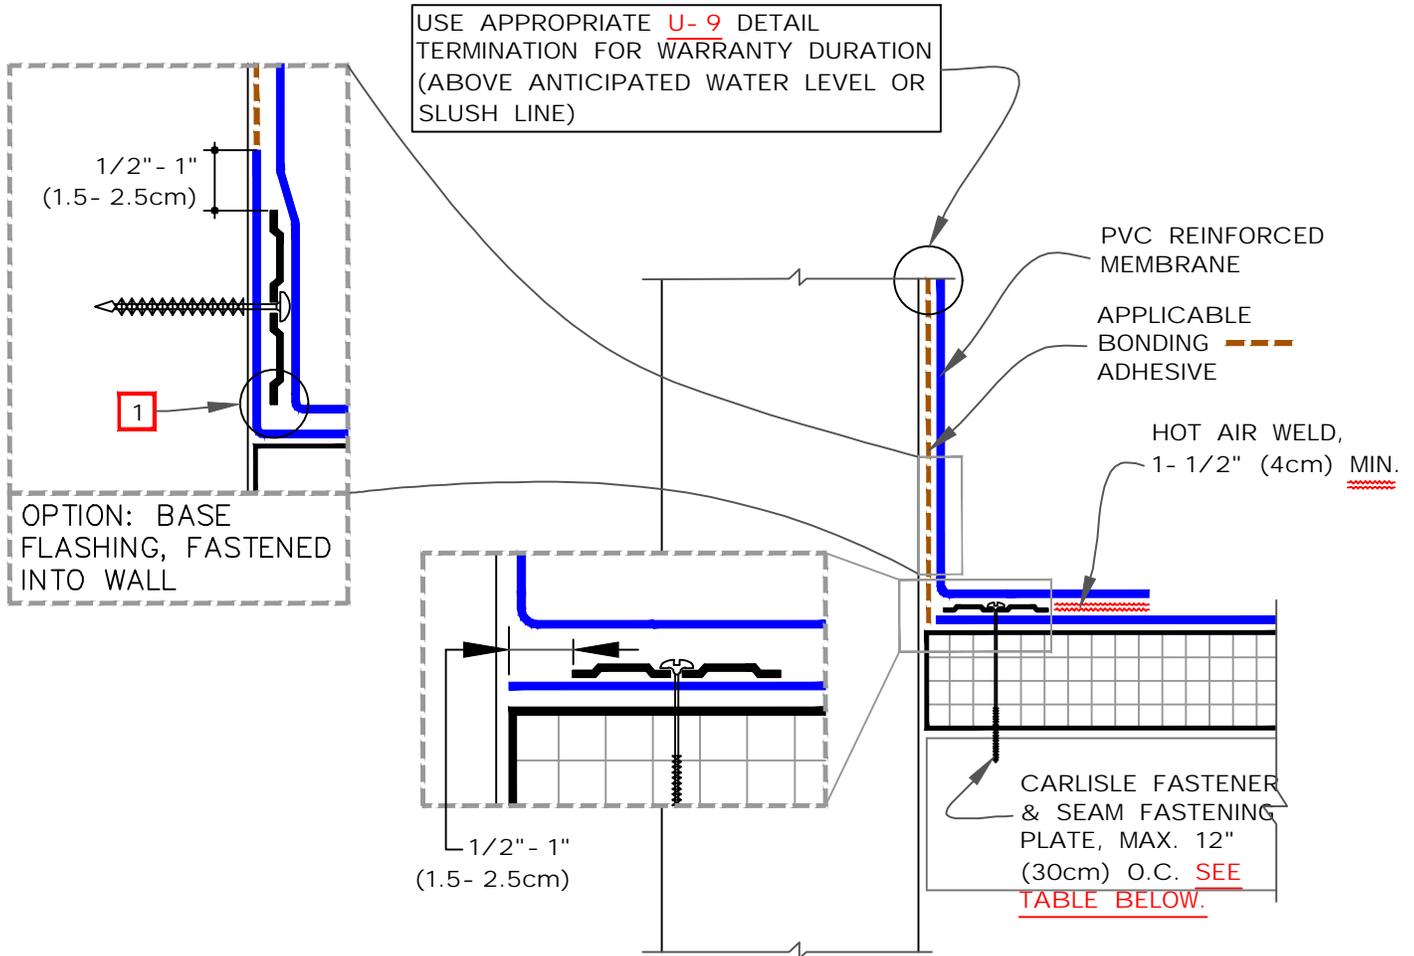

NOTE:

- CARE MUST BE TAKEN TO PRESS THE MEMBRANE TIGHTLY INTO THE ANGLE CHANGE. PLACING THE PLATES TIGHT INTO THE ANGLE CHANGE WILL HELP HOLD THE MEMBRANE IN THE PROPER POSITION.

**FASTENER TYPES ON MECHANICALLY FASTENED ROOF ASSEMBLY**

DECK TYPE	OPTION	FASTENER	PLATE
STEEL OR WOOD	A	HP- X	PIRANHA
	B	HP- XTRA	PIRANHA XTRA
STRUCTURAL CONCRETE	A	CD- 10	PIRANHA
	B	HD 14- 10	PIRANHA



PARAPET BASE FLASHING: FASTENED INTO DECK OR WALL


MAXIMUM WARRANTY: 30 YEARS. SEE CAUTION ON TOP OF PAGE.



DETAIL NO.

U- 12A

U (Universal Detail)

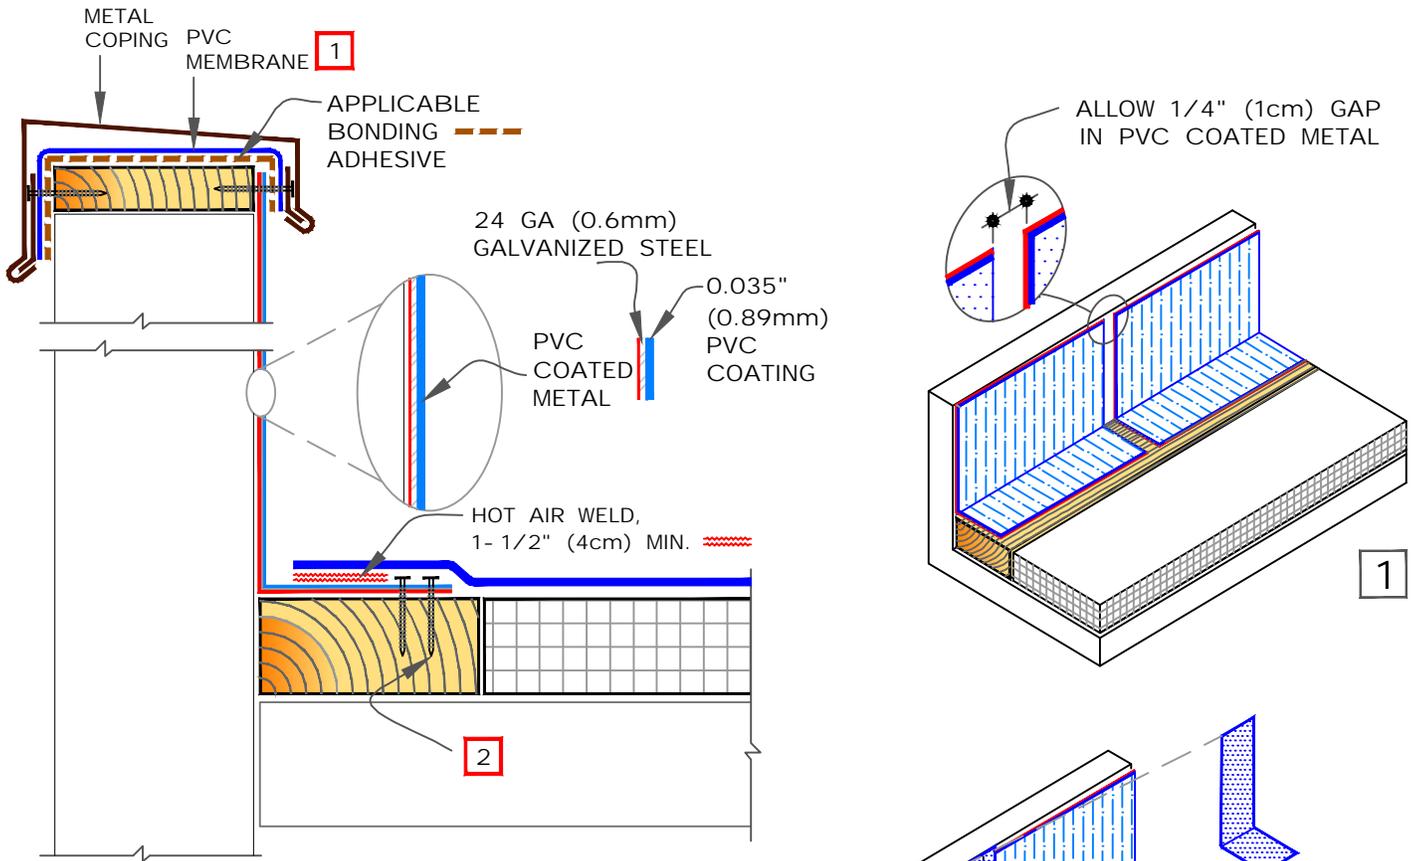

- SEQUENCE:**
1. 3" (7.6cm) REINFORCED MEMBRANE STRIPPING.
  2. FIELD MEMBRANE.
  3. TOP 6" (15.2cm) NON- REINFORCED MEMBRANE STRIPPING.

**NOTES:**

1. PLACE A LAYER OF PVC MEMBRANE UNDER THE METAL CAP TO PROTECT AGAINST MOISTURE INFILTRATION AT JOINTS.
2. FASTEN COATED METAL FLASHING TO WOOD NAILERS USING 1- 1/2" (4cm) MIN. RING SHANK NAILS SPACED 6" (15cm) ON CENTER AND STAGGERED APPROX. 1/2" (1.5cm).

HEAT WELD 3" (7.5cm) WIDE PIECE OF REINFORCED MEMBRANE CENTRALLY ALIGNED OVER JOINT

HEAT WELD 6" (15cm) WIDE PIECE OF NON-REINFORCED MEMBRANE CENTRALLY ALIGNED OVER JOINT, COVERING TOP OF FIELD MEMBRANE. SEE SEQUENCE IN TABLE.



PVC COATED METAL WALL FLASHING


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 12C

U (Universal Detail)

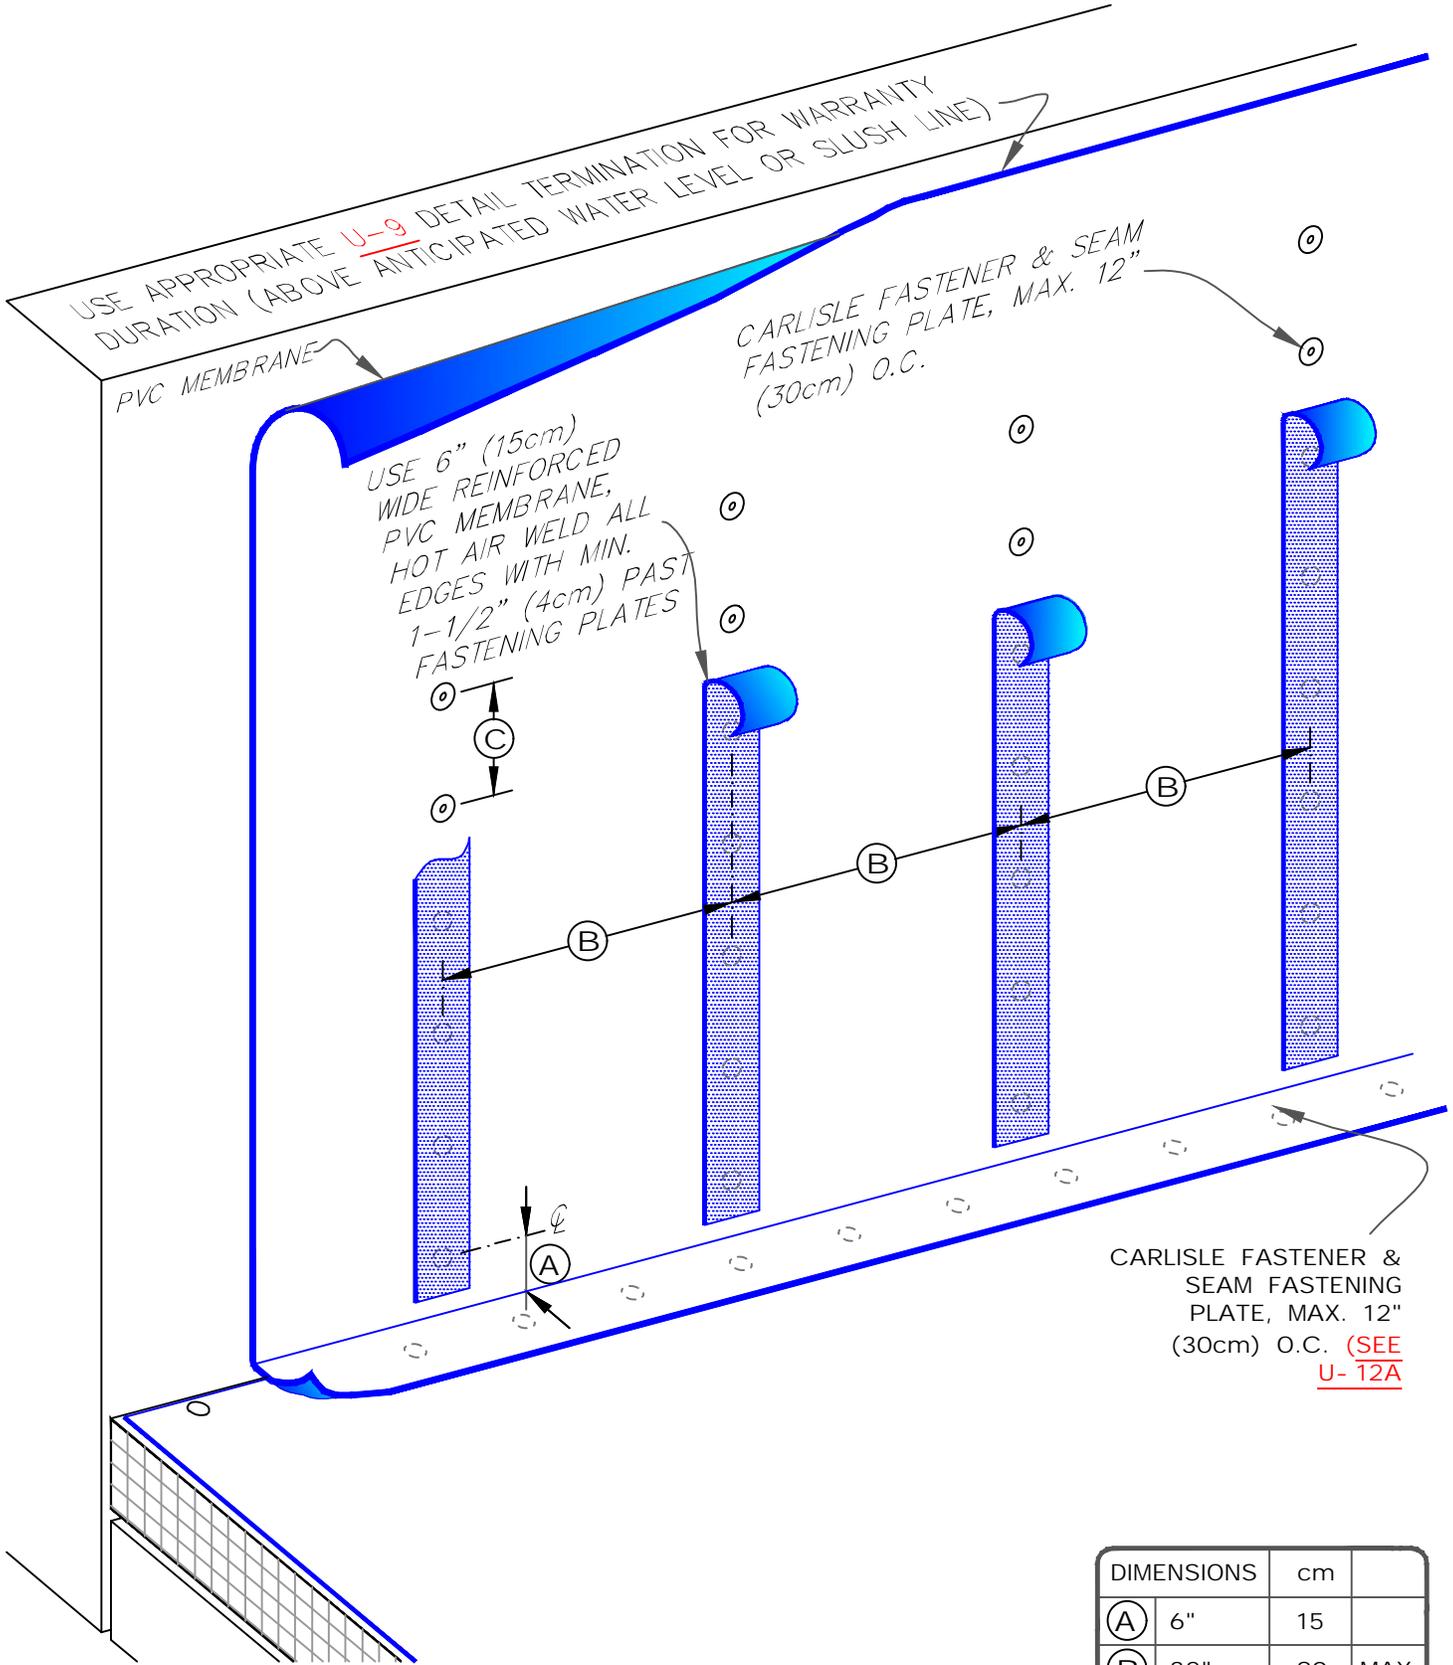


DIMENSIONS	cm	
(A)	6"	15
(B)	32"	80 MAX.
(C)	12"	30 MAX.



PARAPET FLASHING / NO ADHESION  
 - ANY HEIGHT OPTION  
 MAXIMUM WARRANTY: 30 YEARS

DETAIL NO.  
**U- 12F**  
 U (Universal Detail)

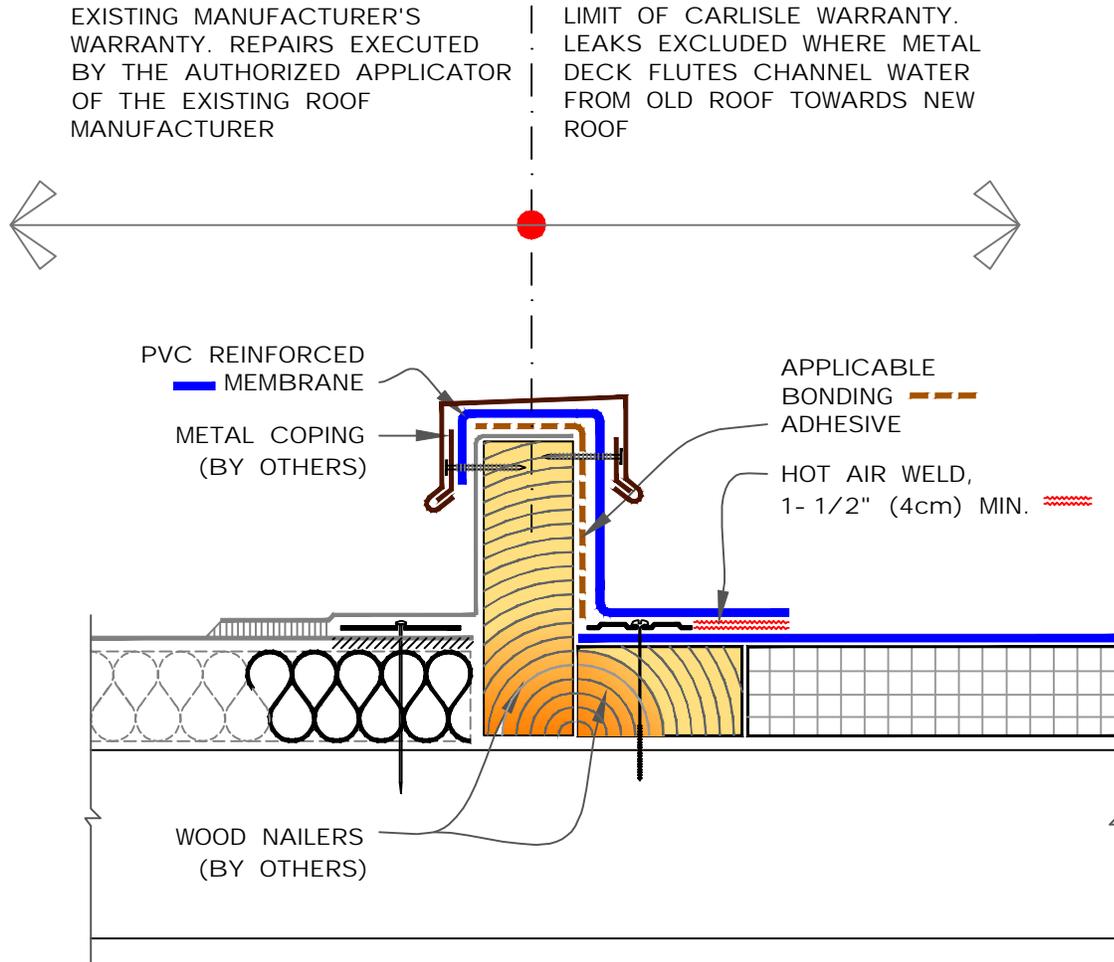

NOTES:

1. POSITION MEMBRANE FASTENING PLATES 1/2" (1.5cm) TO 1" (2.5cm) FROM EDGE OF DECK MEMBRANE.
2. ENSURE THE LOCATION OF CURB WILL NOT IMPEDE THE FLOW OF WATER AT EXISTING ADJACENT ROOF.

PVC ONLY (NOT KEE HP) IN LIEU OF BONDING ADHESIVE, THE CURB FLASHING MAY BE INSTALLED IN CAV GRIP PVC.



PVC TIE-IN TO EXISTING SINGLE PLY ROOF WITH CURB


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 13C


U (Universal Detail)

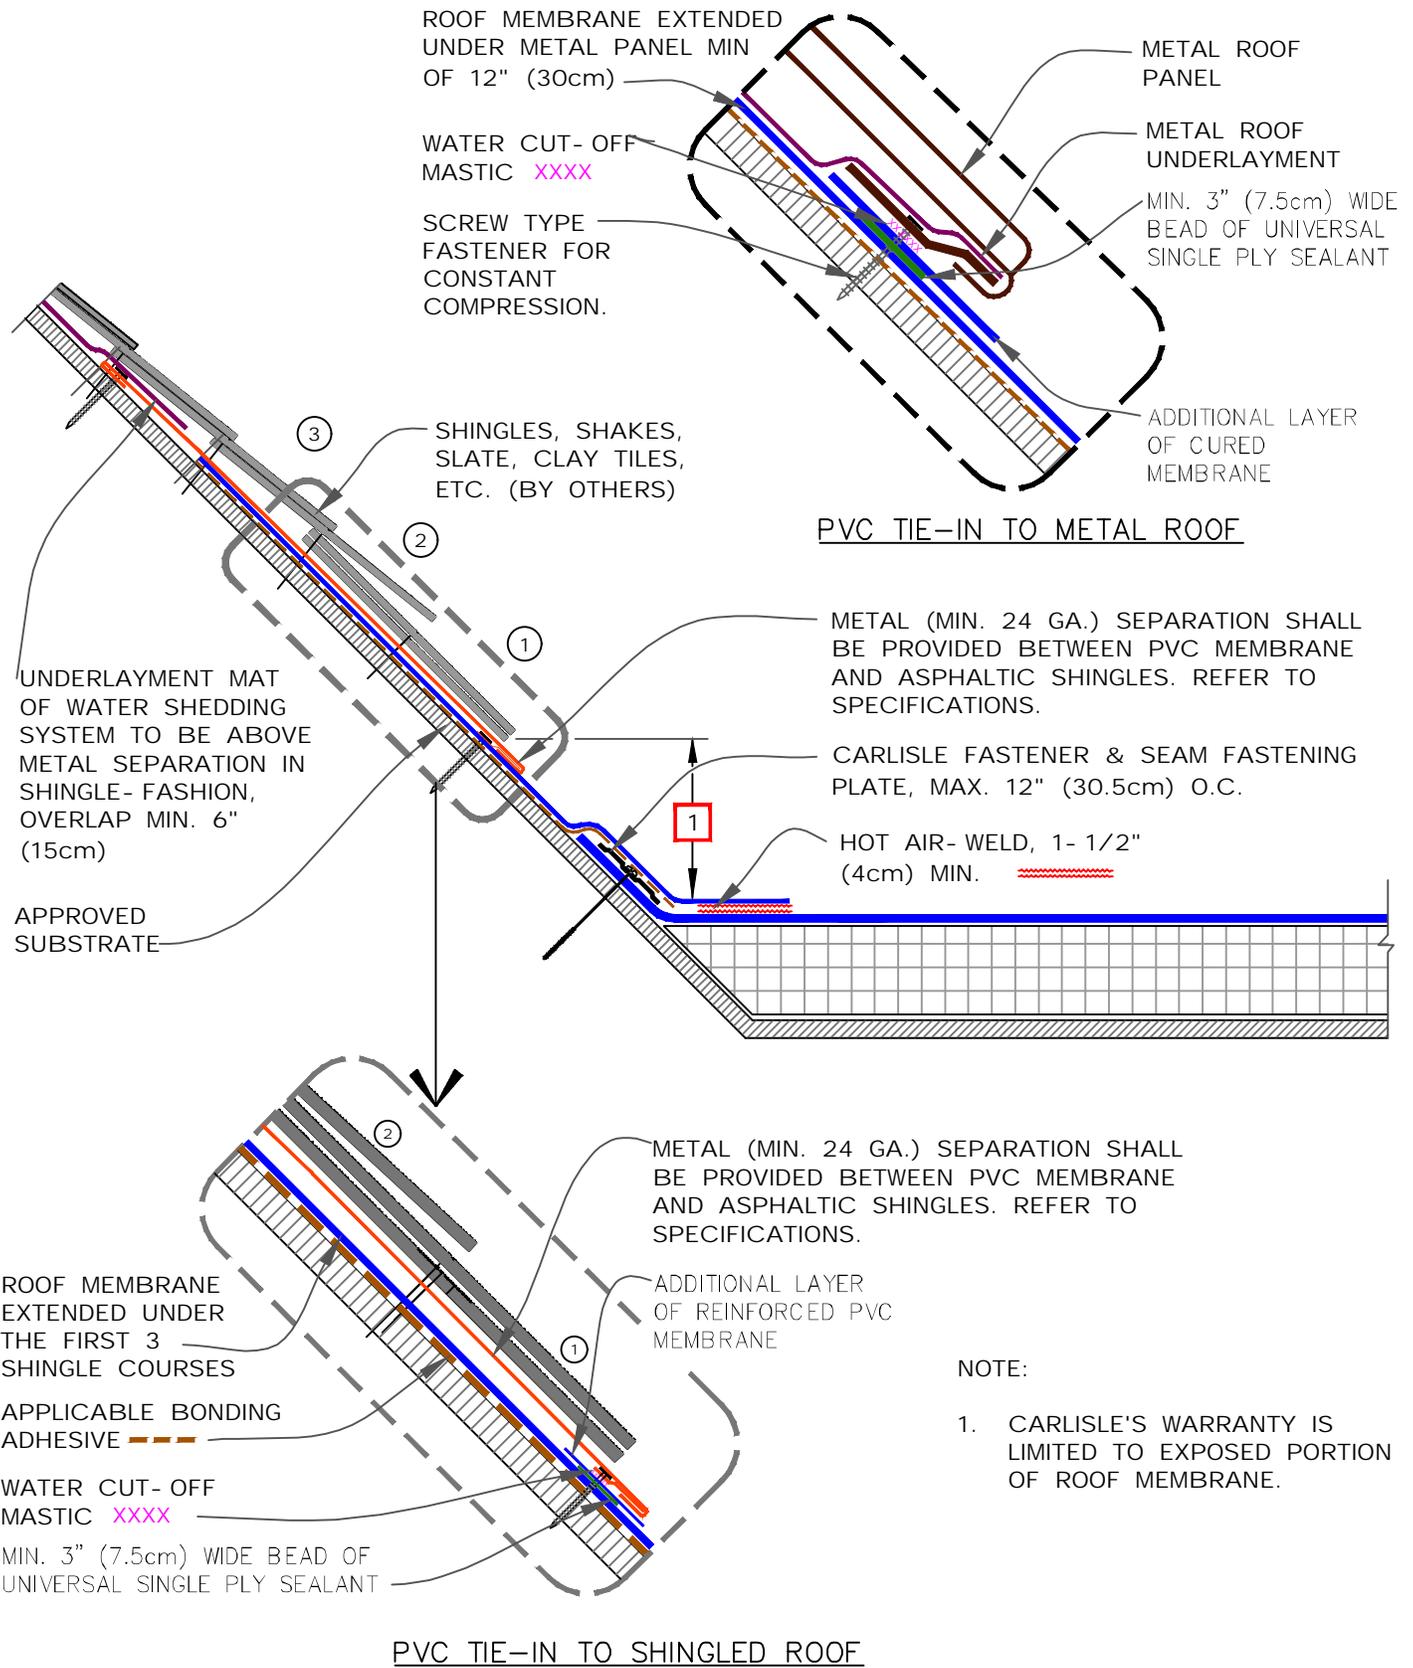

PVC TIE-IN TO SHINGLED OR METAL PANEL ROOF

MAXIMUM WARRANTY: 30 YEARS

	DETAIL NO.
	U- 13F
U (Universal Detail)	

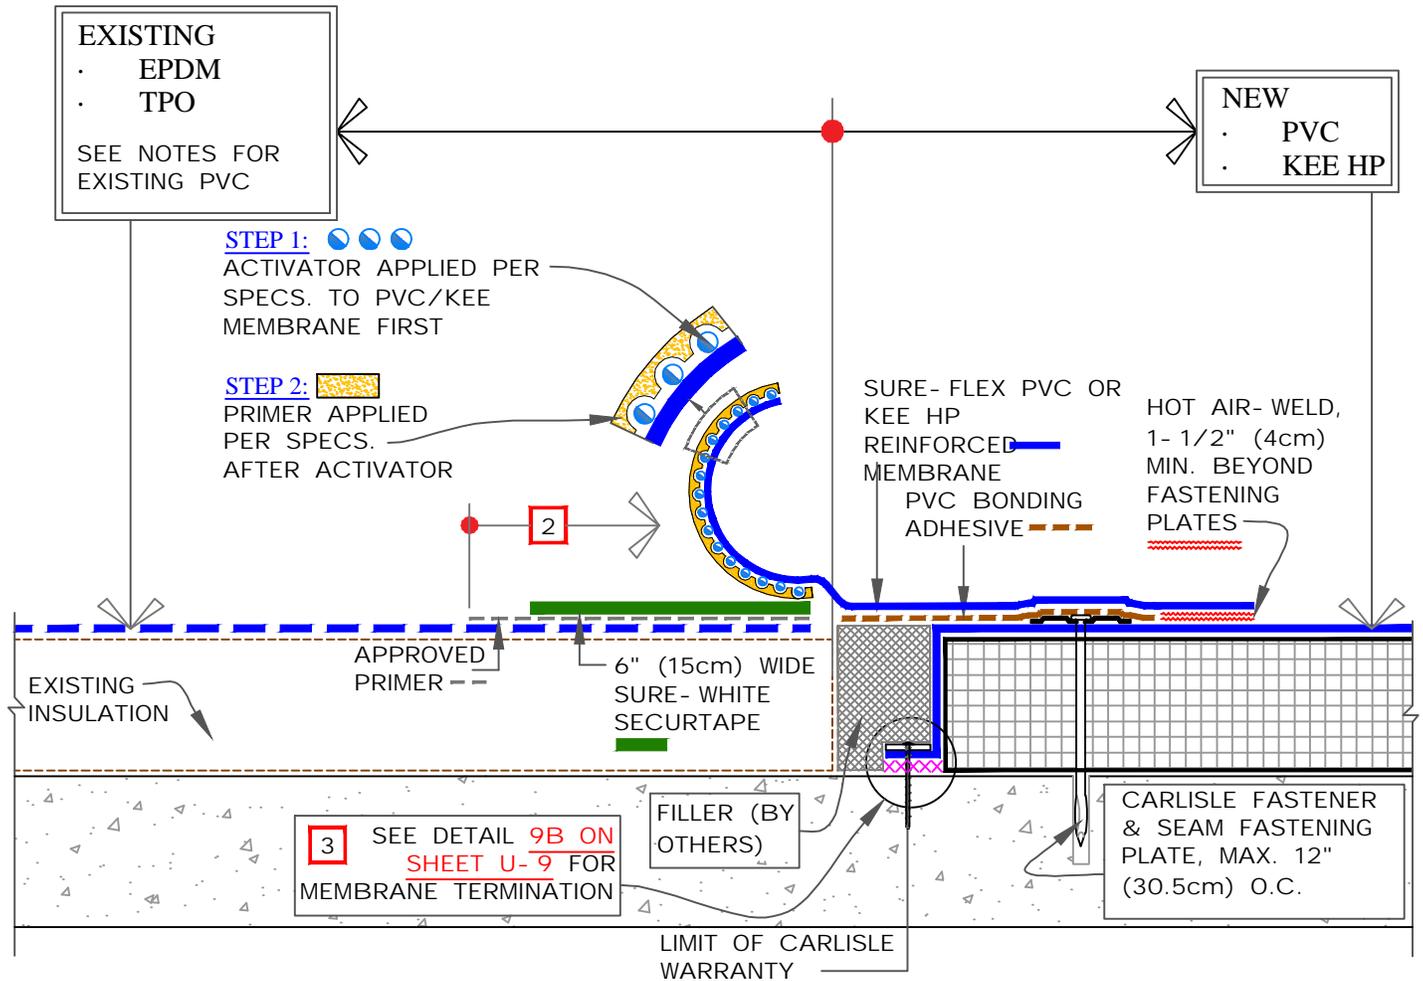

NOTES:


- ON EXISTING WARRANTED ROOFS, SEEK WRITTEN APPROVAL OF ITS MANUFACTURER FOR ACCEPTANCE OF THIS DETAIL. FOR EXISTING BALLASTED SYSTEMS BY OTHERS, CONSULT RESPECTIVE MANUFACTURER FOR ACCEPTABLE GRAVEL CONTAINMENT TO PREVENT GRAVEL MIGRATION.
- EXISTING EPDM/PVC MEMBRANES: CLEAN THE SEAMING AREA WITH WEATHERED MEMBRANE CLEANER AND ALLOW TO DRY. APPLY APPROVED PRIMER.

EXISTING PVC OR KEE MEMBRANES: IF EXISTING MEMBRANE IS NOT ACCEPTABLE FOR WELDING, UTILIZE STEP 1 ACTIVATOR AND STEP 2 PRIMER PROCESS.

- WATER CUT-OFF MASTIC MUST BE HELD UNDER CONSTANT COMPRESSION. WHEN RE-ROOFING OVER PRECAST CONCRETE, APPLY LIBERAL BEAD OF WATER CUT-OFF MASTIC IN JOINTS TO PREVENT MOISTURE MIGRATION.

**WHEN USING 80-MIL (2.03mm) THICK MEMBRANE**  
 APPLY A 4- 1/2" (11.43cm) DIAMETER "T- JOINT" COVER AT FIELD SPLICE INTERSECTIONS, CENTRALLY ALIGNED.

	PVC/KEE HP TIE-IN TO EXISTING SINGLE- PLY ROOF MEMBRANES ON CONCRETE DECK		DETAIL NO.
	MAXIMUM WARRANTY: 20 YEARS		U- 13G
		U (Universal Detail)	

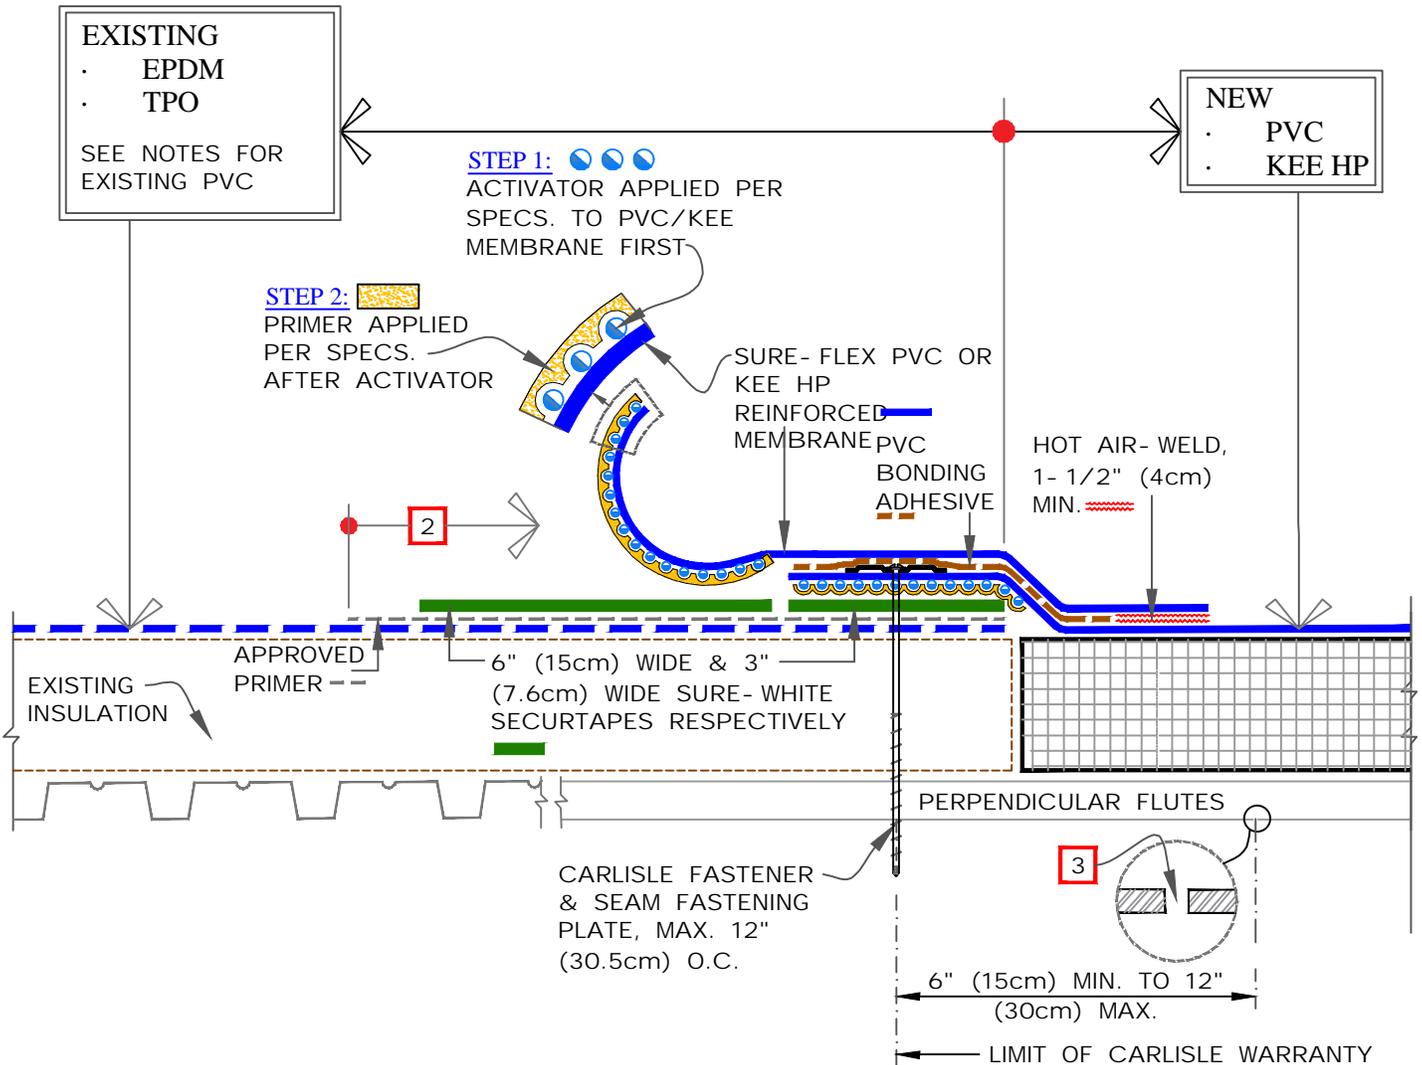

NOTES:

- ON EXISTING WARRANTED ROOFS, SEEK WRITTEN APPROVAL OF ITS MANUFACTURER FOR ACCEPTANCE OF THIS DETAIL. FOR EXISTING BALLASTED SYSTEMS BY OTHERS, CONSULT RESPECTIVE MANUFACTURER FOR ACCEPTABLE GRAVEL CONTAINMENT TO PREVENT GRAVEL MIGRATION.

- EXISTING EPDM/PVC MEMBRANES: CLEAN THE SEAMING AREA WITH WEATHERED MEMBRANE CLEANER AND ALLOW TO DRY. APPLY APPROVED PRIMER.

EXISTING PVC OR KEE MEMBRANES: IF EXISTING MEMBRANE IS NOT ACCEPTABLE FOR WELDING, UTILIZE STEP 1 ACTIVATOR AND STEP 2 PRIMER PROCESS.

- IF FLUTES ARE PERPENDICULAR, DRILL 3/8" (1cm) DIAMETER WEEP HOLES INTO THE BOTTOM FLUTES OF THE STEEL DECK ALONG THE TIE-IN.

**WHEN USING 80-MIL (2.03mm) THICK MEMBRANE**

APPLY A 4- 1/2" (11.43cm) DIAMETER "T- JOINT" COVER AT FIELD SPLICE INTERSECTIONS, CENTRALLY ALIGNED.



PVC/KEE HP TIE-IN TO EXISTING SINGLE-PLY ROOF MEMBRANES ON METAL DECK





MAXIMUM WARRANTY: 20 YEARS



DETAIL NO.

U- 13H

U (Universal Detail)

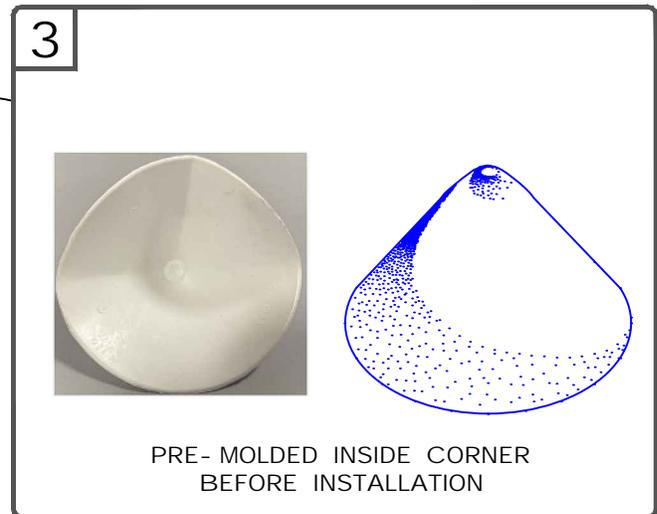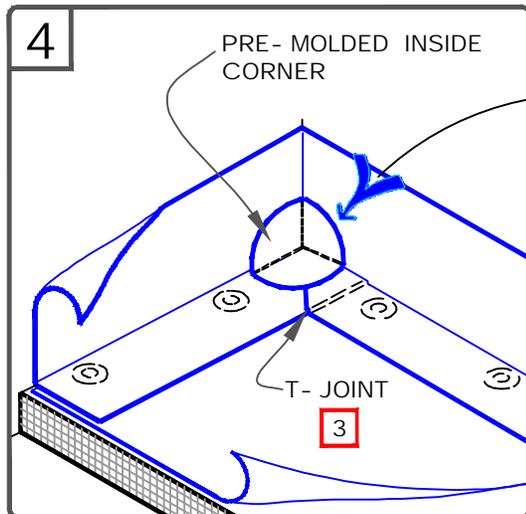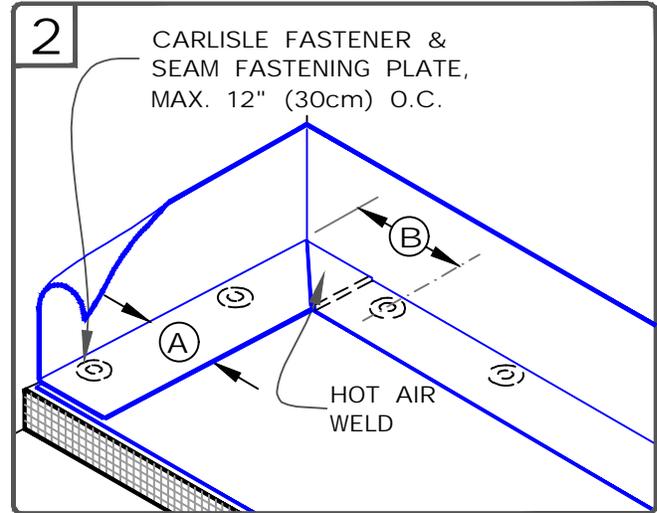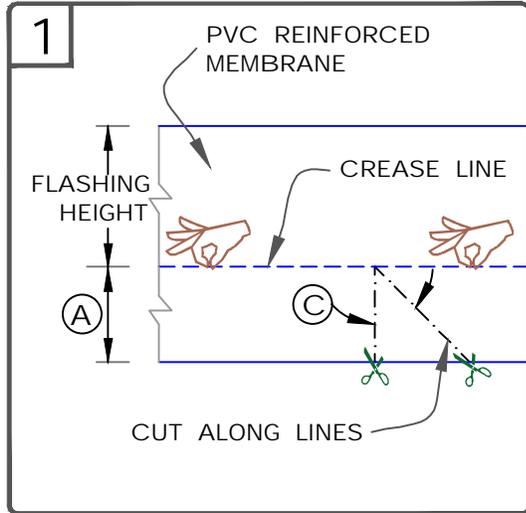

**WHEN USING 80-MIL (2.03mm) THICK MEMBRANE**  
 APPLY A 4- 1/2" (11.43cm) DIAMETER "T-JOINT" COVER AT FIELD SPLICE INTERSECTIONS, CENTRALLY ALIGNED.

NOTES:

1. POSITION FASTENING PLATES 6" TO 9" (15 TO 23cm) FROM THE CORNER AND 1/2" TO 1" (1.5 TO 2.5cm) FROM EDGE OF MEMBRANE.
2. REFER TO CARLISLE SPECIFICATIONS FOR ACCEPTABLE CARLISLE FASTENERS AND PLATES.

DIMENSIONS	cm	
(A)	6"	15 APPROX.
(B)	6" - 9"	15- 23
(C)	45- DEGREES APPROX.	



PRE-MOLDED INSIDE CORNER FLASHING

MAXIMUM WARRANTY: 30 YEARS




DETAIL NO.

U- 15A

U (Universal Detail)

**CAUTION** DETAIL NOT FOR USE ON 25 OR 30-YEAR WARRANTY PROJECTS, PRE-FABRICATED/PRE-MOLDED ACCESSORIES MUST BE UTILIZED. ACCEPTABLE FLASHING SHALL CONFORM WITH PVC UNIVERSAL DETAIL U-15A OR U-15G.

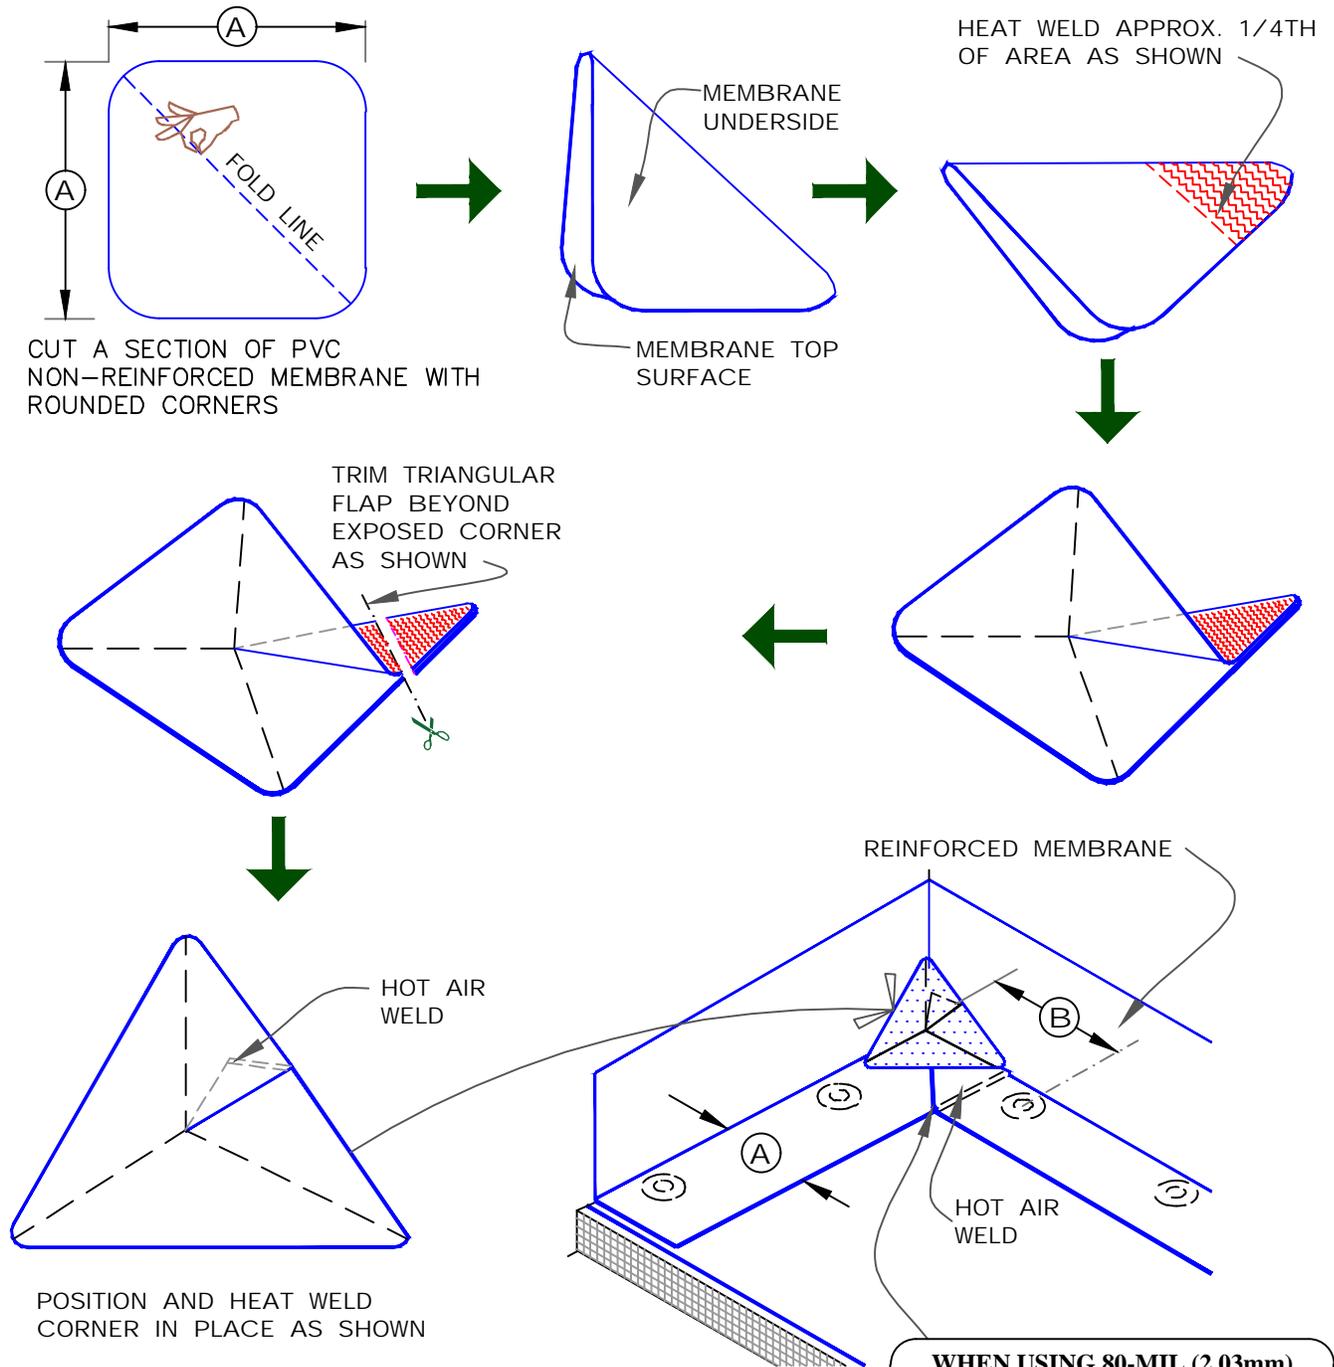

**WHEN USING 80-MIL (2.03mm) THICK MEMBRANE**  
 APPLY A 4- 1/2" (11.43cm) DIAMETER "T- JOINT" COVER AT FIELD SPLICE INTERSECTIONS, CENTRALLY ALIGNED.






DIMENSIONS	cm	
(A)	6"	15 APPROX.
(B)	6"- 9"	15- 23



FIELD FABRICATED INSIDE CORNER FLASHING

MAXIMUM WARRANTY: 20 YEARS. SEE CAUTION ON TOP OF PAGE

DETAIL NO.  
**U- 15B**  
 U (Universal Detail)

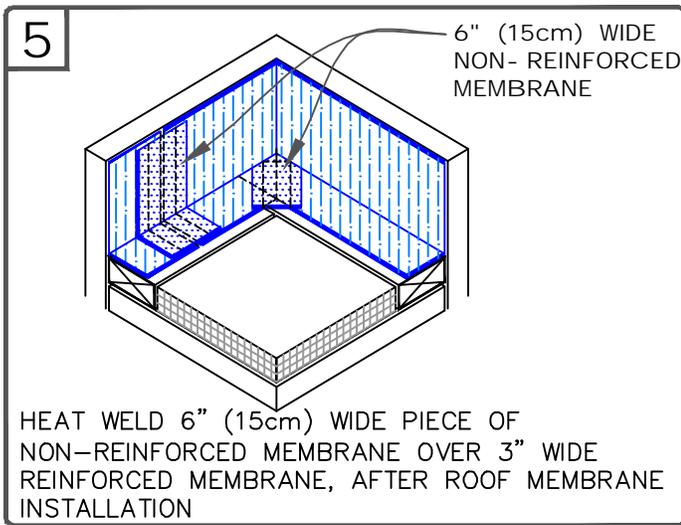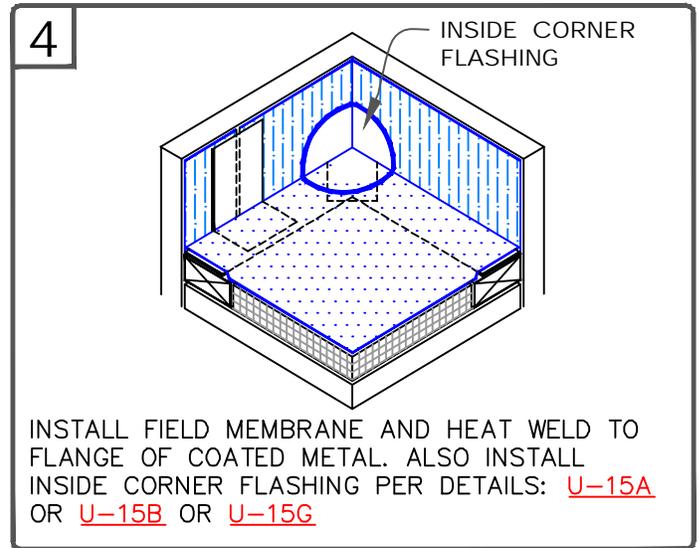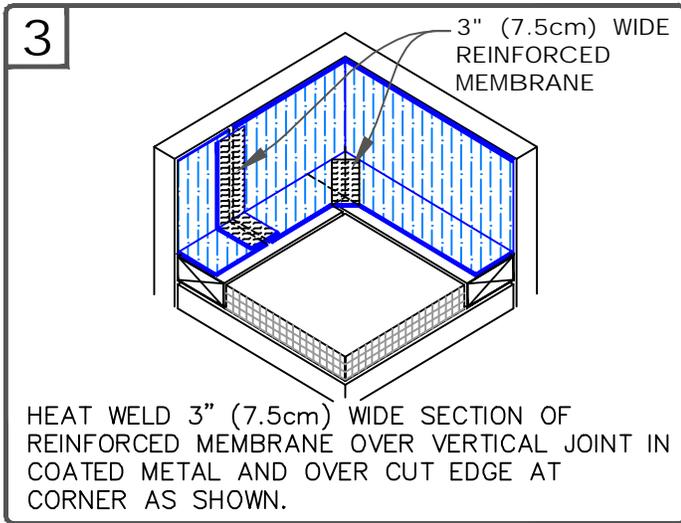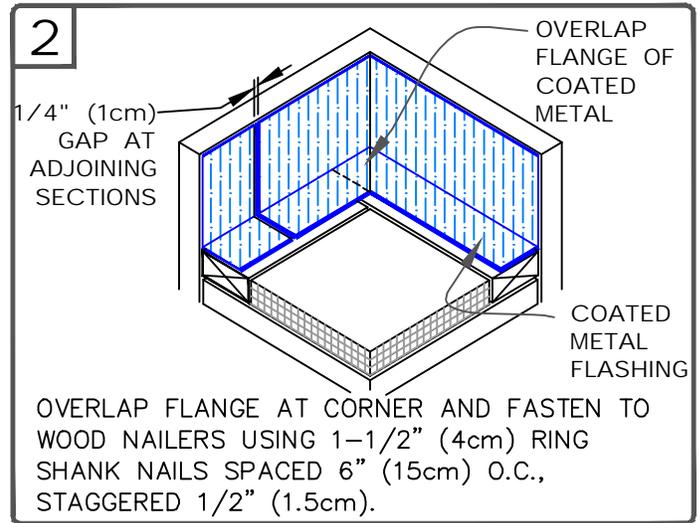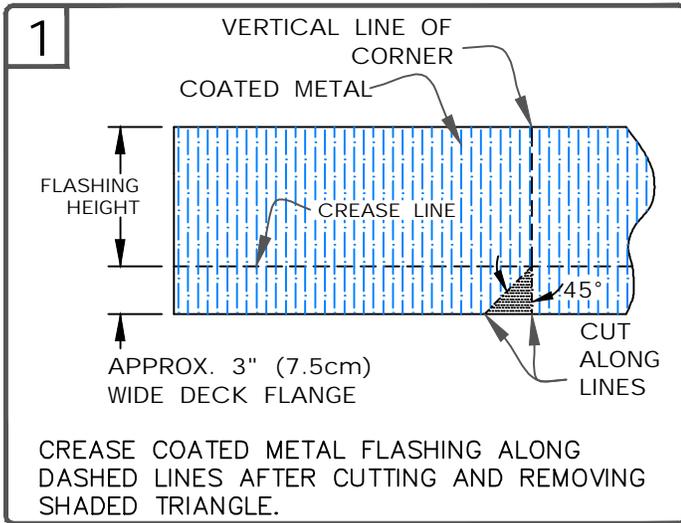

SEQUENCE:

1. 3" (7.6cm) REINFORCED MEMBRANE STRIPPING.
2. FIELD MEMBRANE.
3. TOP 6" (15.2cm) NON-REINFORCED MEMBRANE STRIPPING.

NOTES:

1. FASTEN COATED METAL FLASHING TO WOOD NAILERS USING 1- 1/2" (4cm) MIN. RING SHANK NAILS SPACED 6" (15cm) ON CENTER AND STAGGERED APPROX. 1/2" (1.5cm).
2. COORDINATE THIS DETAIL WITH [U- 12C](#) FOR ADDITIONAL INFORMATION.



INSIDE CORNER WITH PVC COATED METAL WALL FLASHING




MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 15C

U (Universal Detail)

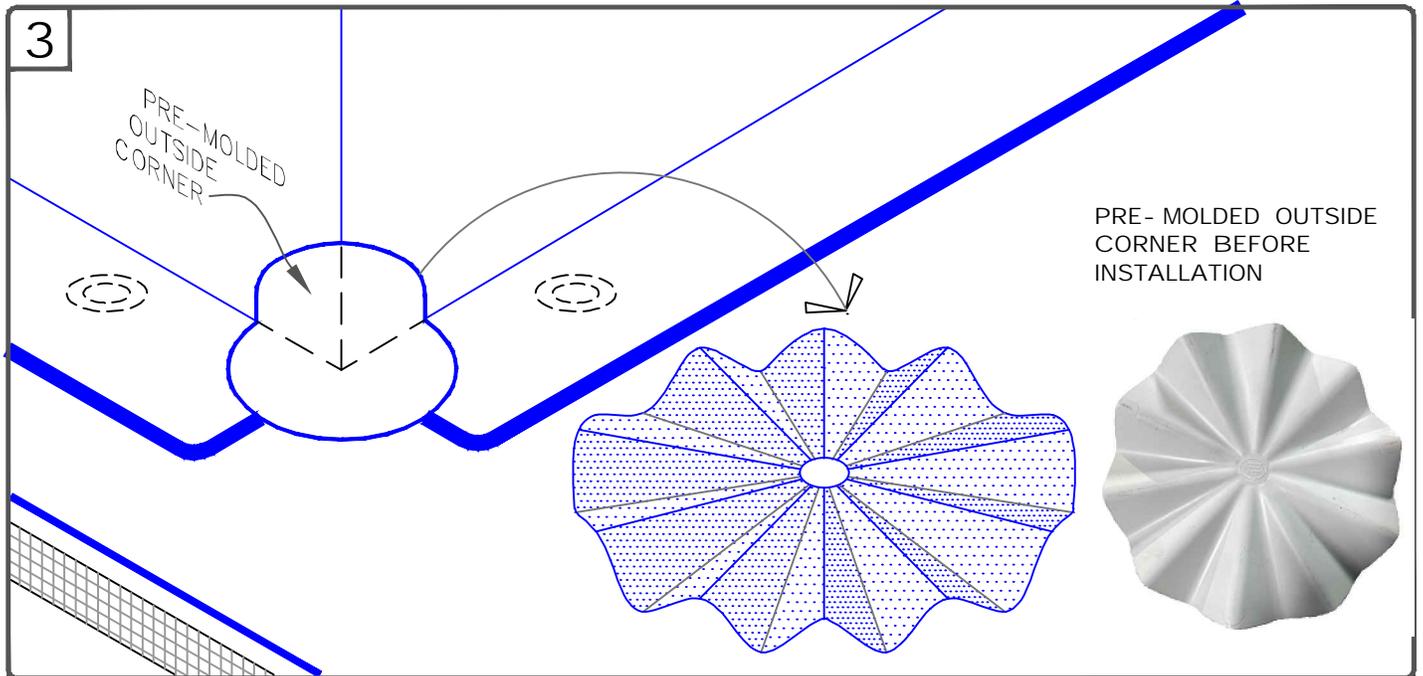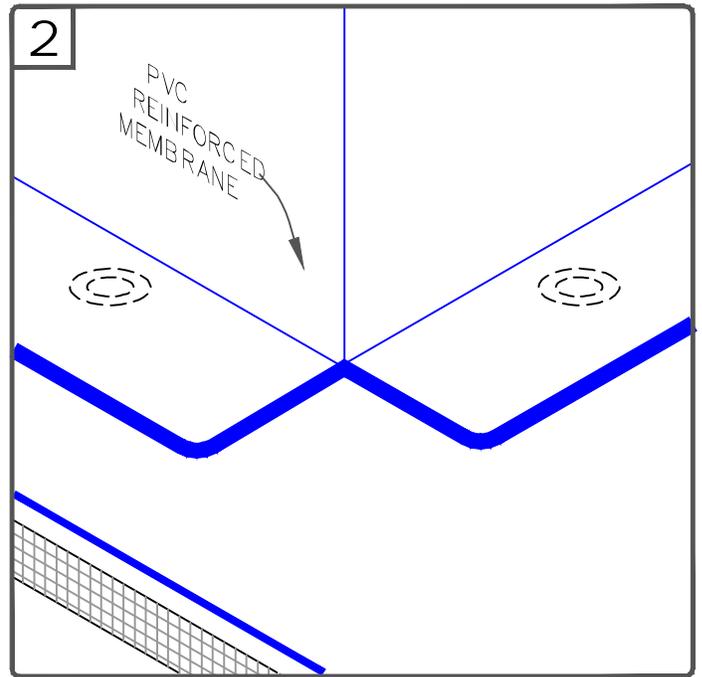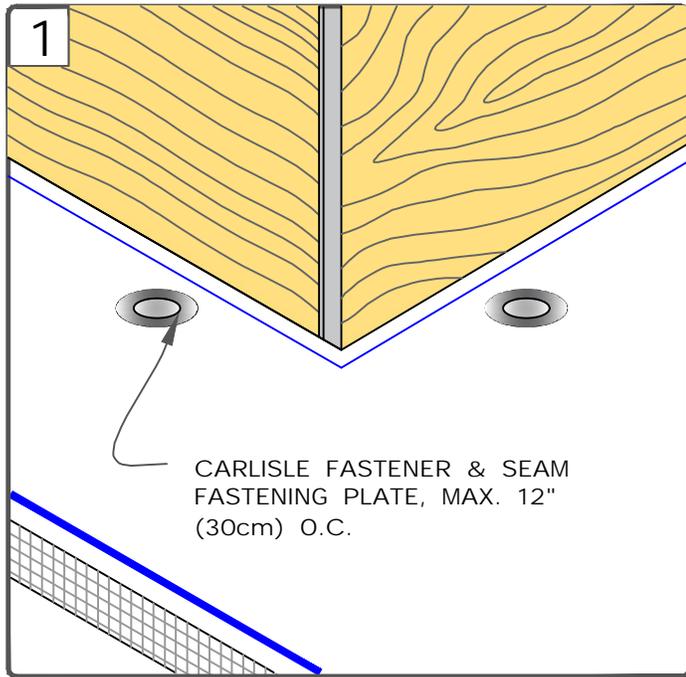


NOTES:

1. POSITION FASTENING PLATES 6" (15cm) FROM THE CORNER AND 1/2" TO 1" (1.5 TO 2.5cm) FROM EDGE OF MEMBRANE.
2. REFER TO CARLISLE SPECIFICATIONS FOR ACCEPTABLE CARLISLE FASTENERS AND PLATES.

	PRE-MOLDED OUTSIDE CORNER FLASHING		DETAIL NO.
	MAXIMUM WARRANTY: 30 YEARS		U- 15D
		U (Universal Detail)	

CAUTION

DETAIL NOT FOR USE ON 25 OR 30-YEAR WARRANTY PROJECTS, PRE-FABRICATED/PRE-MOLDED ACCESSORIES MUST BE UTILIZED. ACCEPTABLE FLASHING SHALL CONFORM WITH PVC UNIVERSAL DETAIL [U- 15D](#) OR [U- 15G](#).

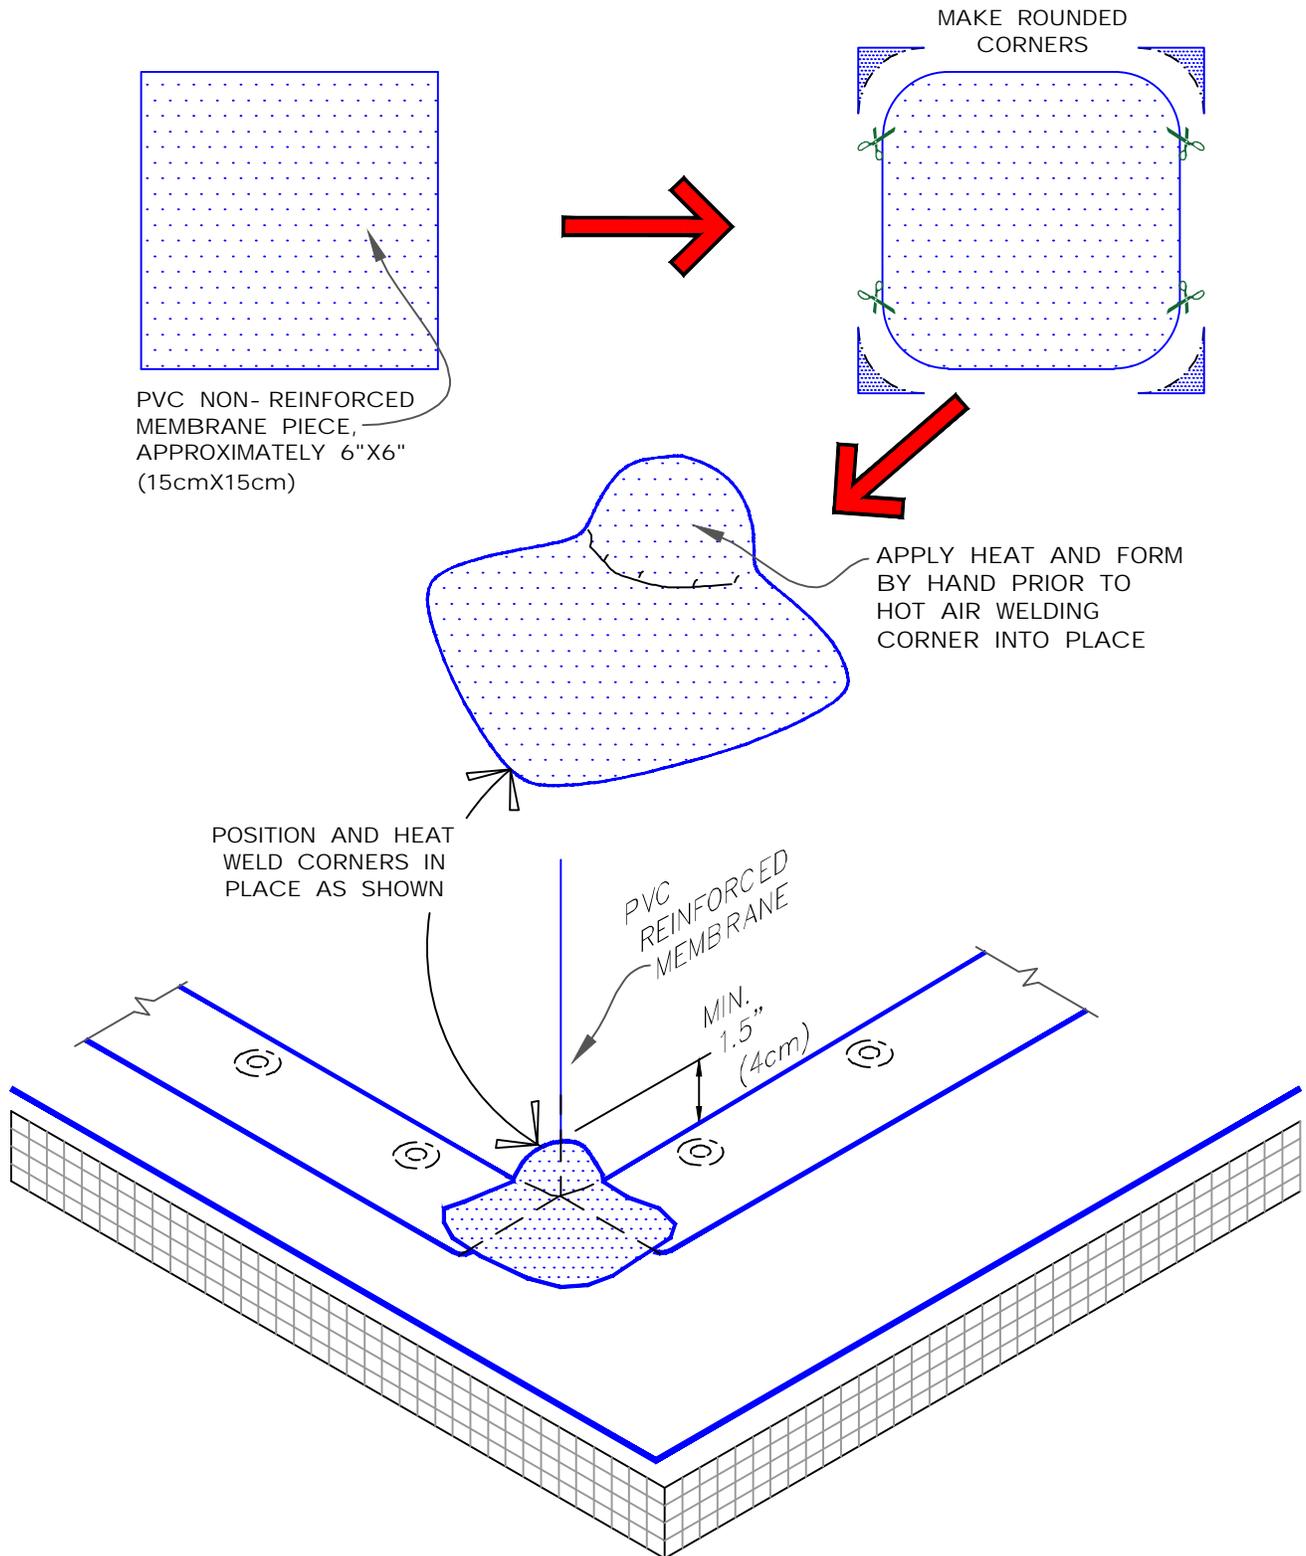

FIELD FABRICATED OUTSIDE CORNER FLASHING




MAXIMUM WARRANTY: 20 YEARS




DETAIL NO.

U- 15E

U (Universal Detail)

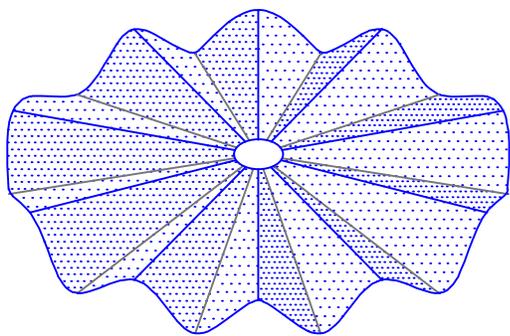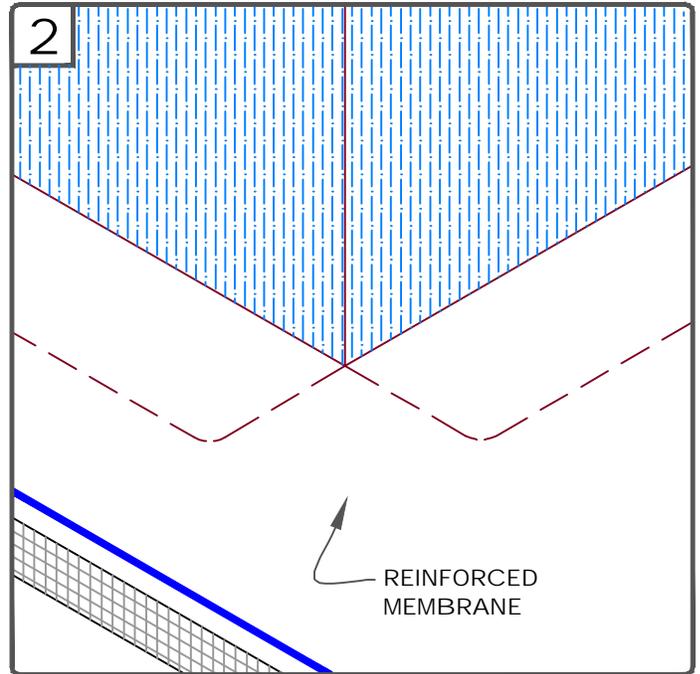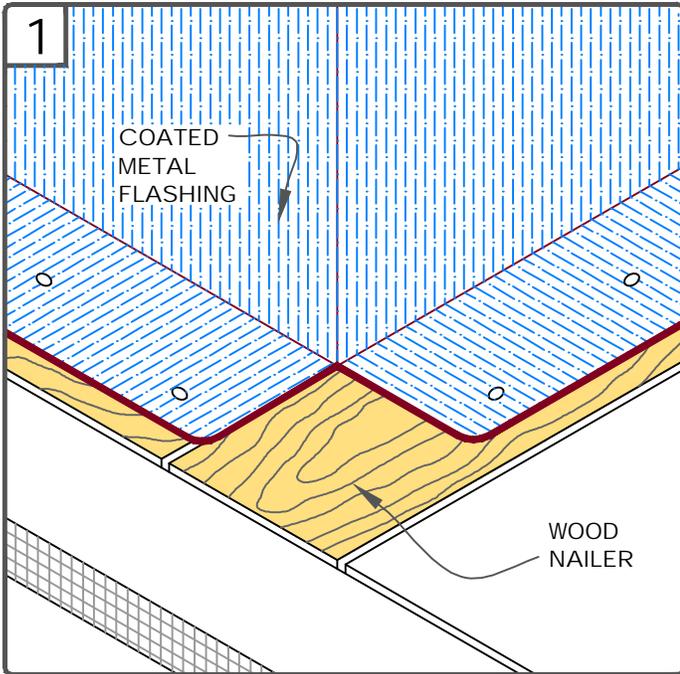

OUTSIDE CORNER BEFORE INSTALLATION

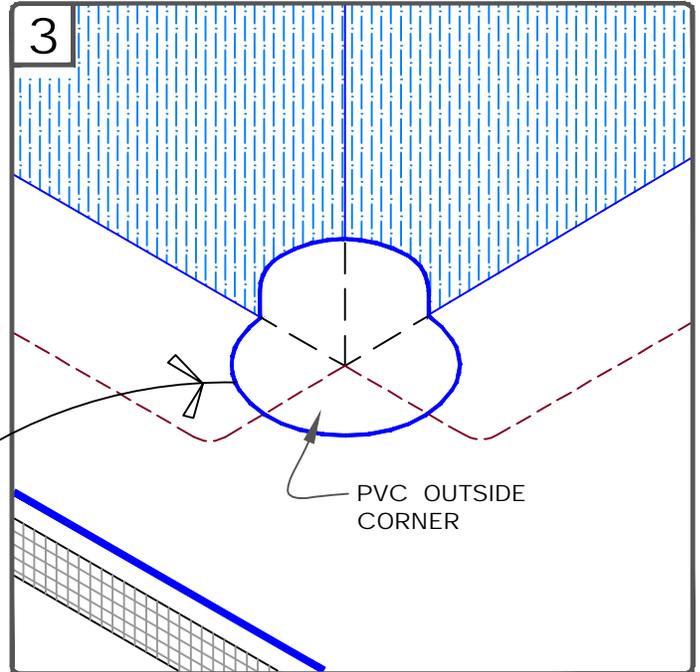

NOTES:

1. FASTEN COATED METAL FLASHING TO WOOD NAILERS USING 1- 1/2" (4cm) MIN. RING SHANK NAILS SPACED 6" (15cm) ON CENTER AND STAGGERED APPROX. 1/2" (1.5cm).
2. REFER TO PVC DETAIL [U- 5B](#) FOR FLASHING VERTICAL JOINTS IN COATED METAL.



OUTSIDE CORNER WITH PVC COATED METAL WALL FLASHING

MAXIMUM WARRANTY: 30 YEARS




DETAIL NO.

U- 15F

U (Universal Detail)




60- MIL (1.52mm) THICK  
PVC, UNIVERSAL CORNERS  
CAN BE USED FOR 3  
DIFFERENT CORNER  
CONDITIONS AS SHOWN  
BELOW

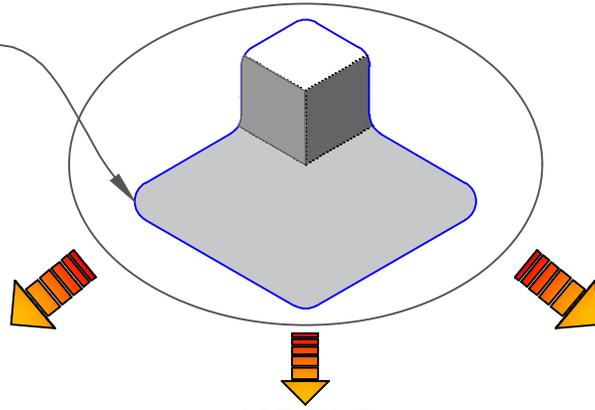

OPTION A


OPTION B

OPTION C

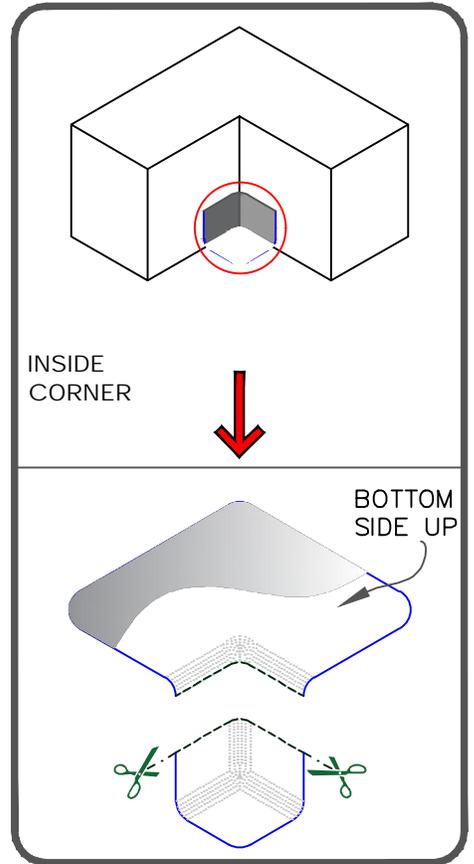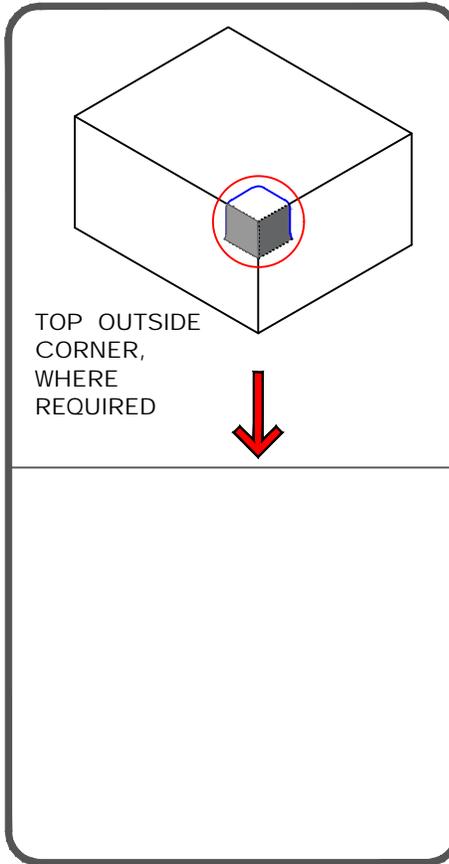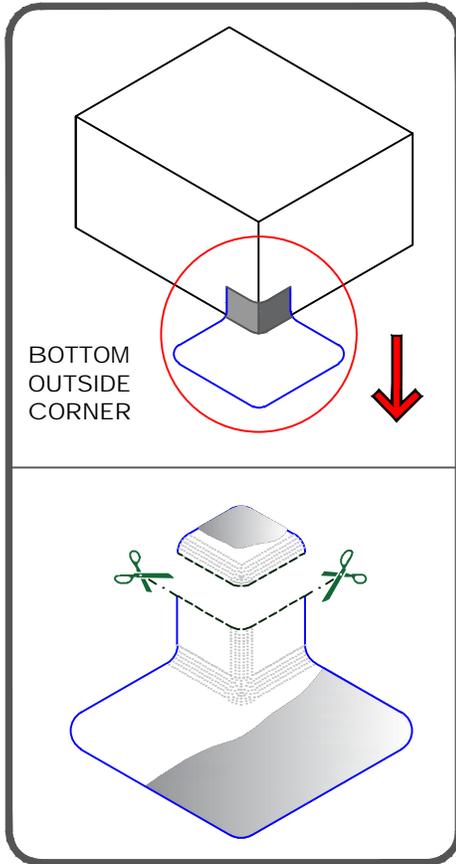

NOTES:

1. ROOF SYSTEMS MUST NOT HAVE FIELD FABRICATED OR BUILT-IN CANT STRIP.
2. REFER TO TECHNICAL DATA BULLETINS FOR COLOR AVAILABILITY.

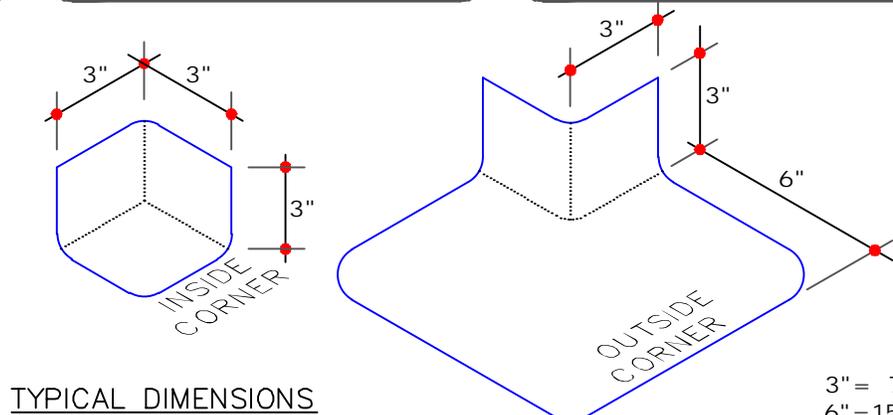


3" = 7.5cm  
6" = 15cm

	PVC UNIVERSAL CORNERS—COMBINATION INSIDE & OUTSIDE CORNERS MAXIMUM WARRANTY: 30 YEARS		DETAIL NO.
		U- 15G	

CAUTION


MOLDED SEALANT POCKETS MUST BE USED WITH RAIN HOODS FOR PROJECTS WITH 25 AND 30- YEAR WARRANTIES.

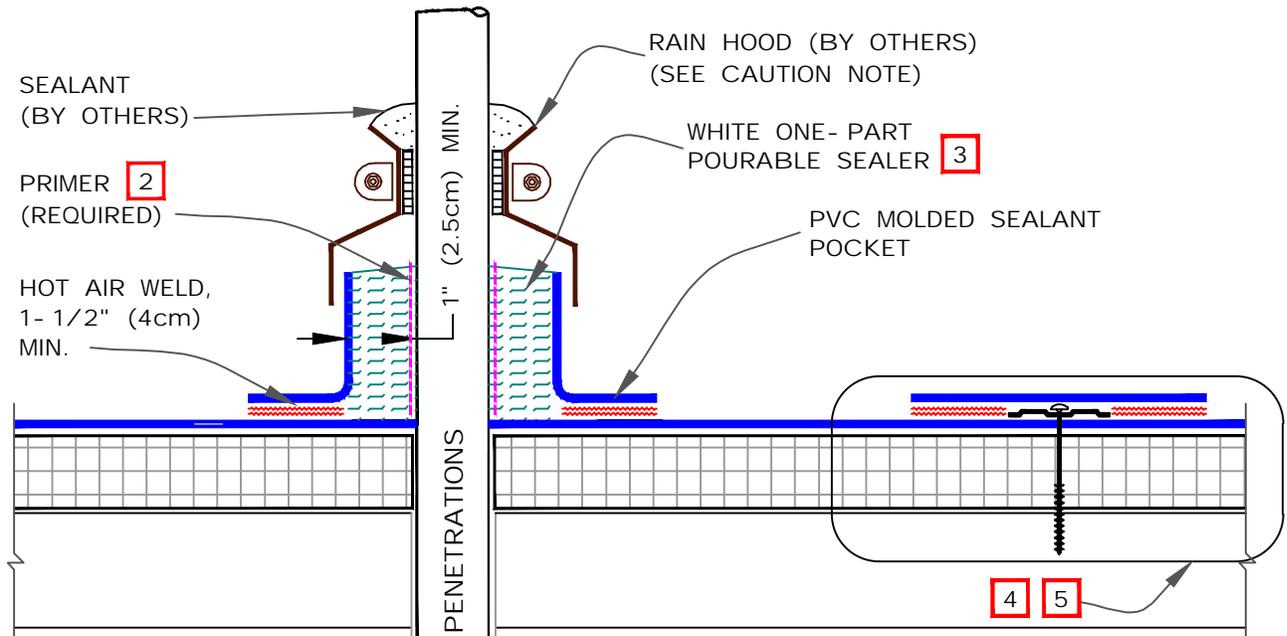

NOTES:

1. TEMPERATURE OF PIPE MUST NOT EXCEED 140° F (60° C).
2. PRIMER MUST BE APPLIED ON PENETRATION SURFACES ONLY WHERE SEALANT WILL BE IN CONTACT.
3. FILL POCKET COMPLETELY WITH WHITE ONE- PART POURABLE SEALER UNTIL RIM IS COVERED WITH SEALANT; ENSURE ALL VOIDS ARE FILLED.
4. ON MECHANICALLY- FASTENED SYSTEMS, INSTALL A MINIMUM OF 4 FASTENING PLATES AROUND SEALANT POCKETS WITH A DIAMETER UP TO 6" (15cm). ADDITIONAL FASTENING PLATES WILL BE REQUIRED FOR SEALANT POCKETS GREATER THAN 6" IN DIAMETER AND SHALL BE SPACED 12" (30cm) ON CENTER MAXIMUM.
5. REFER TO CARLISLE SPECIFICATIONS FOR PROPER FASTENERS AND PLATES.

PLACE MOLDED PVC SEALANT POCKET AROUND PENETRATION AND OVERLAP THE TWO SECTIONS

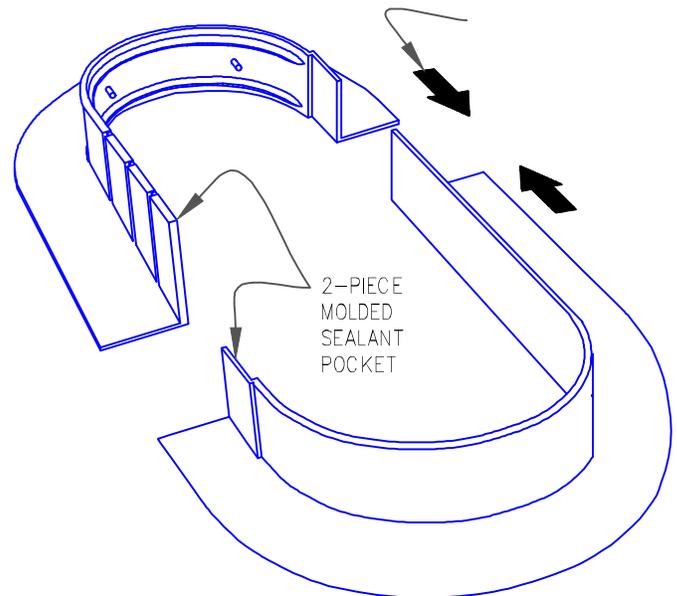


REFER TO PRODUCT DATA SHEET FOR STEP- BY- STEP INSTALLATION PROCEDURES

	MOLDED SEALANT POCKET		DETAIL NO.
	MAXIMUM WARRANTY: 30- YEARS. SEE CAUTION AT THE TOP OF PAGE.		U- 16A
			U (Universal Detail)

CARLISLE  
POURABLE  
SEALER

PVC COATED SHEET METAL  
DAM

REINFORCED PVC  
FLASHING HOT AIR  
WELD, 1- 1/2" (3.8cm)  
MIN.

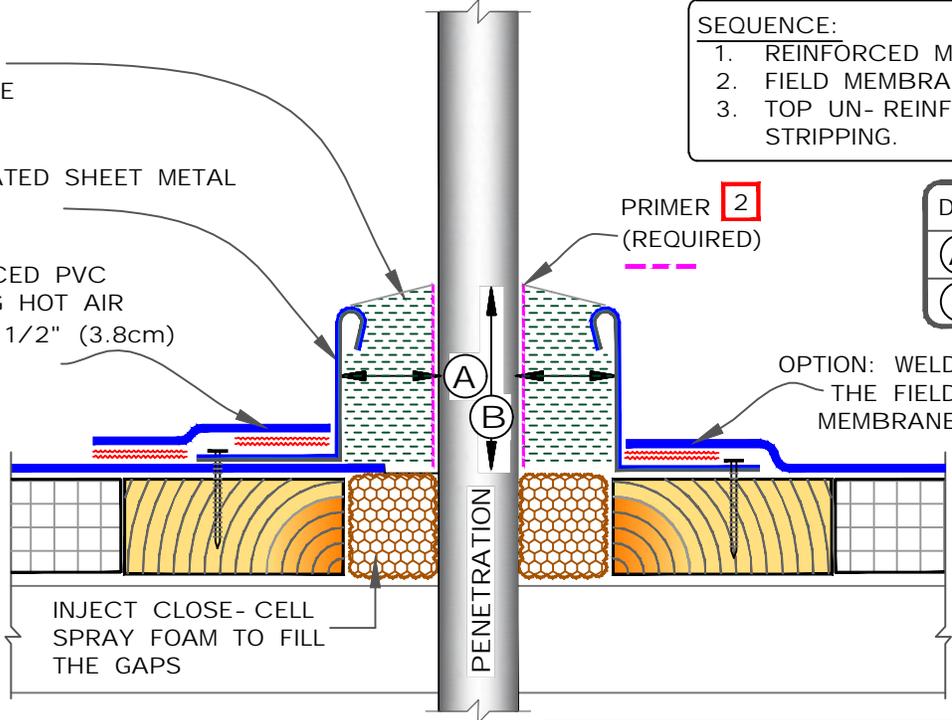



SEQUENCE:

1. REINFORCED MEMBRANE STRIPPING.
2. FIELD MEMBRANE.
3. TOP UN- REINFORCED MEMBRANE STRIPPING.

DIMENSIONS	cm	
(A) 1"	2.5	MIN.
(B) 2.5"	5	MIN.


NOTES:

1. TEMPERATURE OF PENETRATIONS MUST NOT EXCEED 140° F (60° C).
2. PRIMER MUST BE APPLIED TO ALL INSIDE SURFACES AND PENETRATIONS PRIOR TO FILLING WITH SEALANT..
3. FILL POCKET COMPLETELY WITH WHITE ONE- PART POURABLE SEALER UNTIL RIM IS COVERED WITH SEALANT; ENSURE ALL VOIDS ARE FILLED.
4. ON MECHANICALLY- ATTACHED SYSTEMS, INSTALL A MINIMUM OF 4 FASTENING PLATES AROUND SEALANT POCKETS WITH A DIAMETER UP TO 6" (152mm). ADDITIONAL FASTENING PLATES WILL BE REQUIRED FOR SEALANT POCKETS GREATER THAN 6" IN DIAMETER AND SHALL BE SPACED 12" (305mm) ON CENTER MAXIMUM. FASTENERS/PLATES ARE NOT REQUIRED ON ADHERED SYSTEMS UNLESS SEALANT POCKET DIAMETER EXCEEDS 18" (305mm).
5. REFER TO CARLISLE SPECIFICATIONS FOR PROPER TYPES OF FASTENERS AND PLATES.
6. SECUREMENT IS REQUIRED FOR POURABLE SEALER POCKETS WHICH ARE GREATER THAN 18" (46 CM) IN DIAMETER. REFER TO SPECIFICATIONS.
7. WHEN ANY ONE SIDE OF THE FIELD FABRICATED POURABLE SEALER POCKET EXCEEDS 12" (30 CM) USE WOOD BLOCKING TO ANCHOR SHEET METAL.

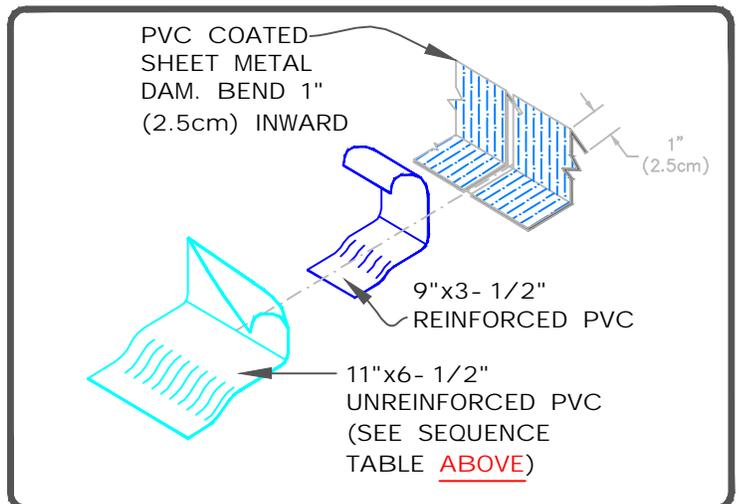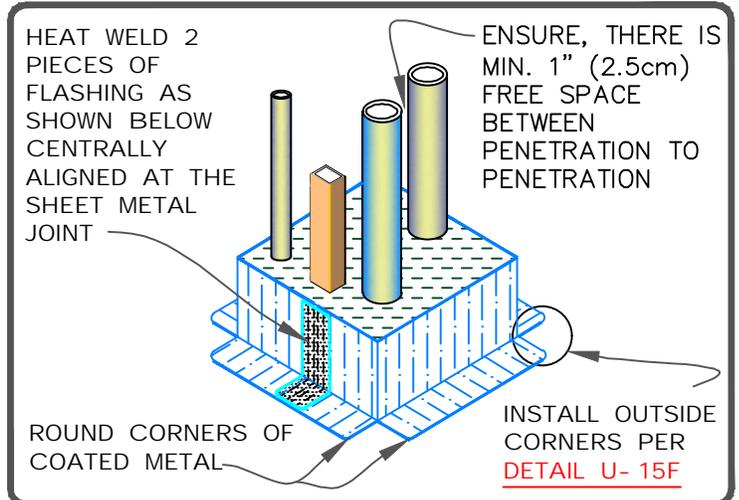

FIELD FABRICATED PVC COATED METAL POCKET


MAXIMUM WARRANTY: 20- YEARS



DETAIL NO.


U- 16B

U (Universal Detail)

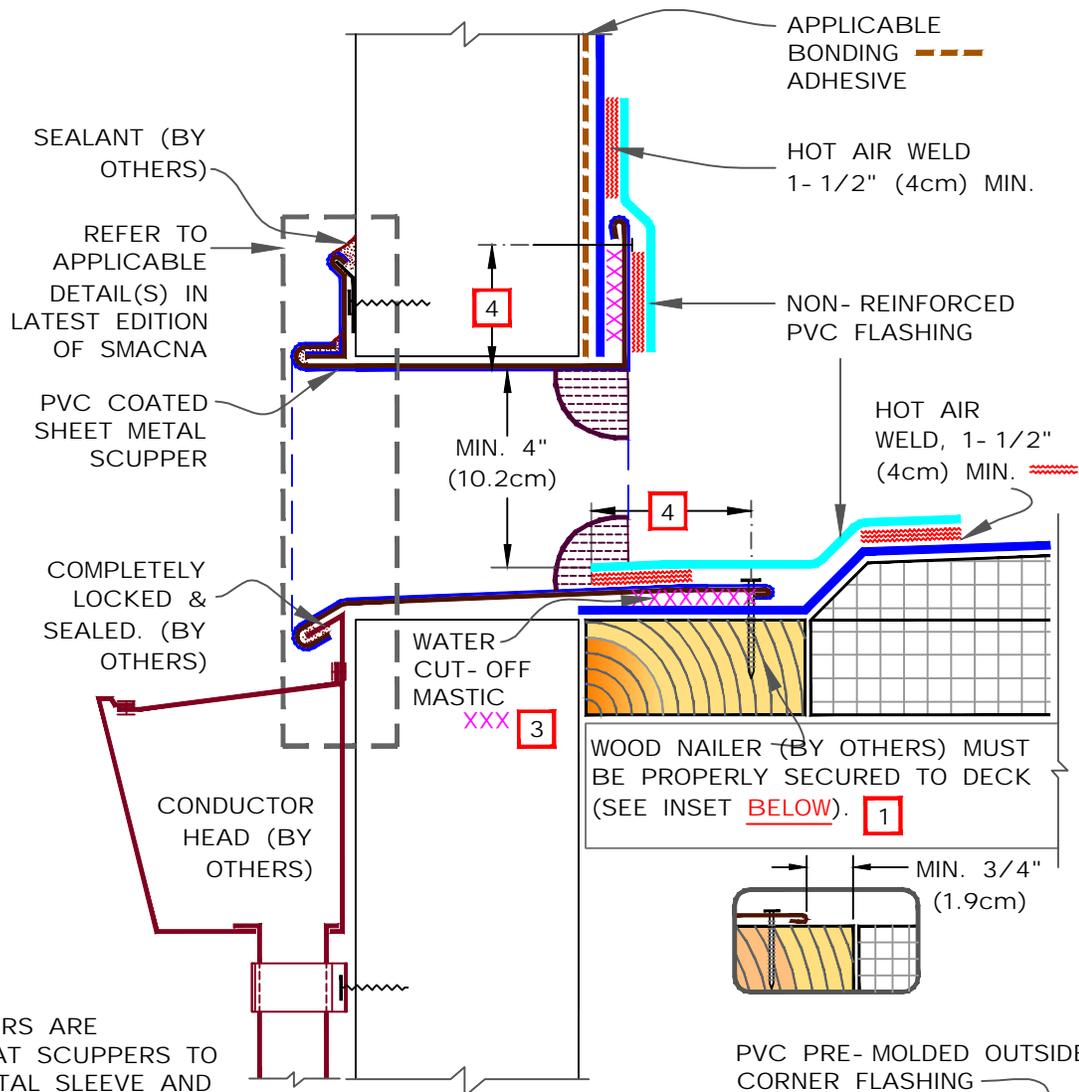

NOTES:

1. WOOD NAILERS ARE INSTALLED AT SCUPPERS TO SECURE METAL SLEEVE AND MUST EXTEND PAST THE WIDTH OF METAL SLEEVE FLANGE.
2. METAL SCUPPER BOX MUST HAVE FOLDED FLANGE CORNERS FULLY COVERED BY OUTSIDE CORNER FLASHING.
3. WATER CUT-OFF MASTIC UNDER SCUPPER FLANGES MUST BE UNDER CONSTANT COMPRESSION.
4. SCUPPER FLANGES MUST BE TOTALLY COVERED BY NON- REINFORCED FLASHING WITH MINIMUM 2" (5cm) COVERAGE PAST NAIL HEAD.

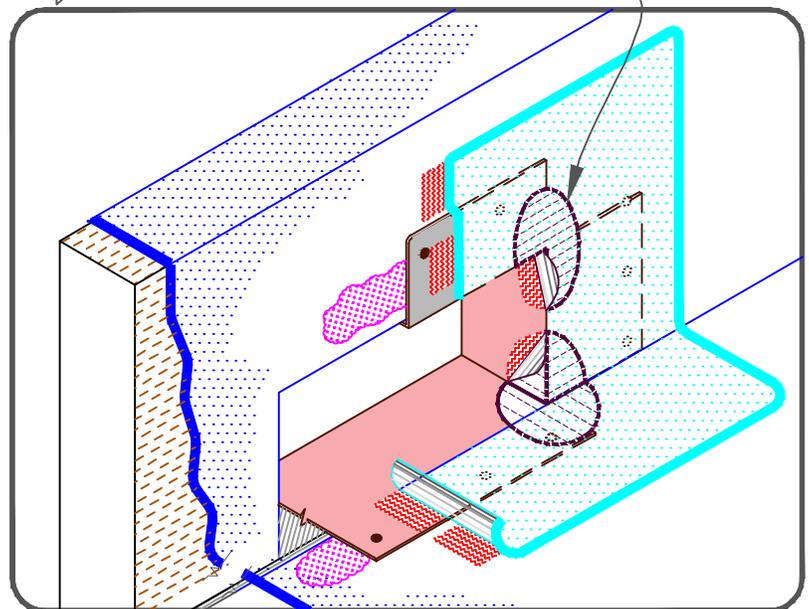

PREFABRICATED SCUPPER WITH PVC COATED METAL


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.


U- 18A

U (Universal Detail)

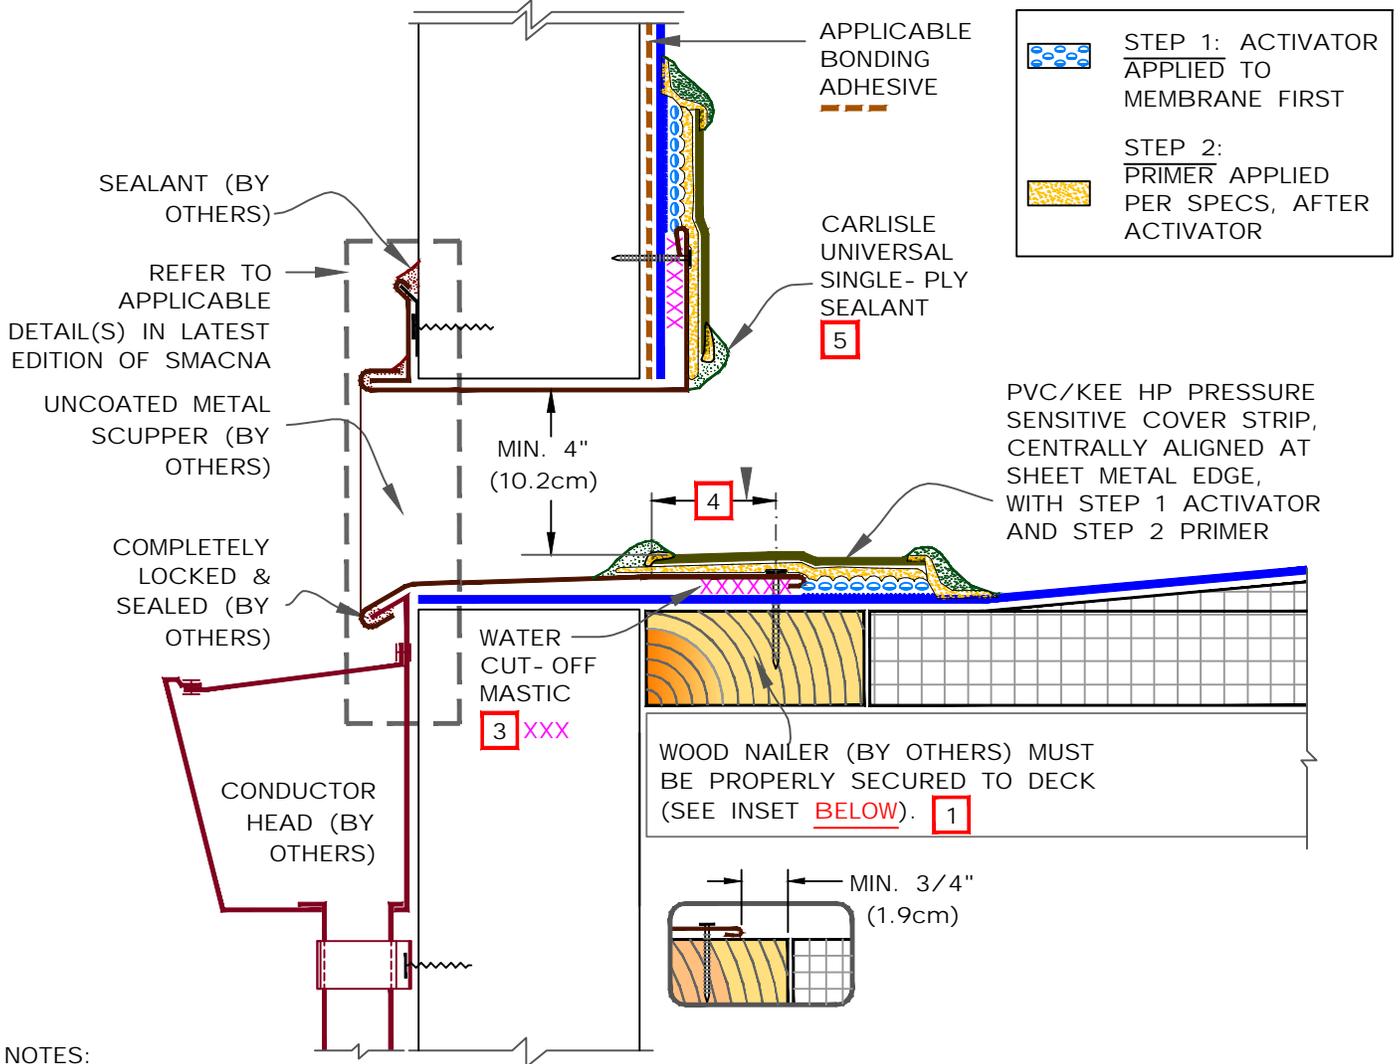


NOTES:

1. WOOD NAILERS ARE INSTALLED ONLY AT SCUPPERS TO SECURE METAL SLEEVE AND MUST EXTEND PAST THE WIDTH OF METAL SLEEVE FLANGE.
2. METAL SCUPPER BOX MUST HAVE CONTINUOUS FLANGES WITH ROUNDED CORNERS, SOLDER ALL SCUPPER SEAMS WATER-TIGHT.
3. WATER CUT-OFF MASTIC UNDER SCUPPER FLANGE MUST BE UNDER CONSTANT COMPRESSION.
4. PRESSURE SENSITIVE COVER STRIP MUST EXTEND A MINIMUM 2" (5cm) COVERAGE PAST NAIL HEAD.
5. UNIVERSAL SINGLE-PLY SEALANT IS REQUIRED AT FLASHING EDGES ON SCUPPER EDGE. PVC STEP 2 PRIMER MUST BE USED TO PREPARE SURFACES PRIOR TO THE APPLICATION OF SEALANT.

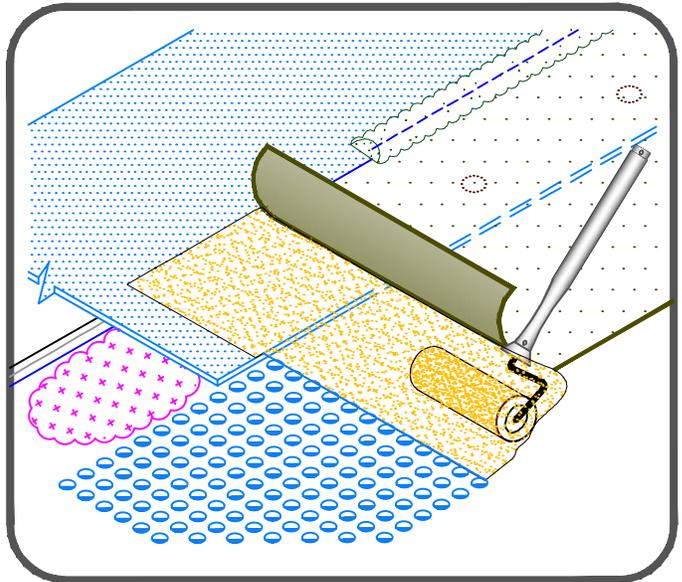

	SCUPPER WITH UNCOATED METAL – PRESSURE-SENSITIVE COVER STRIP PAGE 1 OF 2		DETAIL NO. <b>U-18B</b>
	MAXIMUM WARRANTY: 20 YEARS		U (Universal Detail)

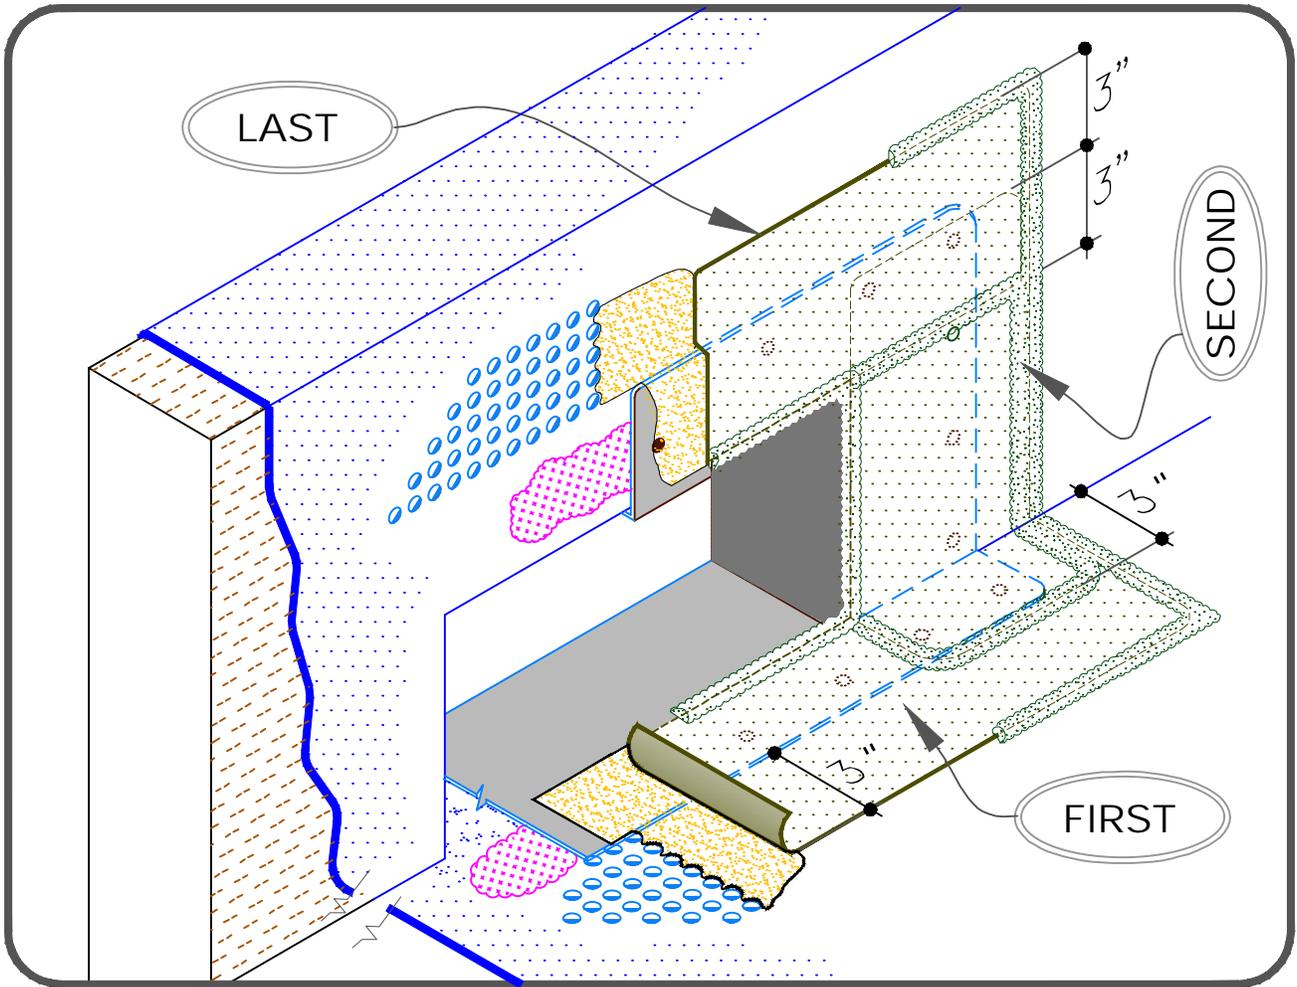

ISOMETRIC



SCUPPER WITH UNCOATED METAL –  
PRESSURE-SENSITIVE COVER STRIP  
PAGE 2 OF 2


MAXIMUM WARRANTY: 20 YEARS



DETAIL NO.


U- 18B

U (Universal Detail)

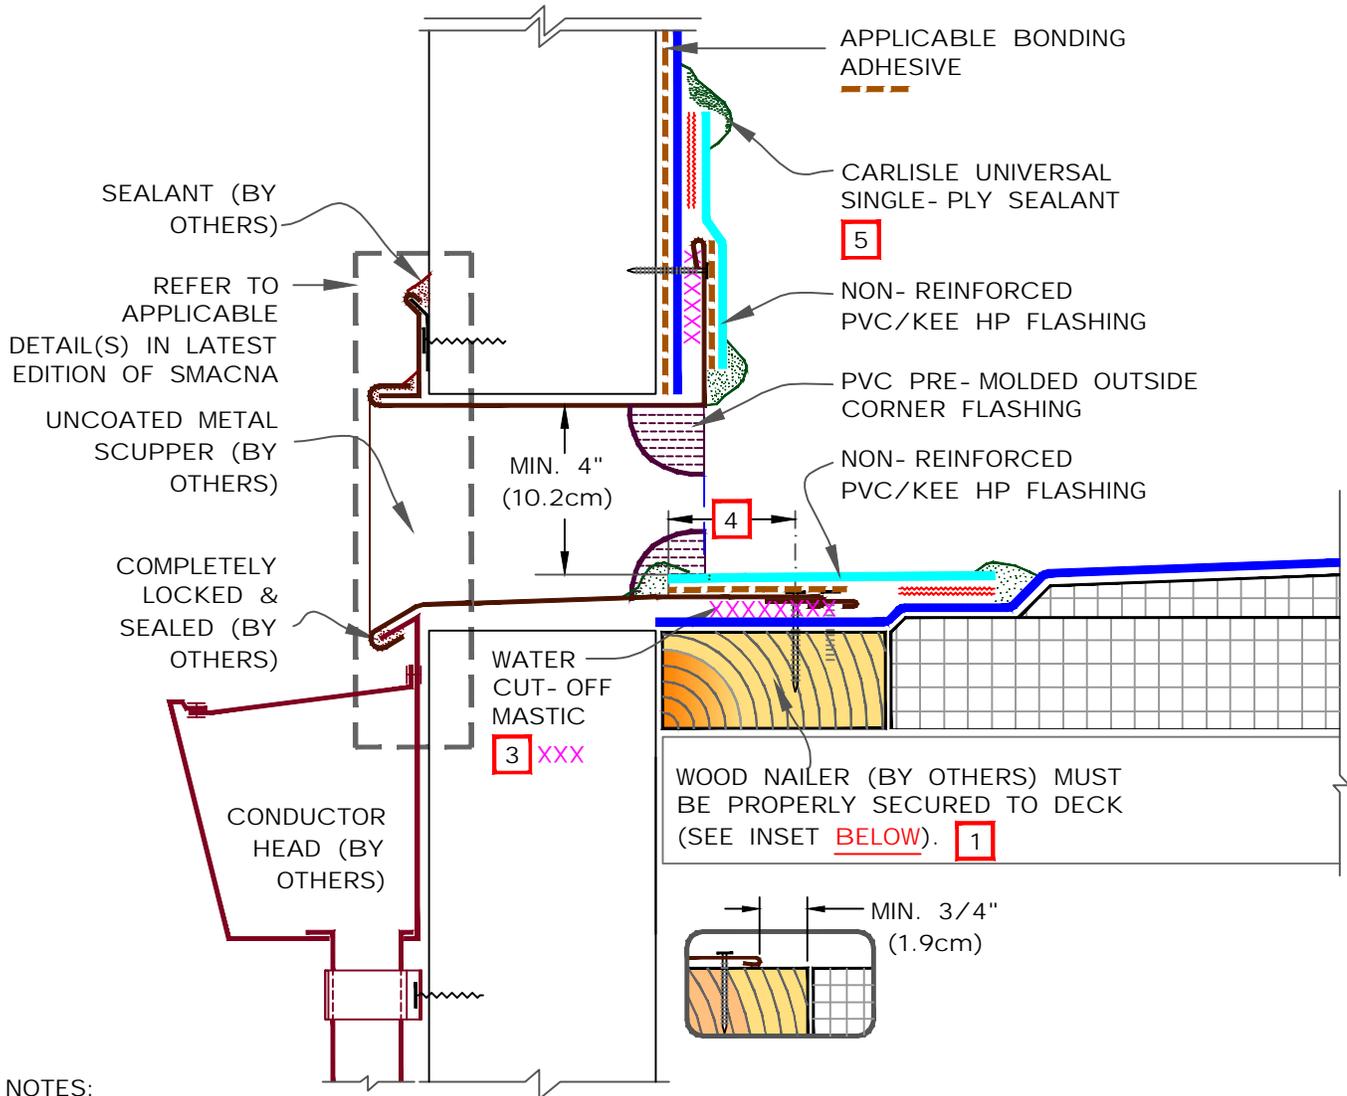


NOTES:

1. WOOD NAILERS ARE INSTALLED ONLY AT SCUPPERS TO SECURE METAL SLEEVE AND MUST EXTEND PAST THE WIDTH OF METAL SLEEVE FLANGE.
2. METAL SCUPPER BOX MUST HAVE CONTINUOUS FLANGES WITH ROUNDED CORNERS, SOLDER ALL SCUPPER SEAMS WATER-TIGHT.
3. WATER CUT-OFF MASTIC UNDER SCUPPER FLANGE MUST BE UNDER CONSTANT COMPRESSION.
4. NON-REINFORCED FLASHING MUST EXTEND A MINIMUM 3" (5cm) COVERAGE PAST NAIL HEAD.
5. UNIVERSAL SINGLE-PLY SEALANT IS REQUIRED AT FLASHING EDGES ON SCUPPER EDGE. PVC STEP 2 PRIMER MUST BE USED TO PREPARE SURFACES PRIOR TO THE APPLICATION OF SEALANT.

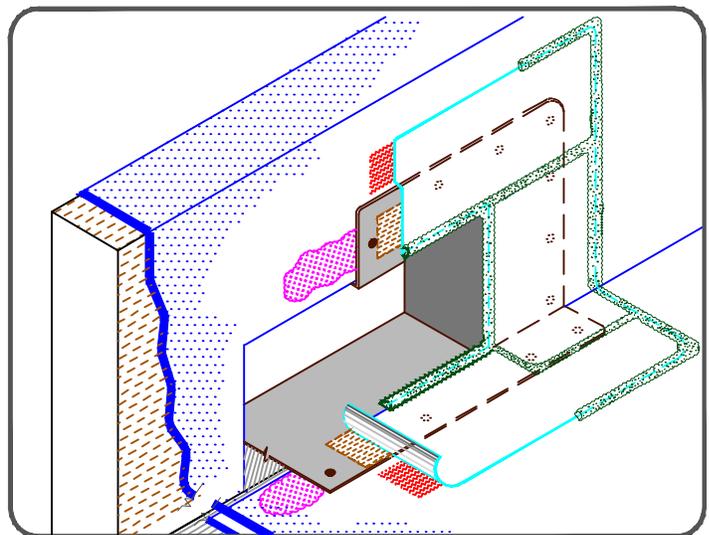

	SCUPPER WITH UNCOATED METAL – PVC FLASHING		DETAIL NO.
	MAXIMUM WARRANTY: 30 YEARS		U-18B.1
		U (Universal Detail)	

USE APPROPRIATE **U-9** DETAIL  
TERMINATION FOR WARRANTY DURATION  
(ABOVE ANTICIPATED WATER LEVEL OR  
SLUSH LINE)

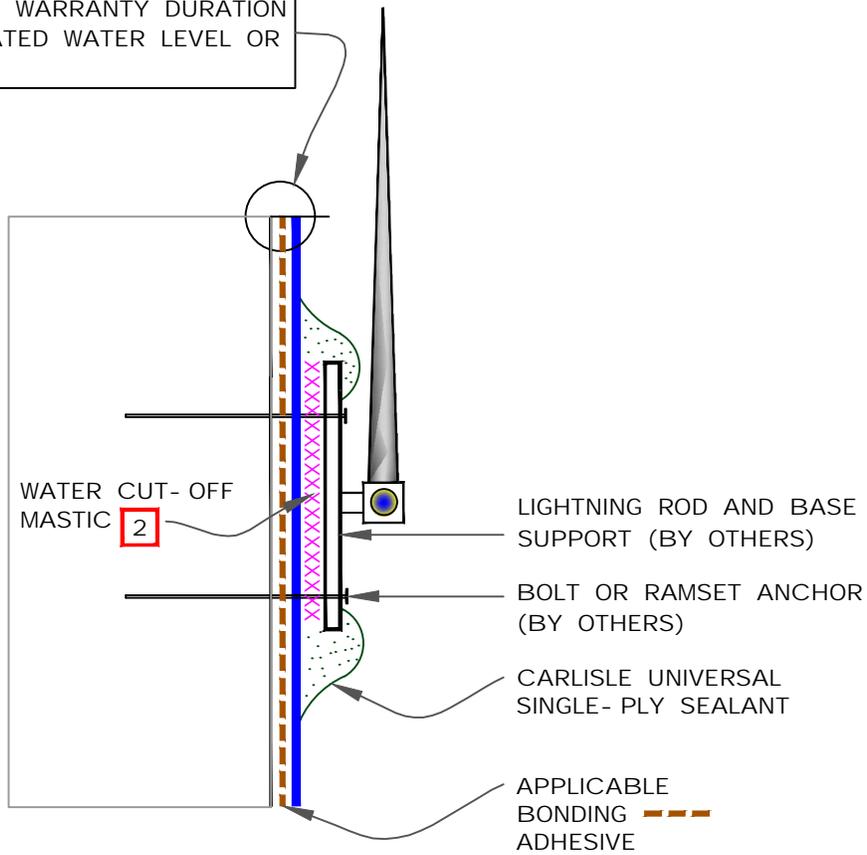

NOTES:

1. DETAIL MAY BE USED FOR ANY FASTENER PENETRATION (E.G., ACCESS LADDER, ANCHOR SUPPORT TO PARAPET).
2. WATER CUT-OFF MASTIC MUST BE UNDER CONSTANT COMPRESSION.
3. DETAIL UNACCEPTABLE FOR HORIZONTAL APPLICATION ON ROOF DECK.
4. COMPLY WITH ZONING ORDINANCE AND LOCAL CODES FOR MOUNTING A LIGHTNING SYSTEM.



LIGHTNING ROD AT PARAPET  
(VERTICAL ATTACHMENT)


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

**U- 20A**

U (Universal Detail)

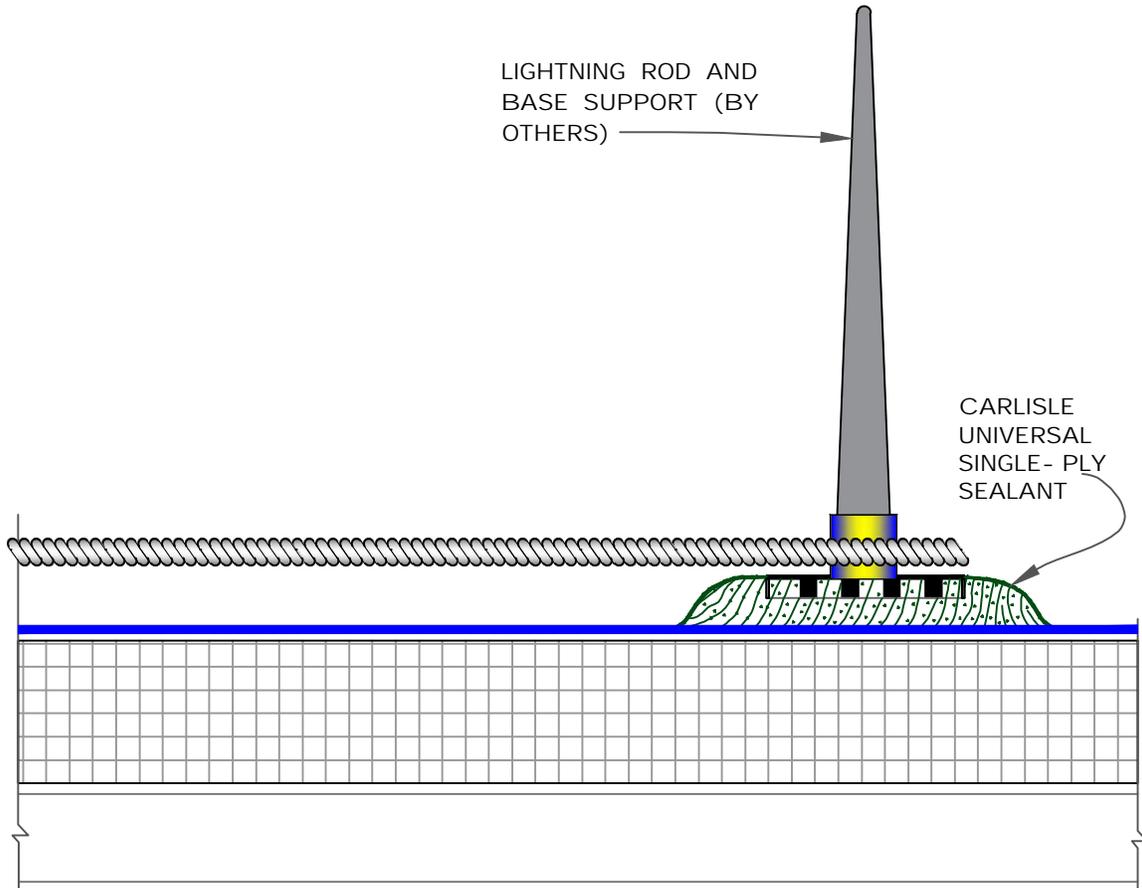

NOTES:

1. CLEAN EXPOSED MEMBRANE SURFACE WITH WEATHERED MEMBRANE CLEANER AND ALLOW TO DRY.
2. COMPLY WITH ZONING ORDINANCE AND LOCAL CODES FOR MOUNTING A LIGHTNING SYSTEM.



LIGHTNING ROD AT DECK LEVEL


MAXIMUM WARRANTY: 30 YEARS




DETAIL NO.

U- 20B

U (Universal Detail)

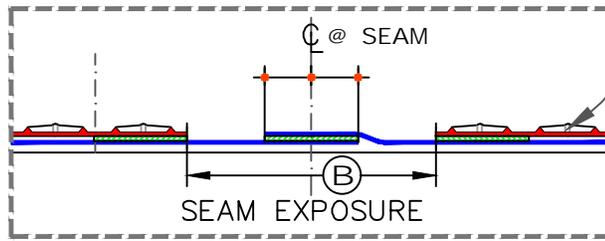

DISCONTINUE WALKWAYS AT FIELD SEAMS AS SHOWN

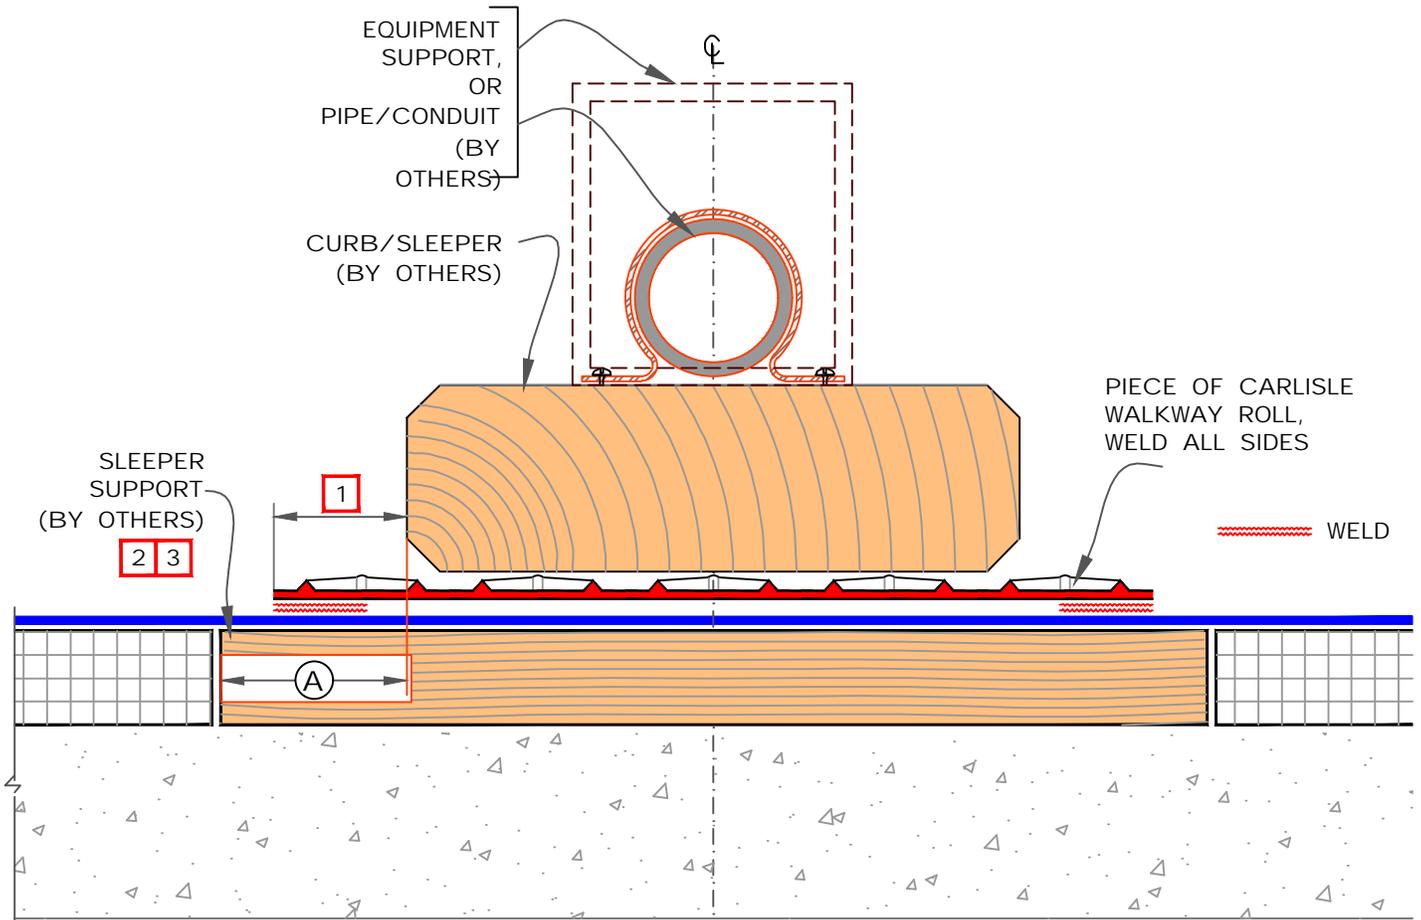

NOTES:

1. SLEEPER MUST BE LARGE ENOUGH TO SUPPORT WEIGHT OF EQUIPMENT WITHOUT INDENTING INSULATION. EXTEND SLEEPER OUT AS REQUIRED BY STRUCTURAL ENGINEER TO DISTRIBUTE SUBJECT LOAD OR AT LEAST EXTEND OUT MIN. 3" (7.5cm).
2. ENSURE SCREW/ANCHOR HEADS IN TOP SURFACE OF WOOD BLOCKING ARE RECESSED TO PROTECT MEMBRANE.
3. SLEEPER SUPPORT NOT REQUIRED UNDER CONDUIT OR PIPE SUPPORTS.
4. CONSULT STRUCTURAL ENGINEER AND/OR SPECIFIER TO AVOID WATER PONDING DUE TO DECK DEFLECTION.
5. RAISE CONDUITS AND PIPES ABOVE THE REGIONAL SNOW LINE WHEN SLOPE OF THE ROOF CAN LEAD TO SLIDING SNOW.

DIMENSIONS		cm	
(A)	3"	7.5	MIN. ALL SIDES
(B)	8"	20	



SLEEPER


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 24

U (Universal Detail)

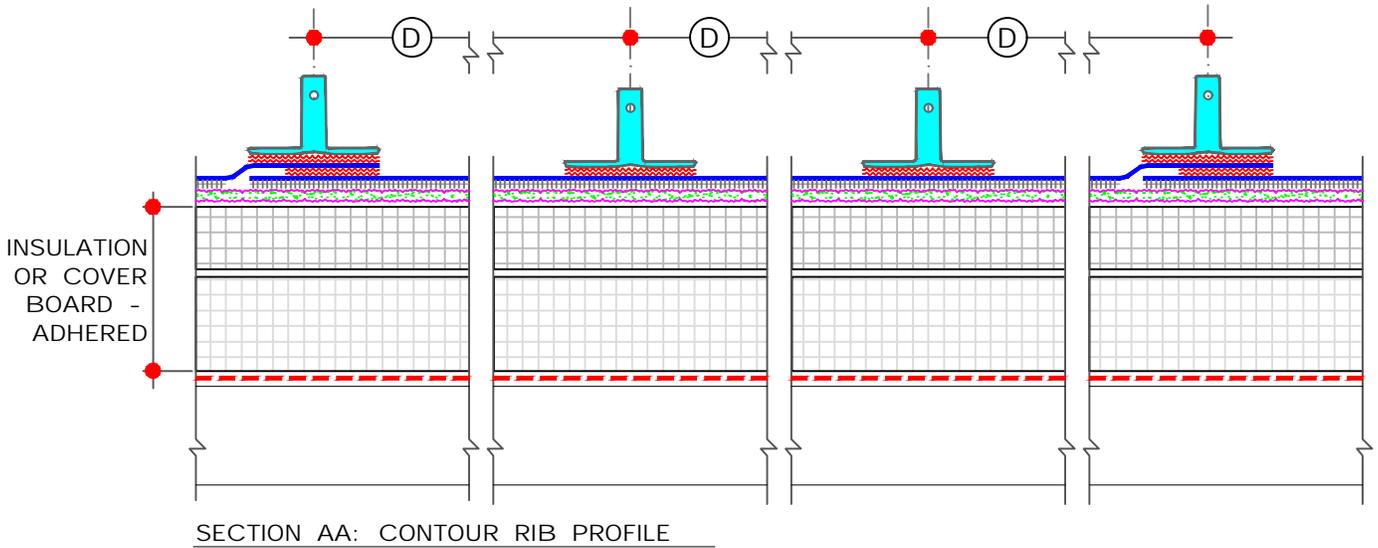

CONTOUR RIB		
DIMENSIONS		cm
(A)	1- 3/4"	4.5
(B)	1- 1/4"	3
(C)	1/2"	1
(D)	VARIES	

-  PVC REINFORCED MEMBRANE
-  APPROVED ADHESIVE
-  HOT AIR WELD (REFER TO SPECS)
-  AIR/VAPOR BARRIER (WHERE REQUIRED)



SUREFLEX PVC RIB: TYPICAL PROFILE




MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 25A

U (Universal Detail)

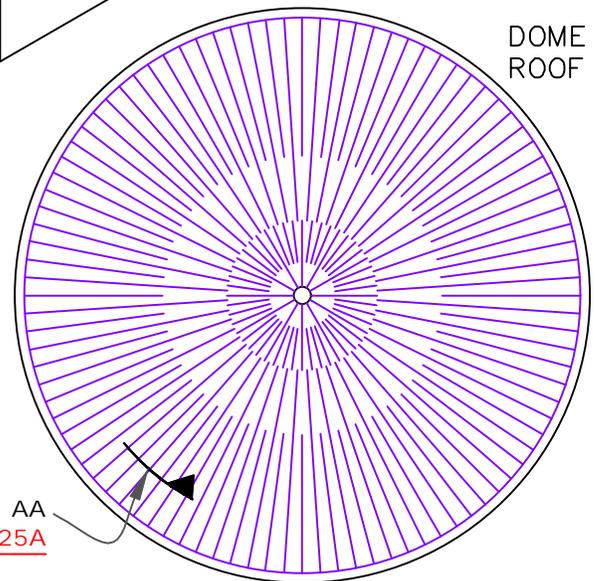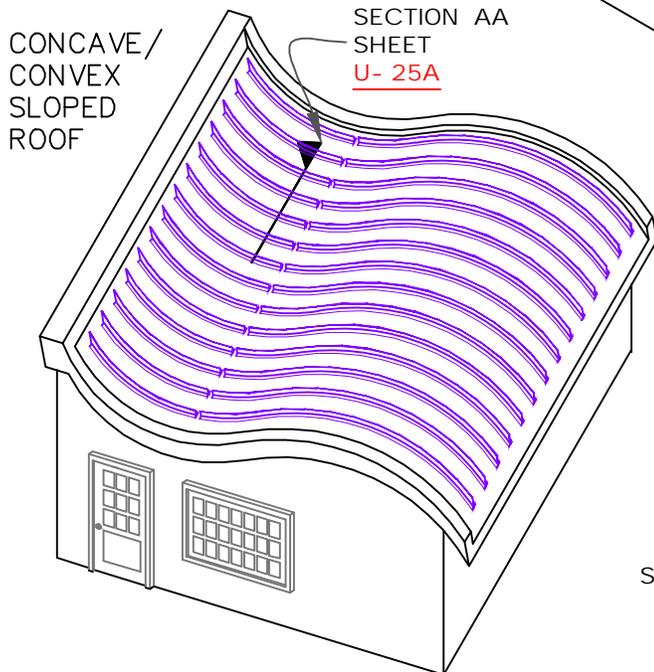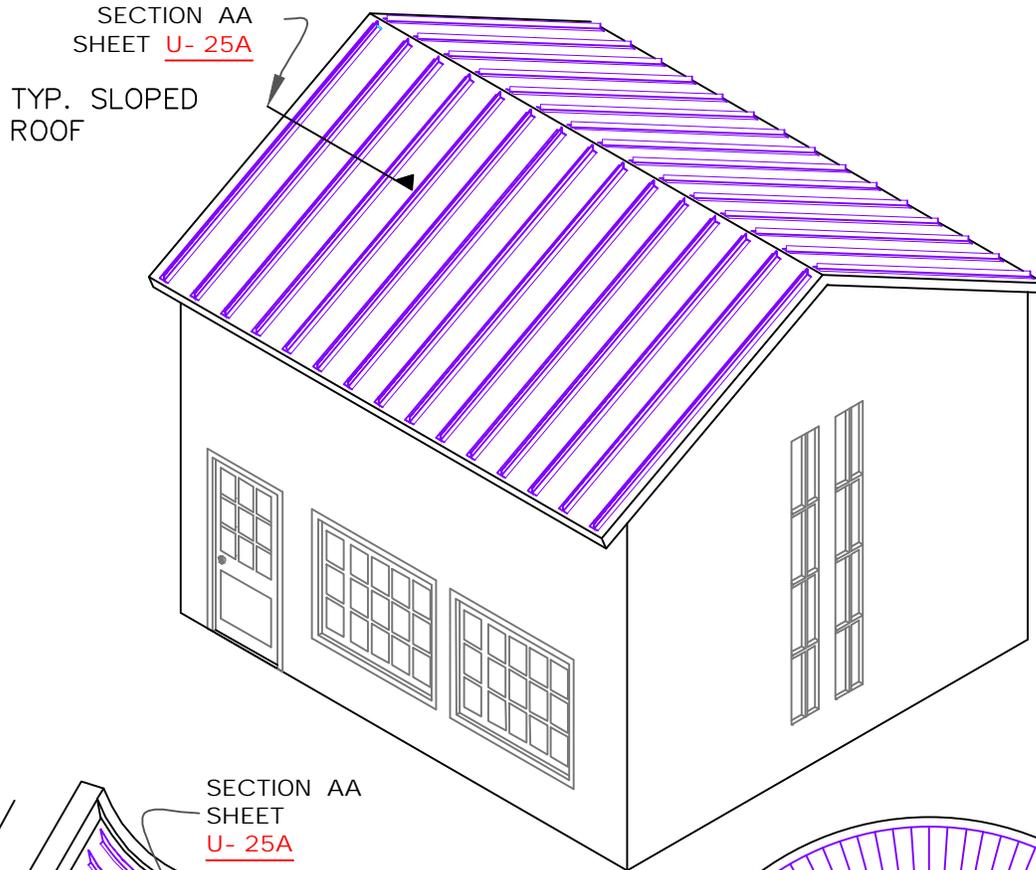

**CONCAVE/CONVEX ROOF SLOPES**

AT COMPLEX GEOMETRIC SHAPES, WITH MULTI-DIRECTIONAL SLOPES, THE SHEET METAL ROOF IS NOT ONLY DIFFICULT TO INSTALL, BUT THE WATER-SHEDDING ABILITY OF METAL ROOF IS SERIOUSLY HAMPERED WITHIN THE CONCAVE (NEGATIVE) SLOPES. THE WATERPROOFED ROOF MEMBRANE WITH THE CONTOUR RIB IS A PRACTICAL SOLUTION.

**TYPICAL PLAN OF DOME ROOF**

WHERE CONCENTRATION OF STANDING SEAMS NEAR CENTER IN METAL SYSTEM IS EXTREMELY HARD TO FABRICATE & INSTALL, THE CONTOUR RIB INSTALLATION IS EXTREMELY SIMPLE & EASY TO INSTALL.



SUREFLEX PVC RIB: VARIOUS APPLICATIONS


MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 25B

U (Universal Detail)

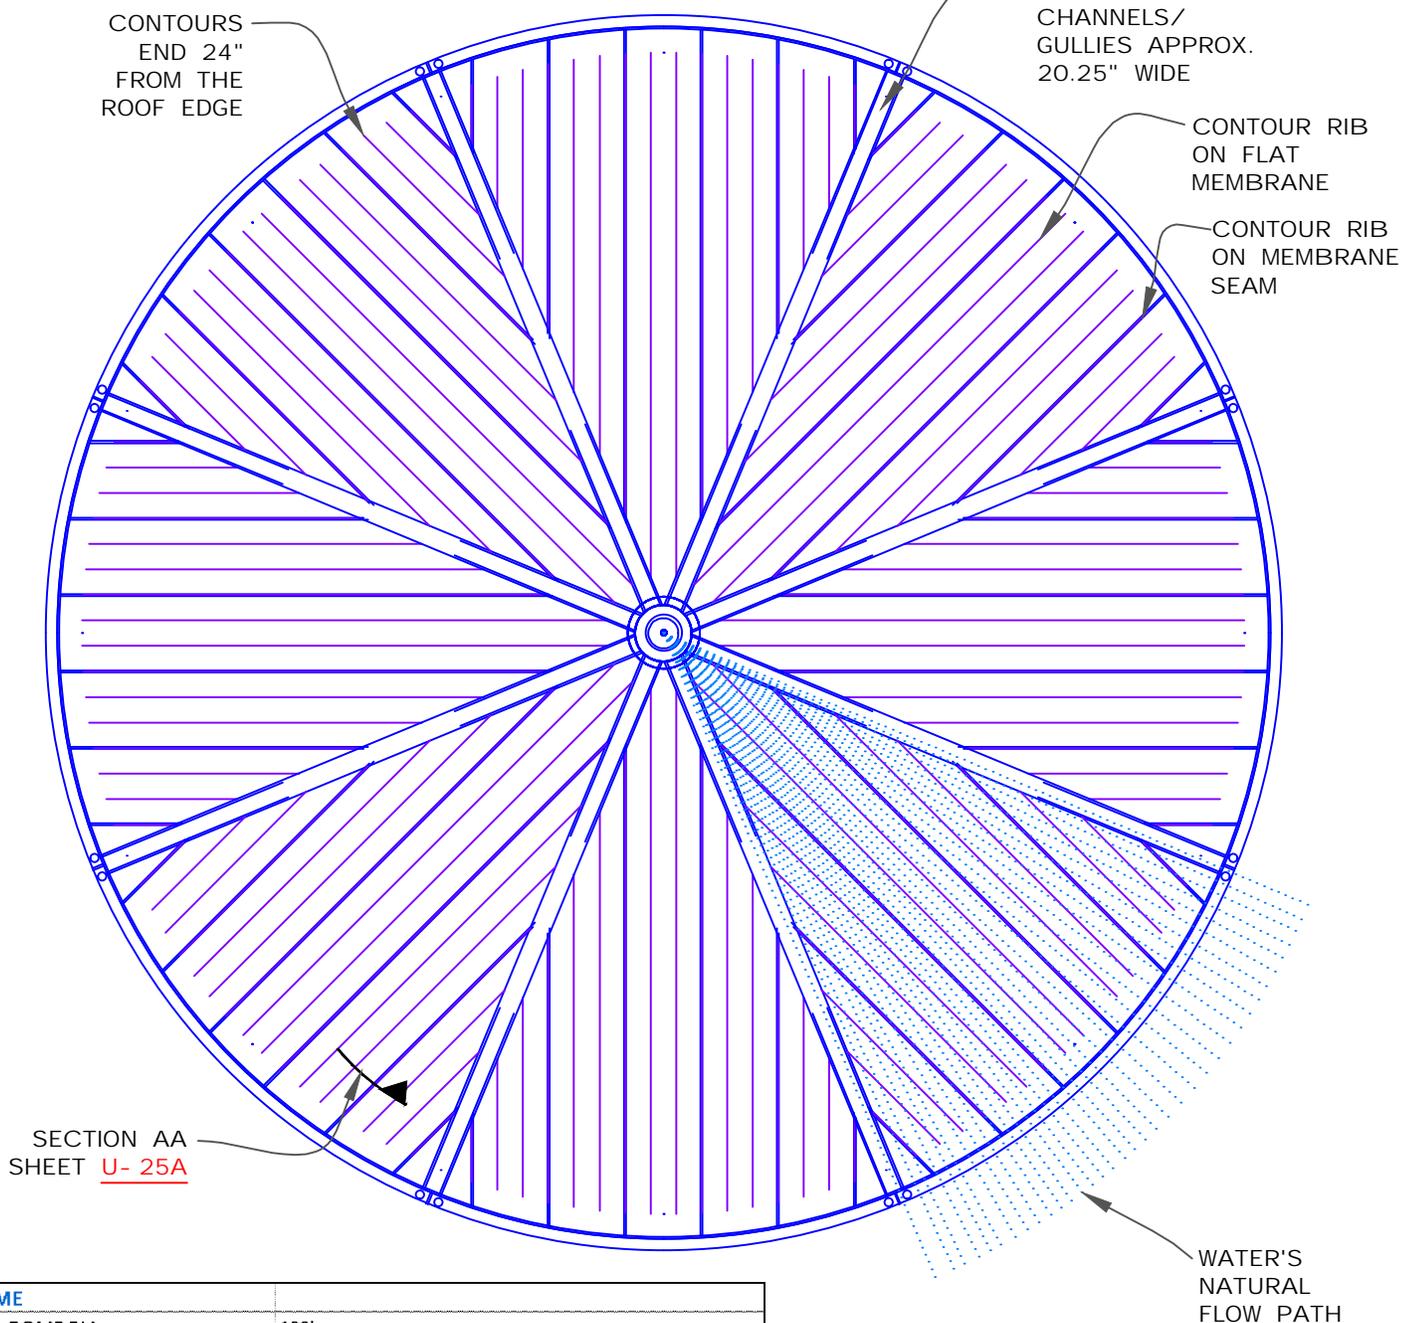

SECTION AA  
SHEET U- 25A

WATER'S  
NATURAL  
FLOW PATH

<b>DOME</b>	
TYP. DOME DIA	100'
DOME AREA	8,550 S.F.
<b>MEMBRANE</b>	
ROLL WIDTH	81"
MEMBRANE SEAM WIDTH	2"
WELDED PORTION	1.5"
CHANNELS/GULLIES	PERFECTLY CUT 1/4TH WIDTH OF 81" ROLL (20.25")
APEX POINT	PERFECTLY CUT CIRCULAR SHAPE AS DESIGNED, APPRX. 37" DIA SHOWN
<b>CONTOUR RIBS</b>	
CONTOUR RIBS O.C.	26.333"
TOTAL LENGTH OF CONTOUR RIBS ON ENTIRE 100 DIA DOME	3256 LINEAR FEET (ADD % FOR DOME CURVE)

TYPICAL EXAMPLE OF 100' DIAMETER DOME  
ROOF PLAN SHOWS 81" WIDE ROLLS  
SHOWING CONTOUR RIBS @ 26" O.C.

NOTE: APEX MAY BE DESIGNED WITH  
SELF- CLEANSING ZINC STRIPS TO CUT  
DOWN STAINING AROUND LIGHTNING ROD  
ARRESTOR



SUREFLEX PVC RIB: EXAMPLE OF  
DOME WITH RIBS ALIGNED OVER  
MEMBRANE SEAMS

MAXIMUM WARRANTY: 30 YEARS



DETAIL NO.

U- 25C

U (Universal Detail)